



OH3000111 CAMBRIDGE, CITY OF

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 3054707	Facility Name: WTP-CAMBRIDGE	Facility Class: CLASS 4
	SMP ID: EP001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015****Chemicals****Monitoring Requirements**

INORGANICS 1 Sample(s) Required between 1/1/2015 and 5/31/2015

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2015 and 1/31/2015

1 Sample(s) Required between 2/1/2015 and 2/28/2015

1 Sample(s) Required between 3/1/2015 and 3/31/2015

1 Sample(s) Required between 4/1/2015 and 4/30/2015

1 Sample(s) Required between 5/1/2015 and 5/31/2015

1 Sample(s) Required between 6/1/2015 and 6/30/2015

1 Sample(s) Required between 7/1/2015 and 7/31/2015

1 Sample(s) Required between 8/1/2015 and 8/31/2015

1 Sample(s) Required between 9/1/2015 and 9/30/2015

1 Sample(s) Required between 10/1/2015 and 10/31/2015

1 Sample(s) Required between 11/1/2015 and 11/30/2015

1 Sample(s) Required between 12/1/2015 and 12/31/2015

RADIOLOGICALS Not Required

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 1 Sample(s) Required between 4/1/2015 and 6/30/2015

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 1/1/2015 and 5/31/2015

TOTAL ORGANIC CARBON (TOC)

1 Paired Sample Set Required between 1/1/2015 and 1/31/2015

1 Paired Sample Set Required between 2/1/2015 and 2/28/2015

1 Paired Sample Set Required between 3/1/2015 and 3/31/2015

1 Paired Sample Set Required between 4/1/2015 and 4/30/2015

1 Paired Sample Set Required between 5/1/2015 and 5/31/2015

1 Paired Sample Set Required between 6/1/2015 and 6/30/2015

1 Paired Sample Set Required between 7/1/2015 and 7/31/2015

1 Paired Sample Set Required between 8/1/2015 and 8/31/2015

1 Paired Sample Set Required between 9/1/2015 and 9/30/2015

1 Paired Sample Set Required between 10/1/2015 and 10/31/2015

1 Paired Sample Set Required between 11/1/2015 and 11/30/2015

1 Paired Sample Set Required between 12/1/2015 and 12/31/2015

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



OH3000111 CAMBRIDGE, CITY OF

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015****DISTRIBUTION MONITORING SCHEDULE**

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: DISTRIBUTION-CAMBRIDGE	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required
ASBESTOS - 1094	Not Required
TOTAL COLIFORM (TCR) - 3100	10 Sample(s) Required between 1/1/2015 and 1/31/2015 10 Sample(s) Required between 2/1/2015 and 2/28/2015 10 Sample(s) Required between 3/1/2015 and 3/31/2015 10 Sample(s) Required between 4/1/2015 and 4/30/2015 10 Sample(s) Required between 5/1/2015 and 5/31/2015 10 Sample(s) Required between 6/1/2015 and 6/30/2015 10 Sample(s) Required between 7/1/2015 and 7/31/2015 10 Sample(s) Required between 8/1/2015 and 8/31/2015 10 Sample(s) Required between 9/1/2015 and 9/30/2015 10 Sample(s) Required between 10/1/2015 and 10/31/2015 10 Sample(s) Required between 11/1/2015 and 11/30/2015 10 Sample(s) Required between 12/1/2015 and 12/31/2015
TOTAL CHLORINE - 1000	10 Sample(s) Required between 1/1/2015 and 1/31/2015 10 Sample(s) Required between 2/1/2015 and 2/28/2015 10 Sample(s) Required between 3/1/2015 and 3/31/2015 10 Sample(s) Required between 4/1/2015 and 4/30/2015 10 Sample(s) Required between 5/1/2015 and 5/31/2015 10 Sample(s) Required between 6/1/2015 and 6/30/2015 10 Sample(s) Required between 7/1/2015 and 7/31/2015 10 Sample(s) Required between 8/1/2015 and 8/31/2015 10 Sample(s) Required between 9/1/2015 and 9/30/2015 10 Sample(s) Required between 10/1/2015 and 10/31/2015 10 Sample(s) Required between 11/1/2015 and 11/30/2015 10 Sample(s) Required between 12/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: DISTRIBUTION-CAMBRIDGE 9900 BRICK CHURCH RD.	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/1/2015 and 2/7/2015 at SMP: DS201 1 Sample(s) Required between 5/1/2015 and 5/7/2015 at SMP: DS201 1 Sample(s) Required between 8/1/2015 and 8/7/2015 at SMP: DS201 1 Sample(s) Required between 11/1/2015 and 11/7/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH3000111 CAMBRIDGE, CITY OF

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: DISTRIBUTION-CAMBRIDGE 1000 WATER ST.	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/1/2015 and 2/7/2015 at SMP: DS202
	1 Sample(s) Required between 5/1/2015 and 5/7/2015 at SMP: DS202
	1 Sample(s) Required between 8/1/2015 and 8/7/2015 at SMP: DS202
	1 Sample(s) Required between 11/1/2015 and 11/7/2015 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS203	Facility Name: DISTRIBUTION-CAMBRIDGE 1300 CLARK ST.	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/1/2015 and 2/7/2015 at SMP: DS203
	1 Sample(s) Required between 5/1/2015 and 5/7/2015 at SMP: DS203
	1 Sample(s) Required between 8/1/2015 and 8/7/2015 at SMP: DS203
	1 Sample(s) Required between 11/1/2015 and 11/7/2015 at SMP: DS203

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS204	Facility Name: DISTRIBUTION-CAMBRIDGE 9547 CADIZ ROAD	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/1/2015 and 2/7/2015 at SMP: DS204
	1 Sample(s) Required between 5/1/2015 and 5/7/2015 at SMP: DS204
	1 Sample(s) Required between 8/1/2015 and 8/7/2015 at SMP: DS204
	1 Sample(s) Required between 11/1/2015 and 11/7/2015 at SMP: DS204

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH3000603 GUERNSEY CO. WATER DEPT.

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: DISTRIBUTION-GUERNSEY CO. WATER DEPT Facility Class: CLASS 1
Location SMP ID: DS000

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100 10 Sample(s) Required between 1/1/2015 and 1/31/2015
10 Sample(s) Required between 2/1/2015 and 2/28/2015
10 Sample(s) Required between 3/1/2015 and 3/31/2015
10 Sample(s) Required between 4/1/2015 and 4/30/2015
10 Sample(s) Required between 5/1/2015 and 5/31/2015
10 Sample(s) Required between 6/1/2015 and 6/30/2015
10 Sample(s) Required between 7/1/2015 and 7/31/2015
10 Sample(s) Required between 8/1/2015 and 8/31/2015
10 Sample(s) Required between 9/1/2015 and 9/30/2015
10 Sample(s) Required between 10/1/2015 and 10/31/2015
10 Sample(s) Required between 11/1/2015 and 11/30/2015
10 Sample(s) Required between 12/1/2015 and 12/31/2015

TOTAL CHLORINE - 1000 10 Sample(s) Required between 1/1/2015 and 1/31/2015
10 Sample(s) Required between 2/1/2015 and 2/28/2015
10 Sample(s) Required between 3/1/2015 and 3/31/2015
10 Sample(s) Required between 4/1/2015 and 4/30/2015
10 Sample(s) Required between 5/1/2015 and 5/31/2015
10 Sample(s) Required between 6/1/2015 and 6/30/2015
10 Sample(s) Required between 7/1/2015 and 7/31/2015
10 Sample(s) Required between 8/1/2015 and 8/31/2015
10 Sample(s) Required between 9/1/2015 and 9/30/2015
10 Sample(s) Required between 10/1/2015 and 10/31/2015
10 Sample(s) Required between 11/1/2015 and 11/30/2015
10 Sample(s) Required between 12/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Facility ID: DS1 Facility Name: DISTRIBUTION-GUERNSEY CO. WATER DEPT Facility Class: CLASS 1
Location SMP ID: DS201 16869 CADIZ RD. LORE CITY

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 6/1/2015 and 6/7/2015 at SMP: DS201
1 Sample(s) Required between 9/1/2015 and 9/7/2015 at SMP: DS201
1 Sample(s) Required between 12/1/2015 and 12/7/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950



Effective Date: 04/10/2015

2015 DISTRIBUTION SCHEDULE

OH3000603 GUERNSEY CO. WATER DEPT.

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: DISTRIBUTION-GUERNSEY CO. WATER DEPT	Facility Class: CLASS 1
	SMP ID: DS202	SR 313 AND SR 660 CAMBRIDGE	

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 6/1/2015 and 6/7/2015 at SMP: DS202
	1 Sample(s) Required between 9/1/2015 and 9/7/2015 at SMP: DS202
	1 Sample(s) Required between 12/1/2015 and 12/7/2015 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

OH3000912 PLEASANT CITY, VILLAGE OF

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 3054714	Facility Name: WTP-PLEASANT CITY	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015

Chemicals	Monitoring Requirements
ARSENIC - 1005	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015
INORGANICS	Not Required
NITRITE - 1041	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2015 and 5/31/2015
<u>Sample for all the analytes listed below:</u> ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 2	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required

**OH3000912 PLEASANT CITY, VILLAGE OF**

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015****DISTRIBUTION MONITORING SCHEDULE**

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: DISTRIBUTION-PLEASANT CITY	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required
ASBESTOS - 1094	Not Required
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 1/31/2015 1 Sample(s) Required between 2/1/2015 and 2/28/2015 1 Sample(s) Required between 3/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 4/30/2015 1 Sample(s) Required between 5/1/2015 and 5/31/2015 1 Sample(s) Required between 6/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 7/31/2015 1 Sample(s) Required between 8/1/2015 and 8/31/2015 1 Sample(s) Required between 9/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 10/31/2015 1 Sample(s) Required between 11/1/2015 and 11/30/2015 1 Sample(s) Required between 12/1/2015 and 12/31/2015
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2015 and 1/31/2015 1 Sample(s) Required between 2/1/2015 and 2/28/2015 1 Sample(s) Required between 3/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 4/30/2015 1 Sample(s) Required between 5/1/2015 and 5/31/2015 1 Sample(s) Required between 6/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 7/31/2015 1 Sample(s) Required between 8/1/2015 and 8/31/2015 1 Sample(s) Required between 9/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 10/31/2015 1 Sample(s) Required between 11/1/2015 and 11/30/2015 1 Sample(s) Required between 12/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: DISTRIBUTION-PLEASANT CITY ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 3/1/2015 and 3/7/2015 at SMP: DS201 1 Sample(s) Required between 6/1/2015 and 6/7/2015 at SMP: DS201 1 Sample(s) Required between 9/1/2015 and 9/7/2015 at SMP: DS201 1 Sample(s) Required between 12/1/2015 and 12/7/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH3000912 PLEASANT CITY, VILLAGE OF

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: DISTRIBUTION-PLEASANT CITY ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements			
DISINFECTION BYPRODUCTS	1 Sample(s) Required between	3/1/2015	and	3/7/2015 at SMP: DS202
	1 Sample(s) Required between	6/1/2015	and	6/7/2015 at SMP: DS202
	1 Sample(s) Required between	9/1/2015	and	9/7/2015 at SMP: DS202
	1 Sample(s) Required between	12/1/2015	and	12/7/2015 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH3001011 QUAKER CITY

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: DISTRIBUTION-QUAKER CITY	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2015 and 9/30/2015
-------------------------------	--

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 1/31/2015
	1 Sample(s) Required between 2/1/2015 and 2/28/2015
	1 Sample(s) Required between 3/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 4/30/2015
	1 Sample(s) Required between 5/1/2015 and 5/31/2015
	1 Sample(s) Required between 6/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 7/31/2015
	1 Sample(s) Required between 8/1/2015 and 8/31/2015
	1 Sample(s) Required between 9/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 10/31/2015
	1 Sample(s) Required between 11/1/2015 and 11/30/2015
	1 Sample(s) Required between 12/1/2015 and 12/31/2015

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2015 and 1/31/2015
	1 Sample(s) Required between 2/1/2015 and 2/28/2015
	1 Sample(s) Required between 3/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 4/30/2015
	1 Sample(s) Required between 5/1/2015 and 5/31/2015
	1 Sample(s) Required between 6/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 7/31/2015
	1 Sample(s) Required between 8/1/2015 and 8/31/2015
	1 Sample(s) Required between 9/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 10/31/2015
	1 Sample(s) Required between 11/1/2015 and 11/30/2015
	1 Sample(s) Required between 12/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: DISTRIBUTION-QUAKER CITY STATE ROUTE 800	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/1/2015 and 1/7/2015 at SMP: DS201
	1 Sample(s) Required between 4/1/2015 and 4/7/2015 at SMP: DS201
	1 Sample(s) Required between 7/1/2015 and 7/7/2015 at SMP: DS201
	1 Sample(s) Required between 10/1/2015 and 10/7/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH3001011 QUAKER CITY

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: DISTRIBUTION-QUAKER CITY 126 FAIR STREET	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements		
DISINFECTION BYPRODUCTS	1 Sample(s) Required between	1/1/2015 and	1/7/2015 at SMP: DS202
	1 Sample(s) Required between	4/1/2015 and	4/7/2015 at SMP: DS202
	1 Sample(s) Required between	7/1/2015 and	7/7/2015 at SMP: DS202
	1 Sample(s) Required between	10/1/2015 and	10/7/2015 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH3001103 WESTERN GUERNSEY REGIONAL WATER DISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: DISTRIBUTION-WESTERN GUERNSEY	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

TOTAL COLIFORM (TCR) - 3100	3 Sample(s) Required between 1/1/2015 and 1/31/2015
	3 Sample(s) Required between 2/1/2015 and 2/28/2015
	3 Sample(s) Required between 3/1/2015 and 3/31/2015
	3 Sample(s) Required between 4/1/2015 and 4/30/2015
	3 Sample(s) Required between 5/1/2015 and 5/31/2015
	3 Sample(s) Required between 6/1/2015 and 6/30/2015
	3 Sample(s) Required between 7/1/2015 and 7/31/2015
	3 Sample(s) Required between 8/1/2015 and 8/31/2015
	3 Sample(s) Required between 9/1/2015 and 9/30/2015
	3 Sample(s) Required between 10/1/2015 and 10/31/2015
	3 Sample(s) Required between 11/1/2015 and 11/30/2015
	3 Sample(s) Required between 12/1/2015 and 12/31/2015

TOTAL CHLORINE - 1000	3 Sample(s) Required between 1/1/2015 and 1/31/2015
	3 Sample(s) Required between 2/1/2015 and 2/28/2015
	3 Sample(s) Required between 3/1/2015 and 3/31/2015
	3 Sample(s) Required between 4/1/2015 and 4/30/2015
	3 Sample(s) Required between 5/1/2015 and 5/31/2015
	3 Sample(s) Required between 6/1/2015 and 6/30/2015
	3 Sample(s) Required between 7/1/2015 and 7/31/2015
	3 Sample(s) Required between 8/1/2015 and 8/31/2015
	3 Sample(s) Required between 9/1/2015 and 9/30/2015
	3 Sample(s) Required between 10/1/2015 and 10/31/2015
	3 Sample(s) Required between 11/1/2015 and 11/30/2015
	3 Sample(s) Required between 12/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: DISTRIBUTION-WESTERN GUERNSEY 2703 BLOOMFIELD ROAD	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/1/2015 and 2/7/2015 at SMP: DS201
	1 Sample(s) Required between 5/1/2015 and 5/7/2015 at SMP: DS201
	1 Sample(s) Required between 8/1/2015 and 8/7/2015 at SMP: DS201
	1 Sample(s) Required between 11/1/2015 and 11/7/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2015

2015 DISTRIBUTION SCHEDULE

OH3001103 WESTERN GUERNSEY REGIONAL WATER DISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: DISTRIBUTION-WESTERN GUERNSEY 56032 CLAYSVILLE ROAD	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/1/2015 and 2/7/2015 at SMP: DS202
	1 Sample(s) Required between 5/1/2015 and 5/7/2015 at SMP: DS202
	1 Sample(s) Required between 8/1/2015 and 8/7/2015 at SMP: DS202
	1 Sample(s) Required between 11/1/2015 and 11/7/2015 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH3001212 BYESVILLE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 3054706	Facility Name: WTP-PLANT #2	Facility Class: CLASS 3
	SMP ID: EP002	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015****Chemicals****Monitoring Requirements**

INORGANICS 1 Sample(s) Required between 1/1/2015 and 5/31/2015

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 1/31/2015
	1 Sample(s) Required between 2/1/2015 and 2/28/2015
	1 Sample(s) Required between 3/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 4/30/2015
	1 Sample(s) Required between 5/1/2015 and 5/31/2015
	1 Sample(s) Required between 6/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 7/31/2015
	1 Sample(s) Required between 8/1/2015 and 8/31/2015
	1 Sample(s) Required between 9/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 10/31/2015
	1 Sample(s) Required between 11/1/2015 and 11/30/2015
	1 Sample(s) Required between 12/1/2015 and 12/31/2015

RADIOLOGICALS Not Required

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 1 Sample(s) Required between 4/1/2015 and 6/30/2015

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 1/1/2015 and 5/31/2015

**OH3001212 BYESVILLE**

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: DISTRIBUTION-BYESVILLE	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	20 Sample(s) Required between 6/1/2015 and 9/30/2015
-------------------------------	--

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	5 Sample(s) Required between 1/1/2015 and 1/31/2015
	5 Sample(s) Required between 2/1/2015 and 2/28/2015
	5 Sample(s) Required between 3/1/2015 and 3/31/2015
	5 Sample(s) Required between 4/1/2015 and 4/30/2015
	5 Sample(s) Required between 5/1/2015 and 5/31/2015
	5 Sample(s) Required between 6/1/2015 and 6/30/2015
	5 Sample(s) Required between 7/1/2015 and 7/31/2015
	5 Sample(s) Required between 8/1/2015 and 8/31/2015
	5 Sample(s) Required between 9/1/2015 and 9/30/2015
	5 Sample(s) Required between 10/1/2015 and 10/31/2015
	5 Sample(s) Required between 11/1/2015 and 11/30/2015
	5 Sample(s) Required between 12/1/2015 and 12/31/2015

TOTAL CHLORINE - 1000	5 Sample(s) Required between 1/1/2015 and 1/31/2015
	5 Sample(s) Required between 2/1/2015 and 2/28/2015
	5 Sample(s) Required between 3/1/2015 and 3/31/2015
	5 Sample(s) Required between 4/1/2015 and 4/30/2015
	5 Sample(s) Required between 5/1/2015 and 5/31/2015
	5 Sample(s) Required between 6/1/2015 and 6/30/2015
	5 Sample(s) Required between 7/1/2015 and 7/31/2015
	5 Sample(s) Required between 8/1/2015 and 8/31/2015
	5 Sample(s) Required between 9/1/2015 and 9/30/2015
	5 Sample(s) Required between 10/1/2015 and 10/31/2015
	5 Sample(s) Required between 11/1/2015 and 11/30/2015
	5 Sample(s) Required between 12/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: DISTRIBUTION-BYESVILLE 431 CARL STREET	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 3/1/2015 and 3/7/2015 at SMP: DS201
	1 Sample(s) Required between 6/1/2015 and 6/7/2015 at SMP: DS201
	1 Sample(s) Required between 9/1/2015 and 9/7/2015 at SMP: DS201



OH3001212 BYESVILLE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: DISTRIBUTION-BYESVILLE 431 CARL STREET	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 12/1/2015 and 12/7/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: DISTRIBUTION-BYESVILLE 357 NORTH CAMBRIDGE STREET	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 3/1/2015 and 3/7/2015 at SMP: DS202
	1 Sample(s) Required between 6/1/2015 and 6/7/2015 at SMP: DS202
	1 Sample(s) Required between 9/1/2015 and 9/7/2015 at SMP: DS202
	1 Sample(s) Required between 12/1/2015 and 12/7/2015 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH3033712 MWCD PIEDMONT CAMP P2 PWS

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **MWCD,PIEDMONT CAMP P2 DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **3054726** Facility Name: **MWCD PIEDMONT CAMP P2**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

Where to Collect Samples For a Small Public Water System

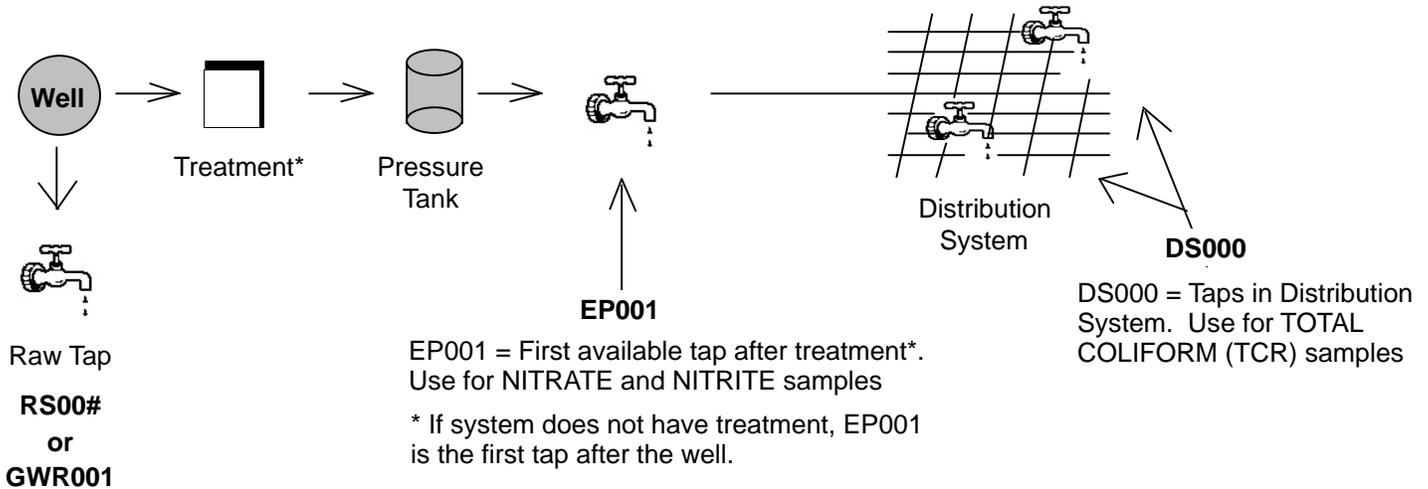

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3033912 THE SHACK

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **SUGARSHACK DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **3054727** Facility Name: **SUGARSHACK**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

Where to Collect Samples For a Small Public Water System

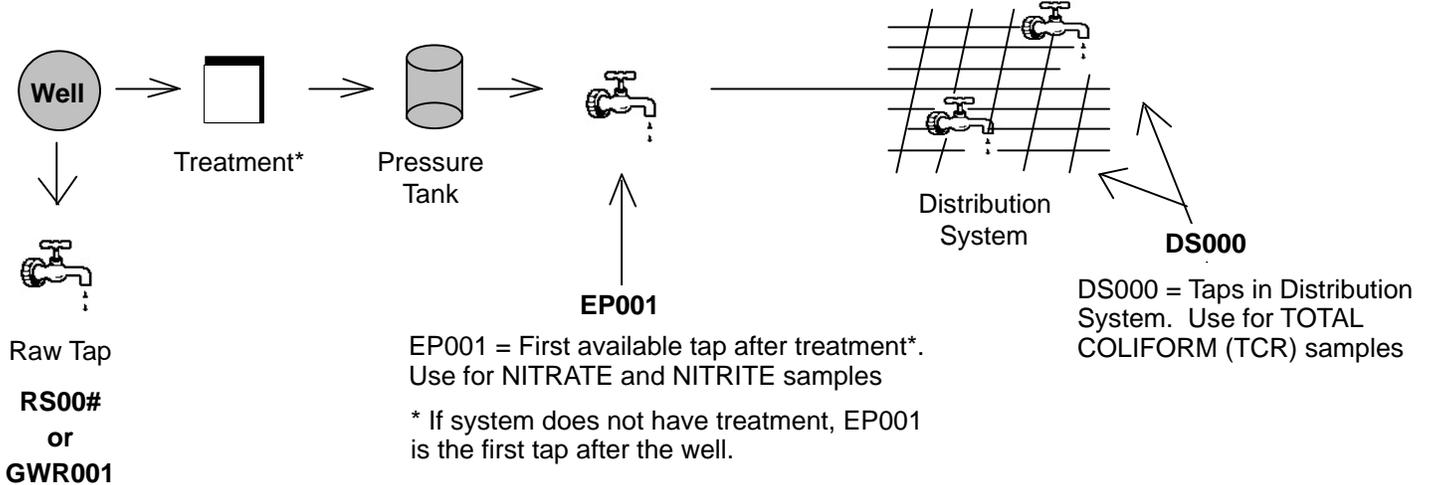

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:
<http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3034212 I70 FUEL MART 727

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **I70 FUEL MART 727 DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **3054728** Facility Name: **PORTS PETROLEUM CO INC GAS MART NO 727**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

Where to Collect Samples For a Small Public Water System

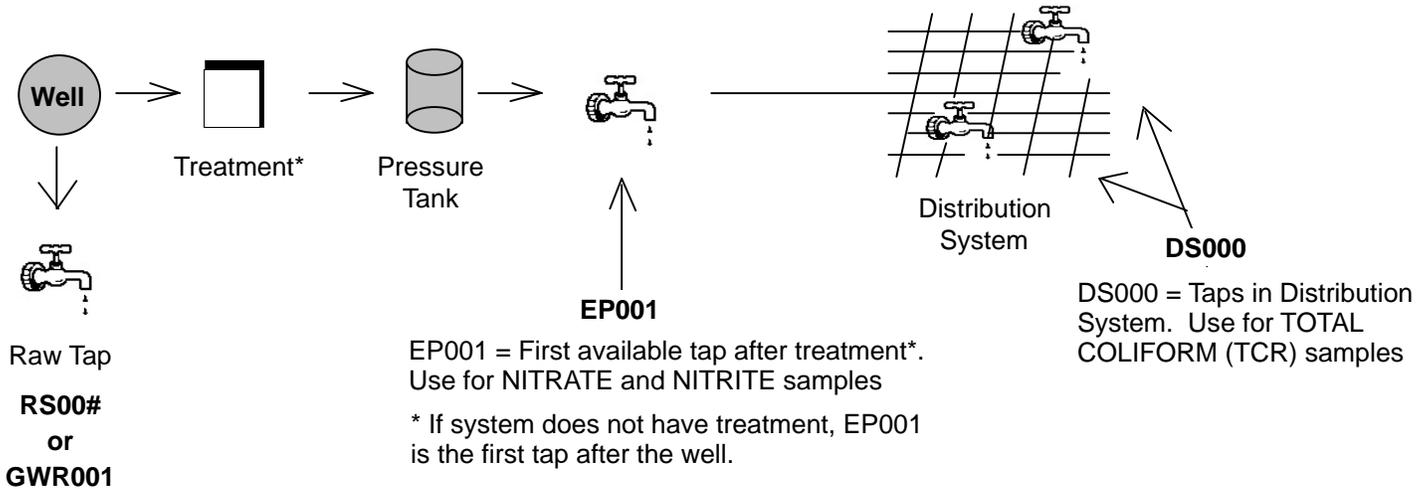

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3034312 SPRING VALLEY OUTDOORS, INC

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **SPRING VALLEY CAMPGROUND DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **3054729** Facility Name: **SPRING VALLEY CAMPGROUND**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

Where to Collect Samples For a Small Public Water System

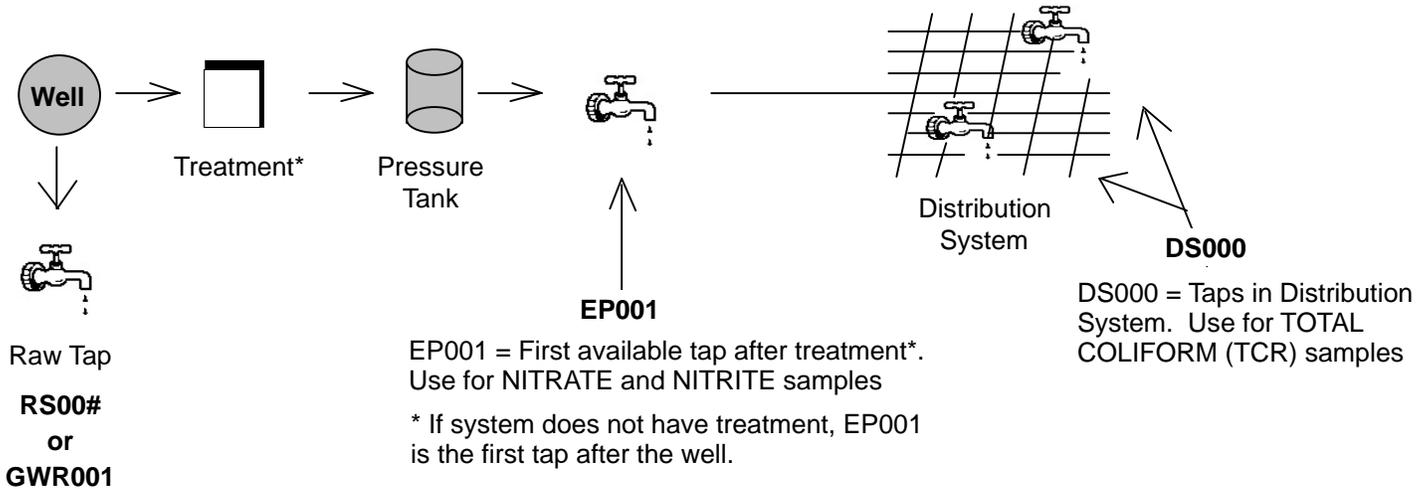

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



OH3053012 SALT FORK UTILITY CO.

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: SALT FORK UTILITY CO. DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2015 and 1/31/2015
	2 Sample(s) Required between 2/1/2015 and 2/28/2015
	2 Sample(s) Required between 3/1/2015 and 3/31/2015
	2 Sample(s) Required between 4/1/2015 and 4/30/2015
	2 Sample(s) Required between 5/1/2015 and 5/31/2015
	2 Sample(s) Required between 6/1/2015 and 6/30/2015
	2 Sample(s) Required between 7/1/2015 and 7/31/2015
	2 Sample(s) Required between 8/1/2015 and 8/31/2015
	2 Sample(s) Required between 9/1/2015 and 9/30/2015
	2 Sample(s) Required between 10/1/2015 and 10/31/2015
	2 Sample(s) Required between 11/1/2015 and 11/30/2015
	2 Sample(s) Required between 12/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3054731	Facility Name: SALT FORK UTILITY CO	
Location SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS A

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required

OH3053012 SALT FORK UTILITY CO.

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.


Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3054731	Facility Name: SALT FORK UTILITY CO	Facility Class: CLASS A
Location SMP ID: EP001	Facility Source: Ground Water	

Chemicals	Monitoring Requirements
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

Where to Collect Samples For a Small Public Water System

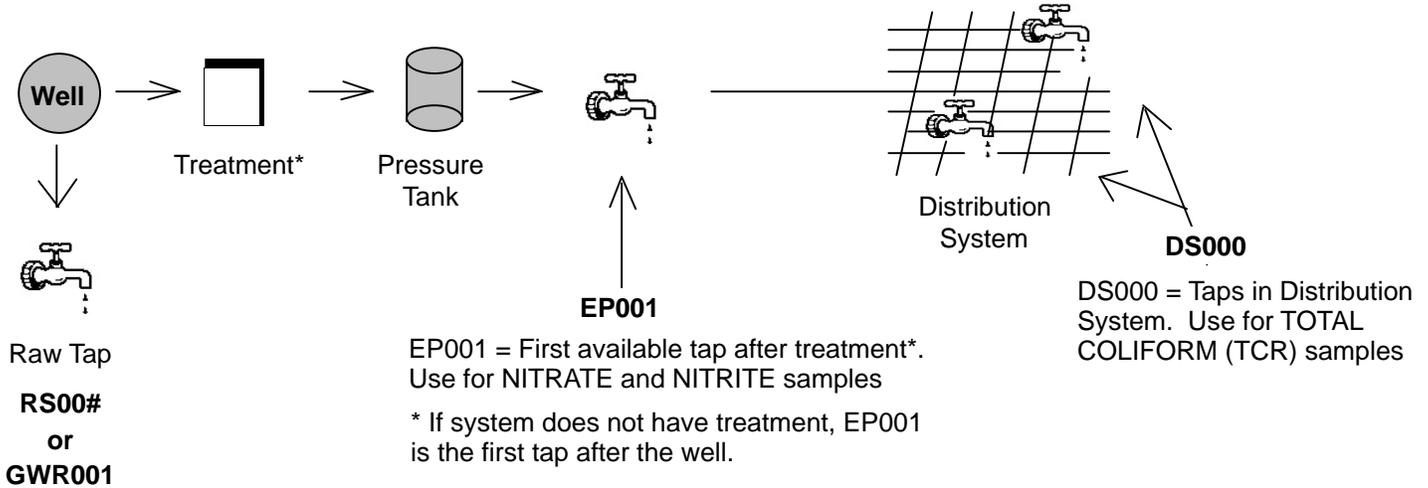

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3053312 GENIE MANAGEMENT, LLC PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **B P FOOD MART DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **3054732** Facility Name: **GENIE MANAGEMENT LLC**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

Where to Collect Samples For a Small Public Water System

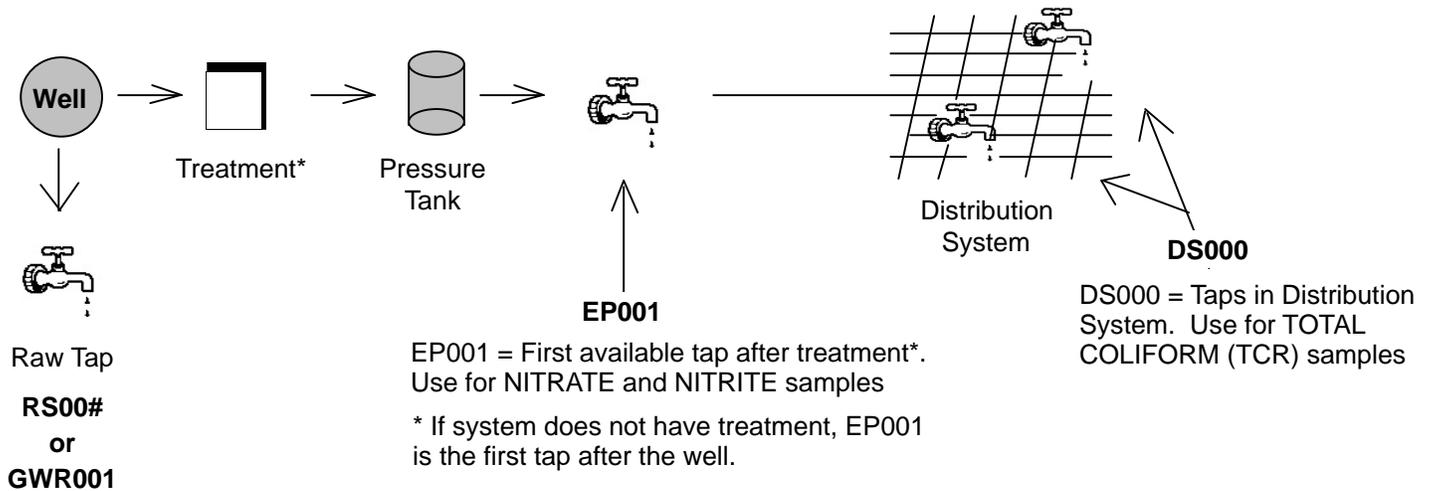

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3053712 BANANA PEEL ICE CREAM PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: THE BANANA PEEL ICE CREA DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3054734	Facility Name: THE BANANA PEEL
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

Where to Collect Samples For a Small Public Water System

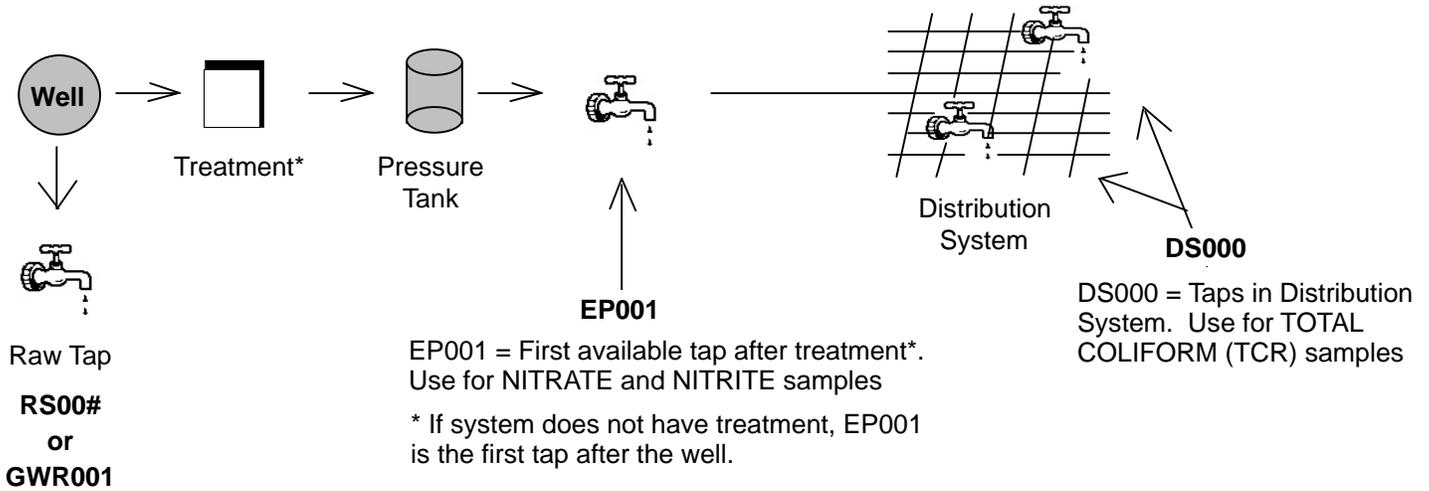

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3053912 GARYS BP PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **GARYS BP DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **3054736** Facility Name: **GARYS BP**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

Where to Collect Samples For a Small Public Water System

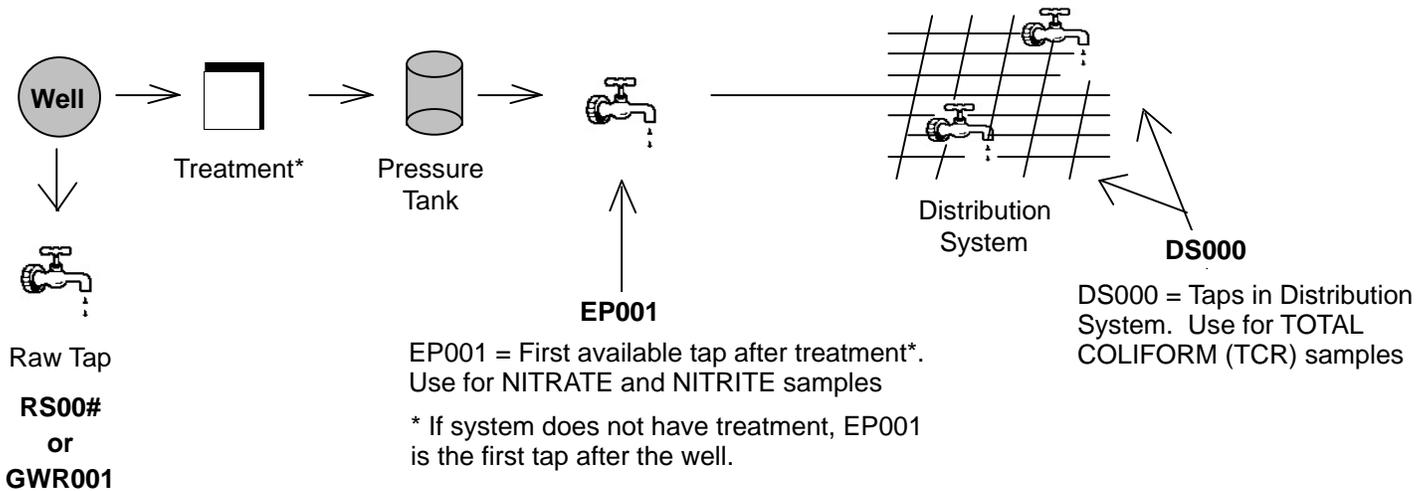

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3054212 BIG SKY CAMPGROUND

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **BIG SKY CAMPGROUND DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **3054739** Facility Name: **BIG SKY CAMPGROUND**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

Where to Collect Samples For a Small Public Water System

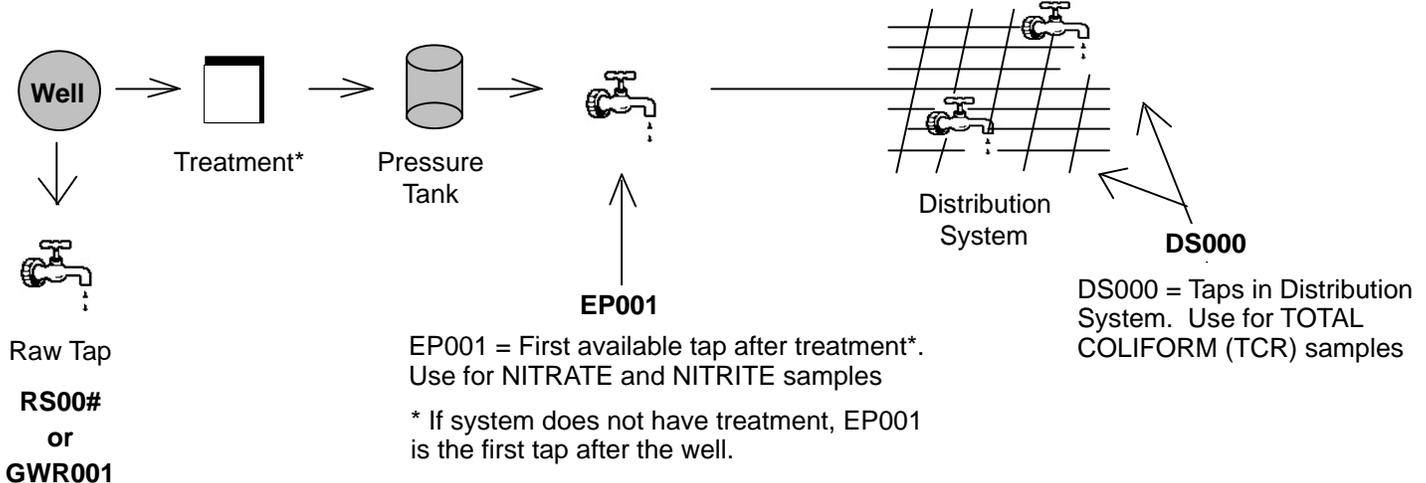

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3054312 JACKIES FAMILY RESTAURANT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: JACKIES FAMILY RESTAURANT DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3054740	Facility Name: JACKIES FAMILY RESTAURANT
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 4/1/2015 and 6/30/2015

Where to Collect Samples For a Small Public Water System

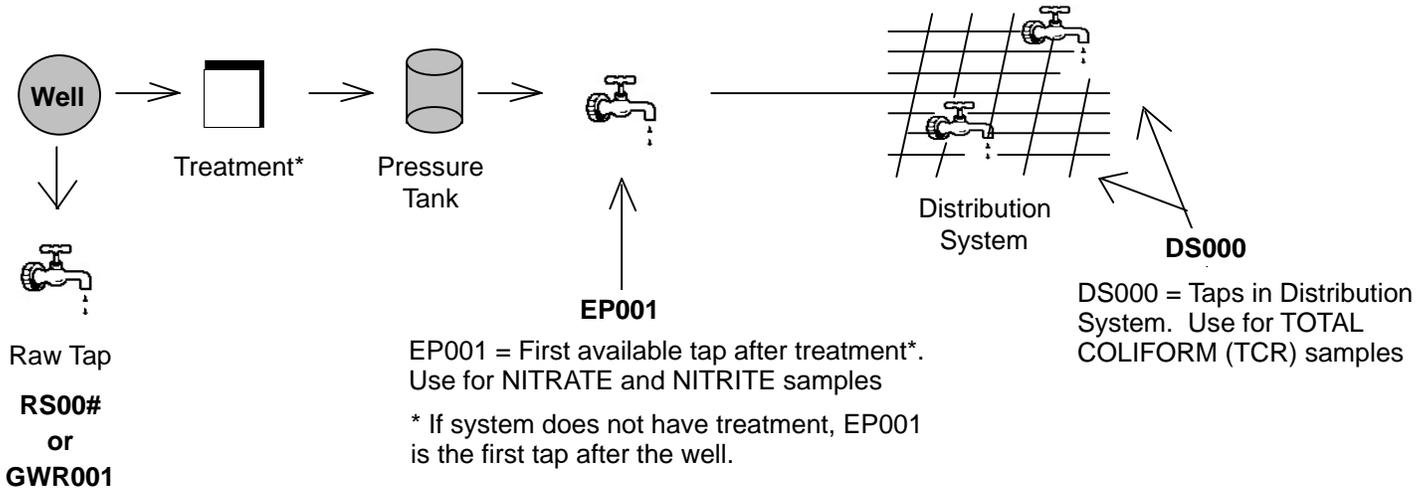

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3054512 GEORGETOWN WINERY PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: GEORGETOWN WINERY DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3062156	Facility Name: GEORGETOWN WINERY
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

Where to Collect Samples For a Small Public Water System

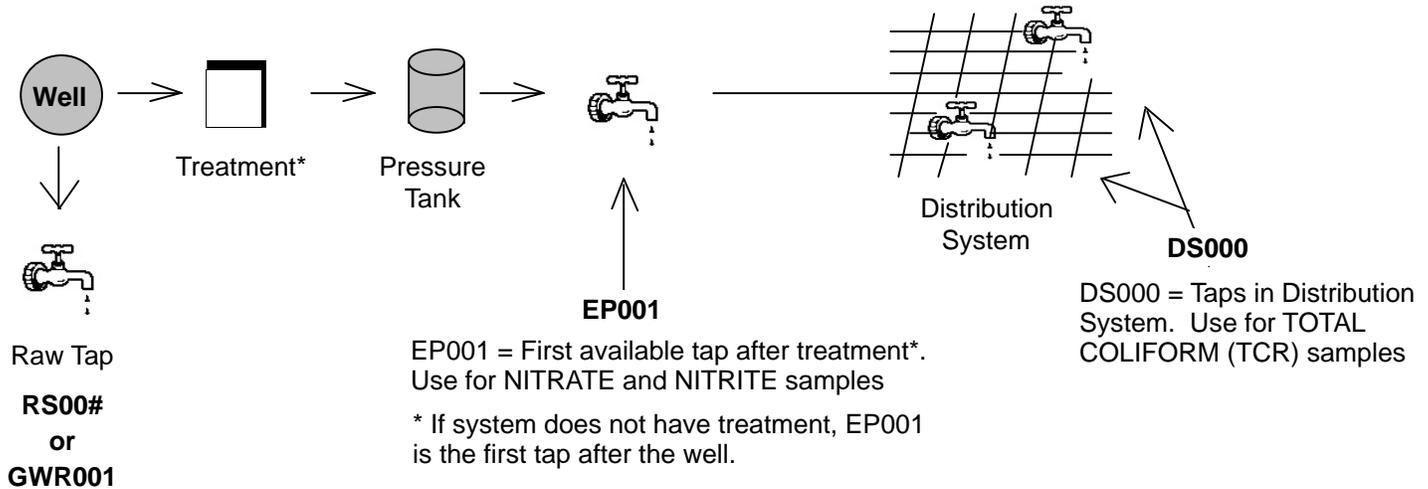

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!