

**OHIO's PUBLIC WATER SYSTEMS
ANNUAL COMPLIANCE REPORT**

For

CALENDAR YEAR 2002

**Ohio Environmental Protection Agency
Division of Drinking and Ground Waters
July 1, 2003**

TABLE OF CONTENTS

Introduction 1
The Drinking Water Program: An Overview 1

Regulated Public Water Systems in Ohio 2

Annual State PWS Compliance Report 3
 Maximum Contaminant Level 3
 Treatment Techniques 3
 Monitoring 4
 Consumer Notification 4
 Variances and Exemptions 4

Compliance Table Summary Analysis 4
 Organic Contaminants 7
 Inorganic Contaminants 12
 Radionuclide Contaminants 14
 Total Coliform Regulations 15
 Surface Water Treatment Regulations 17
 Lead and Copper Regulations 19
 Consumer Confidence Report Requirements 21

Ohio EPA’s Public Water System Compliance Assistance 22

Listing of Maximum Contaminant Level and Treatment Technique Violations . . . 22

Report Availability and Contact Information 24

APPENDIX A: COMPLIANCE SUMMARY TABLE

APPENDIX B: MCL and TT VIOLATION LISTING

List of Tables

Table 1.	Public Water System Summary by Category Type	2
Table 2.	Public Water System Summary by Population Categories	3
Table 3.	Violation Totals and Compliance Rates per Contaminant Group	5
Table 4.	Violation Totals and Compliance Rates for Individual MCL Contaminant Group Constituents	6
Table 5.	Violation Totals for 2002	6
Table 6.	Enforcement Action Code Types	23

List of Figures

Figure 1.	Percentage Distribution of PWSs with Violations per System Type and Population Served Category	7
Figure 2.	Systems with Organic Contaminant Monitoring/Reporting Violations by Population Categories	11
Figure 3.	Systems with Organic Contaminant Monitoring/Reporting Violations by System Type	11
Figure 4.	Systems with Inorganic Contaminant Monitoring/Reporting Violations by System Type	12
Figure 5.	Systems with Inorganic Contaminant Monitoring/Reporting Violations by Population Categories	14
Figure 6.	Community Systems with Radionuclide Contaminant Monitoring/Reporting Violations by Population Categories	15
Figure 7.	Systems with Total Coliform MCL (Acute and Non-Acute) and Significant Monitoring/Reporting Violations by Population Categories	16
Figure 8.	Systems with Total Coliform MCL (Acute and Non-Acute) and Significant Monitoring/Reporting Violations by System Type	17
Figure 9.	Systems with Surface Water Treatment Rule Monitoring/Reporting and Treatment Technique Violations by System Type	18
Figure 10.	Systems with Surface Water Treatment Rule Monitoring/Reporting and Treatment Technique Violations by Population Categories	19
Figure 11.	Systems with Lead and Copper Significant Initial and Follow-up/Routine Monitoring/Reporting Violations by Population Categories	20
Figure 12.	Systems with Lead and Copper Significant Initial and Follow-up/Routine Monitoring/Reporting Violations by System Type	20
Figure 13.	Systems with Consumer Confidence Report Violations by Population Categories	21

Introduction

The 1996 Amendments to the Safe Drinking Water Act require each State to prepare an Annual Compliance Report summarizing violations incurred by Public Water Systems. The Annual Compliance Report is to be compiled by the State and submitted to U.S. EPA and made available to the public. This report summarizes compliance rates and the number and types of violations generated as a result of various public water systems failing to meet certain Safe Drinking Water Act requirements for calendar year 2002.

Ohio's 2002 Annual Compliance Report contains an overview of the Public Water System Supervision Program in Ohio; provides summary information on the number, types and population served for public water systems; explains the requirements of the annual compliance report; defines the primary categories for which violation information are summarized; a summary table of the number and types of violations; an analysis of public water system compliance with the regulations; and a list of public water system violations for the maximum contaminant level and treatment technique categories.

The Drinking Water Program: An Overview

U.S. EPA established the Public Water System Supervision (PWSS) Program under the authority of the 1974 Safe Drinking Water Act (SDWA). Under the SDWA and the 1986 and 1996 Amendments, U.S. EPA sets national limits on contaminant levels in drinking water to ensure that the water is safe for human consumption. These limits are known as Maximum Contaminant Levels (MCLs). For some regulations, U.S. EPA establishes treatment techniques in lieu of an MCL to control unacceptable levels of contaminants in water by measuring the level of treatment. The Agency also regulates how often public water systems (PWSs) monitor their water for contaminants and report the monitoring results to the States or U.S. EPA. Generally, the larger the population served by a water system, the more frequent the monitoring and reporting (M/R) requirements. However, the M/R requirements vary dependent on which contaminant is being evaluated and the source water used by a system (surface water systems and systems that use ground water under the direct influence of surface water typically monitor more frequently than a ground water system). Finally, public water systems are required to notify the public when they have violated these regulations. The 1986 Amendments and further revisions under the 1996 Amendments to the SDWA require public notification to include a clear and understandable explanation of the nature of the violation, its potential adverse health effects, steps that the public water system is undertaking to correct the violation and the possibility for the need to obtain alternative water supplies during the violation.

The SDWA allows States to seek U.S. EPA approval to administer their own PWSS Programs. The authority to run a PWSS Program is called primacy. To receive primacy, States must meet certain requirements set forth in the SDWA and the regulations, including the adoption of drinking water regulations that are at least as stringent as the Federal regulations and provide a demonstration that they can enforce the program requirements. *Ohio is a primacy state.*

Regulated Public Water Systems in Ohio

In Ohio, a public water system (PWS) is defined as a system that provides piped water for human consumption to at least 15 service connections or serves an average of at least 25 people for at least 60 days each year. There are three types of public water systems:

- community water systems serve at least fifteen service connections used by year-round residents or regularly serve at least twenty-five year-round residents (e.g. cities; mobile home parks)
- non-transient non-community systems serve at least twenty-five of the same persons over six months per year (e.g. schools; businesses)
- transient non-community systems serves at least 25 different persons over 60 days per year (e.g. rest stops; parks)

These three type of systems use either a ground water source, surface water source, or use ground water under the direct influence of surface water. In addition, Ohio regulates the drinking water systems associated with agricultural migrant labor camps as defined by the Ohio Department of Agriculture even though they may not meet the minimum number of people or service connections. For this report when the acronym "PWS" is used, it means systems of all types unless specified in greater detail. In Ohio, 5,621 public water systems serve approximately 10.8 million people daily with an average production of approximately 1.6 billion gallons of water per day. This yields an average water use of 148.1 gallons per person per day. Table 1 summarizes the total number and percentage of active public water systems per type with the corresponding total population served daily.

The total number and percentage of PWS by population categories are presented in Table 2. An interesting note from this table is that 10 PWS, less than 1 percent of the total systems in the state, serve over 40 percent of the entire states population.

Table 1. Public Water System Summary by Category Type

PWS Category Type	Number of PWSs per Category	Percentage of each PWS Type	Total Population Served Daily per Category
Community (CWS)	1,352	24%	10,086,515
Non-Transient Non-Community (NTNC)	1,031	18.3%	257,530
Transient Non-Community (TNC)	3,238	57.7%	497,875
Total	5,621	100%	10,841,920

Table 2. Public Water System Summary by Population Categories

PWS Populations Categories	Number of PWS per Category	Percentage of the Total PWS for each Category	Total Population Served Daily per Category
Population: 25 - 500	4,609	82%	597,801
Population: 501 - 3,300	703	12.5%	870,029
Population: 3,301 - 10,000	156	2.8%	966,698
Population: 10,001 - 100,000	143	2.5%	3,815,179
Population: Greater than 100,000	10	0.2%	4,592,213
Total	5,621	100%	10,841,920

Annual State PWS Compliance Report

Ohio EPA submits data to U.S. EPA's Safe Drinking Water Information System (SDWIS/FED) on a quarterly basis. The data includes PWS inventory statistics, the incidence of Maximum Contaminant Level (MCL), major monitoring, treatment technique violations, and the enforcement actions taken against violators. This Annual Compliance Report provides a total annual representation of the number of violations for each of the four categories listed in section 1414(c)(3)(A)(i) of the Safe Drinking Water Act re-authorization, as well as consumer notification requirements. This report will analyze violation and compliance information for the 2002 calendar year using five categories: MCLs, treatment techniques, significant monitoring violations, consumer notifications, and variances and exemptions. This report was generated with the data available to Ohio EPA by May of 2003.

1. *Maximum Contaminant Level*

Under the SDWA, U.S. EPA sets national limits on contaminant levels in drinking water to ensure that the water is safe for human consumption. These limits are known as MCLs. When a public water system exceeds an MCL, they are required to notify the public of the violation within 24 hours for acute violations that may pose an acute risk to human health (e.g. nitrate; total coliform), and within 30 days for nonacute MCL violations (e.g. VOCs; SOCs). In addition, the water system must continue to monitor regularly, as well as take steps to correct the contamination problem.

2. *Treatment Techniques*

For some regulations, the EPA establishes treatment techniques (TTs) in lieu of an MCL to control unacceptable levels of certain contaminants by a measurement of the treatment process. Treatment techniques have been established for viruses, some bacteria, turbidity, lead and copper and disinfection by-product precursors.

3. *Monitoring*

A PWS is required to monitor and verify that the levels of contaminants present in the water do not exceed the MCL. If a PWS fails to have its water tested as required, then a monitoring violation occurs. A monitoring violation also includes failure to report test results correctly to the State. These violations occur when a system misses one or more of several sampling events, or samples but does so outside the required time period. When a public water system fails to have its water tested as required, they are required to notify the public of the violation within 30 days. For systems monitoring less frequently than quarterly, they are required to sample for the contaminant(s) missed, in order to return to compliance.

Return to Compliance

As noted in the definition of monitoring violations, systems which monitor less frequently than quarterly can return to compliance. Some systems can return to compliance if they monitor for the missed contaminants or submit reports late. In this report, return to compliance rates were determined for inorganic contaminants, nitrate, nitrite, regulated volatile organic contaminants, synthetic organic contaminants, trihalomethanes, haloacetic acids (DBPs), and radiological contaminants, as a group.

Significant Monitoring Violations

For this report, significant monitoring violations are defined as any major monitoring violation that has occurred during the specified report interval. A major monitoring violation occurs when no samples were taken or no results are reported during a compliance period.

4. *Consumer Notification*

Every Community Water System is required to deliver to its customers a brief annual water quality report - a Consumer Confidence Report (CCR). This report is to include some educational material, and will provide information on the source water, the levels of any detected contaminants, and compliance with drinking water regulations.

Significant Consumer Notification Violations

A significant public notification violation occurred if a community water system completely failed to provide its customers the required annual water quality report.

5. *Variances and Exemptions*

Variances and exemptions to specific requirements under the SDWA Amendments of 1996 may be granted under certain circumstances. If, due to the characteristics of the raw water sources reasonably available, a PWS cannot meet the MCL, the State can grant the PWS a variance from the applicable primary drinking water regulation on the condition that the system install the best available technology which the Administrator finds is available (taking costs into account). *Ohio did not issue any variances or exemptions during the 2002 compliance year.*

Compliance Table Summary Analysis

A summary table of public water system compliance rates and violations for the 2002 calendar year is

included in Appendix A. The information summarized in the table includes the total number of PWS required to monitor during the 2002 calendar year; total number of violations; total number of systems with a violation; and percent compliance achieved for a particular regulated contaminant in three different violation categories. These violation categories are MCL, Treatment Technique and Monitoring (CCR notification violations have also been included under this heading). The regulatory contaminant categories include: organic contaminants, inorganic contaminants, and radionuclide contaminants, all which are classified as the MCL contaminant group; total coliform bacteria regulations (TCR); surface water treatment regulations (SWTR); lead and copper regulations, and CCR notifications.

Violation totals and compliance rates for each of the contaminant groups are presented in Table 3. Compliance rates are based on the total number of systems *required to* comply with each of the contaminant categories. For example, the 85% CCR compliance rate is based on 1,352 CWS required to send notifications with 200 systems failing to comply. The total number of violations and total number of water systems with at least one violation is presented in Table 4. A system may be required to monitor more than once for a contaminant which results in the number of violations being greater than the number of systems in violation. However, the overall compliance rate for MCL Contaminant Group is determined by dividing the number of violations (added from each individual contaminant from Table 4) by the number of systems required to monitor. Systems with more than one violation in different contaminant groups are “double counted” artificially lowering the compliance rate.

Table 3. Violation Totals and Compliance Rates per Contaminant Group Category

Contaminant Category	MCL			Treatment Technique			Monitoring or CCR notifications		
	Violations	No. of Systems in Violation	Comp. Rate	Violations	No. of Systems in Violation	Comp. Rate	Violations	No. of Systems in Violation	Comp. Rate
MCL Contaminant Group ¹	40	22	99.6%				5500	991	82%
TCR ²	816	568	88%				2088	1309	77%
SWTR ³				346	53	69%	8	4	98%
Lead and Copper				0	0	N/A	92	92	93%
CCR ⁴							200	200	85%

¹MCL Contaminant Group includes volatile organic, synthetic organic, inorganic, total trihalomethanes, haloacetic acid, nitrate and nitrite chemicals and radiological contaminants

²total coliform rule

³surface water treatment rule

⁴consumer confidence reports

Table 4. Violation Totals and Compliance Rates for the Individual MCL Contaminant Group Constituents

Contaminant Category	MCL				Monitoring Requirements			
	Violations	No. of Systems in Violation	No. of Systems Required to Monitor	Comp. Rate	Violations	No. of Systems in Violation	No. of Systems Required to Monitor	Comp. Rate
VOCs ¹	4	1	1083	99.9%	3255	128	1083	88.2%
SOCs ²	0	0	2115	100.0%	647	217	2115	89.7%
TTHMs ³	6	5	355	98.6%	43	31	355	91.3%
DBPs ⁴ (HAA5)	0	0	292	100.0%	49	36	292	87.7%
IOCs ⁵	0	0	726	100.0%	878	103	726	85.8%
Nitrate	27	15	5188	99.7%	589	441	5188	91.5%
Nitrite	0	0	143	100.0%	27	27	143	81.1%
RADS ⁶	3	1	414	99.8%	39	35	414	91.5%

¹volatile organic chemicals

²synthetic organic chemicals

³total trihalomethanes

⁴haloacetic acids

⁵inorganic chemicals


⁶radiological contaminants

* The number of systems required to monitor for the different IOCs and SOC's varies, but 726 PWS were required to monitor for at least one of the inorganic chemicals, and 2115 PWS were required to monitor for at least one of the SOC's. See Appendix A for details.

Table 5. State of Ohio Violation Totals for 2002

	State of Ohio Data
Total Number of Systems in Violation	3,357
Total Number of Violations	9,090

Figure 1.

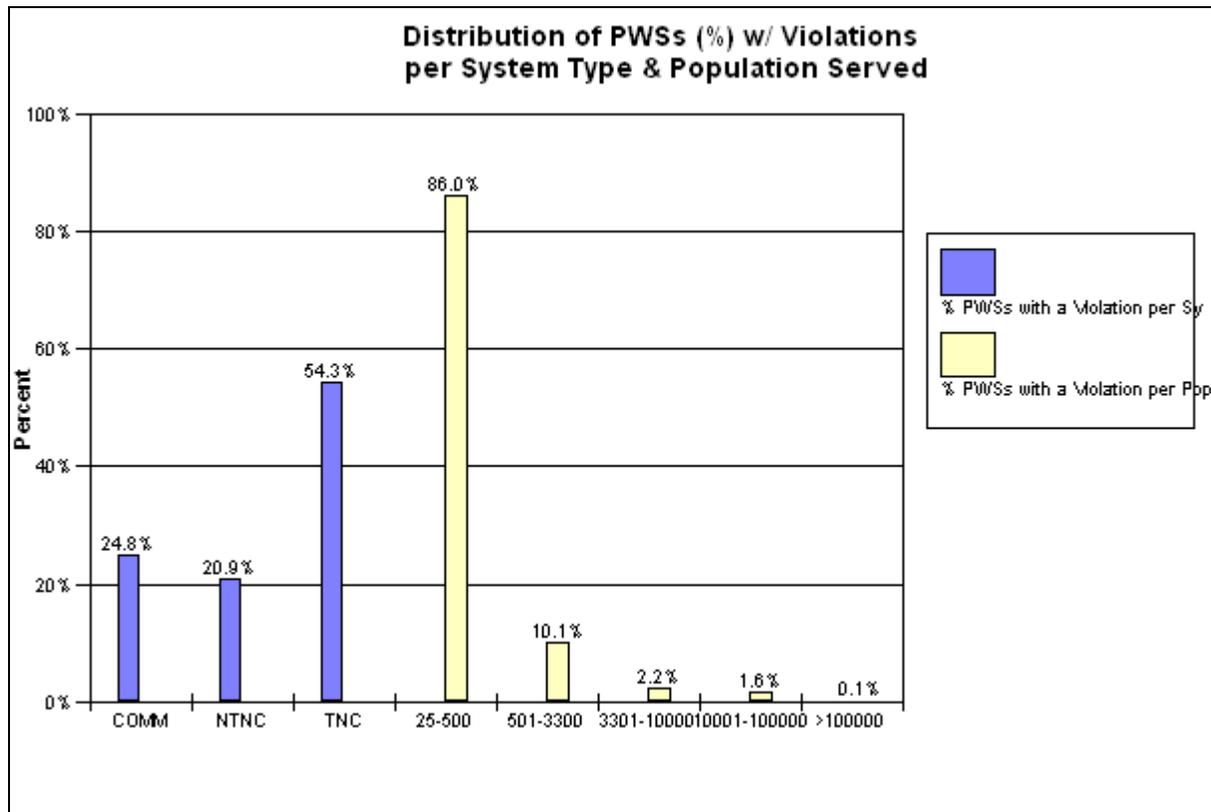

As depicted in Figure 1, of all water systems with at least one violation, 54.3 percent were associated with TNC water systems, 20.9 percent with NTNC water systems and 24.8 percent with CWS. Of the PWSs having one or more violations, 86 percent were associated with a population served category of serving fewer than 500 people per day.

More than 86 percent of the violations in Ohio occur because public water systems fail to monitor and report for various required contaminants in the period as specified on an individual system monitoring schedule provided by the Director of the Ohio EPA, or as a result of failing to collect follow-up or repeat samples. An average of 69 percent of systems returned to compliance following their violation(s) (see the definition of “return to compliance” for the list of contaminants included in the calculation). A detailed analysis of each contaminant group and violation category is presented below. When sufficient data was available, charts displaying the number of water systems with a violation per system type and population categories have been prepared and included in this report.

Organic Contaminants

The organic contaminants group summarized in the Compliance Table include: volatile organic chemicals (VOCs); synthetic organic chemicals (SOCs); total trihalomethanes (TTHMs) and haloacetic acids (DBPs).

VOCs are predominantly used as solvents, degreasers, cleaning solutions, dry cleaning fluids, and components of pesticides and plastics. These chemicals are described as volatile because of their tendency to evaporate. They generally enter drinking water systems through spills and improper disposal. VOCs are monitored by all community and NTNC PWSs (and 2 purchased water systems) on one of three schedules based on source type and past monitoring history: one sample quarterly, one sample annually, or one sample in 3 years. During 2002, 1,083 public water systems were required to sample at least once for VOCs. A significant difference to note between monitoring for VOCs and other contaminant groups is that every time a PWS samples for VOCs, they are required to have the sample analyzed for all 21 regulated VOC compounds using one analytical method which scans for all of the compounds. So, for each missed VOC sample, a PWS would have 21 violations for the regulated VOC compounds. This creates an artificially high number of violations for the VOC group as well as the total number of violations issued in Ohio. There are 3,255 individual VOC compound M/R violations. This really represents 188 VOC samples which were not collected. There were 128 of the 1,083 public water systems required to sample during 2002 that failed to collect one or more samples which resulted in a M/R violation. Overall compliance for the VOC M/R is 88.2 percent, up from 87.5 percent in 2001. Approximately 92 percent of the VOC M/R violations were associated with NTNC systems. Of those public water systems with a VOC M/R violation, 83 percent were associated with water systems serving less than 500 people. One system exceeded the MCL of 2 micrograms per liter for vinyl chloride. This system returned to compliance by switching to a new source. Some people who drink water containing vinyl chloride in excess of the MCL over many years may have an increased risk of getting cancer.

VOC Contaminant Group Highlights

- ▶ 1,083 public water systems required to collect VOC samples
- ▶ 99.9 percent compliance with all VOC MCLs
- ▶ 88.2 percent of the public water systems are in compliance for the VOC M/R category
- ▶ 3,255 individual VOC compound violations
- ▶ 83 percent of the VOC M/R violations occurred at PWS serving less than 500 people

SOCs, which includes primarily pesticides, are monitored by all community and NTNC PWS (and 2 purchased water systems). Some of the SOC's are monitored more often than others because they are used in large quantities on Ohio farm fields, like alachlor, atrazine, and simazine. Based on Ohio's pesticide study, systems are required to monitor or monitor more frequently during time periods which are most likely to see occurrence of the contaminants.

Ground water systems monitor for alachlor, atrazine, and simazine at least once every three years. If a ground water system has a detection for one of these SOC's, they are required to monitor at a minimum on a quarterly basis. All ground water systems were required to monitor for these three SOC's during the July through September quarter, 2002.

Because Ohio's surface water systems are more vulnerable to pesticide contamination, they are required to monitor for alachlor, atrazine, and simazine every year at a much greater frequency, including every-other-week May thru July for systems that have a history of elevated pesticide levels in their finished water.

Systems are required to monitor the remaining 14 SOC's once every three years if they have a mean nitrate measurement greater than 2 mg/L. Nitrate is used as an indicator of a system's susceptibility. Monitoring

waivers are granted for systems that have a mean nitrate concentration less than or equal to 2 mg/L. The waivers are granted for a 3-year period and must be renewed when that period lapses.

During the 2002 calendar year, 2115 public water systems were required to sample for one or more of the SOC compounds. All of the SOC violations incurred during the 2002 calendar year were related to M/R requirements. No public water systems incurred an SOC MCL during 2002. The overall M/R compliance rate for 2002 is 89.7 percent, up from 80.3 percent from 2001, when only 422 systems were required to monitor.

SOC Contaminant Group Highlights

- ▶ 2115 public water systems required to sample for SOCs
- ▶ 100 percent compliance with all SOC MCLs
- ▶ 89.7 percent of the public water systems were in compliance for all SOC M/R
- ▶ 76.5 percent of the M/R violations which occurred were for public water systems serving fewer than 500 people

Total trihalomethanes (TTHMs) are classified as organic disinfection by-products. They are created when organic compounds react with the disinfectant added to the water. (It is important to note that disinfectants are an important part of the control of water-borne pathogens.) TTHMs are sampled in the distribution systems of community PWSs that treat their water with any combination of chlorine, chloramines, chlorine dioxide or ozone. Ohio required consecutive community surface water systems that deliver disinfected water, but do not add any additional treatment, to sample for TTHMs in 2002. Ground water systems and nontransient noncommunity surface water systems serving less than 10,000 persons will not be required to sample for TTHMs until 2004.

During the 2002 calendar year, 126 PWSs serving 10,000 or more persons were scheduled to monitor for TTHMs. (63 surface water and 63 ground water). None of these systems failed to monitor for TTHMs. Five of the surface water systems in this group exceeded the MCL of 0.080 milligrams per liter (mg/L). Compliance with the TTHM MCL is determined by calculating a running annual average at the end of each quarter. Some people who drink water containing TTHMs in excess of the MCL over many years may experience problems with their liver, kidneys, or central nervous system, and may have an increased risk of getting cancer.

121 surface water PWSs serving less than 10,000 persons were required to monitor for TTHMs in 2002. This was the first year of monitoring for these systems. There is no federal equivalent to the state rule that required these systems to monitor. The MCL for TTHMs will be effective for these systems beginning in 2004. 21 M/R violations were issued to 15 systems in this category. At the end of 2002, 52 systems had a running annual average greater than 0.080 mg/L (29 surface water and 23 purchased surface water).

111 consecutive surface water systems that do not add any additional treatment were scheduled by Ohio to monitor for TTHMs in 2002. 25 of these systems serve a population greater than or equal to 10,000. Consecutive systems that do not add a disinfectant were not included in U.S EPA rules for disinfection by-products. 17 M/R violations were issued to 12 systems in this category. At the end of 2002, 20 consecutive systems had a running annual average greater than 0.080 mg/L. US EPA has indicated that they intend to include these systems in the D/DBP 2 Rule.

Haloacetic acids (DBPs) are another class of organic disinfection by-products that form when a disinfectant reacts with organic matter in the water. Haloacetic acids are also sampled in the distribution systems of community surface water systems that treat their water with any combination of chlorine, chloramines, chlorine dioxide or ozone. Ohio required consecutive community surface water systems that deliver disinfected water, but do not add any additional treatment, to sample for Haloacetic acids in 2002. There were no ground water systems scheduled to monitor for Haloacetic acids in 2002.

During the 2002 calendar year, 63 surface water PWSs serving greater than 10,000 or more persons were scheduled to monitor for Haloacetic acids. None of these systems failed to monitor for Haloacetic acids. All 63 of these PWSs were in compliance with the MCL of 0.060 mg/L.

121 surface water PWSs serving less than 10,000 persons were required to monitor for Haloacetic acids in 2002. This was the first year of monitoring for these systems. There is no federal equivalent to the state rule that required these systems to monitor. The MCL for Haloacetic acids will be effective for these systems beginning in 2004. 21 M/R violations were issued to 15 systems in this category. At the end of 2002, 7 systems had a running annual average greater than 0.060 mg/L.

111 consecutive surface water systems that do not add any additional treatment were scheduled to monitor for Haloacetic acids in 2002. 25 of these systems serve a population greater than or equal to 10,000. Consecutive systems that do not add a disinfectant were not included in U.S. EPA rules for disinfection by-products. 22 M/R violations were issued to 12 systems in this category. At the end of 2002, 1 consecutive system had a running annual average greater than 0.060 mg/L. US EPA has indicated that they intend to include these systems in the D/DBP 2 Rule.

TTHM and DBP Contaminant Group Highlights for US EPA Required Sampling

- ▶ 121 community public water systems required to sample for TTHMs
- ▶ 63 surface water community public water systems required to sample for DBPs
- ▶ 95.9 percent compliance with the TTHM MCL
- ▶ 100 percent compliance with the DBP MCL
- ▶ 100 percent of the public water systems were in compliance for TTHM and DBP M/R.

Figures 2 and 3 show VOC, SOC, TTHM, and DBP(HAAs) violation numbers by population categories and system types, respectively. For specific information on each contaminant, such as the number of PWSs required to sample a contaminant in 2002 and how many violations occurred for that contaminant, please refer to the Appendix A Compliance Table.

Figure 2.


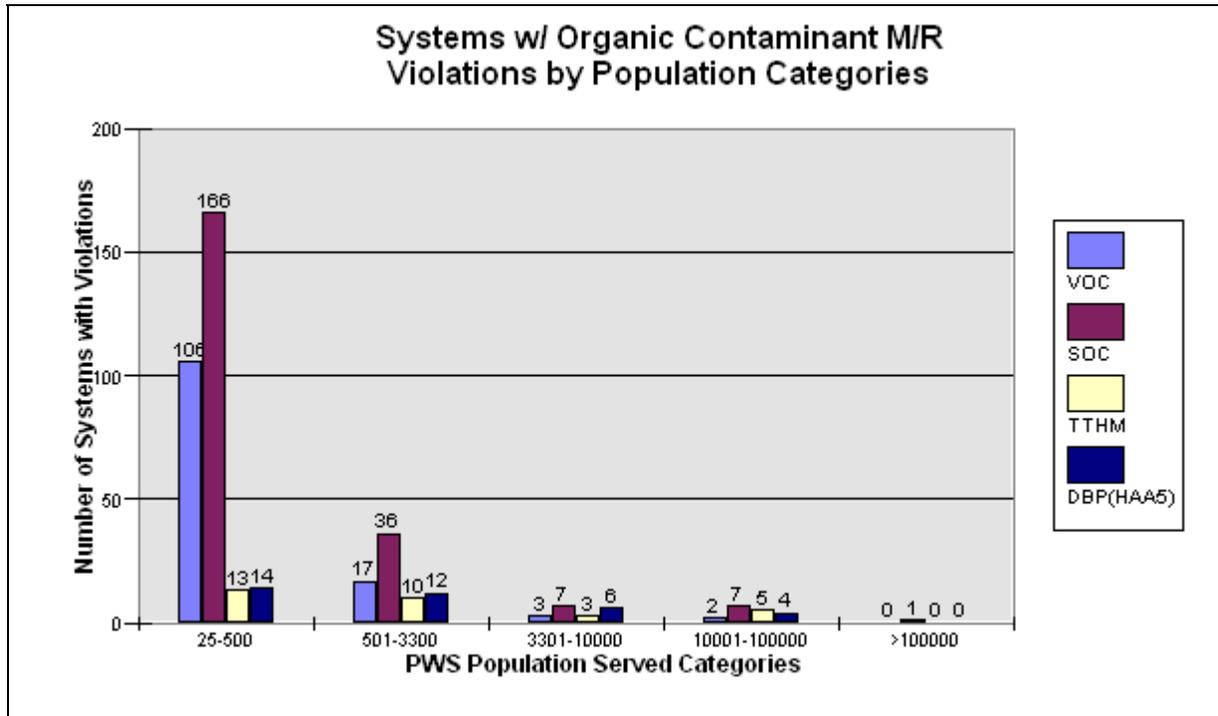


Figure 3.

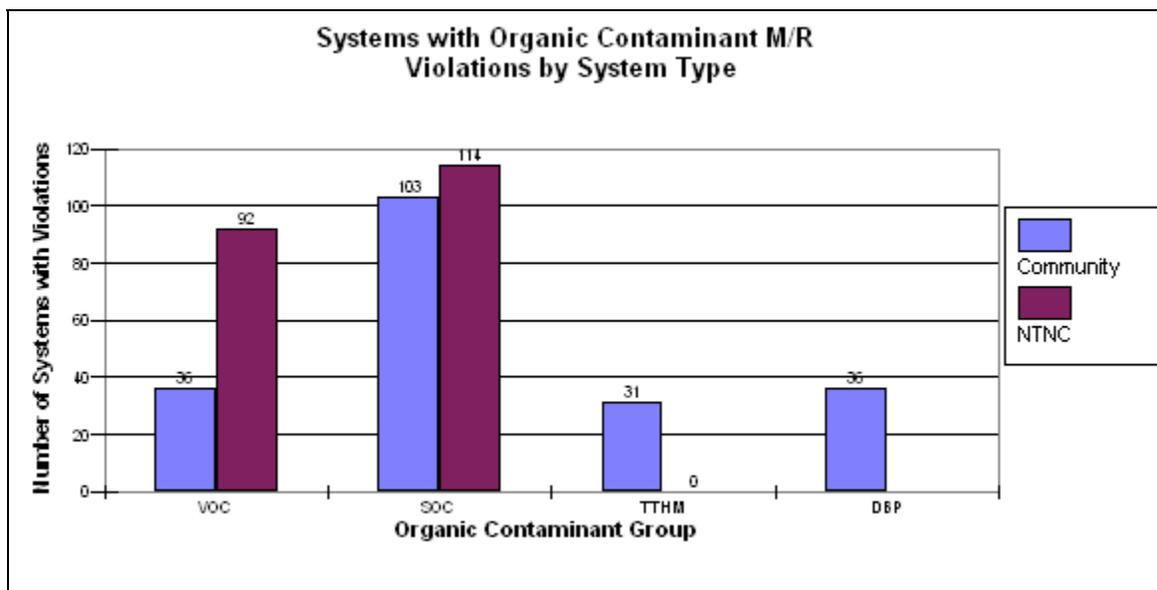

Inorganic Contaminants


The inorganic contaminant group summarized in the Appendix A Compliance Table includes metals (e.g. chromium, cadmium, mercury, etc.) and non-metal contaminants (e.g. asbestos, cyanide, nitrate, etc.). Many of these naturally occurring chemicals are also used in different manufacturing processes. Nitrate and nitrite are separated out as a group from the other inorganics (IOCs) for monitoring purposes and they are discussed in a separate section below. Both IOC and Nitrate/Nitrite violation numbers are shown in Figures 4 and 5.

Except for nitrate and nitrite, IOCs are monitored by all community and NTNC PWS (and 2 purchased systems). Most IOCs are monitored by surface water systems on an annual basis and by ground water systems once in 3 years. One exception is asbestos, which is monitored once in 9 years. During the 2002 calendar year, 726 public water systems were required to sample for at least one of the 13 individual IOC compounds. The overall M/R compliance rate for the IOC contaminant group is 85.8 percent. Of the 103 water systems with an IOC M/R violation, approximately 50% were community water systems, and 50% were non-community water systems. However, 69 percent of all violations were associated with water systems serving less than 500 people. No systems exceeded any of the inorganic MCLs.

IOC Contaminant Group Highlights

- ▶ 726 public water systems were required to sample for at least one IOC
- ▶ 100 percent compliance with all IOC MCLs
- ▶ 85.8 percent of the public water systems were in compliance for IOC M/R
- ▶ 69 percent of the M/R violations were associated with public water systems serving fewer than 500 people

Figure 4.

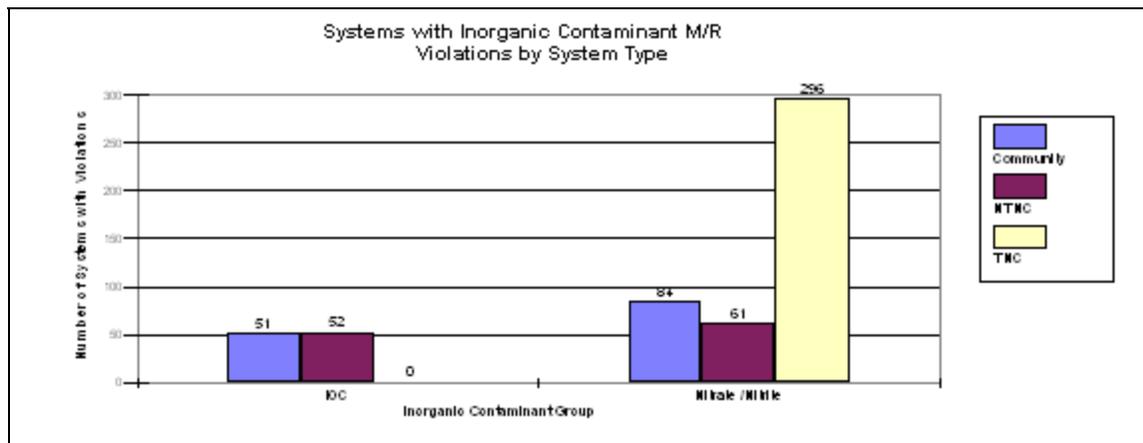

Nitrate contamination of drinking water usually results from runoff of agricultural fertilizers, or from human or animal wastes, such as feedlots or faulty septic systems. Nitrite is the reduced form of nitrate, and is usually found in nature at lower levels than nitrate. Nitrate is monitored by all community, NTNC, and TNC PWS (and 2 purchased systems). Nitrate is monitored monthly by surface water systems, ground

water systems under the direct influence of surface water, and by systems using treatment to remove nitrate. Ground water systems monitor annually for nitrate. Some ground water systems may be monitoring quarterly for nitrate based upon the levels reported in previous sampling. Since the requirements have become effective, nitrite, as a single contaminant, has been monitored only once by each system. Occurrence of nitrate, nitrite or nitrate/nitrite may require the systems to do additional monitoring. During the 2002 calendar year, 5,188 water systems were required to monitor for nitrate and 143 water systems were required to monitor for nitrite.

The compliance rate for nitrate M/R during 2002 is 91.5 percent, and 81.1 percent for nitrite. Of the 441 water systems with a nitrate violation during the 2002 calendar year, 67 percent were issued to TNC water systems and approximately 89.5 percent were associated with systems serving fewer than 500 people.

The highest number of MCL violations for any chemical parameter was associated with nitrate. During the 2002 calendar year, 27 nitrate MCL violations occurred at 15 water systems. These occurrences typically last for a short duration if they occur in a surface water system. There were no MCL violations for nitrite during 2002. Infants below the age of six months who drink water containing nitrate or nitrite in excess of the MCL could become seriously ill and if untreated, may die. Symptoms include shortness of breath and blue-baby syndrome.

Nitrate/Nitrite Contaminant Group Highlights

- ▶ 5188 public water systems were required to sample for nitrate and 143 for nitrite
- ▶ 99.7 percent compliance rate for nitrate MCLs
- ▶ 100 percent compliance rate for nitrite MCLs
- ▶ 27 nitrate MCL violations occurred at 15 water systems
- ▶ 91.5 percent of the public water systems were in compliance for nitrate M/R
- ▶ 81.1 percent of the public water systems required to monitor were in compliance for nitrite M/R
- ▶ 89.5 percent of the M/R violations were associated with public water systems serving fewer than 500 people

For specific information on each contaminant, such as the number of PWSs required to sample a contaminant in 2002 and how many violations occurred for that contaminant, please refer to Appendix A-Compliance Table.

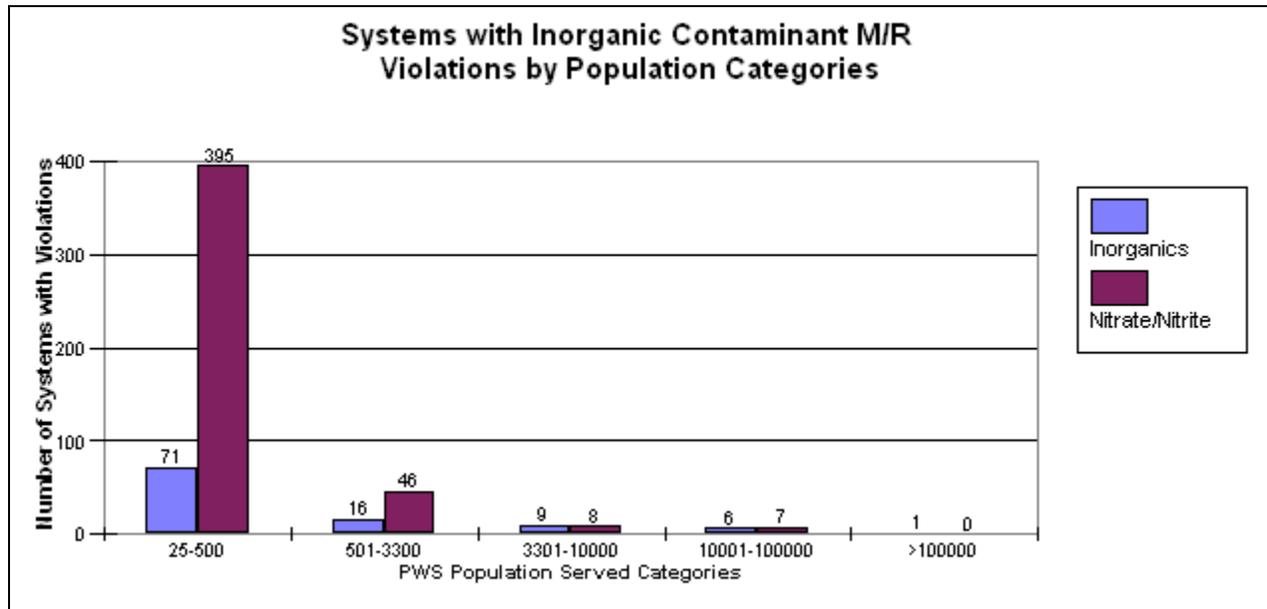


Figure 5.

Radionuclide Contaminants

The radionuclide group, which includes the contaminants gross alpha, gross beta, radium-226 and radium-228, occurs from the erosion or decay of natural and manmade deposits. Radium-226 and radium-228 are only monitored individually when a PWS exceeds the gross alpha action level of 5 pCi/L.

Radionuclides are monitored by all community PWSs (and 2 purchased systems). Initially, systems monitor for radionuclides quarterly, then annually for surface water systems, and once every 3 years for ground water systems. If the MCL is exceeded, systems return to quarterly monitoring. During the 2002 calendar year, 414 water systems were required to monitor for radionuclides. The overall radionuclide MCL compliance rate is 99.8 percent. Only one water system incurred MCL violations for radium 226/228. This system installed treatment as required by Ohio EPA. Some people who drink water containing radium 226 or 228 in excess of the MCL of 5 pico- curies per liter over many years may have an increased risk of getting cancer. The overall compliance rate for radionuclide M/R is 91.5 percent. Of the 35 water systems with a violation during the 2002 calendar year, 51 percent were associated with systems serving fewer than 500 people.

Radionuclides Contaminant Group Highlights

- ▶ 414 public water systems were required to sample for radionuclides
- ▶ 99.8 percent compliance rate for radionuclide MCLs
- ▶ 3 radium 226/228 MCL violations occurred at 1 water system with a population <500
- ▶ 91.5 percent of the water systems were in compliance for radionuclides M/R
- ▶ 51 percent of the M/R violations were associated with public water systems serving fewer than 500

people

For specific information on each contaminant, such as the number of PWSs required to sample a contaminant in 2001 and how many violations occurred for that contaminant, please refer to Appendix A.

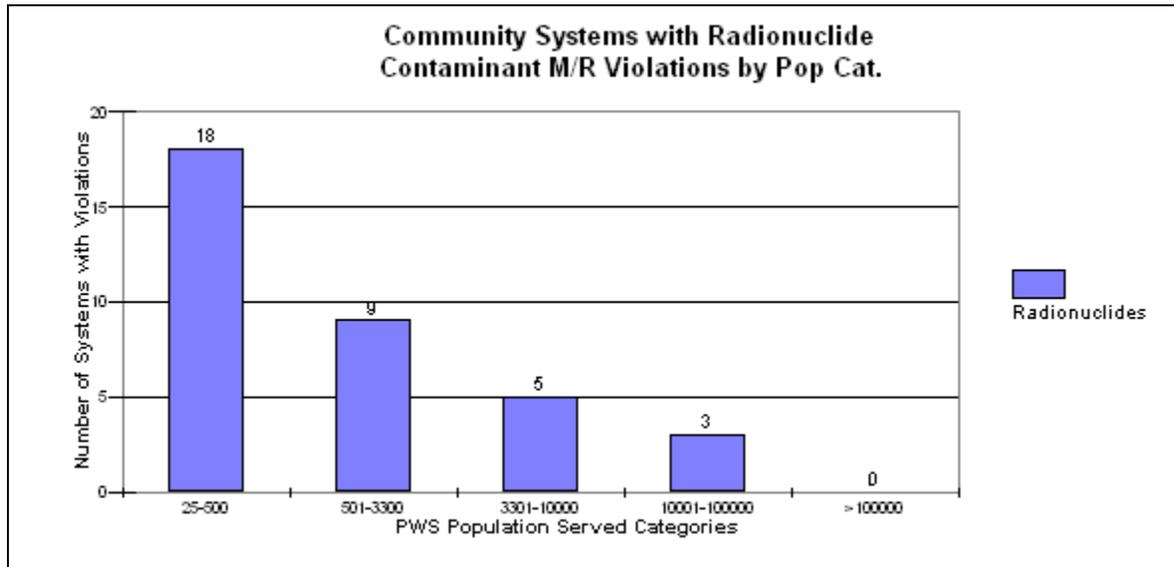


Figure 6.

Total Coliform Regulations

The total coliform regulations determine if microbiological contaminants are present in drinking water. If contaminants are detected, the regulations require further analysis to indicate if they are an unsafe type. Total coliform is a family of bacteria which contain pathogenic as well as harmless organisms. Total coliform, alone, is not used to determine if contamination exists. Fecal and *E. coli* bacteria are specific types of coliform bacteria which are associated with animal waste and can indicate a breakdown in treatment or some other influence of animal waste, including failing septic systems. In Ohio, a total coliform (TC) test is used initially to indicate whether or not microbiological contaminants are present. If a sample is TC positive (microbiological contaminants are present), further analysis for either fecal coliform and *E. Coli* and the collection of additional samples are required to determine if contamination is present. TC is monitored by all PWSs. The frequency of TC testing and the number of samples collected is dependent upon the type of PWS, the population served and source type. Sampling requirements range from as few as one TC sample per quarter for TNC water systems to hundreds of TC samples per month for large community water systems. Ohio's minimum monitoring requirements of one sample per quarter can be up to four times as frequent as the federal requirements. Two types of MCL violations, acute and non-acute, are associated with the total coliform regulations. An acute violation occurs when more than

one sample is total coliform positive and at least one sample contains *E. coli* or fecal coliform bacteria. An acute violation also occurs in Ohio when an insufficient number of samples are collected following one or more TC positive samples. Non-acute MCL violations occur when greater than 5 percent (or 2 or more samples if collecting less than 40 samples per month) of all the samples collected are TC positive.


During the 2002 calendar year, the compliance rate for TC acute MCL violations is 88 percent (89% in 2001) and 77 percent for non-acute MCL violations (78% in 2001). Of the 568 water systems with TC MCL violations, 76 percent were associated with TNC water systems, and 94 percent were associated with water systems serving less than 500 people. The majority of acute MCL violations can be attributed to Ohio assigning an acute MCL to a water system failing to collect a sufficient number of samples following a positive total coliform sample. Creating an additional acute MCL violation is most protective of public health, but results in higher numbers of acute MCL violations for Ohio. Major routine and follow-up M/R violations for the TC regulations are incurred by water systems when they fail to sample or report all of the required samples during a given monitoring period. Of the water systems with one or more major routine and follow-up M/R violations, 79 percent were associated with TNC water systems and 94 percent were associated with water systems serving less than 500 people.

Total Coliform Contaminant Group Highlights


- ▶ 5,621 public water systems were required to sample for TC
- ▶ 88 percent compliance with the acute MCL
- ▶ 77 percent compliance with the TC M/R requirements
- ▶ 94 percent of the M/R violations and 94 percent of MCL violations were associated with public water systems serving fewer than 500 people, mostly TNC water systems

Figure 7.

Figure 8.

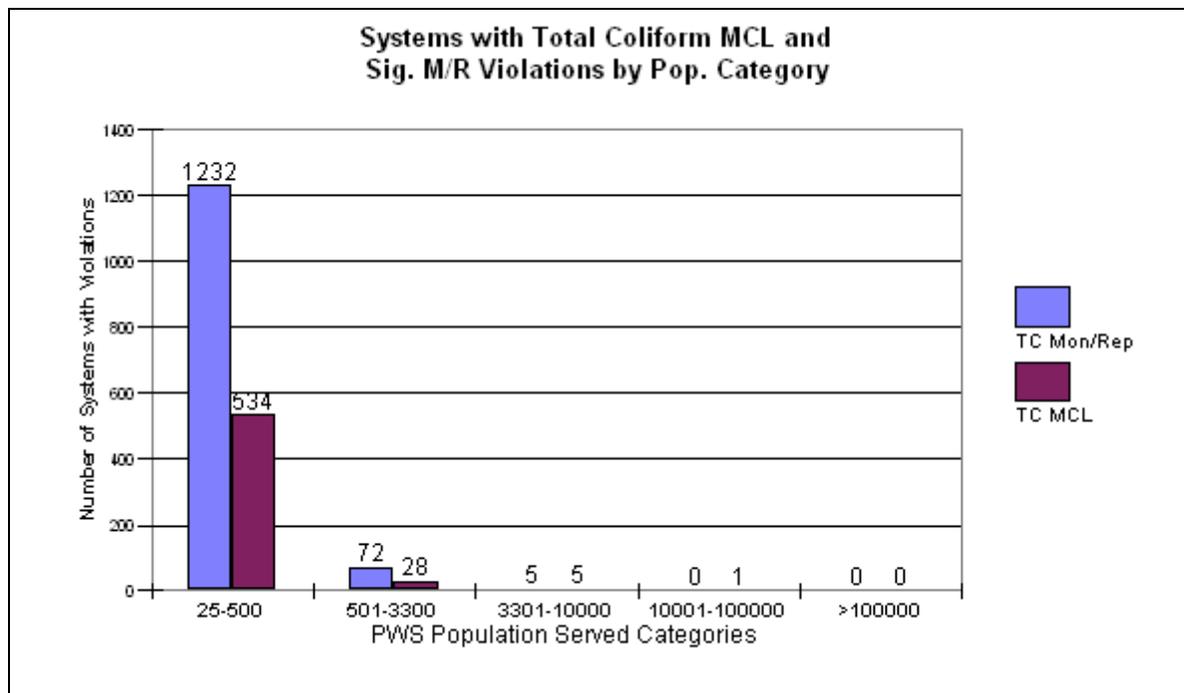

Surface Water Treatment Regulations

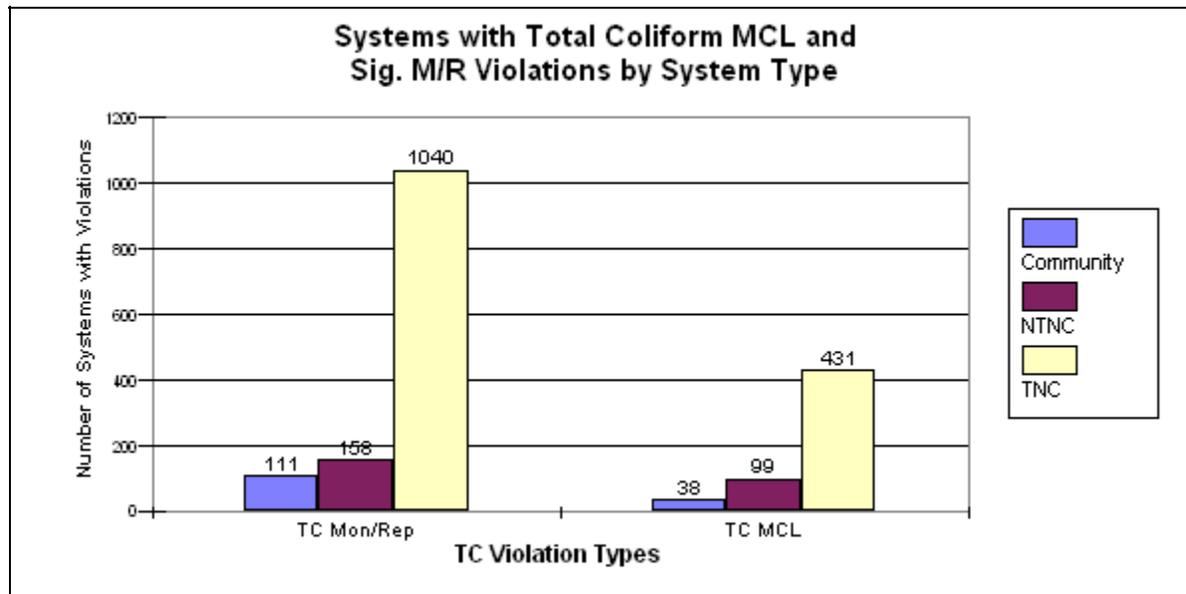

The surface water treatment regulations (SWTR) in Ohio establish treatment and monitoring standards for water systems that have sources designated as surface water or ground water under the direct influence of surface water. Ground water under the direct influence of surface water are systems that use wells to obtain their water, but the water quality is subject to the influence of surface water. The influence of surface water can be from unacceptably constructed wells to the type of aquifer from which the system is drawing. Public water systems subject to these regulations are required to provide filtration and disinfection of the water. The surface water treatment requirements are designed to inactivate or kill pathogens found in surface water. Water quality tests are performed on the water to ensure treatment is being maintained to a set standard that should prevent contamination. Tests include evaluation and measurement of sufficient chlorination contact time, filtration type and effectiveness, turbidity levels, and residual chlorine levels in the distribution system. Failure to meet one or more of these standards results in a monthly treatment technique (TT) violation. During the 2002 calendar year, 170 water systems were subject to the SWTR TT and M/R requirements. The overall SWTR TT compliance rate is 69 percent (62% in 2001). The majority of water systems with these violations are the systems designated ground water under the direct influence of surface water (GUDI). GUDI systems have 18 months, by rule, to eliminate the causes of the GUDI designation or install surface water treatment. Many small systems have exceeded the 18 month time period in 2002 and are accumulating TT violations. The overall compliance rate for SWTR M/R is 98 percent (99.5% in 2001). Of the 53 water systems with a TT violation during the 2002 calendar year, 72 percent were associated with systems serving fewer than 500 people.

Surface water systems serving a population of greater than 10,000 were required to meet lower turbidity

requirements and expanded performance standards in 2002 under the Enhanced Surface Water Treatment Rules. Overall, the large systems have been meeting all the new requirements. There were only 4 TT violations at 3 systems and no monitoring or reporting violations at the large surface water systems.

SWTR Contaminant Group Highlights

- ▶ 170 public water systems were subject to the SWTR monitoring and treatment requirements
- ▶ 69 percent of the public water systems were in compliance with the TT requirements
- ▶ 98 percent of water systems which provide treatment were in compliance with the SWTR M/R requirements
- ▶ 72 percent of the water systems with a TT violations were associated with water systems serving fewer than 500 people

Figure 9.


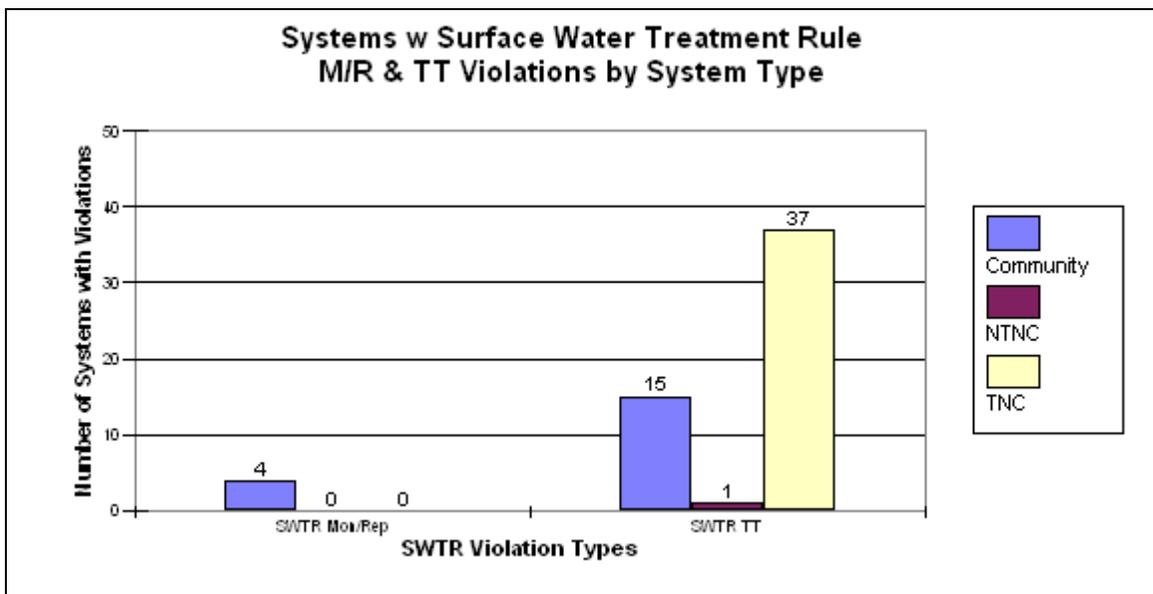


Figure 10.

Lead and Copper Regulations

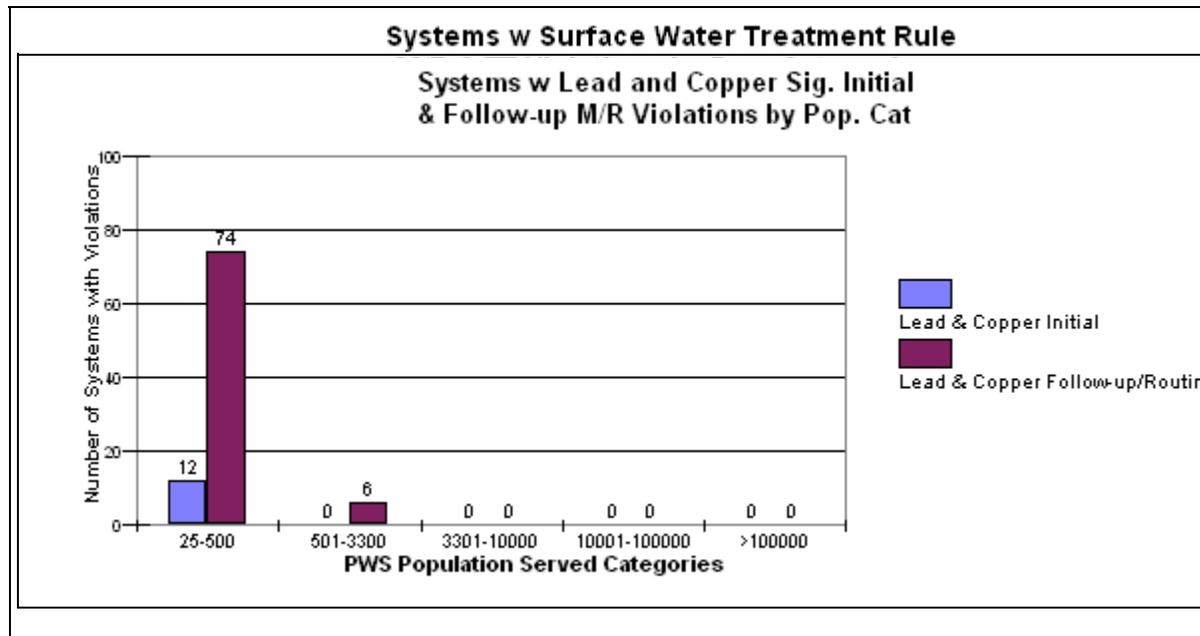

The lead and copper regulations in Ohio establish standards for levels of lead and copper in the distribution systems of community and NTNC public water systems. During the beginning phases of monitoring, these public water systems are required to perform initial monitoring during two consecutive six month periods. Following completion of these periods, routine annual or triennial monitoring periods are required. For the 2002 calendar year, 119 water systems were required to perform initial monitoring and 1171 systems were required to perform either annual or triennial monitoring. In addition, 45 systems were required to perform public education notifications due to an exceedance of the lead action level. The overall compliance for lead and copper monitoring is 93 percent (88% in 2001). Of the 92 water systems with lead and copper violations, 93 percent were associated with systems serving fewer than 500 people.

Lead and Copper Contaminant Group Highlights


- ▶ 1,335 public water systems were required to perform initial, annual or triennial monitoring and public education requirements
- ▶ 93 percent of water systems were in compliance with the lead and copper M/R requirements
- ▶ 93 percent of the water systems with a lead and copper M/R violation were associated with public water systems serving fewer than 500 people

Figure 11.

Figure 12.

Consumer Confidence Reports

Every Community Water System is required to deliver to its customers a Consumer Confidence Report

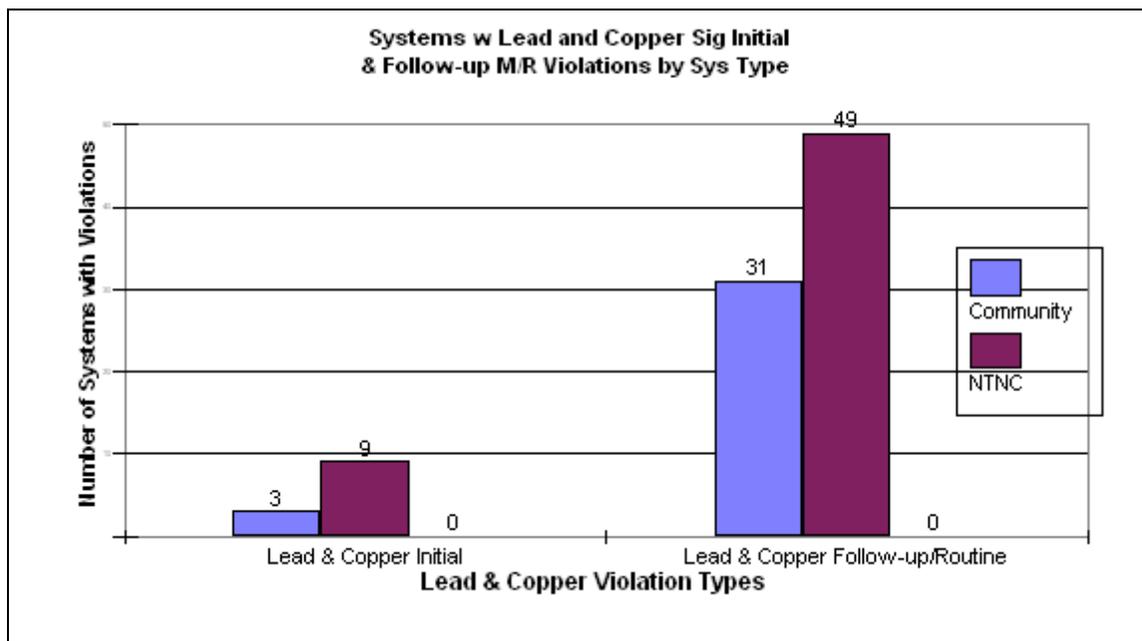


(C
CR
).
Thi
s
rep
ort
is
to
incl
ude
so
me
edu
cati
ona
l
mat
eria
l,

provide information on the source water, levels of any detected contaminants, and compliance with drinking water regulations. A significant public notification violation occurred if a community water system completely failed to provide its customers the required annual water quality report. A total of 1,352 community water systems were required to provide their customers with a CCR. For the 2002 calendar year, 75 systems failed to provide this report in violation of these requirements, and 125 systems that provided a CCR did not include all the required content which resulted in a violation. Of the 200 systems failing to meet these requirements, 60.5 percent were communities serving less than 500 people. Figure 13 shows the breakdown of community water systems in violation by population served. The overall compliance for CCR requirements is 85 percent (85% in 2001).

Consumer Confidence Report Highlights

- ▶ 1,352 public water systems were subject CCR requirements
- ▶ 85 percent of the water systems were in compliance with the requirements
- ▶ 60.5 percent of the systems that had CCR notification violations were associated with systems serving less than 500 people

Figure 13.

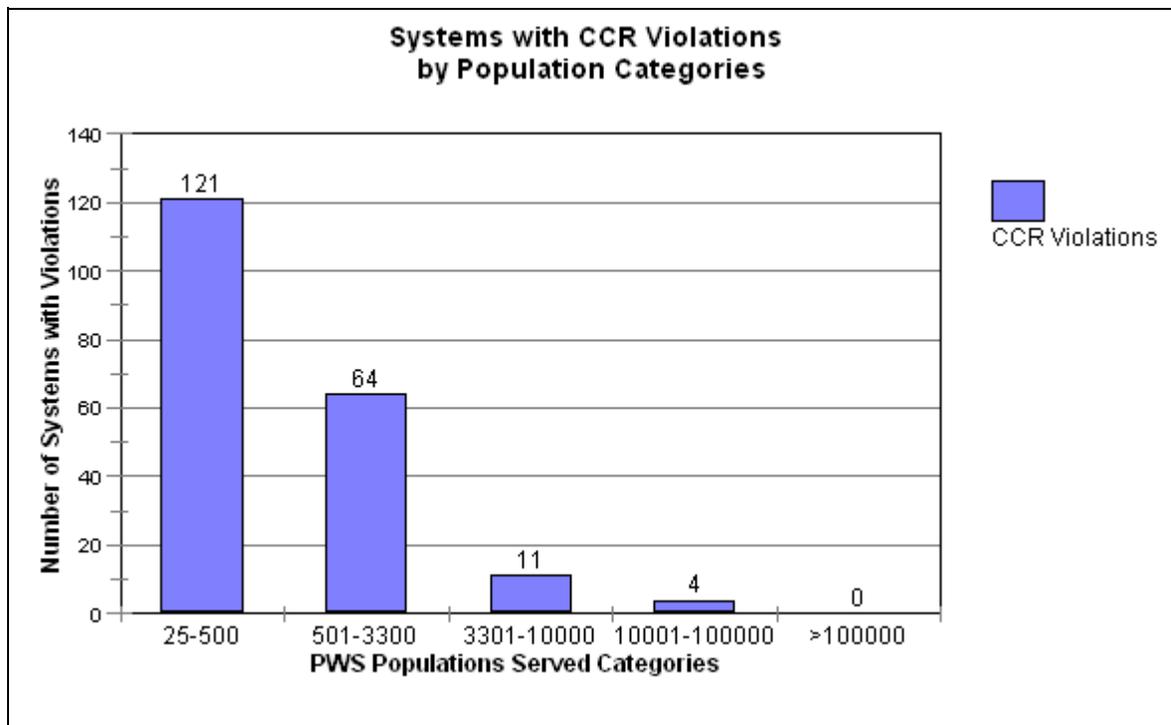

o EPA's Public Water System Compliance Assistance

Ohio EPA employs various methods to assist public water systems in achieving compliance with the Safe Drinking Water Act regulations. Some of the methods that may be used include: providing a sampling and monitoring schedule for each public water system; offering technical assistance during facility inspections (sanitary surveys) and follow-up visits; assisting in investigations of contamination; performing investigatory monitoring; providing off-site assistance through phone calls and meetings; providing outreach training sessions for new rules and treatment; assistance in finding funding for projects; providing operator and laboratory personnel training sessions; distributing reminder postcards and/or contacting the water systems towards the end of the monitoring period to ensure collection of the required samples; and sending notice of violation letters for failure to meet the requirements for each specific regulation. The use of these methods is based on the availability of Ohio EPA personnel and resources. Activities such as follow-up visits, contamination investigation, sampling, outreach training, distributing reminder post cards and other reminders to sample were curtailed due to a reduction in funding. In particular, the small GUDI systems have not received the compliance assistance that is necessary to meet the 18 month compliance date and for the large part, remain unaddressed. Compliance rates were impacted, at least in part, by Ohio EPA's reduction in technical assistance.

In the next several years, Ohio EPA will be required to implement several new rules directly related to surface water treatment and disinfection by-products for smaller systems, arsenic, additional radiological contaminants, ground water source monitoring, as well as other contaminants. Additional staffing and resources are not expected. Additional funding for public water systems to meet the new requirements is also not anticipated. As a result, there will be less resources available to spend on compliance assistance, something that public water systems need more of as they face the challenge of meeting all of the new requirements.

Listing of Maximum Contaminant Level and Treatment Technique Violations

Appendix B contains a listing of all violation types related to the MCL and TT regulation categories. The listing is ordered by water system identification number and violation date. Violation type or contaminant codes associated with the violations are defined in the Appendix A Compliance Summary Table. Included in the violation listing are enforcement action type codes (e.g. A, E, G, etc) associated with each violation. These are the particular actions the State of Ohio took to address each violation with the water system. Table 6 describes the enforcement action type codes used in Appendix B. Not all violations are required to have a compliance achieved enforcement action type code associated with them when a public water system has returned to compliance. In particular, the total coliform (code 3100) MCL violations listed do not have the returned to compliance enforcement code associated violations while almost all systems have returned to compliance. A return to compliance for these violations is determined by lack of subsequent on-going violations.

Table 6. Enforcement Action Type Code Descriptions

Enforcement Action Type Code	Description
A	Notice of Violation Letter sent to Public Water System
C	Technical Assistance Visit, Meeting, or Investigation
E	Request for System to Public Notice
F	Public Notice received from Public Water System
G	Ohio EPA News Release (Public Notice)
H	Boil Water Order
J	Division, Notice of Violation Warning Letter
K	Bilateral Compliance Agreement Signed
L	Administrative Order without penalty
O	Administrative Order with penalty
Q	Civil Case Filed
R	State Consent Decree or Consent Judgement
X	Compliance Achieved
9	Civil Case Referred to Attorney Generals Office

A list of violations can also be viewed using the Internet at U.S. EPA's site known as "Envirofacts". This Internet site provides access to a subset of data available from U.S. EPA's Safe Drinking Water Information System (SDWIS). Using the Envirofacts website allows the user to select by state, county, public system name, public water system identification number and population size to obtain general facility information and violation information for public water systems in Ohio. The Internet address for this Envirofacts site is http://www.epa.gov/enviro/html/sdwis/sdwis_query.html.

Report Availability and Contact Information

The 2002 summary report may be obtained by writing to the State of Ohio at: PWS Annual Compliance Report, Ohio EPA - DDAGW, P.O. Box 1049, Columbus, OH 43216-1049. In addition, this summary report has been posted on the Ohio EPA's Website at <http://www.epa.state.oh.us/ddagw/annualreports.html>.

For further information concerning this report, you may contact Rick Magni or Beth Messer with the Ohio EPA Division of Drinking and Ground Waters at (614) 644-2752. If you have questions concerning the specific violations associated with individual water systems, contact your local Ohio EPA District Office in your region.

Scot Foltz
Ohio EPA
Central District Office
3232 Alum Creek Drive
Columbus, Ohio 43207
(614) 728-3778

Janet Barth
Ohio EPA
Southeast District Office
2195 Front Street
Logan, Ohio 43138
(740) 385-8501

Jeff Davidson
Ohio EPA
Southwest District Office
401 East 5TH Street
Dayton, Ohio 45402
(937) 285-6357

Doug Scharp
Ohio EPA
Northwest District Office
347 N. Dunbridge Road
Bowling Green, Ohio 43402
(419) 352-8461

Nancy Rice
Ohio EPA
Northeast District Office
2110 E. Aurora Road
Twinsburg, Ohio 44087
(330) 963-1200

APPENDIX A:

COMPLIANCE SUMMARY TABLE

Appendix A Compliance Table

State:	OHIO
Reporting Interval:	JANUARY 1, 2002 - DECEMBER 31, 2002

SDWIS Codes	Contaminant	MCL (mg/l) ¹	Number of Systems Required to Sample during 2002	MCLs			Treatment Techniques			Significant Monitoring/Reporting		
				Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems with Violations	Percent of Systems in Compliance
	Organic Contaminants											
2981	1,1,1-Trichloroethane	0.2	1083	0	0	100.0%				155	128	88.0%
2977	1,1-Dichloroethylene	0.007	1083	0	0	100.0%				155	128	88.0%
2985	1,1,2-Trichloroethane	0.005	1083	0	0	100.0%				155	128	88.0%
2378	1,2,4-Trichlorobenzene	0.07	1083	0	0	100.0%				155	128	88.0%
2931	1,2-Dibromo-3-chloropropane (DBCP)	0.0002	0	N/A	N/A	N/A				N/A	N/A	N/A
2980	1,2-Dichloroethane	0.005	1083	0	0	100.0%				155	128	88.0%
2983	1,2-Dichloropropane	0.005	1083	0	0	100.0%				155	128	88.0%
2063	2,3,7,8-TCDD (Dioxin)	3x10 ⁻⁸	0	N/A	N/A	N/A				N/A	N/A	N/A
2110	2,4,5-TP	0.05	0	N/A	N/A	N/A				N/A	N/A	N/A
2105	2,4-D	0.07	1	0	0	100.0%				0	0	100.0%
2265	Acrylamide						0	0	N/A			

State:	OHIO
Reporting Interval:	JANUARY 1, 2002 - DECEMBER 31, 2002

SDWIS Codes	Contaminant	MCL (mg/l) ¹	Number of Systems Required to Sample during 2002	MCLs			Treatment Techniques			Significant Monitoring/Reporting		
				Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems with Violations	Percent of Systems in Compliance
2051	Alachlor	0.002	2115	0	0	100.0%				213	210	90.0%
2050	Atrazine	0.003	2115	0	0	100.0%				212	209	90.0%
2990	Benzene	0.005	1083	0	0	100.0%				155	128	88.0%
2306	Benzo[a]pyrene	0.0002	0	N/A	N/A	N/A				N/A	N/A	N/A
2046	Carbofuran	0.04	0	N/A	N/A	N/A				N/A	N/A	N/A
2982	Carbon tetrachloride	0.005	1083	0	0	100.0%				155	128	88.0%
2959	Chlordane	0.002	0	N/A	N/A	N/A				N/A	N/A	N/A
2380	cis-1,2-Dichloroethylene	0.07	1083	0	0	100.0%				155	128	88.0%
2031	Dalapon	0.2	0	N/A	N/A	N/A				N/A	N/A	N/A
2035	Di(2-ethylhexyl)adipate	0.4	1	0	0	100.0%				1	1	0.0%
2039	Di(2-ethylhexyl)phthalate	0.006	64	0	0	100.0%				11	9	86.0%
2964	Dichloromethane	0.005	1083	0	0	100.0%				155	128	88.0%
2041	Dinoseb	0.007	0	N/A	N/A	N/A				N/A	N/A	N/A
2032	Diquat	0.02	4	0	0	100.0%				0	0	100.0%
2033	Endothall	0.1	0	N/A	N/A	N/A				N/A	N/A	N/A
2005	Endrin	0.002	0	N/A	N/A	N/A				N/A	N/A	N/A

State:	OHIO
Reporting Interval:	JANUARY 1, 2002 - DECEMBER 31, 2002

SDWIS Codes	Contaminant	MCL (mg/l) ¹	Number of Systems Required to Sample during 2002	MCLs			Treatment Techniques			Significant Monitoring/Reporting		
				Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems with Violations	Percent of Systems in Compliance
2257	Epichlorohydrin						0	0	100			
2992	Ethylbenzene	0.7	1083	0	0	100.0%				155	128	88.0%
2946	Ethylene dibromide	0.00005	0	N/A	N/A	N/A				N/A	N/A	N/A
2034	Glyphosate	0.7	0	N/A	N/A	N/A				N/A	N/A	N/A
2065	Heptachlor	0.0004	0	N/A	N/A	N/A				N/A	N/A	N/A
2067	Heptachlor epoxide	0.0002	0	N/A	N/A	N/A				N/A	N/A	N/A
2274	Hexachlorobenzene	0.001	0	N/A	N/A	N/A				N/A	N/A	N/A
2042	Hexachlorocyclopentadiene	0.05	0	N/A	N/A	N/A				N/A	N/A	N/A
2010	Lindane	0.0002	0	N/A	N/A	N/A				N/A	N/A	N/A
2015	Methoxychlor	0.04	0	N/A	N/A	N/A				N/A	N/A	N/A
2989	Monochlorobenzene	0.1	1083	0	0	100.0%				155	128	88.0%
2968	o-Dichlorobenzene	0.6	1083	0	0	100.0%				155	128	88.0%
2969	p-Dichlorobenzene	0.075	1083	0	0	100.0%				155	128	88.0%
2383	Total polychlorinated biphenyls	0.0005	0	N/A	N/A	N/A				N/A	N/A	N/A
2326	Pentachlorophenol	0.001	1	0	0	100.0%				0	0	100.0%

State:	OHIO
Reporting Interval:	JANUARY 1, 2002 - DECEMBER 31, 2002

SDWIS Codes	Contaminant	MCL (mg/l) ¹	Number of Systems Required to Sample during 2002	MCLs			Treatment Techniques			Significant Monitoring/Reporting		
				Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems with Violations	Percent of Systems in Compliance
2987	Tetrachloroethylene	0.005	1083	0	0	100.0%				155	128	88.0%
2984	Trichloroethylene	0.005	1083	0	0	100.0%				155	128	88.0%
2996	Styrene	0.1	1083	0	0	100.0%				155	128	88.0%
2991	Toluene	1	1083	0	0	100.0%				155	128	88.0%
2979	trans-1,2-Dichloroethylene	0.1	1083	0	0	100.0%				155	128	88.0%
2955	Xylenes (total)	10	1083	0	0	100.0%				155	128	88.0%
2020	Toxaphene	0.003	0	N/A	N/A	N/A				N/A	N/A	N/A
2036	Oxamyl (Vydate)	0.2	0	N/A	N/A	N/A				N/A	N/A	N/A
2040	Picloram	0.5	0	N/A	N/A	N/A				N/A	N/A	N/A
2037	Simazine	0.004	2115	0	0	100.0%				210	207	90.0%
2976	Vinyl chloride	0.002	1083	4	1	99.9%				155	128	88.0%
2456	Haloacetic Acids (HAA5)	0.60	292	0	0	100.0%				49	36	88.0%
2950	Total trihalomethanes	0.800	355	6	5	98.6%				43	31	91.0%

State:	OHIO
Reporting Interval:	JANUARY 1, 2002 - DECEMBER 31, 2002

SDWIS Codes	Contaminant	MCL (mg/l) ¹	Number of Systems Required to Sample during 2002	MCLs			Treatment Techniques			Significant Monitoring/Reporting		
				Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems with Violations	Percent of Systems in Compliance
	Inorganic Contaminants											
1074	Antimony	0.006	726	0	0	100.0%				80	80	89.0%
1005	Arsenic	0.05	726	0	0	100.0%				74	74	90.0%
1094	Asbestos	7 million fibers/l ≤ 10 μm long	29	0	0	100.0%				5	5	83.0%
1010	Barium	2	726	0	0	100.0%				79	79	89.0%
1075	Beryllium	0.004	726	0	0	100.0%				78	78	89.0%
1015	Cadmium	0.005	726	0	0	100.0%				79	79	89.0%
1020	Chromium	0.1	726	0	0	100.0%				78	78	89.0%
1024	Cyanide (as free cyanide)	0.2	726	0	0	100.0%				89	89	89.0%
1025	Fluoride	4.0	726	0	0	100.0%				74	74	90.0%
1035	Mercury	0.002	726	0	0	100.0%				83	82	89.0%
1040	Nitrate	10 (as Nitrogen)	5188	27	15	99.7%				576	440	91.5%

State:	OHIO
Reporting Interval:	JANUARY 1, 2002 - DECEMBER 31, 2002

SDWIS Codes	Contaminant	MCL (mg/l) ¹	Number of Systems Required to Sample during 2002	MCLs			Treatment Techniques			Significant Monitoring/Reporting		
				Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems with Violations	Percent of Systems in Compliance
1041	Nitrite	1 (as Nitrogen)	143	0	0	100.0%				27	27	81.1%
1045	Selenium	0.05	726	0	0	100.0%				79	79	89.0%
1085	Thallium	0.002	726	0	0	100.0%				80	80	89.0%
1038	Total nitrate and nitrite	10 (as Nitrogen)	N/A	N/A	N/A	N/A				N/A	N/A	N/A

State:	OHIO
Reporting Interval:	JANUARY 1, 2002 - DECEMBER 31, 2002

SDWIS Codes	Contaminant	MCL (mg/l) ¹	Number of Systems Required to Sample during 2002	MCLs			Treatment Techniques			Significant Monitoring/Reporting		
				Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems with Violations	Percent of Systems in Compliance
	Radionuclide MCLs											
4000	Gross alpha	15 pCi/l	414	0	0	100.0%				32	32	92.0%
4010	Radium-226 and radium-228	5 pCi/l	1	3	1	0.0%				0	0	100.0%
4100	Gross beta	4 mrem/yr	136	0	0	100.0%				7	7	95.0%
	All Chemical Groups Subtotal		5621	40	22	99.6%				5500	991	82.0%

State:	OHIO
Reporting Interval:	JANUARY 1, 2002 - DECEMBER 31, 2002

SDWIS Codes	Contaminant	MCL (mg/l) ¹	Number of Systems Required to Sample during 2002	MCLs			Treatment Techniques			Significant Monitoring/Reporting		
				Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems with Violations	Percent of Systems in Compliance
	Total Coliform Rule											
21	Acute MCL violation	Presence	5621	313	273	95.0%						
22	Non-acute MCL violation	Presence	5621	503	424	92.5%						
23,25	Major routine and follow up monitoring		5621							2,088	1,309	77.0%
28	Sanitary survey ²									0	0	N/A
	TCR Subtotal		5621	816	697	87.6%				2088	1309	77.0%

State:	OHIO
Reporting Interval:	JANUARY 1, 2002 - DECEMBER 31, 2002

SDWIS Codes	Contaminant	MCL (mg/l) ¹	Number of Systems Required to Sample during 2002	MCLs			Treatment Techniques			Significant Monitoring/Reporting		
				Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems with Violations	Percent of Systems in Compliance
	Surface Water Treatment Rule											
	Filtered systems											
36	Monitoring		170							8	4	97.0%
41	Treatment techniques		170				346	53	69.0%			
	Unfiltered systems											
31	Monitoring		NA							NA	NA	NA
42	Failure to filter		NA				0	0	N/A			
	SWTR Subtotal		170				346	53	69.0%	8	4	97.0%

State:	OHIO
Reporting Interval:	JANUARY 1, 2002 - DECEMBER 31, 2002

SDWIS Codes	Contaminant	MCL (mg/l) ¹	Number of Systems Required to Sample during 2002	MCLs			Treatment Techniques			Significant Monitoring/Reporting		
				Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems with Violations	Percent of Systems in Compliance
	Lead and Copper Rule											
51	Initial lead and copper tap M/R		119							12	12	90.0%
52	Follow-up or routine lead and copper tap M/R		1171							80	80	93.0%
58, 62	Treatment Installation		N/A				NA	NA	NA			
65	Public education		45				0	0	100.0%			
	Lead & Copper Subbtotal		1335				0	0	100.00%	92	92	93.0%

State:	OHIO
Reporting Interval:	JANUARY 1, 2002 - DECEMBER 31, 2002

SDWIS Codes		MCL (mg/l) ³	Number of Systems Required to Sample during 2002	CCR Notifications		
				Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance
	Consumer Confidence Report (CCR):					
71	Report Violation		1352	75	75	94.0%
72	Adequacy, Delivery, Content		1352	125	125	91.0%
	CCR Totals		1352	200	200	85.0%

1. Values are in milligrams per liter (mg/l), unless otherwise specified.
2. Number of major monitoring violations for sanitary survey under the Total Coliform Rule.

Definitions for Violations Table

The following definitions apply to the Summary of Violations table.

NA: Not Applicable, no requirements for 2002, compliance rate is not calculated.

Consumer Confidence Report: Requires every Community Water System to deliver to its customers a brief annual water quality report. This report is to include some educational material, and will provide information on the source water, the levels of any detected contaminants, and compliance with drinking water regulations.

Significant Consumer Notification Violations: SDWIS Violation Code 71 occurs when a community water system completely fails to provide its customers the required annual water quality report.

Filtered Systems: Water systems that have installed filtration treatment [40 CFR 141, Subpart H].

Inorganic Contaminants: Non-carbon-based compounds such as metals, nitrates, and asbestos. These contaminants are naturally-occurring in some water, but can get into water through farming, chemical manufacturing, and other human activities. EPA has established MCLs for 15 inorganic contaminants [40 CFR 141.62].

Lead and Copper Rule: This rule established national limits on lead and copper in drinking water [40 CFR 141.80-91]. Lead and copper corrosion pose various health risks when ingested at any level, and can enter drinking water from household pipes and plumbing fixtures. States report violations of the Lead and Copper Rule in the following six categories:

Initial lead and copper tap M/R: SDWIS Violation Code 51 indicates that a system did not meet initial lead and copper testing requirements, or failed to report the results of those tests to the State.

Follow-up or routine lead and copper tap M/R: SDWIS Violation Code 52 indicates that a system did not meet follow-up or routine lead and copper tap testing requirements, or failed to report the results.

Treatment installation: SDWIS Violation Codes 58 AND 62 indicate a failure to install optimal corrosion control treatment system (58) or source water treatment system (62) which would reduce lead and copper levels in water at the tap. [One number is to be reported for the sum of violations in these two categories].

Public education: SDWIS Violation Code 65 shows that a system did not provide required public education about reducing or avoiding lead intake from water.

Maximum Contaminant Level (MCL): The highest amount of a contaminant that EPA allows in drinking water. MCLs ensure that drinking water does not pose either a short-term or long-term health risk. MCLs are defined in milligrams per liter (parts per million) unless otherwise specified.

Monitoring: EPA specifies which water testing methods the water systems must use, and sets schedules for the frequency of testing. A water system that does not follow EPA's schedule or methodology is in violation [40 CFR 141].

States must report monitoring violations that are significant as determined by the EPA Administrator and in consultation with the States. For purposes of this report, significant monitoring violations are major violations and they occur when no samples are taken or no results are reported during a compliance period. A major monitoring violation for the surface water treatment rule occurs when at least 90% of the required samples are not taken or results are not reported during the compliance period.

Organic Contaminants: Carbon-based compounds, such as industrial solvents and pesticides. These contaminants generally get into water through runoff from cropland or discharge from factories. EPA has set legal limits on 54 organic contaminants that are to be reported [40 CFR 141.61].

Radionuclides: Radioactive particles which can occur naturally in water or result from human activity. EPA has set legal limits on four types of radionuclides: radium-226, radium-228, gross alpha, and beta particle/photon radioactivity [40 CFR 141]. Violations for these contaminants are to be reported using the following three categories:

Gross alpha: SDWIS Contaminant Code 4000 for alpha radiation above MCL of 15 picocuries/liter. Gross alpha includes radium-226 but excludes radon and uranium.

Combined radium-226 and radium-228: SDWIS Contaminant Code 4010 for combined radiation from these two isotopes above MCL of 5 pCi/L.

Gross beta: SDWIS Contaminant Code 4101 for beta particle and photon radioactivity from man-made radionuclides above 4 millirem/year.

Reporting Interval: The reporting interval for violations to be included in the first PWS Annual Compliance Report is from January 1, 2002 through December 31, 2002.

SDWIS Code: Specific numeric codes from the Safe Drinking Water Information System (SDWIS) have been assigned to each violation type included in this report. The violations to be reported include exceeding contaminant MCLs, failure to comply with treatment requirements, and failure to meet monitoring and reporting requirements. Four-digit SDWIS Contaminant Codes have also been included in the chart for specific MCL contaminants.

Surface Water Treatment Rule: The Surface Water Treatment Rule establishes criteria under which water systems supplied by surface water sources, or ground water sources under the direct influence of surface water, must filter and disinfect their water [40 CFR 141, Subpart H]. Violations of the "Surface Water Treatment Rule" are to be reported for the following four categories:

Monitoring, routine/repeat (for filtered systems): SDWIS Violation Code 36 indicates a system's failure to carry out required tests, or to report the results of those tests.

Treatment techniques (for filtered systems): SDWIS Violation Code 41 shows a system's failure to properly treat its water.

Monitoring, routine/repeat (for unfiltered systems): SDWIS Violation Code 31 indicates a system's failure to carry out required water tests, or to report the results of those tests.

Failure to filter (for unfiltered systems): SDWIS Violation Code 42 shows a system's failure to properly treat its water. Data for this violation code will be supplied to the States by EPA.

Total Coliform Rule (TCR): The Total Coliform Rule establishes regulations for microbiological contaminants in drinking water. These contaminants can cause short-term health problems. If no samples are collected during the one month compliance period, a significant monitoring violation occurs. States are to report four categories of violations:

Acute MCL violation: SDWIS Violation Code 21 indicates that the system found fecal coliform or E. coli, potentially harmful bacteria, in its water, thereby violating the rule.

Non-acute MCL violation: SDWIS Violation Code 22 indicates that the system found total coliform in samples of its water at a frequency or at a level that violates the rule. For systems collecting fewer than 40 samples per month, more than one positive sample for total coliform is a violation. For systems collecting 40 or more samples per month, more than 5% of the samples positive for total coliform is a violation.

Major routine and follow-up monitoring: SDWIS Violation Codes 23 AND 25 show that a system did not perform any monitoring. [One number is to be reported for the sum of violations in these two categories.]

Sanitary Survey: SDWIS Violation Code 28 indicates a major monitoring violation if a system fails to collect 5 routine monthly samples if sanitary survey is not performed.

Treatment Techniques: A water disinfection process that EPA requires instead of an MCL for contaminants that laboratories cannot adequately measure. Failure to meet other operational and system requirements under the Surface Water Treatment and the Lead and Copper Rules have also been included in this category of violation for purposes of this report.

Unfiltered Systems: Water systems that do not need to filter their water before disinfecting it because the source is very clean [40 CFR, Subpart H].

Violation: A failure to meet any state or federal drinking water regulation.

APPENDIX B:

MCL and TT VIOLATION LISTING

Appendix B
CY2002 MCL and TT Violations for Ohio

PWSID	System Name	Sys Type	Source	Size Category	Vio Date	Vio Code	Cont Code
243112	ZION EVANG LUTH CHURCH	TNC	GW	Very Small	4/1/2002	22	3100
244612	CAIRO UM CHURCH	TNC	GW	Very Small	7/1/2002	21	3100
247812	ODOT-REST AREA 1-31 EB	TNC	GW	Very Small	7/1/2002	21	3100
247812	ODOT-REST AREA 1-31 EB	TNC	GW	Very Small	7/1/2002	22	3100
247812	ODOT-REST AREA 1-31 EB	TNC	GW	Very Small	10/1/2002	21	3100
247912	ODOT-REST AREA 1-32 WB	TNC	GW	Very Small	7/1/2002	21	3100
333112	AMERICAN AUGERS	NTNC	GW	Very Small	7/1/2002	22	3100
333112	AMERICAN AUGERS	NTNC	GW	Very Small	10/1/2002	22	3100
334712	MWCD-MARINA-CM1	TNC	GW	Very Small	10/1/2002	21	3100
341212	ROUND LAKE GOLF COURSE	TNC	GW	Very Small	10/1/2002	22	3100
401312	GRAND VALLEY COUNTRY MAN	COMM	GW	Very Small	11/1/2002	22	3100
433612	CAMP WHITEWOOD	TNC	GW	Very Small	1/1/2002	21	3100
441712	TREASURE ISLAND	TNC	GW	Very Small	1/1/2002	41	SWTR
441712	TREASURE ISLAND	TNC	GW	Very Small	2/1/2002	41	SWTR
441712	TREASURE ISLAND	TNC	GW	Very Small	3/1/2002	41	SWTR
441712	TREASURE ISLAND	TNC	GW	Very Small	4/1/2002	41	SWTR
441712	TREASURE ISLAND	TNC	GW	Very Small	5/1/2002	41	SWTR
441712	TREASURE ISLAND	TNC	GW	Very Small	6/1/2002	41	SWTR
441712	TREASURE ISLAND	TNC	GW	Very Small	8/1/2002	41	SWTR
441712	TREASURE ISLAND	TNC	GW	Very Small	9/1/2002	41	SWTR
441712	TREASURE ISLAND	TNC	GW	Very Small	11/1/2002	41	SWTR
445512	PYMATUNING COMMUNITY CHU	TNC	GW	Very Small	10/1/2002	22	3100
634412	BETHLEHEM CHRISTIAN UNIN	TNC	GW	Very Small	4/1/2002	22	3100
636112	HARMON'S LANDING	TNC	GW	Very Small	7/1/2002	22	3100
900612	EDGEWOOD MOBILE HOME PK.	COMM	GW	Very Small	7/1/2002	21	3100
900612	EDGEWOOD MOBILE HOME PK.	COMM	GW	Very Small	7/1/2002	22	3100
932212	KIATTA SALOON	TNC	GW	Very Small	1/1/2002	21	3100
937212	CHRISTIAN ASSY OF GOD	TNC	GW	Very Small	10/1/2002	22	3100
937412	JEHOVAH'S WITNESS-HAM E	TNC	GW	Very Small	1/1/2002	41	SWTR
937412	JEHOVAH'S WITNESS-HAM E	TNC	GW	Very Small	2/1/2002	41	SWTR
937412	JEHOVAH'S WITNESS-HAM E	TNC	GW	Very Small	3/1/2002	41	SWTR
937412	JEHOVAH'S WITNESS-HAM E	TNC	GW	Very Small	4/1/2002	41	SWTR
937412	JEHOVAH'S WITNESS-HAM E	TNC	GW	Very Small	5/1/2002	41	SWTR
937412	JEHOVAH'S WITNESS-HAM E	TNC	GW	Very Small	6/1/2002	41	SWTR
937412	JEHOVAH'S WITNESS-HAM E	TNC	GW	Very Small	7/1/2002	41	SWTR
937412	JEHOVAH'S WITNESS-HAM E	TNC	GW	Very Small	8/1/2002	41	SWTR
937412	JEHOVAH'S WITNESS-HAM E	TNC	GW	Very Small	9/1/2002	41	SWTR
937412	JEHOVAH'S WITNESS-HAM E	TNC	GW	Very Small	11/1/2002	41	SWTR
937412	JEHOVAH'S WITNESS-HAM E	TNC	GW	Very Small	12/1/2002	41	SWTR
937712	5 STAR DRIVERS TRNG	TNC	GW	Very Small	4/1/2002	21	3100
937712	5 STAR DRIVERS TRNG	TNC	GW	Very Small	4/1/2002	22	3100
937712	5 STAR DRIVERS TRNG	TNC	GW	Very Small	7/1/2002	21	3100
937712	5 STAR DRIVERS TRNG	TNC	GW	Very Small	7/1/2002	22	3100
938412	ROSS CHEVRON	TNC	GW	Small	1/1/2002	21	3100
938412	ROSS CHEVRON	TNC	GW	Small	1/1/2002	22	3100
938412	ROSS CHEVRON	TNC	GW	Small	4/1/2002	21	3100
938412	ROSS CHEVRON	TNC	GW	Small	7/1/2002	21	3100
938412	ROSS CHEVRON	TNC	GW	Small	7/1/2002	22	3100
939012	MILLIS TRANSFER INC	TNC	GW	Very Small	10/1/2002	22	3100

Appendix B
CY2002 MCL and TT Violations for Ohio

1000212	MINOR MOBILE HOME PARK	COMM	GW	Very Small	7/1/2002	21	3100
1030912	CAMPERS PARADISE	TNC	GW	Very Small	4/1/2002	22	3100
1032512	PERRY POST	TNC	GW	Very Small	10/1/2002	21	3100
1032512	PERRY POST	TNC	GW	Very Small	10/1/2002	22	3100
1034112	TWIN VALLEY CAMPGROUND	TNC	GW	Very Small	7/1/2002	22	3100
1037812	MWCD-LEESVILLE S.FORK L8	TNC	GW	Very Small	7/1/2002	22	3100
1038012	MWCD-LEESVILLE N.FORK L5	TNC	GW	Very Small	7/1/2002	22	3100
1038411	ATWOOD LAKE PARK	TNC	SW	Small	6/1/2002	41	SWTR
1038411	ATWOOD LAKE PARK CAMP	TNC	SW	Small	12/1/2002	41	SWTR
1038411	ATWOOD LAKE PARK-CAMP	TNC	SW	Small	3/1/2002	41	SWTR
1038411	ATWOOD PARK	TNC	SW	Small	5/1/2002	41	SWTR
1038411	ATWOOD PARK	TNC	SW	Small	9/1/2002	41	SWTR
1038411	ATWOOD PARK	TNC	SW	Small	11/1/2002	41	SWTR
1038411	MWCD-ATWOOD PARK	TNC	SW	Small	1/1/2002	41	SWTR
1038411	MWCD-ATWOOD PARK	TNC	SW	Small	4/1/2002	41	SWTR
1039312	HARRISON HILLS CMP RSRT2	TNC	GW	Very Small	7/1/2002	22	3100
1039512	HARRISON HILLS CMP RSRT5	TNC	GW	Very Small	7/1/2002	22	3100
1042112	CATHY'S KITCHEN	TNC	GW	Very Small	7/1/2002	22	3100
1101212	CITY OF URBANA	COMM	GW	Large	10/1/2002	22	3100
1201312	CLEARVIEW MOBILE HOME PK	COMM	SW	Very Small	1/1/2002	41	SWTR
1201312	CLEARVIEW MOBILE HOME PK	COMM	SW	Very Small	2/1/2002	41	SWTR
1201312	CLEARVIEW MOBILE HOME PK	COMM	SW	Very Small	3/1/2002	41	SWTR
1201312	CLEARVIEW MOBILE HOME PK	COMM	SW	Very Small	4/1/2002	41	SWTR
1201312	CLEARVIEW MOBILE HOME PK	COMM	SW	Very Small	5/1/2002	41	SWTR
1201312	CLEARVIEW MOBILE HOME PK	COMM	SW	Very Small	6/1/2002	41	SWTR
1201312	CLEARVIEW MOBILE HOME PK	COMM	SW	Very Small	7/1/2002	41	SWTR
1201312	CLEARVIEW MOBILE HOME PK	COMM	SW	Very Small	8/1/2002	41	SWTR
1201312	CLEARVIEW MOBILE HOME PK	COMM	SW	Very Small	9/1/2002	41	SWTR
1201312	CLEARVIEW MOBILE HOME PK	COMM	SW	Very Small	11/1/2002	41	SWTR
1201312	CLEARVIEW MOBILE HOME PK	COMM	SW	Very Small	12/1/2002	41	SWTR
1204012	HADDIX ROAD APTS	COMM	GW	Very Small	1/1/2002	41	SWTR
1204012	HADDIX ROAD APTS	COMM	GW	Very Small	2/1/2002	41	SWTR
1204012	HADDIX ROAD APTS	COMM	GW	Very Small	3/1/2002	41	SWTR
1204012	HADDIX ROAD APTS	COMM	GW	Very Small	4/1/2002	41	SWTR
1204012	HADDIX ROAD APTS	COMM	GW	Very Small	5/1/2002	41	SWTR
1204012	HADDIX ROAD APTS	COMM	GW	Very Small	6/1/2002	41	SWTR
1204012	HADDIX ROAD APTS	COMM	GW	Very Small	7/1/2002	41	SWTR
1204012	HADDIX ROAD APTS	COMM	GW	Very Small	8/1/2002	41	SWTR
1204012	HADDIX ROAD APTS	COMM	GW	Very Small	9/1/2002	41	SWTR
1204012	HADDIX ROAD APTS	COMM	GW	Very Small	11/1/2002	41	SWTR
1204012	HADDIX ROAD APTS	COMM	GW	Very Small	12/1/2002	41	SWTR
1230012	ROOT 41	TNC	GW	Very Small	4/1/2002	01	1040
1230012	ROOT 41	TNC	GW	Very Small	7/1/2002	01	1040
1230412	CARMICHAEL MACHINE CORP	NTNC	GW	Very Small	10/1/2002	21	3100
1231212	F O E #3491	TNC	GW	Very Small	1/1/2002	22	3100
1231912	TOM'S DELI & CARRYOUT	TNC	GW	Very Small	7/1/2002	22	3100
1231912	TOM'S DELI AND CARRYOUT	TNC	GW	Very Small	7/1/2002	21	3100
1232712	KONE KORNER	TNC	GW	Very Small	4/1/2002	02	1040
1232712	KONE KORNER	TNC	GW	Very Small	7/1/2002	02	1040
1232712	KONE KORNER	TNC	GW	Very Small	10/1/2002	02	1040

Appendix B
CY2002 MCL and TT Violations for Ohio

1232712	KONE KORNER	TNC	GW	Very Small	10/1/2002	22	3100
1232812	LOCUST HILL GC-CLUBHOUSE	TNC	GW	Very Small	10/1/2002	22	3100
1235512	BASS LAKE	TNC	GW	Very Small	10/1/2002	22	3100
1237612	ACTIVE U.S.A., INC.	NTNC	GW	Very Small	4/1/2002	21	3100
1238212	MARKOU'S	TNC	GW	Very Small	1/1/2002	41	SWTR
1238212	MARKOU'S	TNC	GW	Very Small	2/1/2002	41	SWTR
1238212	MARKOU'S	TNC	GW	Very Small	3/1/2002	41	SWTR
1238212	MARKOU'S	TNC	GW	Very Small	4/1/2002	41	SWTR
1238212	MARKOU'S	TNC	GW	Very Small	5/1/2002	41	SWTR
1238212	MARKOU'S	TNC	GW	Very Small	6/1/2002	41	SWTR
1238212	MARKOU'S	TNC	GW	Very Small	7/1/2002	41	SWTR
1238212	MARKOU'S	TNC	GW	Very Small	8/1/2002	41	SWTR
1238212	MARKOU'S	TNC	GW	Very Small	9/1/2002	41	SWTR
1238212	MARKOV'S	TNC	GW	Very Small	10/1/2002	41	SWTR
1240112	V F W POST 9684	TNC	GW	Very Small	7/1/2002	22	3100
1240112	V F W POST 9684	TNC	GW	Very Small	10/1/2002	22	3100
1240822	BEAVER VALLEY RSRT.LAND.	TNC	GW	Very Small	1/1/2002	22	3100
1240822	BEAVER VALLEY RSRT.LAND.	TNC	GW	Very Small	4/1/2002	22	3100
1240822	BEAVER VALLEY RSRT.LAND.	TNC	GW	Very Small	10/1/2002	22	3100
1242512	MELODY CRUISE-IN THEATER	TNC	GW	Very Small	10/1/2002	22	3100
1244112	EAGLE BEVERAGE	NTNC	GW	Very Small	4/1/2002	21	3100
1244112	EAGLE BEVERAGE	NTNC	GW	Very Small	4/1/2002	22	3100
1244112	EAGLE BEVERAGE	NTNC	GW	Very Small	7/1/2002	21	3100
1244112	EAGLE BEVERAGE	NTNC	GW	Very Small	7/1/2002	22	3100
1244412	MMS TRUCKING, INC.	TNC	GW	Very Small	1/1/2002	21	3100
1244512	SCARFF'S NURSERY	NTNC	GW	Very Small	1/1/2002	02	2976
1244512	SCARFF'S NURSERY	NTNC	GW	Very Small	4/1/2002	02	2976
1244512	SCARFF'S NURSERY	NTNC	GW	Very Small	7/1/2002	02	2976
1244512	SCARFF'S NURSERY	NTNC	GW	Very Small	10/1/2002	02	2976
1244612	SCARFF'S NURSERY CAMP	TNC	GW	Very Small	7/1/2002	22	3100
1244612	SCARFF'S NURSERY CAMP	TNC	GW	Very Small	10/1/2002	22	3100
1245212	RISEN CHRIST LUTHERAN	TNC	GW	Very Small	6/1/2002	22	3100
1245212	RISEN CHRIST LUTHERAN CH	TNC	GW	Very Small	10/1/2002	22	3100
1245812	AMVETS POST 148	TNC	GW	Very Small	7/1/2002	21	3100
1246512	SUGAR ISLE SNACK SHOP	TNC	GW	Very Small	4/1/2002	22	3100
1246512	SUGAR ISLE SNACK SHOP	TNC	GW	Very Small	7/1/2002	22	3100
1246612	BEACH MANUFACTURING COMP	NTNC	GW	Very Small	7/1/2002	21	3100
1246612	BEACH MANUFACTURING COMP	NTNC	GW	Very Small	7/1/2002	22	3100
1247312	HEART OF OHIO ANTIQUE	TNC	GW	Small	10/1/2002	21	3100
1248412	POSSUM RD COG-FELLOWSHIP	TNC	GW	Very Small	4/1/2002	22	3100
1248412	POSSUM RD COG-FELLOWSHIP	TNC	GW	Very Small	7/1/2002	22	3100
1248412	POSSUM RD COG-FELLOWSHIP	TNC	GW	Very Small	10/1/2002	22	3100
1248512	POSSUM RD CHURCH OF GOD	TNC	GW	Very Small	7/1/2002	21	3100
1248812	MAYBERRY MINI-MART	TNC	GW	Very Small	1/1/2002	22	3100
1248912	ROCKY LAKES GOLF COURSE	TNC	GW	Very Small	4/1/2002	22	3100
1249812	ENON EAGLES	TNC	GW	Very Small	4/1/2002	21	3100
1249812	ENON EAGLES	TNC	GW	Very Small	4/1/2002	22	3100
1249812	ENON EAGLES	TNC	GW	Very Small	7/1/2002	21	3100
1249812	ENON EAGLES	TNC	GW	Very Small	7/1/2002	22	3100
1249912	FOREST VLY FREE WILL CHR	TNC	GW	Very Small	7/1/2002	21	3100

Appendix B
CY2002 MCL and TT Violations for Ohio

1249912	FOREST VLY FREE WILL CHR	TNC	GW	Very Small	7/1/2002	22	3100
1250212	BOUNTIFUL PIZZA AND SUBS	TNC	GW	Very Small	10/1/2002	22	3100
1250512	PIZZA PAUSE	TNC	GW	Very Small	4/1/2002	21	3100
1250512	PIZZA PAUSE	TNC	GW	Very Small	4/1/2002	22	3100
1250512	PIZZA PAUSE	TNC	GW	Very Small	7/1/2002	21	3100
1250512	PIZZA PAUSE	TNC	GW	Very Small	7/1/2002	22	3100
1400512	MARTINSVILLE,VILLAGE OF	COMM	GW	Very Small	5/1/2002	22	3100
1432612	MAPLE GROVE CAMP	TNC	GW	Very Small	7/1/2002	21	3100
1432612	MAPLE GROVE CAMPGROUND	TNC	GW	Very Small	4/1/2002	21	3100
1432612	MAPLE GROVE CAMPGROUND	TNC	GW	Very Small	10/1/2002	21	3100
1432612	MAPLE GROVE CAMPGROUND	TNC	GW	Very Small	10/1/2002	22	3100
1434612	SHADY OAKS CAMPGROUNDS	TNC	GW	Very Small	10/1/2002	21	3100
1500811	EAST LIVERPOOL,CITY OF	COMM	SW	Large	7/1/2002	41	SWTR
1502111	SALINEVILLE,VILLAGE OF	COMM	SW	Small	9/1/2002	41	SWTR
1502111	SALINEVILLE,VILLAGE OF	COMM	SW	Small	11/1/2002	41	SWTR
1502111	SALINEVILLE,VILLAGE OF	COMM	SW	Small	12/1/2002	41	SWTR
1502612	TOWN & COUNTRY ESTATES	COMM	GW	Very Small	7/1/2002	21	3100
1502612	TOWN & COUNTRY ESTATES	COMM	GW	Very Small	7/1/2002	22	3100
1533622	WESTVILLE LK CAMPGRND-BA	TNC	GW	Very Small	7/1/2002	22	3100
1537012	EAST FAIRFIELD MARKET	TNC	GW	Very Small	10/1/2002	21	3100
1538212	E FAIRFIELD UN METH CH	TNC	GW	Very Small	10/1/2002	22	3100
1538712	Y-INN	TNC	SW	Very Small	1/1/2002	41	SWTR
1538712	Y-INN	TNC	SW	Very Small	2/1/2002	41	SWTR
1538712	Y-INN	TNC	SW	Very Small	3/1/2002	41	SWTR
1538712	Y-INN	TNC	SW	Very Small	5/1/2002	41	SWTR
1538712	Y-INN	TNC	SW	Very Small	6/1/2002	41	SWTR
1538712	Y-INN	TNC	SW	Very Small	7/1/2002	41	SWTR
1538712	Y-INN	TNC	SW	Very Small	8/1/2002	41	SWTR
1538712	Y-INN	TNC	SW	Very Small	9/1/2002	41	SWTR
1538712	Y-INN	TNC	SW	Very Small	10/1/2002	41	SWTR
1538712	Y-INN	TNC	SW	Very Small	11/1/2002	41	SWTR
1538712	Y-INN	TNC	SW	Very Small	12/1/2002	41	SWTR
1543912	PINKY'S TAVERN	TNC	GW	Very Small	4/1/2002	22	3100
1545412	EAST OHIO MACHINERY	NTNC	GW	Very Small	4/1/2002	22	3100
1545412	EAST OHIO MACHINERY	NTNC	GW	Very Small	10/1/2002	22	3100
1547912	ODNR-BEAVR CR/HORSE #2	TNC	GW	Very Small	7/1/2002	22	3100
1547912	ODNR-BEAVR CR/HORSE #2	TNC	GW	Very Small	10/1/2002	22	3100
1555612	GOD'S HAVEN CHRISTIAN AC	TNC	GW	Very Small	10/1/2002	22	3100
1555712	EMPLOYMENT DEVELOPMENT	NTNC	GW	Very Small	10/1/2002	22	3100
1556912	BUCK RUN GOLF COURSE	TNC	GW	Very Small	1/1/2002	22	3100
1557512	PARADISE LAKE PARK-CAMP	TNC	GW	Very Small	7/1/2002	22	3100
1558812	BARNETTS MOTEL	TNC	GW	Very Small	7/1/2002	22	3100
1560012	VITTLE VILLAGE	TNC	GW	Very Small	4/1/2002	22	3100
1560512	COL TAB ASSEMBLY OF GOD	TNC	GW	Very Small	7/1/2002	22	3100
1560512	COL TAB ASSEMBLY OF GOD	TNC	GW	Very Small	10/1/2002	22	3100
1560812	SALEM SAXON CLUB	TNC	GW	Very Small	4/1/2002	22	3100
1561412	CHURCH OF CHRIST OF SALE	TNC	GW	Very Small	12/1/2002	21	3100
1561512	KINGDOM HALL OF JEH WIT	TNC	GW	Very Small	7/1/2002	22	3100
1562612	CH OF CHRIST AT PLEASTVW	TNC	GW	Very Small	4/1/2002	21	3100
1562612	CH OF CHRIST AT PLEASTVW	TNC	GW	Very Small	7/1/2002	22	3100

Appendix B
CY2002 MCL and TT Violations for Ohio

1563812	SEVAKEEN COUNTRY CLUB	TNC	GW	Very Small	10/1/2002	21	3100
1563812	SEVAKEEN COUNTRY CLUB	TNC	GW	Very Small	10/1/2002	22	3100
1564912	ODNR-BEAVER CR/OFFICE	TNC	GW	Very Small	7/1/2002	22	3100
1600212	EDGEWOOD TERRACE MHP	COMM	GW	Very Small	8/1/2002	22	3100
1600811	ECHOING HILLS	COMM	SW	Very Small	11/1/2002	22	3100
1630612	ROSCOE COLONIAL CAMPGROU	TNC	GW	Very Small	7/1/2002	22	3100
1632712	WHISPERING FALLS, INC.	TNC	GW	Very Small	7/1/2002	21	3100
1632712	WHISPERING FALLS, INC.	TNC	GW	Very Small	7/1/2002	22	3100
1635012	MWCD MOWHAWK DAM CAMP	TNC	GW	Very Small	7/1/2002	21	3100
1636512	KINGDOM HALL JEHOVAH WIT	TNC	GW	Very Small	7/1/2002	21	3100
1636512	KINGDOM HALL JEHOVAH WIT	TNC	GW	Very Small	7/1/2002	22	3100
1636512	KINGDOM HALL JEHOVAH WIT	TNC	GW	Very Small	10/1/2002	21	3100
1636512	KINGDOM HALL JEHOVAH WIT	TNC	GW	Very Small	10/1/2002	22	3100
1636712	COSHOCTON LAKE PARK/CAMP	TNC	GW	Very Small	7/1/2002	22	3100
1637012	RIVERGREEN GOLF-SHELTER	TNC	GW	Very Small	7/1/2002	22	3100
1637412	SALEM AMISH FELLOWSHIP	NTNC	GW	Very Small	7/1/2002	22	3100
1733612	ST.PAUL'S LUTHERAN CHURC	TNC	GW	Very Small	7/1/2002	22	3100
1733612	ST.PAUL'S LUTHERAN CHURC	TNC	GW	Very Small	10/1/2002	21	3100
1733612	ST.PAUL'S LUTHERAN CHURC	TNC	GW	Very Small	10/1/2002	22	3100
1736812	NATIONAL LIME & STONE-BU	NTNC	GW	Very Small	4/1/2002	22	3100
1736812	NATIONAL LIME & STONE-BU	NTNC	GW	Very Small	7/1/2002	22	3100
1736812	NATIONAL LIME & STONE-BU	NTNC	GW	Very Small	10/1/2002	22	3100
1831812	ORANGE CHRISTIAN ACADEMY	NTNC	GW	Very Small	7/1/2002	22	3100
1836812	CLEV.METROPKS/ALBION WOO	TNC	GW	Very Small	7/1/2002	22	3100
1836812	CLEV.METROPKS/ALBION WOO	TNC	GW	Very Small	10/1/2002	21	3100
1839912	BETHELEM CHRISTIAN SCHO	NTNC	GW	Very Small	10/1/2002	22	3100
1901112	SHERWOOD FOREST M.H.PARK	COMM	GW	Small	7/1/2002	22	3100
1932512	THIRD BASE BAR	TNC	GW	Very Small	10/1/2002	22	3100
1934012	GOD'S TABERNACLE	TNC	GW	Very Small	7/1/2002	22	3100
1943012	PITSBURG CH OF BRETHREN	TNC	GW	Very Small	7/1/2002	21	3100
1943012	PITSBURG CH OF BRETHREN	TNC	GW	Very Small	7/1/2002	22	3100
1945212	STILLWATER BEACH CAMP	TNC	GW	Very Small	4/1/2002	22	3100
1945212	STILLWATER BEACH CAMP	TNC	GW	Very Small	7/1/2002	21	3100
1946712	SPRING VALLEY SCHOOL	NTNC	GW	Very Small	4/1/2002	21	3100
1946712	SPRING VALLEY SCHOOL	NTNC	GW	Very Small	4/1/2002	22	3100
1946712	SPRING VALLEY SCHOOL	NTNC	GW	Very Small	7/1/2002	22	3100
1947612	BEECHWOOD GOLF COURSE-18	TNC	GW	Very Small	1/1/2002	22	3100
1948212	BEECHWOOD GOLF CLUB	TNC	GW	Very Small	4/1/2002	21	3100
1948712	ONE STOP FOOD MART	TNC	GW	Very Small	4/1/2002	22	3100
1948712	ONE STOP FOOD MART	TNC	GW	Very Small	7/1/2002	22	3100
2000111	DEFIANCE, CITY OF	COMM	SW	Large	10/1/2002	02	2950
2000111	DEFIANCE, CITY OF	COMM	SW	Large	12/1/2002	02	1040
2035412	RAINBOW PROMISE CHILD CA	NTNC	GW	Very Small	7/1/2002	22	3100
2100711	LAKE OF THE WOODS WAT.CO	COMM	SW	Very Small	4/1/2002	22	3100
2134112	EAGLE CREEK-CASTLE	TNC	GW	Very Small	4/1/2002	21	3100
2201111	KELLEYS ISLAND, VLG. OF	COMM	SW	Small	1/1/2002	41	SWTR
2201111	KELLEYS ISLAND, VLG. OF	COMM	SW	Small	2/1/2002	41	SWTR
2201111	KELLEYS ISLAND, VLG. OF	COMM	SW	Small	3/1/2002	41	SWTR
2201312	RIVERVIEW MANOR APTS.	COMM	GW	Very Small	1/1/2002	22	3100
2201312	RIVERVIEW MANOR APTS.	COMM	GW	Very Small	2/1/2002	22	3100

Appendix B
CY2002 MCL and TT Violations for Ohio

2230411	CAMP PATMOS	TNC	SW	Very Small	5/1/2002	41	SWTR
2300512	COLONY VILLAGE MHP	COMM	GW	Very Small	5/1/2002	22	3100
2331312	ULTRAK	NTNC	GW	Very Small	7/1/2002	22	3100
2332312	GENEVA HILLS LODGE	TNC	GW	Very Small	7/1/2002	22	3100
2332312	GENEVA HILLS LODGE	TNC	GW	Very Small	10/1/2002	21	3100
2332312	GENEVA HILLS LODGE	TNC	GW	Very Small	10/1/2002	22	3100
2333812	MARCY STORE	TNC	GW	Very Small	7/1/2002	22	3100
2333812	MARCY STORE	TNC	GW	Very Small	10/1/2002	21	3100
2333812	MARCY STORE	TNC	GW	Very Small	10/1/2002	22	3100
2334712	RIPPLING STREAM CAMPGRND	TNC	GW	Very Small	10/1/2002	22	3100
2345712	BEACHCOMBER	TNC	GW	Very Small	4/1/2002	21	3100
2346112	NEW SALEM PARK	TNC	GW	Very Small	4/1/2002	21	3100
2346112	NEW SALEM PARK	TNC	GW	Very Small	7/1/2002	22	3100
2347712	TRIPLE S CAMP	TNC	GW	Very Small	4/1/2002	22	3100
2347712	TRIPLE S CAMP	TNC	GW	Very Small	7/1/2002	22	3100
2347712	TRIPLE S CAMP	TNC	GW	Very Small	10/1/2002	22	3100
2349312	WAhKEENA NATURE PRESER	TNC	GW	Very Small	9/1/2002	22	3100
2349312	WAhKEENA NATURE PRESERVE	TNC	GW	Very Small	7/1/2002	21	3100
2400312	HILLCREST MANOR NURSING	COMM	GW	Very Small	6/1/2002	21	3100
2531812	FIRST BAPTIST CHURCH	TNC	GW	Very Small	4/1/2002	21	3100
2531812	FIRST BAPTIST CHURCH	TNC	GW	Very Small	4/1/2002	22	3100
2534012	KINETICS NOISE CONTROL	NTNC	GW	Very Small	10/1/2002	21	3100
2534012	KINETICS NOISE CONTROL	NTNC	GW	Very Small	10/1/2002	22	3100
2535012	SCIOTO TRAIL VFW 2505	TNC	GW	Very Small	4/1/2002	22	3100
2535012	SCIOTO TRAIL VFW 2505	TNC	GW	Very Small	7/1/2002	22	3100
2535012	SCIOTO TRAIL VFW 2505	TNC	GW	Very Small	10/1/2002	21	3100
2535012	SCIOTO TRAIL VFW 2505	TNC	GW	Very Small	10/1/2002	22	3100
2542812	INDIAN RIDGE AREA-SOUTH	TNC	GW	Very Small	7/1/2002	22	3100
2549612	GROVEPORT GOLF CLUB	TNC	GW	Very Small	4/1/2002	22	3100
2550712	BERWICK CHURCH OF GOD	TNC	GW	Very Small	4/1/2002	22	3100
2550912	COLUMBUS DANCE-TOTAL FIT	TNC	SW	Very Small	4/1/2002	41	SWTR
2550912	COLUMBUS DANCE-TOTAL FIT	TNC	SW	Very Small	5/1/2002	41	SWTR
2550912	COLUMBUS DANCE-TOTAL FIT	TNC	SW	Very Small	6/1/2002	41	SWTR
2550912	COLUMBUS DANCE-TOTAL FIT	TNC	SW	Very Small	8/1/2002	41	SWTR
2550912	COLUMBUS DANCE-TOTAL FIT	TNC	SW	Very Small	9/1/2002	41	SWTR
2550912	COLUMBUS DANCE-TOTAL FIT	TNC	SW	Very Small	12/1/2002	41	SWTR
2552812	CASHFLOW INVESTMENTS	NTNC	GW	Very Small	10/1/2002	21	3100
2553412	SUPPORT RESOURCES, INC.	TNC	GW	Very Small	4/1/2002	21	3100
2554412	THE HOMESTEAD PARK	TNC	GW	Very Small	6/1/2002	22	3100
2554512	THE HOMESTEAD PARK ADDIT	TNC	GW	Very Small	10/1/2002	22	3100
2554912	TURNPOINT APOSTOLIC CHUR	TNC	GW	Very Small	4/1/2002	22	3100
2554912	TURNPOINT APOSTOLIC CHUR	TNC	GW	Very Small	7/1/2002	21	3100
2554912	TURNPOINT APOSTOLIC CHUR	TNC	GW	Very Small	10/1/2002	21	3100
2555312	CYPRESS WESLEYAN CHURCH	NTNC	GW	Very Small	4/1/2002	21	3100
2555312	CYPRESS WESLEYAN CHURCH	NTNC	GW	Very Small	4/1/2002	22	3100
2555812	THE DARBY HOUSE	TNC	GW	Very Small	10/1/2002	21	3100
2555812	THE DARBY HOUSE	TNC	GW	Very Small	10/1/2002	22	3100
2556112	NEW LIFE BAPTIST CHURCH	TNC	GW	Very Small	7/1/2002	21	3100
2557212	MAKOY CENTER, INC.	TNC	GW	Very Small	7/1/2002	22	3100
2557212	MAKOY CENTER, INC.	TNC	GW	Very Small	10/1/2002	21	3100

Appendix B
CY2002 MCL and TT Violations for Ohio

2557212	MAKOY CENTER, INC.	TNC	GW	Very Small	10/1/2002	22	3100
2633312	OLD PINES GOLF CLUB	TNC	GW	Very Small	4/1/2002	21	3100
2633312	OLD PINES GOLF CLUB	TNC	GW	Very Small	10/1/2002	22	3100
2635612	ST LUKE LUTHERAN CHURCH	TNC	GW	Very Small	10/1/2002	21	3100
2636112	TEDROW UN METHODIST CH	TNC	GW	Very Small	1/1/2002	21	3100
2636912	SHILOH CHRIST UN CHURCH	TNC	GW	Very Small	7/1/2002	22	3100
2636912	SHILOH CHRIST UN CHURCH	TNC	GW	Very Small	10/1/2002	21	3100
2830912	CAMP WISE	TNC	GW	Very Small	4/1/2002	21	3100
2832712	BURTON ASSEMBLY OF GOD	TNC	GW	Very Small	4/1/2002	22	3100
2833912	HOUSE OF NAGY	TNC	GW	Very Small	4/1/2002	22	3100
2833912	HOUSE OF NAGY	TNC	GW	Very Small	10/1/2002	21	3100
2834512	DR.NOVAK, DVM	TNC	GW	Very Small	4/1/2002	22	3100
2837312	RIVERSIDE TAVERN	TNC	GW	Very Small	10/1/2002	21	3100
2837312	RIVERSIDE TAVERN	TNC	GW	Very Small	12/1/2002	22	3100
2841412	POINT VIEW TAVERN	TNC	GW	Very Small	10/1/2002	22	3100
2843612	LUCIANO'S RESTAURANT	TNC	GW	Very Small	7/1/2002	21	3100
2845012	MIDDLEFIELD PLASTIC CORP	NTNC	GW	Very Small	4/1/2002	22	3100
2845212	PLEASANT HILLS GOLF CLUB	TNC	GW	Very Small	7/1/2002	22	3100
2849312	MANFREDI MOTOR TERMINAL	NTNC	GW	Very Small	4/1/2002	22	3100
2857812	ASM INTERNATIONAL	NTNC	GW	Very Small	10/1/2002	21	3100
2859712	BAINBRIDGE TOWNSHIP BLDG	TNC	GW	Very Small	4/1/2002	22	3100
2860512	CHESTER CHRISTIAN CENTER	TNC	GW	Very Small	4/1/2002	21	3100
2860512	CHESTER CHRISTIAN CENTER	TNC	GW	Very Small	4/1/2002	22	3100
2863612	E-CHECK - MUNN ROAD	TNC	GW	Very Small	7/1/2002	22	3100
2863612	E-CHECK - MUNN ROAD	TNC	GW	Very Small	10/1/2002	21	3100
2863612	E-CHECK - MUNN ROAD	TNC	GW	Very Small	10/1/2002	22	3100
2863712	E-CHECK - AUBURN ROAD	TNC	GW	Very Small	7/1/2002	22	3100
2864612	COMMUNITY CHURCH/PRESCH	NTNC	GW	Very Small	7/1/2002	22	3100
2864812	MANFREDI CORPORATE OFFIC	NTNC	GW	Very Small	4/1/2002	22	3100
2866812	GREAT LAKES CHEESE-HIRAM	NTNC	GW	Very Small	4/1/2002	22	3100
2939312	XENIA CHRIST TEMPLE CHUR	TNC	GW	Very Small	7/1/2002	21	3100
2939612	4-H CAMP CLIFTON, INC.	TNC	GW	Very Small	4/1/2002	21	3100
2945712	CAMP CLIFTON DAY CAMP	TNC	GW	Very Small	4/1/2002	21	3100
2947212	GRACE COVENANT CHURCH	TNC	GW	Very Small	10/1/2002	22	3100
2948312	GREENE VALLEY RECREATION	TNC	GW	Very Small	4/1/2002	21	3100
2948312	GREENE VALLEY RECREATION	TNC	GW	Very Small	4/1/2002	22	3100
2956312	KIL-KARE INCORPORATED #2	TNC	GW	Very Small	4/1/2002	02	1040
2956312	KIL-KARE INCORPORATED #2	TNC	GW	Very Small	7/1/2002	02	1040
2956312	KIL-KARE INCORPORATED #2	TNC	GW	Very Small	10/1/2002	02	1040
2956812	PLAYERS SPORTS PUB	TNC	GW	Very Small	1/1/2002	21	3100
2957112	BINGLAND CAMPGROUND	TNC	GW	Very Small	4/1/2002	21	3100
2957112	BINGLAND CAMPGROUND	TNC	GW	Very Small	10/1/2002	22	3100
3000111	CAMBRIDGE	COMM	SW	Large	10/1/2002	02	2950
3000212	CUMBERLAND	COMM	SW	Very Small	1/1/2002	41	SWTR
3000212	CUMBERLAND	COMM	SW	Very Small	2/1/2002	41	SWTR
3000212	CUMBERLAND	COMM	SW	Very Small	3/1/2002	41	SWTR
3000212	CUMBERLAND	COMM	SW	Very Small	4/1/2002	41	SWTR
3000212	CUMBERLAND	COMM	SW	Very Small	5/1/2002	41	SWTR
3000212	CUMBERLAND	COMM	SW	Very Small	6/1/2002	41	SWTR
3000212	CUMBERLAND	COMM	SW	Very Small	8/1/2002	41	SWTR

Appendix B
CY2002 MCL and TT Violations for Ohio

3000212	CUMBERLAND	COMM	SW	Very Small	9/1/2002	41	SWTR
3000212	CUMBERLAND	COMM	SW	Very Small	11/1/2002	41	SWTR
3000212	CUMBERLAND	COMM	SW	Very Small	12/1/2002	41	SWTR
3001212	BYESVILLE WATER - 1 & 2	COMM	SW	Medium	1/1/2002	41	SWTR
3001212	BYESVILLE WATER - 1 & 2	COMM	SW	Medium	2/1/2002	41	SWTR
3001212	BYESVILLE WATER - 1 & 2	COMM	SW	Medium	3/1/2002	41	SWTR
3001212	BYESVILLE WATER - 1 & 2	COMM	SW	Medium	4/1/2002	41	SWTR
3001212	BYESVILLE WATER - 1 & 2	COMM	SW	Medium	5/1/2002	41	SWTR
3001212	BYESVILLE WATER - 1 & 2	COMM	SW	Medium	6/1/2002	41	SWTR
3001212	BYESVILLE WATER - 1 & 2	COMM	SW	Medium	8/1/2002	41	SWTR
3001212	BYESVILLE WATER - 1 & 2	COMM	SW	Medium	9/1/2002	41	SWTR
3001212	BYESVILLE WATER - 1 & 2	COMM	SW	Medium	11/1/2002	41	SWTR
3001212	BYESVILLE WATER - 1 & 2	COMM	SW	Medium	12/1/2002	41	SWTR
3030812	HERITAGE C SCH	NTNC	GW	Very Small	4/1/2002	22	3100
3030812	HERITAGE C SCH	NTNC	GW	Very Small	10/1/2002	21	3100
3053712	THE BANANA PEEL ICE CREA	TNC	GW	Very Small	4/1/2002	21	3100
3100012	ADDYSTON,VILLAGE OF	COMM	GW	Small	7/1/2002	21	3100
3132412	TOWNSHIP FIELDS TAVERN	TNC	GW	Very Small	1/1/2002	21	3100
3135012	PASTIME PARK	TNC	GW	Very Small	7/1/2002	21	3100
3135012	PASTIME PARK	TNC	GW	Very Small	10/1/2002	22	3100
3138712	MIAMI WHITEWATER-SHAKER	TNC	GW	Very Small	7/1/2002	22	3100
3138812	WHITEWATER SENIOR CENTER	TNC	GW	Very Small	7/1/2002	22	3100
3139012	TOM'S FOOD MART	TNC	PGW	Very Small	4/1/2002	21	3100
3139012	TOM'S FOOD MART	TNC	PGW	Very Small	7/1/2002	21	3100
3139012	TOM'S FOOD MART	TNC	PGW	Very Small	10/1/2002	21	3100
3200411	MCCOMB WTP	COMM	SW	Small	7/1/2002	41	SWTR
3200411	MCCOMB, VILLAGE OF	COMM	SW	Small	8/1/2002	41	SWTR
3233412	GOOD SHEPHERD U M CHURCH	TNC	GW	Very Small	7/1/2002	21	3100
3233412	GOOD SHEPHERD U M CHURCH	TNC	GW	Very Small	7/1/2002	22	3100
3233412	GOOD SHEPHERD U M CHURCH	TNC	GW	Very Small	10/1/2002	21	3100
3233412	GOOD SHEPHERD U M CHURCH	TNC	GW	Very Small	10/1/2002	22	3100
3240112	SHADYLAKE CAMPGROUND	TNC	GW	Very Small	7/1/2002	22	3100
3242012	UN CONSV & OUTDOOR ASSN	TNC	GW	Very Small	7/1/2002	21	3100
3244512	LIBERTY BAPTIST CHAPEL	TNC	GW	Very Small	1/1/2002	22	3100
3244912	UNIV OF FINDLAY-SOUTH	NTNC	GW	Very Small	4/1/2002	22	3100
3245512	RILEY CREEK BAPTIST CHUR	TNC	GW	Very Small	7/1/2002	22	3100
3245512	RILEY CREEK BAPTIST CHUR	TNC	GW	Very Small	10/1/2002	22	3100
3245712	OAKWOOD DISCOVERY CENTER	TNC	GW	Very Small	10/1/2002	22	3100
3246412	TIFFIN ROAD CHURCH OF CH	TNC	GW	Very Small	7/1/2002	21	3100
3247412	SULPHUR LAKE CAMPGROUND	TNC	GW	Very Small	10/1/2002	21	3100
3330412	BLUE MOON CAFE	TNC	GW	Very Small	7/1/2002	21	3100
3331812	MORTON BUILDINGS, INC.	NTNC	GW	Very Small	10/1/2002	21	3100
3331812	MORTON BUILDINGS, INC.	NTNC	GW	Very Small	10/1/2002	22	3100
3332412	REAM-MCELROY VFW POST	TNC	GW	Very Small	10/1/2002	21	3100
3332712	RIDGEMONT HIGH SCHOOL	NTNC	GW	Very Small	10/1/2002	22	3100
3334812	ALLIANCE CHURCH	TNC	GW	Very Small	10/1/2002	21	3100
3335212	VETERANS' MEMORIAL PARK	TNC	GW	Very Small	7/1/2002	21	3100
3401312	SCIO	COMM	GW	Small	8/1/2002	21	3100
3430112	ASBURY CHAPEL	TNC	GW	Very Small	7/1/2002	21	3100
3435812	TAPPAN LAKE-PK CABIN/T-2	TNC	GW	Very Small	7/1/2002	21	3100

Appendix B
CY2002 MCL and TT Violations for Ohio

3438412	HANOVER METHODIST CHURCH	TNC	GW	Very Small	7/1/2002	21	3100
3438412	HANOVER METHODIST CHURCH	TNC	GW	Very Small	7/1/2002	22	3100
3438812	LAKESIDE RESTAURANT	TNC	GW	Very Small	7/1/2002	21	3100
3500711	MCCLURE, VILLAGE OF	COMM	SW	Small	12/1/2002	02	1040
3531411	CAMPBELL SOUP SUPPLY CO	NTNC	SW	Small	12/1/2002	02	1040
3532012	EMANUELS UN CH OF CHRIST	TNC	GW	Very Small	7/1/2002	21	3100
3534912	PLEASANT BEND UM CHURCH	TNC	GW	Very Small	4/1/2002	21	3100
3534912	PLEASANT BEND UM CHURCH	TNC	GW	Very Small	7/1/2002	22	3100
3534912	PLEASANT BEND UM CHURCH	TNC	GW	Very Small	10/1/2002	22	3100
3632512	SHADY TRAILS CAMPGROUND	TNC	GW	Very Small	4/1/2002	22	3100
3632612	ODOT-REST AREA 9-36	TNC	GW	Very Small	1/1/2002	22	3100
3636912	LEESBURG AMISH SCHOOL	NTNC	GW	Very Small	9/1/2002	22	3100
3732312	WINDY HILLS GOLF	TNC	GW	Very Small	7/1/2002	21	3100
3732312	WINDY HILLS GOLF	TNC	GW	Very Small	7/1/2002	22	3100
3732712	STH BLOOMGVIL SCH	NTNC	GW	Very Small	7/1/2002	22	3100
3734112	HEAVENLY VIEW TABERNACLE	TNC	GW	Very Small	4/1/2002	21	3100
3734112	HEAVENLY VIEW TABERNACLE	TNC	GW	Very Small	4/1/2002	22	3100
3736712	LAKE LOGAN CAMPGROUND	TNC	GW	Very Small	7/1/2002	22	3100
3736812	ST. JOHN RECORD PROGRAMS	NTNC	GW	Very Small	7/1/2002	22	3100
3736812	ST. JOHN RECORD PROGRAMS	NTNC	GW	Very Small	10/1/2002	21	3100
3736812	ST. JOHN RECORD PROGRAMS	NTNC	GW	Very Small	10/1/2002	22	3100
3738012	HOCKING HILLS CHU-CHRIST	TNC	GW	Very Small	10/1/2002	21	3100
3738012	HOCKING HILLS CHU-CHRIST	TNC	GW	Very Small	10/1/2002	22	3100
3739412	ASH CAVE CABINS & CONF.	TNC	GW	Very Small	1/1/2002	22	3100
3739412	ASH CAVE CABINS & CONF.	TNC	GW	Very Small	10/1/2002	22	3100
3831412	MT HOPE AUCTION	TNC	GW	Small	10/1/2002	22	3100
3834312	LONG LAKE PARK-CANTEEN	TNC	GW	Very Small	4/1/2002	22	3100
3834612	META-FAB INCORPORATED	NTNC	GW	Very Small	1/1/2002	21	3100
3834612	META-FAB INCORPORATED	NTNC	GW	Very Small	7/1/2002	22	3100
3838912	WISE ELEMENTARY SCHOOL	NTNC	GW	Very Small	7/1/2002	21	3100
3838912	WISE ELEMENTARY SCHOOL	NTNC	GW	Very Small	7/1/2002	22	3100
3839412	ZION CHRISTIAN SCHOOL	NTNC	GW	Very Small	11/1/2002	22	3100
3840112	FRYBURG BEACHY CHURCH	TNC	GW	Very Small	4/1/2002	22	3100
3840112	FRYBURG BEACHY CHURCH	TNC	GW	Very Small	4/1/2002	41	SWTR
3840112	FRYBURG BEACHY CHURCH	TNC	GW	Very Small	5/1/2002	22	3100
3840112	FRYBURG BEACHY CHURCH	TNC	GW	Very Small	5/1/2002	41	SWTR
3840112	FRYBURG BEACHY CHURCH	TNC	GW	Very Small	6/1/2002	41	SWTR
3840112	FRYBURG BEACHY CHURCH	TNC	GW	Very Small	8/1/2002	41	SWTR
3840112	FRYBURG BEACHY CHURCH	TNC	GW	Very Small	9/1/2002	41	SWTR
3842212	HOLMESVILLE ELEM SCHOOL	NTNC	GW	Very Small	9/1/2002	22	3100
3842212	HOLMESVILLE ELEMENTARY	NTNC	GW	Very Small	10/1/2002	22	3100
3844812	MILLERSBURG UN METH CH	TNC	GW	Very Small	10/1/2002	21	3100
3846212	CAMP BETHANY-BATH HOUSE	TNC	GW	Very Small	7/1/2002	21	3100
3848112	3M ASSOCIATES, LTD.	NTNC	GW	Very Small	4/1/2002	21	3100
3848112	3M ASSOCIATES, LTD.	NTNC	GW	Very Small	4/1/2002	22	3100
3901111	NORWALK, CITY OF	COMM	SW	Large	10/1/2002	02	2950
3937212	KLAUS, BILL PONTIAC	TNC	GW	Very Small	7/1/2002	22	3100
3937212	KLAUS, BILL PONTIAC	TNC	GW	Very Small	10/1/2002	21	3100
3937212	KLAUS, BILL PONTIAC	TNC	GW	Very Small	10/1/2002	22	3100
3946412	FREEDOM VALLEY PARK & CA	TNC	GW	Very Small	4/1/2002	21	3100

Appendix B
CY2002 MCL and TT Violations for Ohio

4001912	WELLSTON - NORTH & SOUTH	COMM	SW	Medium	11/1/2002	21	3100
4101103	JEFF CO SD- M	COMM	PSW	Large	10/1/2002	02	2950
4132712	ROADSIDE INN	TNC	GW	Very Small	4/1/2002	21	3100
4132712	ROADSIDE INN	TNC	GW	Very Small	7/1/2002	21	3100
4133112	RED OAKS COUNTRY CLUB	TNC	SW	Very Small	4/1/2002	41	SWTR
4133112	RED OAKS GOLF COURSE	TNC	SW	Very Small	10/1/2002	22	3100
4133112	RED OAKS GOLF COURSE INC	TNC	SW	Very Small	5/1/2002	41	SWTR
4133112	RED OAKS GOLF COURSE INC	TNC	SW	Very Small	6/1/2002	41	SWTR
4133112	RED OAKS GOLF COURSE INC	TNC	SW	Very Small	8/1/2002	41	SWTR
4133112	RED OAKS GOLF COURSE INC	TNC	SW	Very Small	9/1/2002	21	3100
4133112	RED OAKS GOLF COURSE INC	TNC	SW	Very Small	9/1/2002	22	3100
4133112	RED OAKS GOLF COURSE INC	TNC	SW	Very Small	9/1/2002	41	SWTR
4200912	MOUNT VERNON ACADEMY	NTNC	GW	Very Small	7/1/2002	22	3100
4231512	SPEARMAN'S RESTAURANT	TNC	GW	Very Small	1/1/2002	01	1040
4231512	SPEARMAN'S RESTAURANT	TNC	GW	Very Small	4/1/2002	01	1040
4235112	HIDDEN HILLS GOLF COURSE	TNC	GW	Very Small	7/1/2002	21	3100
4236312	TSC STORE	TNC	GW	Very Small	7/1/2002	21	3100
4236312	TSC STORE	TNC	GW	Very Small	7/1/2002	22	3100
4236712	BIG BROTHERS/BIG SISTERS	TNC	GW	Very Small	1/1/2002	21	3100
4236712	BIG BROTHERS/BIG SISTERS	TNC	GW	Very Small	1/1/2002	22	3100
4236712	BIG BROTHERS/BIG SISTERS	TNC	GW	Very Small	4/1/2002	21	3100
4236712	BIG BROTHERS/BIG SISTERS	TNC	GW	Very Small	4/1/2002	22	3100
4236912	WHIP-POOR-WILL HILLS CAM	TNC	GW	Very Small	4/1/2002	22	3100
4237112	WYANDOT GOLF COURSE	TNC	GW	Very Small	10/1/2002	21	3100
4239812	MT VERNON CHURCH OF GOD	TNC	GW	Very Small	10/1/2002	22	3100
4240012	CHAPEL HILL GOLF COURSE	TNC	GW	Very Small	7/1/2002	22	3100
4240012	CHAPEL HILL GOLF COURSE	TNC	GW	Very Small	10/1/2002	22	3100
4240312	HOT RODS SUNOCO	TNC	SW	Small	1/1/2002	41	SWTR
4240312	HOT RODS SUNOCO	TNC	SW	Small	2/1/2002	41	SWTR
4240312	HOT RODS SUNOCO	TNC	SW	Small	3/1/2002	41	SWTR
4240312	HOT RODS SUNOCO	TNC	SW	Small	4/1/2002	41	SWTR
4240312	HOT RODS SUNOCO	TNC	SW	Small	5/1/2002	21	3100
4240312	HOT RODS SUNOCO	TNC	SW	Small	5/1/2002	41	SWTR
4240312	HOT RODS SUNOCO	TNC	SW	Small	6/1/2002	41	SWTR
4240312	HOT RODS SUNOCO	TNC	SW	Small	7/1/2002	21	3100
4240312	HOT RODS SUNOCO	TNC	SW	Small	7/1/2002	22	3100
4240312	HOT RODS SUNOCO	TNC	SW	Small	9/1/2002	41	SWTR
4241712	GOETZMAN CHRYSLER	TNC	GW	Very Small	7/1/2002	21	3100
4241712	GOETZMAN CHRYSLER	TNC	GW	Very Small	7/1/2002	22	3100
4241712	GOETZMAN CHRYSLER	TNC	GW	Very Small	10/1/2002	21	3100
4241712	GOETZMAN CHRYSLER	TNC	GW	Very Small	10/1/2002	22	3100
4241812	MID-OHIO	TNC	GW	Very Small	10/1/2002	22	3100
4242512	ECR COMPUTERS	TNC	GW	Very Small	7/1/2002	21	3100
4242512	ECR COMPUTERS	TNC	GW	Very Small	10/1/2002	21	3100
4242512	ECR COMPUTERS	TNC	GW	Very Small	10/1/2002	22	3100
4338012	LAKE CO.-RIVERVIEW PARK	TNC	GW	Very Small	1/1/2002	21	3100
4402003	LAWRENCE WATER CORP	COMM	PGW	Medium	6/1/2002	22	3100
4505412	SOUTHWEST LICKING WATER	COMM	GW	Medium	9/1/2002	22	3100
4531412	PAPA BOO'S	TNC	GW	Very Small	4/1/2002	21	3100
4533512	EXCEL ACADEMY	NTNC	GW	Very Small	10/1/2002	22	3100

Appendix B
CY2002 MCL and TT Violations for Ohio

4536812	THORNVILLE DUKE & DUCHES	TNC	GW	Very Small	7/1/2002	22	3100
4542512	KRANER'S CORNER	TNC	SW	Very Small	1/1/2002	41	SWTR
4542512	KRANER'S CORNER	TNC	SW	Very Small	2/1/2002	41	SWTR
4542512	KRANER'S CORNER	TNC	SW	Very Small	3/1/2002	41	SWTR
4542512	KRANER'S CORNER	TNC	SW	Very Small	4/1/2002	41	SWTR
4542512	KRANER'S CORNER	TNC	SW	Very Small	5/1/2002	41	SWTR
4542512	KRANER'S CORNER	TNC	SW	Very Small	6/1/2002	41	SWTR
4542512	KRANER'S CORNER	TNC	SW	Very Small	8/1/2002	41	SWTR
4542512	KRANER'S CORNER	TNC	SW	Very Small	9/1/2002	41	SWTR
4542512	KRANER'S CORNER	TNC	SW	Very Small	12/1/2002	41	SWTR
4546712	TOBOSO ELEMENTARY SCHOOL	NTNC	GW	Very Small	7/1/2002	22	3100
4547212	WILLOW RUN GOLF COURSE	TNC	GW	Very Small	1/1/2002	22	3100
4547212	WILLOW RUN GOLF COURSE	TNC	GW	Very Small	10/1/2002	21	3100
4547512	BURNING TREE GOLF COURSE	TNC	GW	Very Small	7/1/2002	21	3100
4547512	BURNING TREE GOLF COURSE	TNC	GW	Very Small	7/1/2002	22	3100
4547512	BURNING TREE GOLF COURSE	TNC	GW	Very Small	10/1/2002	22	3100
4551212	FLINT RIDGE ST MEMORIAL	TNC	GW	Very Small	10/1/2002	21	3100
4555112	MPW INDUSTRIAL SERVICES	NTNC	GW	Very Small	4/1/2002	22	3100
4556212	DELUXE INN	TNC	GW	Very Small	7/1/2002	21	3100
4556512	NEW LIFE TABERNACLE PMC	TNC	GW	Very Small	7/1/2002	21	3100
4556512	NEW LIFE TABERNACLE PMC	TNC	GW	Very Small	10/1/2002	21	3100
4559812	VILLAGE VIEW GOLF	TNC	GW	Very Small	10/1/2002	21	3100
4559812	VILLAGE VIEW GOLF	TNC	GW	Very Small	10/1/2002	22	3100
4559912	BUCKEYE LAKE SHELL MART	TNC	GW	Very Small	7/1/2002	21	3100
4559912	BUCKEYE LAKE SHELL MART	TNC	GW	Very Small	10/1/2002	21	3100
4559912	BUCKEYE LAKE SHELL MART	TNC	GW	Very Small	10/1/2002	22	3100
4560712	THE HERB-N-EWE	TNC	GW	Very Small	10/1/2002	21	3100
4560712	THE HERB-N-EWE	TNC	GW	Very Small	10/1/2002	22	3100
4561312	ERNIE'S OASIS CITGO	TNC	GW	Very Small	4/1/2002	21	3100
4561612	NATIONAL TRAIL RACEWAY T	TNC	SW	Very Small	6/1/2002	22	3100
4561612	NATIONAL TRAIL RACEWAY T	TNC	SW	Very Small	12/1/2002	41	SWTR
4561812	NATIONAL TRAIL RACEWAY G	TNC	SW	Small	3/1/2002	41	SWTR
4563112	BLACK RUN CHURCH OF GOD	TNC	GW	Very Small	7/1/2002	22	3100
4602512	WEST MANSFIELD, VLG. OF	COMM	GW	Small	6/1/2002	22	3100
4630512	ARIES MEDICAL CENTER	TNC	GW	Very Small	7/1/2002	22	3100
4632412	CREE PARK	TNC	GW	Very Small	4/1/2002	22	3100
4634412	MARMON VALLEY FARM	TNC	GW	Very Small	1/1/2002	21	3100
4634412	MARMON VALLEY FARM	TNC	GW	Very Small	1/1/2002	22	3100
4634412	MARMON VALLEY FARM	TNC	GW	Very Small	10/1/2002	22	3100
4635012	KORNER KAFE	TNC	GW	Very Small	10/1/2002	21	3100
4635012	KORNER KAFE	TNC	GW	Very Small	10/1/2002	22	3100
4637612	TURKEY FOOT RESORT	TNC	GW	Very Small	4/1/2002	21	3100
4637612	TURKEY FOOT RESORT	TNC	GW	Very Small	4/1/2002	22	3100
4637612	TURKEY FOOT RESORT	TNC	GW	Very Small	10/1/2002	21	3100
4637612	TURKEY FOOT RESORT	TNC	GW	Very Small	10/1/2002	22	3100
4638512	ODNR-IND LK-MOUNDWD BOAT	TNC	GW	Very Small	4/1/2002	22	3100
4638512	ODNR-IND LK-MOUNDWD BOAT	TNC	GW	Very Small	10/1/2002	21	3100
4641612	MOUNTAIN TOP CAMPGROUND	TNC	GW	Very Small	7/1/2002	21	3100
4641612	MOUNTAIN TOP CAMPGROUND	TNC	GW	Very Small	7/1/2002	22	3100
4641612	MOUNTAIN TOP CAMPGROUND	TNC	GW	Very Small	10/1/2002	21	3100

Appendix B
CY2002 MCL and TT Violations for Ohio

4643612	MIDWEST EXPRESS 4 W WELL	NTNC	GW	Very Small	10/1/2002	22	3100
4644212	MIDWEST EXPRESS 5 & 6	NTNC	GW	Very Small	7/1/2002	22	3100
4644212	MIDWEST EXPRESS 5 & 6	NTNC	GW	Very Small	10/1/2002	22	3100
4644312	TINSLEY'S IGA	TNC	GW	Very Small	7/1/2002	22	3100
4644512	LAKEVIEW HARDWARE	NTNC	GW	Very Small	10/1/2002	21	3100
4645012	TURKEY FOOT BOAT DOCKS	TNC	GW	Very Small	4/1/2002	22	3100
4647012	ODNR INDN LK MOUNDWD RR	TNC	GW	Very Small	4/1/2002	22	3100
4647012	ODNR INDN LK MOUNDWD RR	TNC	GW	Very Small	7/1/2002	22	3100
4647312	FOUR SEASONS CAMP-NORTH	TNC	GW	Very Small	4/1/2002	22	3100
4647412	TREE LINKS GOLF COURSE	TNC	GW	Very Small	7/1/2002	21	3100
4647412	TREE LINKS GOLF COURSE	TNC	GW	Very Small	7/1/2002	22	3100
4647612	SABO'S RESORT	TNC	GW	Very Small	10/1/2002	21	3100
4648212	HUNTSVILLE MARASTOP	TNC	GW	Small	7/1/2002	21	3100
4701411	SOUTH AMHERST, VILLAGE	COMM	SW	Small	7/1/2002	41	SWTR
4701411	VILLAGE OF SOUTH AMHERST	COMM	SW	Small	1/1/2002	41	SWTR
4701411	VILLAGE OF SOUTH AMHERST	COMM	SW	Small	2/1/2002	41	SWTR
4701411	VILLAGE OF SOUTH AMHERST	COMM	SW	Small	3/1/2002	41	SWTR
4730912	SPRINGS OF LIFE CHURCH	TNC	GW	Very Small	10/1/2002	21	3100
4731012	CRYSTAL SPRINGS RV CAMPG	TNC	GW	Very Small	7/1/2002	22	3100
4800112	ARROWHEAD MHP	COMM	GW	Very Small	6/1/2002	21	3100
4800112	ARROWHEAD MHP	COMM	GW	Very Small	6/1/2002	22	3100
4841412	SECOR METROPARK-NAT CTR	TNC	GW	Very Small	7/1/2002	22	3100
4845512	SCHMIDT BROS.INC. AMLC	TNC	GW	Very Small	7/1/2002	21	3100
4845512	SCHMIDT BROS.INC. AMLC	TNC	GW	Very Small	10/1/2002	22	3100
4845712	BETHANY BAPTIST CHURCH	TNC	GW	Very Small	10/1/2002	21	3100
4900412	DARBY CREST CIVIC ASSOC	COMM	GW	Very Small	7/1/2002	21	3100
4901312	VILLAGE OF SOUTH SOLON	COMM	GW	Very Small	10/1/2002	21	3100
4901512	PICKET FENCES MOBILE HOM	COMM	GW	Very Small	6/1/2002	22	3100
4932612	HICKORY GROVE GOLF CRS	TNC	GW	Very Small	4/1/2002	22	3100
4934112	MATCO INDUSTRIES	NTNC	GW	Very Small	4/1/2002	22	3100
4934212	MADISON PLAINS HIGH SCH.	NTNC	GW	Small	10/1/2002	22	3100
4936812	HENRY'S RESTAURANT	TNC	GW	Very Small	7/1/2002	21	3100
4937812	AMERICAN LEGION POST 201	TNC	GW	Very Small	7/1/2002	22	3100
4939812	BUCKEYE FORD INC	NTNC	GW	Very Small	7/1/2002	21	3100
4939812	BUCKEYE FORD INC	NTNC	GW	Very Small	10/1/2002	22	3100
4939912	UN BETHEL MENNONITE CH	TNC	SW	Very Small	4/1/2002	41	SWTR
4939912	UN BETHEL MENNONITE CH	TNC	SW	Very Small	5/1/2002	41	SWTR
4939912	UN BETHEL MENNONITE CH	TNC	SW	Very Small	6/1/2002	41	SWTR
4939912	UN BETHEL MENNONITE CH	TNC	SW	Very Small	8/1/2002	41	SWTR
4939912	UN BETHEL MENNONITE CH	TNC	SW	Very Small	9/1/2002	41	SWTR
4939912	UN BETHEL MENNONITE CH	TNC	SW	Very Small	12/1/2002	41	SWTR
4939912	UNITED BETHEL MENN	TNC	SW	Very Small	1/1/2002	41	SWTR
4939912	UNITED BETHEL MENN	TNC	SW	Very Small	2/1/2002	41	SWTR
4939912	UNITED BETHEL MENN	TNC	SW	Very Small	3/1/2002	41	SWTR
4942312	TACO BELL	TNC	GW	Very Small	10/1/2002	21	3100
4942312	TACO BELL	TNC	GW	Very Small	10/1/2002	22	3100
4942412	JEHOVAH WITNESS KINGDOM	TNC	GW	Very Small	1/1/2002	21	3100
4942412	JEHOVAH WITNESS KINGDOM	TNC	GW	Very Small	4/1/2002	22	3100
4942412	JEHOVAH WITNESS KINGDOM	TNC	GW	Very Small	7/1/2002	21	3100
4943812	J.D. EQUIPMENT, INC.	NTNC	GW	Very Small	10/1/2002	22	3100

Appendix B
CY2002 MCL and TT Violations for Ohio

4943912	TRI-GREEN INTERSTATE EQ	TNC	GW	Very Small	10/1/2002	22	3100
4944412	MADISON CHRISTIAN ACADEM	NTNC	GW	Very Small	7/1/2002	22	3100
5001012	LAKE MILTON M.H.P.	COMM	GW	Very Small	1/1/2002	02	4010
5001012	LAKE MILTON M.H.P.	COMM	GW	Very Small	4/1/2002	02	4010
5001012	LAKE MILTON M.H.P.	COMM	GW	Very Small	7/1/2002	02	4010
5033512	COUNTRYSIDE GOLF COURSE	TNC	GW	Very Small	4/1/2002	22	3100
5033712		TNC	SW	Very Small	9/1/2002	41	SWTR
5033712	DEPOT LOUNGE	TNC	SW	Very Small	1/1/2002	41	SWTR
5033712	DEPOT LOUNGE	TNC	SW	Very Small	2/1/2002	41	SWTR
5033712	DEPOT LOUNGE	TNC	SW	Very Small	3/1/2002	41	SWTR
5033712	DEPOT LOUNGE	TNC	SW	Very Small	4/1/2002	41	SWTR
5033712	DEPOT LOUNGE	TNC	SW	Very Small	5/1/2002	41	SWTR
5033712	DEPOT LOUNGE	TNC	SW	Very Small	6/1/2002	41	SWTR
5033712	DEPOT LOUNGE	TNC	SW	Very Small	7/1/2002	41	SWTR
5033712	DEPOT LOUNGE	TNC	SW	Very Small	8/1/2002	41	SWTR
5033712	DEPOT LOUNGE	TNC	SW	Very Small	11/1/2002	41	SWTR
5033712	DEPOT LOUNGE	TNC	SW	Very Small	12/1/2002	41	SWTR
5034112	SHILLING MILL TAVERN	TNC	GW	Very Small	1/1/2002	21	3100
5041012	ODOT-REST AREA 4-44	TNC	GW	Very Small	7/1/2002	21	3100
5041012	ODOT-REST AREA 4-44	TNC	GW	Very Small	7/1/2002	22	3100
5043322	GREEN ACRES-SOUTH WELL	TNC	GW	Very Small	7/1/2002	21	3100
5045312	AMERICAN LEGION POST 737	TNC	GW	Very Small	10/1/2002	21	3100
5046712	CANFIELD JEHOVAH WITNESS	TNC	GW	Very Small	7/1/2002	22	3100
5046812	BAILEY RD BAPTIST CHURCH	TNC	GW	Very Small	1/1/2002	21	3100
5046812	BAILEY RD BAPTIST CHURCH	TNC	GW	Very Small	1/1/2002	22	3100
5046812	BAILEY RD BAPTIST CHURCH	TNC	GW	Very Small	4/1/2002	22	3100
5046812	BAILEY RD BAPTIST CHURCH	TNC	GW	Very Small	7/1/2002	22	3100
5046912	N BENTON UN PRESBY CH	TNC	GW	Very Small	10/1/2002	22	3100
5047612		TNC	SW	Very Small	9/1/2002	41	SWTR
5047612	MAH VALLEY CHIR & REHAB	TNC	SW	Very Small	4/1/2002	21	3100
5047612	MAH VALLEY CHIR & REHAB	TNC	SW	Very Small	7/1/2002	41	SWTR
5047612	MAH VALLEY CHIR & REHAB	TNC	SW	Very Small	8/1/2002	41	SWTR
5047612	MAH VALLEY CHIR & REHAB	TNC	SW	Very Small	11/1/2002	41	SWTR
5047612	MAH VALLEY CHIR & REHAB	TNC	SW	Very Small	12/1/2002	41	SWTR
5052412	MIDWAY MENNONITE CHURCH	TNC	GW	Very Small	7/1/2002	21	3100
5052412	MIDWAY MENNONITE CHURCH	TNC	GW	Very Small	7/1/2002	22	3100
5052412	MIDWAY MENNONITE CHURCH	TNC	GW	Very Small	10/1/2002	22	3100
5133112	CONEFLOWERS	TNC	GW	Very Small	7/1/2002	22	3100
5134512	RIVER BEND RESORT	TNC	GW	Very Small	4/1/2002	21	3100
5137512	COMMUNITY UM CHURCH	NTNC	GW	Very Small	10/1/2002	22	3100
5137612	ELGIN HIGH SCHOOL	NTNC	GW	Very Small	10/1/2002	22	3100
5138012	GRACE BAPTIST CHURCH	TNC	GW	Very Small	7/1/2002	21	3100
5141912	GREEN ACRES GOLF COURSE	TNC	GW	Very Small	10/1/2002	21	3100
5200514	MEDINA, CITY OF	COMM	PSW	Large	3/1/2002	41	SWTR
5200514	MEDINA, CITY OF	COMM	PSW	Large	4/1/2002	41	SWTR
5200514	MEDINA, CITY OF	COMM	PSW	Large	5/1/2002	41	SWTR
5200514	MEDINA, CITY OF	COMM	PSW	Large	6/1/2002	41	SWTR
5231812	CARO'S PARTY CENTER	TNC	GW	Very Small	4/1/2002	22	3100
5237812	BURBANK CITGO	TNC	GW	Very Small	1/1/2002	21	3100
5243412	RIDGE TOP GOLF COURSE	TNC	GW	Very Small	10/1/2002	22	3100

Appendix B
CY2002 MCL and TT Violations for Ohio

5244412	SKYPARK AIRPORT	TNC	GW	Very Small	4/1/2002	22	3100
5253812	RUDY'S LOUNGE	TNC	GW	Very Small	1/1/2002	41	SWTR
5253812	RUDY'S LOUNGE	TNC	GW	Very Small	2/1/2002	41	SWTR
5253812	RUDY'S LOUNGE	TNC	GW	Very Small	3/1/2002	41	SWTR
5253812	RUDY'S LOUNGE	TNC	GW	Very Small	4/1/2002	22	3100
5253812	RUDY'S LOUNGE	TNC	GW	Very Small	4/1/2002	41	SWTR
5255212	BUZZARD COVE SNACK BAR	TNC	GW	Very Small	7/1/2002	21	3100
5257212	NAZARENE CHRISTIAN COMM	TNC	GW	Very Small	10/1/2002	22	3100
5257612	MEDINA CO PKS/PLUM CREEK	TNC	GW	Very Small	7/1/2002	22	3100
5257812	DUKE AND DUTCHESS #109	TNC	GW	Very Small	7/1/2002	22	3100
5258412	SPEEDWAY #3650	TNC	GW	Very Small	7/1/2002	22	3100
5259512	VICTORY BAPTIST CHURCH	NTNC	GW	Very Small	7/1/2002	22	3100
5400011	CELINA, CITY OF	COMM	SW	Large	7/1/2002	02	2950
5400011	CELINA, CITY OF	COMM	SW	Large	10/1/2002	02	2950
5440312	S&K PRODUCTS COMPANY	NTNC	GW	Very Small	1/1/2002	22	3100
5440312	S&K PRODUCTS COMPANY	NTNC	GW	Very Small	4/1/2002	22	3100
5441312	VFW POST 6515	TNC	GW	Very Small	7/1/2002	22	3100
5531112	UAW UNION HALL	TNC	GW	Very Small	10/1/2002	22	3100
5533612	STILLWATER RIDGE, INC.	TNC	GW	Very Small	1/1/2002	22	3100
5533612	STILLWATER RIDGE, INC.	TNC	GW	Very Small	4/1/2002	21	3100
5533612	STILLWATER RIDGE, INC.	TNC	GW	Very Small	4/1/2002	22	3100
5537712	MIAMI EAST SOUTH ELEM SC	NTNC	GW	Very Small	1/1/2002	22	3100
5541212	TROY FREEWILL BAPTIST CH	TNC	GW	Very Small	1/1/2002	21	3100
5541912	W. CHAR. CH. OF THE BRET	NTNC	GW	Very Small	4/1/2002	22	3100
5541912	W. CHAR. CH. OF THE BRET	NTNC	GW	Very Small	7/1/2002	21	3100
5544612	STARFIRE EXPRESS	TNC	GW	Small	4/1/2002	02	1040
5545812	ROLLING HILLS GIRL SCOUT	TNC	GW	Very Small	10/1/2002	22	3100
5546012	SEVENTH DAY ADVENTIST	TNC	GW	Very Small	10/1/2002	21	3100
5546012	SEVENTH DAY ADVENTIST	TNC	GW	Very Small	10/1/2002	22	3100
5547412	PATHWAY SCHOOL INC	NTNC	GW	Very Small	10/1/2002	22	3100
5548612	PROCESS EQUIP CO-PLANT#3	NTNC	GW	Very Small	10/1/2002	22	3100
5549012	TROY C CLUB HALFWAYHOUSE	TNC	GW	Very Small	7/1/2002	21	3100
5549012	TROY C CLUB HALFWAYHOUSE	TNC	GW	Very Small	7/1/2002	22	3100
5550212	KINGDOM HALL OF JEH WIT	TNC	GW	Very Small	1/1/2002	21	3100
5550512	FRIENDSHIP COMM CHURCH	TNC	GW	Very Small	10/1/2002	21	3100
5550912	TIPP CITY CH. OF CHRIST	TNC	GW	Very Small	4/1/2002	21	3100
5550912	TIPP CITY CH. OF CHRIST	TNC	GW	Very Small	4/1/2002	22	3100
5550912	TIPP CITY CHRCH OF CHRST	TNC	GW	Very Small	7/1/2002	21	3100
5550912	TIPP CITY CHRCH OF CHRST	TNC	GW	Very Small	7/1/2002	22	3100
5550912	TIPP CITY CHRCH OF CHRST	TNC	GW	Very Small	10/1/2002	22	3100
5551412	STEADFAST HARVEST CHURCH	TNC	GW	Very Small	1/1/2002	21	3100
5551412	STEADFAST HARVEST CHURCH	TNC	GW	Very Small	4/1/2002	21	3100
5551412	STEADFAST HARVEST CHURCH	TNC	GW	Very Small	10/1/2002	21	3100
5552012	1 STOP PIZZA & CARRY-OUT	TNC	GW	Very Small	10/1/2002	22	3100
5631512	RIVERVIEW RESTAURANT	TNC	GW	Very Small	7/1/2002	21	3100
5631512	RIVERVIEW RESTAURANT	TNC	GW	Very Small	7/1/2002	22	3100
5702112	PHILLIPSBURG,VILLAGE OF	COMM	GW	Small	6/1/2002	02	1040
5730312	AULLW.AUDUB.NATURE CTR.	TNC	GW	Very Small	4/1/2002	22	3100
5730312	AULLW.AUDUB.NATURE CTR.	TNC	GW	Very Small	7/1/2002	21	3100
5730312	AULLW.AUDUB.NATURE CTR.	TNC	GW	Very Small	7/1/2002	22	3100

Appendix B
CY2002 MCL and TT Violations for Ohio

5730312	AULLW.AUDUB.NATURE CTR.	TNC	GW	Very Small	10/1/2002	22	3100
5734812	HUNGARIAN E&R CHURCH	TNC	GW	Very Small	10/1/2002	22	3100
5738512	PLAINVIEW OPEN BIBLE	TNC	GW	Very Small	10/1/2002	22	3100
5738512	POLK GROVE	TNC	GW	Very Small	10/1/2002	41	SWTR
5738612	POLK GROVE CHURCH	TNC	SW	Very Small	1/1/2002	41	SWTR
5738612	POLK GROVE CHURCH	TNC	SW	Very Small	2/1/2002	41	SWTR
5738612	POLK GROVE CHURCH	TNC	SW	Very Small	3/1/2002	41	SWTR
5738612	POLK GROVE CHURCH	TNC	SW	Very Small	4/1/2002	41	SWTR
5738612	POLK GROVE CHURCH	TNC	SW	Very Small	5/1/2002	41	SWTR
5738612	POLK GROVE CHURCH	TNC	SW	Very Small	6/1/2002	41	SWTR
5738612	POLK GROVE CHURCH	TNC	SW	Very Small	7/1/2002	41	SWTR
5738612	POLK GROVE CHURCH	TNC	SW	Very Small	8/1/2002	01	1040
5738612	POLK GROVE CHURCH	TNC	SW	Very Small	8/1/2002	41	SWTR
5738612	POLK GROVE CHURCH	TNC	SW	Very Small	9/1/2002	01	1040
5738612	POLK GROVE CHURCH	TNC	SW	Very Small	9/1/2002	41	SWTR
5738612	POLK GROVE CHURCH	TNC	SW	Very Small	10/1/2002	01	1040
5738612	POLK GROVE CHURCH	TNC	SW	Very Small	11/1/2002	41	SWTR
5738612	POLK GROVE CHURCH	TNC	SW	Very Small	12/1/2002	41	SWTR
5739412	SALEM CHURCH OF BRETHREN	TNC	GW	Very Small	1/1/2002	22	3100
5740412	TEMPLE BAPTIST CHURCH	TNC	GW	Very Small	1/1/2002	21	3100
5740412	TEMPLE BAPTIST CHURCH	TNC	GW	Very Small	6/1/2002	21	3100
5740412	TEMPLE BAPTIST CHURCH	TNC	GW	Very Small	7/1/2002	21	3100
5740412	TEMPLE BAPTIST CHURCH	TNC	GW	Very Small	10/1/2002	21	3100
5740912	HIGH SPIRITS	TNC	GW	Very Small	7/1/2002	21	3100
5744112	CRICKETHOLLER SCT RESV	TNC	GW	Very Small	1/1/2002	22	3100
5747112	NORTHMONT COMM. CHURCH	TNC	GW	Very Small	4/1/2002	21	3100
5748812	CATHEDRAL OF PRAISE CH.	TNC	GW	Very Small	7/1/2002	21	3100
5748812	NEW PARIS	TNC	GW	Very Small	10/1/2002	41	SWTR
5801203	MORGAN-MEIGSVILLE	COMM	PGW	Very Small	7/1/2002	22	3100
5801203	MORGAN-MEIGSVILLE SR 376	COMM	PGW	Very Small	2/1/2002	21	3100
5801203	MORGAN-MEIGSVILLE SR 376	COMM	PGW	Very Small	8/1/2002	21	3100
5831412	OH POWER N1 KEFFLER KAMP	TNC	GW	Very Small	4/1/2002	22	3100
5832812	OH POWER F RV CREWS PARK	TNC	GW	Very Small	4/1/2002	22	3100
5900512	LAKEVIEW EST MHP	COMM	GW	Very Small	11/1/2002	21	3100
5900512	LAKEVIEW ESTATES M.H.PK.	COMM	GW	Very Small	2/1/2002	21	3100
5936712	PLEASANT GROVE CH OF CHR	TNC	GW	Very Small	4/1/2002	21	3100
5941412	APPLE PIE INN	TNC	SW	Very Small	3/1/2002	41	SWTR
5941412	APPLE PIE INN	TNC	SW	Very Small	5/1/2002	41	SWTR
5941412	APPLE PIE INN	TNC	SW	Very Small	6/1/2002	41	SWTR
5941412	APPLE PIE INN	TNC	SW	Very Small	8/1/2002	41	SWTR
5941412	APPLE PIE INN	TNC	SW	Very Small	9/1/2002	41	SWTR
5941412	APPLE PIE INN	TNC	SW	Very Small	12/1/2002	41	SWTR
5941412	APPLIE PIE INN	TNC	SW	Very Small	1/1/2002	41	SWTR
5941412	APPLIE PIE INN	TNC	SW	Very Small	2/1/2002	41	SWTR
5941412	APPLIE PIE INN	TNC	SW	Very Small	4/1/2002	41	SWTR
6000812	GREEN ACRES CAMPGROUND	TNC	GW	Very Small	4/1/2002	21	3100
6036712	RIVERSIDE CAFE	TNC	GW	Very Small	7/1/2002	22	3100
6042812	THE LONGABERGER COMPANY	NTNC	GW	Medium	8/1/2002	22	3100
6043112	TRI-VALLEY OPEN BIBLE CH	TNC	GW	Very Small	7/1/2002	21	3100
6043112	TRI-VALLEY OPEN BIBLE CH	TNC	GW	Very Small	7/1/2002	22	3100

Appendix B
CY2002 MCL and TT Violations for Ohio

6044512	BAKER'S STORE	TNC	GW	Very Small	7/1/2002	21	3100
6044512	BAKER'S STORE	TNC	GW	Very Small	7/1/2002	22	3100
6044712	DRESDEN ENERGY CORP.	NTNC	GW	Very Small	10/1/2002	21	3100
6044712	DRESDEN ENERGY CORP.	NTNC	GW	Very Small	10/1/2002	22	3100
6100011	VILLAGE OF CALDWELL	COMM	SW	Medium	11/1/2002	41	SWTR
6235212	LIMESTONE TAVERN	TNC	GW	Very Small	10/1/2002	22	3100
6248912	PAT DAILEY'S TAVERN AT T	TNC	GW	Very Small	7/1/2002	21	3100
6300312	OAKWOOD, VILLAGE OF	COMM	GW	Small	8/1/2002	22	3100
6331012	UNCLE FUDD'S PLACE	TNC	GW	Very Small	7/1/2002	21	3100
6331012	UNCLE FUDD'S PLACE	TNC	GW	Very Small	7/1/2002	22	3100
6332312	MORNING STAR CONVENIENCE	TNC	GW	Small	1/1/2002	22	3100
6333312	ODOT US 24 REST AREA	TNC	GW	Very Small	7/1/2002	21	3100
6333312	ODOT US 24 REST AREA	TNC	GW	Very Small	7/1/2002	22	3100
6401111	SOMERSET	COMM	SW	Small	12/1/2002	41	SWTR
6401503	SPCWD BUCKINGHAM	COMM	PSW	Very Small	6/1/2002	22	3100
6430412	COUNTRY DAIRY BAR	TNC	GW	Very Small	10/1/2002	21	3100
6431212	NEW SALEM COUNTRY CLUB	TNC	GW	Very Small	10/1/2002	21	3100
6431512	PERRY COUNTRY CLUB	TNC	GW	Very Small	7/1/2002	21	3100
6431912	RUSHCREEK GOLF COURSE	TNC	GW	Very Small	10/1/2002	21	3100
6431912	RUSHCREEK GOLF COURSE	TNC	GW	Very Small	10/1/2002	22	3100
6433312	OGLEBAY NORTON IND SANDS	NTNC	GW	Very Small	10/1/2002	22	3100
6434612	PERRY TRAILS & CAMP. INC	TNC	PGW	Very Small	10/1/2002	21	3100
6434612	PERRY TRAILS & CAMP. INC	TNC	PGW	Very Small	10/1/2002	22	3100
6502112	VLG OF SOUTH BLOOMFIELD	COMM	GW	Small	5/1/2002	21	3100
6533312	TINKS	TNC	GW	Very Small	1/1/2002	22	3100
6535612	HILL'S DAIRY KREAM	TNC	GW	Very Small	4/1/2002	21	3100
6538112	SLATE RUN HISTORICAL FAR	TNC	GW	Very Small	10/1/2002	21	3100
6538112	SLATE RUN HISTORICAL FAR	TNC	GW	Very Small	10/1/2002	22	3100
6539412	SLATE RUN-BUZZARDS ROOST	TNC	GW	Very Small	10/1/2002	21	3100
6539412	SLATE RUN-BUZZARDS ROOST	TNC	GW	Very Small	10/1/2002	22	3100
6540712	SPLIT ROCK GOLF COURSE	TNC	GW	Very Small	10/1/2002	22	3100
6541112	CIRCLEVILLE CARRIER ANNE	NTNC	GW	Very Small	7/1/2002	22	3100
6541512	LOCKHART'S HARRISBURG PL	TNC	SW	Very Small	1/1/2002	01	1040
6541512	LOCKHART'S HARRISBURG PL	TNC	SW	Very Small	4/1/2002	01	1040
6541512	LOCKHART'S HARRISBURG PL	TNC	SW	Very Small	7/1/2002	01	1040
6541512	LOCKHART'S HARRISBURG PL	TNC	SW	Very Small	10/1/2002	02	1040
6705212	OHIO-AMERICAN WATER-BEEC	COMM	GW	Small	7/1/2002	22	3100
6733512	CAMP JESSIE MAE FAGEOL	TNC	GW	Very Small	10/1/2002	22	3100
6738712	EAST MANUFACTURING CORP	NTNC	GW	Very Small	4/1/2002	22	3100
6745112	KENT STATE GOLF-CLUBHOUS	TNC	GW	Very Small	10/1/2002	22	3100
6749612	PARADISE LAKE GOLF&BANQU	TNC	GW	Very Small	10/1/2002	21	3100
6751112	RANDOLPH FAIR	TNC	GW	Very Small	7/1/2002	22	3100
6754912	CROSSROADS TAVERN	TNC	GW	Very Small	1/1/2002	21	3100
6763112	SCOTT MOLDERS INCORPORAT	NTNC	GW	Very Small	7/1/2002	22	3100
6763312	RACCOON HILL GOLF CLUB	TNC	GW	Very Small	7/1/2002	22	3100
6767512	ODOT REST AREA 4-36	TNC	GW	Small	7/1/2002	22	3100
6770112	JOHNSON FARM	TNC	GW	Very Small	7/1/2002	22	3100
6770212	KNIGHTS OF COLUMBUS#2039	TNC	GW	Very Small	7/1/2002	22	3100
6774412	CAMP ASBURY-CENTRAL	TNC	GW	Very Small	4/1/2002	22	3100
6776212	KENT CHURCH OF NAZARENE	NTNC	GW	Very Small	1/1/2002	22	3100

Appendix B
CY2002 MCL and TT Violations for Ohio

6776212	KENT CHURCH OF NAZARENE	NTNC	GW	Very Small	10/1/2002	22	3100
6777512	HARRISON MACHINE/PLASTIC	NTNC	GW	Very Small	10/1/2002	22	3100
6778712	TWIN LAKES ASSOC- BEACH	TNC	GW	Very Small	4/1/2002	22	3100
6783812	THE DIAMOND LODGE	TNC	GW	Very Small	11/1/2002	21	3100
6784512	MED CENTER ONE-KENT	TNC	GW	Very Small	1/1/2002	22	3100
6784512	MED CENTER ONE-KENT	TNC	GW	Very Small	4/1/2002	22	3100
6784512	MED CENTER ONE-KENT	TNC	GW	Very Small	7/1/2002	22	3100
6800912	NEW PARIS, VILLAGE OF	COMM	SW	Small	1/1/2002	41	SWTR
6800912	NEW PARIS, VILLAGE OF	COMM	SW	Small	2/1/2002	41	SWTR
6800912	NEW PARIS, VILLAGE OF	COMM	SW	Small	3/1/2002	41	SWTR
6800912	NEW PARIS, VILLAGE OF	COMM	SW	Small	4/1/2002	41	SWTR
6800912	NEW PARIS, VILLAGE OF	COMM	SW	Small	5/1/2002	41	SWTR
6800912	NEW PARIS, VILLAGE OF	COMM	SW	Small	6/1/2002	41	SWTR
6800912	NEW PARIS, VILLAGE OF	COMM	SW	Small	7/1/2002	41	SWTR
6800912	NEW PARIS, VILLAGE OF	COMM	SW	Small	8/1/2002	41	SWTR
6800912	NEW PARIS, VILLAGE OF	COMM	SW	Small	9/1/2002	41	SWTR
6800912	NEW PARIS, VILLAGE OF	COMM	SW	Small	11/1/2002	41	SWTR
6800912	NEW PARIS, VILLAGE OF	COMM	SW	Small	12/1/2002	41	SWTR
6801212	VERONA, VILLAGE OF	COMM	GW	Small	6/1/2002	21	3100
6833012	WARES CHAPEL UNITED METH	TNC	GW	Very Small	9/1/2002	21	3100
6833722	CAMP AMERICA, INC.	TNC	GW	Very Small	7/1/2002	22	3100
6834912	WOODLAND TRAILS SCOUT RE	TNC	GW	Very Small	10/1/2002	22	3100
6835412	IAMS COMPANY	NTNC	GW	Very Small	4/1/2002	22	3100
6836912	PENN TERRA GOLF COURSE	TNC	GW	Very Small	10/1/2002	22	3100
6837312	PRECISION WOOD PRODUCTS	TNC	GW	Very Small	10/1/2002	22	3100
6939512	NORTH MT. ZION CHURCH	TNC	GW	Very Small	4/1/2002	21	3100
6939512	NORTH MT. ZION CHURCH	TNC	GW	Very Small	7/1/2002	22	3100
6944112	SCHROEDER AMLC	TNC	GW	Very Small	5/1/2002	41	SWTR
6944112	SCHROEDER AMLC	TNC	GW	Very Small	6/1/2002	41	SWTR
6944112	SCHROEDER AMLC	TNC	GW	Very Small	7/1/2002	41	SWTR
6944112	SCHROEDER AMLC	TNC	GW	Very Small	8/1/2002	41	SWTR
6944712	INKROTT AMLC	TNC	GW	Very Small	10/1/2002	22	3100
6945012	COLS. GROVE PRK-SENIOR C	TNC	GW	Very Small	4/1/2002	22	3100
6945712	S & A PRODUCE	TNC	GW	Very Small	7/1/2002	21	3100
7000622	CLEARFORK MHP/WELL 2	COMM	GW	Very Small	11/1/2002	22	3100
7038212	MILLIRON IRON & METAL	TNC	GW	Very Small	10/1/2002	21	3100
7043012	LITTLE WASH. CONGR. CHURCH	TNC	GW	Very Small	10/1/2002	21	3100
7045912	SWIFTY STATION #186	TNC	GW	Small	7/1/2002	22	3100
7045912	SWIFTY STATION #186	TNC	GW	Small	10/1/2002	21	3100
7045912	SWIFTY STATION #186	TNC	GW	Small	10/1/2002	22	3100
7048912	MICKEY MART	TNC	GW	Very Small	10/1/2002	22	3100
7049212	MILLIRON AUTO PARTS	TNC	GW	Very Small	10/1/2002	21	3100
7049212	MILLIRON AUTO PARTS	TNC	GW	Very Small	10/1/2002	22	3100
7051612	COLUMBIA GAS TRANS-PAVON	TNC	GW	Very Small	10/1/2002	22	3100
7052812	WESTBROOK GOLF COURSE	TNC	GW	Very Small	7/1/2002	22	3100
7055112	MAYFLOWER CONGREGATIONA	TNC	GW	Very Small	4/1/2002	22	3100
7101912	V A HOSPITAL	COMM	GW	Small	5/1/2002	21	3100
7200311	FREMONT, CITY OF	COMM	SW	Large	12/1/2002	02	1040
7230212	THURSTON ZWIR POST 121	TNC	GW	Very Small	7/1/2002	22	3100
7232812	GILLMOR, AMLC	TNC	GW	Very Small	10/1/2002	21	3100

Appendix B
CY2002 MCL and TT Violations for Ohio

7235112	HIDDEN HILLS GOLF CLUB,	TNC	GW	Very Small	4/1/2002	21	3100
7235112	HIDDEN HILLS GOLF CLUB,	TNC	GW	Very Small	7/1/2002	22	3100
7236512	TRW AUTOMOTIVE	NTNC	GW	Very Small	10/1/2002	22	3100
7241612	MILLERSVILLE ST MARYS SC	NTNC	GW	Very Small	4/1/2002	21	3100
7255212	FIRELANDS COUNSELING & R	TNC	GW	Very Small	10/1/2002	21	3100
7255412	LOYAL ORDER OF MOOSE #12	TNC	GW	Very Small	7/1/2002	22	3100
7256512	TRACTOR SUPPLY CO. - FRE	TNC	GW	Very Small	7/1/2002	22	3100
7256912	HELENA MIGRANT HEAD STAR	TNC	GW	Very Small	10/1/2002	22	3100
7330012	HOLIDAY PT MARINA - CAMP	TNC	GW	Very Small	4/1/2002	22	3100
7331412	SUNOCO, INC./BPA	NTNC	GW	Very Small	10/1/2002	22	3100
7400411	FOSTORIA, CITY OF	COMM	SW	Large	2/1/2002	41	SWTR
7400411	FOSTORIA, CITY OF	COMM	SW	Large	7/1/2002	41	SWTR
7400614	OH/AM WATER-TIFFIN DIST.	COMM	SW	Large	12/1/2002	02	1040
7400712	FOSTORIA MOBILE ESTATES	COMM	GW	Very Small	11/1/2002	21	3100
7401412	HOPEWELL ESTATES MHP	COMM	GW	Very Small	11/1/2002	21	3100
7432312	CLINTON LK CAMPING #2	TNC	GW	Very Small	10/1/2002	21	3100
7432312	CLINTON LK CAMPING #2	TNC	GW	Very Small	10/1/2002	22	3100
7433212	BOOMERZ	TNC	GW	Very Small	1/1/2002	21	3100
7433212	BOOMERZ	TNC	GW	Very Small	1/1/2002	22	3100
7435912	LOUDON MEADOWS GOLF COUP	TNC	GW	Very Small	7/1/2002	21	3100
7439812	QUALITY INN	TNC	GW	Very Small	4/1/2002	21	3100
7439812	QUALITY INN	TNC	GW	Very Small	4/1/2002	22	3100
7441712	ST BONIFACE CHURCH	TNC	GW	Very Small	7/1/2002	22	3100
7442212	STEYER AMLC #1	TNC	GW	Very Small	10/1/2002	22	3100
7446712	STEYER AMLC #2	TNC	GW	Very Small	4/1/2002	02	1040
7446712	STEYER AMLC #2	TNC	GW	Very Small	10/1/2002	02	1040
7447312	FIRST CHRISTIAN CHURCH	TNC	GW	Very Small	7/1/2002	21	3100
7447312	FIRST CHRISTIAN CHURCH	TNC	GW	Very Small	7/1/2002	22	3100
7533012	RIVER'S EDGE SPORTS BAR	TNC	GW	Very Small	10/1/2002	22	3100
7534212	RUSSIA INN	TNC	SW	Very Small	1/1/2002	41	SWTR
7534212	RUSSIA INN	TNC	SW	Very Small	2/1/2002	41	SWTR
7534212	RUSSIA INN	TNC	SW	Very Small	3/1/2002	41	SWTR
7534212	RUSSIA INN	TNC	SW	Very Small	4/1/2002	41	SWTR
7534212	RUSSIA INN	TNC	SW	Very Small	5/1/2002	41	SWTR
7534212	RUSSIA INN	TNC	SW	Very Small	6/1/2002	22	3100
7534212	RUSSIA INN	TNC	SW	Very Small	6/1/2002	41	SWTR
7534212	RUSSIA INN	TNC	SW	Very Small	7/1/2002	41	SWTR
7534212	RUSSIA INN	TNC	SW	Very Small	8/1/2002	41	SWTR
7534212	RUSSIA INN	TNC	SW	Very Small	9/1/2002	41	SWTR
7534212	RUSSIA INN	TNC	SW	Very Small	10/1/2002	41	SWTR
7534212	RUSSIA INN	TNC	SW	Very Small	11/1/2002	41	SWTR
7534212	RUSSIA INN	TNC	SW	Very Small	12/1/2002	41	SWTR
7539112	CHRIST THE KING CHURCH	TNC	GW	Very Small	4/1/2002	21	3100
7539112	CHRIST THE KING CHURCH	TNC	GW	Very Small	7/1/2002	21	3100
7539112	CHRIST THE KING CHURCH	TNC	GW	Very Small	7/1/2002	22	3100
7539312	PLASTIPAK MAIN #1	NTNC	GW	Small	4/1/2002	22	3100
7540212	SUPERIOR ALUMINUM PROD.	NTNC	GW	Very Small	4/1/2002	22	3100
7540512	VFW POST 4239	TNC	GW	Very Small	10/1/2002	22	3100
7631812	TOWPATH TAVERN	TNC	SW	Very Small	1/1/2002	41	SWTR
7631812	TOWPATH TAVERN	TNC	SW	Very Small	2/1/2002	41	SWTR

Appendix B
CY2002 MCL and TT Violations for Ohio

7631812	TOWPATH TAVERN	TNC	SW	Very Small	3/1/2002	41	SWTR
7631812	TOWPATH TAVERN	TNC	SW	Very Small	4/1/2002	41	SWTR
7631812	TOWPATH TAVERN	TNC	SW	Very Small	5/1/2002	41	SWTR
7631812	TOWPATH TAVERN	TNC	SW	Very Small	6/1/2002	41	SWTR
7631812	TOWPATH TAVERN	TNC	SW	Very Small	7/1/2002	41	SWTR
7631812	TOWPATH TAVERN	TNC	SW	Very Small	8/1/2002	41	SWTR
7631812	TOWPATH TAVERN	TNC	SW	Very Small	9/1/2002	41	SWTR
7631812	TOWPATH TAVERN	TNC	SW	Very Small	10/1/2002	41	SWTR
7631812	TOWPATH TAVERN	TNC	SW	Very Small	11/1/2002	41	SWTR
7631812	TOWPATH TAVERN	TNC	SW	Very Small	12/1/2002	41	SWTR
7631912	BUD'S CORNER	TNC	GW	Very Small	4/1/2002	22	3100
7633212	COUNTRY INN & LONGHORN	TNC	GW	Very Small	7/1/2002	22	3100
7633912	CITE GRILL	TNC	GW	Very Small	1/1/2002	22	3100
7636812	LAKE HIGH SCHOOL	NTNC	GW	Small	10/1/2002	22	3100
7637412	DAIRY MART-HARTVILLE	TNC	GW	Very Small	1/1/2002	22	3100
7637412	DAIRY MART-HARTVILLE	TNC	GW	Very Small	4/1/2002	22	3100
7638512	MARLBORO MFG INC	NTNC	GW	Very Small	6/1/2002	22	3100
7638512	MARLBORO MFG INC	NTNC	GW	Very Small	7/1/2002	22	3100
7638512	MARLBORO MFG INC	NTNC	GW	Very Small	10/1/2002	22	3100
7642512	SKYLAND PINE SWIM & TENN	TNC	GW	Very Small	7/1/2002	22	3100
7643912	VFW POST 7490	TNC	GW	Very Small	10/1/2002	22	3100
7646512	MEADOWLAKE GOLF	TNC	SW	Very Small	10/1/2002	41	SWTR
7646512	MEADOWLAKE GOLF & SWIM	TNC	SW	Very Small	1/1/2002	41	SWTR
7646512	MEADOWLAKE GOLF & SWIM	TNC	SW	Very Small	2/1/2002	41	SWTR
7646512	MEADOWLAKE GOLF & SWIM	TNC	SW	Very Small	3/1/2002	41	SWTR
7646512	MEADOWLAKE GOLF & SWIM	TNC	SW	Very Small	4/1/2002	41	SWTR
7646512	MEADOWLAKE GOLF & SWIM	TNC	SW	Very Small	5/1/2002	41	SWTR
7646512	MEADOWLAKE GOLF & SWIM	TNC	SW	Very Small	6/1/2002	41	SWTR
7646512	MEADOWLAKE GOLF & SWIM	TNC	SW	Very Small	7/1/2002	41	SWTR
7646512	MEADOWLAKE GOLF & SWIM	TNC	SW	Very Small	8/1/2002	41	SWTR
7646512	MEADOWLAKE GOLF & SWIM	TNC	SW	Very Small	9/1/2002	41	SWTR
7646512	MEADOWLAKE GOLF & SWIM	TNC	SW	Very Small	11/1/2002	41	SWTR
7646512	MEADOWLAKE GOLF & SWIM	TNC	SW	Very Small	12/1/2002	41	SWTR
7646812	JIM & CATHY'S MUSICAL	TNC	GW	Very Small	4/1/2002	41	SWTR
7646812	JIM & CATHYS MUSIC	TNC	GW	Very Small	10/1/2002	41	SWTR
7646812	JIM & CATHYS MUSICAL INN	TNC	GW	Very Small	11/1/2002	41	SWTR
7646812	JIM & CATHYS MUSICAL INN	TNC	GW	Very Small	12/1/2002	41	SWTR
7646812	MUSICAL INN	TNC	GW	Very Small	1/1/2002	41	SWTR
7646812	MUSICAL INN	TNC	GW	Very Small	3/1/2002	41	SWTR
7646812	MUSICAL INN	TNC	GW	Very Small	5/1/2002	41	SWTR
7646812	MUSICAL INN	TNC	GW	Very Small	6/1/2002	41	SWTR
7646812	MUSICAL INN	TNC	GW	Very Small	8/1/2002	22	3100
7646812	MUSICAL INN	TNC	GW	Very Small	8/1/2002	41	SWTR
7646812	MUSICAL INN	TNC	GW	Very Small	9/1/2002	41	SWTR
7647512	SHORT STOP INN	TNC	GW	Very Small	4/1/2002	41	SWTR
7647512	SHORT STOP INN	TNC	GW	Very Small	5/1/2002	41	SWTR
7647512	SHORT STOP INN	TNC	GW	Very Small	6/1/2002	41	SWTR
7647912	THE DOG HOUSE	TNC	SW	Very Small	1/1/2002	41	SWTR
7647912	THE DOG HOUSE	TNC	SW	Very Small	2/1/2002	41	SWTR
7647912	THE DOG HOUSE	TNC	SW	Very Small	7/1/2002	41	SWTR

Appendix B
CY2002 MCL and TT Violations for Ohio

7647912	THE DOG HOUSE	TNC	SW	Very Small	8/1/2002	41	SWTR
7647912	THE DOG HOUSE	TNC	SW	Very Small	9/1/2002	41	SWTR
7647912	THE DOG HOUSE	TNC	SW	Very Small	10/1/2002	41	SWTR
7647912	THE DOG HOUSE	TNC	SW	Very Small	11/1/2002	41	SWTR
7647912	THE DOG HOUSE	TNC	SW	Very Small	12/1/2002	41	SWTR
7648312	SPUD'S CORNER	TNC	GW	Very Small	10/1/2002	22	3100
7649512	NORTH LAWRENCE FIRE DEPT	TNC	GW	Very Small	1/1/2002	22	3100
7649512	NORTH LAWRENCE FIRE DEPT	TNC	GW	Very Small	10/1/2002	21	3100
7654812	CLAY'S PARK CAMPING RSRT	TNC	GW	Small	10/1/2002	22	3100
7655712	KAUFMAN CENTER	TNC	GW	Very Small	7/1/2002	21	3100
7655712	KAUFMAN CENTER	TNC	GW	Very Small	7/1/2002	22	3100
7657112	HARTVILLE ARBY'S	TNC	GW	Very Small	12/1/2002	22	3100
7659112	QUAIL HOLLOW MANOR HOUSE	TNC	GW	Very Small	7/1/2002	22	3100
7659112	QUAIL HOLLOW MANOR HOUSE	TNC	GW	Very Small	10/1/2002	22	3100
7661512	CLAY'S PARK RESORTS FOX	TNC	GW	Very Small	1/1/2002	21	3100
7662512	CATHEDRAL OF LIFE	TNC	GW	Very Small	7/1/2002	22	3100
7663012	DIAMOND COMMUNITY CENTER	TNC	GW	Very Small	10/1/2002	22	3100
7664912	ELM INN	TNC	GW	Very Small	4/1/2002	22	3100
7665012	TUSLAW CITGO	TNC	GW	Very Small	7/1/2002	22	3100
7665012	TUSLAW CITGO	TNC	GW	Very Small	10/1/2002	22	3100
7666512	RED DOG SALOON	TNC	GW	Very Small	4/1/2002	22	3100
7667412	SMITH'S WACO MARKET	TNC	GW	Very Small	4/1/2002	22	3100
7668112	PERRY CONE CORNER	TNC	GW	Very Small	10/1/2002	21	3100
7668112	PERRY CONE CORNER	TNC	GW	Very Small	10/1/2002	22	3100
7670712	KOCH KNIGHT LLC	NTNC	GW	Very Small	9/1/2002	22	3100
7671312	BARKER SPRING-CANTON PKS	TNC	GW	Very Small	4/1/2002	21	3100
7705312	WILLOW REST TRAILER PARK	COMM	GW	Very Small	7/1/2002	22	3100
7721112	RUBBER ASSOCIATES	NTNC	GW	Very Small	10/1/2002	22	3100
7722312	GHENT ACADEMY FOR BOYS	NTNC	GW	Very Small	10/1/2002	22	3100
7722912	LO BOY OIL, INC.	TNC	GW	Very Small	1/1/2002	22	3100
7724112	STEVE'S MOTEL	TNC	GW	Very Small	4/1/2002	21	3100
7724212		TNC	SW	Very Small	9/1/2002	41	SWTR
7724212	MASSILLON ROAD	TNC	SW	Very Small	10/1/2002	41	SWTR
7724212	MASSILLON ROAD MOTEL	TNC	SW	Very Small	1/1/2002	21	3100
7724212	MASSILLON ROAD MOTEL	TNC	SW	Very Small	1/1/2002	41	SWTR
7724212	MASSILLON ROAD MOTEL	TNC	SW	Very Small	2/1/2002	41	SWTR
7724212	MASSILLON ROAD MOTEL	TNC	SW	Very Small	3/1/2002	41	SWTR
7724212	MASSILLON ROAD MOTEL	TNC	SW	Very Small	4/1/2002	41	SWTR
7724212	MASSILLON ROAD MOTEL	TNC	SW	Very Small	5/1/2002	41	SWTR
7724212	MASSILLON ROAD MOTEL	TNC	SW	Very Small	6/1/2002	41	SWTR
7724212	MASSILLON ROAD MOTEL	TNC	SW	Very Small	7/1/2002	41	SWTR
7724212	MASSILLON ROAD MOTEL	TNC	SW	Very Small	8/1/2002	41	SWTR
7724212	MASSILLON ROAD MOTEL	TNC	SW	Very Small	11/1/2002	41	SWTR
7724212	MASSILLON ROAD MOTEL	TNC	SW	Very Small	12/1/2002	41	SWTR
7724512	GHENT CHRISTIAN CHURCH	TNC	GW	Very Small	7/1/2002	21	3100
7725912	PINE VALLEY LAKE PARK #2	TNC	GW	Very Small	10/1/2002	21	3100
7727012	CAMP Y NOAH-LDC	TNC	GW	Very Small	4/1/2002	21	3100
7727812	DOWNING ENTER. CENTERVIE	NTNC	GW	Very Small	10/1/2002	22	3100
7728012	MOGADORE CHRISTIAN ACADA	NTNC	GW	Very Small	7/1/2002	21	3100
7728012	MOGADORE CHRISTIAN ACADA	NTNC	GW	Very Small	7/1/2002	22	3100

Appendix B
CY2002 MCL and TT Violations for Ohio

7730112	AMF AKRON LANES	TNC	GW	Very Small	7/1/2002	22	3100
7732112	CAMP Y NOAH	TNC	GW	Very Small	1/1/2002	41	SWTR
7732112	CAMP Y NOAH	TNC	GW	Very Small	2/1/2002	41	SWTR
7732812	CONSOLIDATED FREIGHT	NTNC	GW	Very Small	8/1/2002	22	3100
7733712	WARD TRUCKING	NTNC	GW	Very Small	10/1/2002	22	3100
7735312	HISSONG KENWORTH INC	NTNC	GW	Very Small	10/1/2002	22	3100
7736412	CVS STORE #4312	TNC	GW	Very Small	10/1/2002	22	3100
7737412	OLDE LOYAL OAK TAVERN	TNC	GW	Very Small	4/1/2002	21	3100
7737412	OLDE LOYAL OAK TAVERN	TNC	GW	Very Small	4/1/2002	22	3100
7740312	SIR DUDLEY'S SPORTS PUB	TNC	GW	Very Small	1/1/2002	41	SWTR
7740312	SIR DUDLEY'S SPORTS PUB	TNC	GW	Very Small	2/1/2002	41	SWTR
7740312	SIR DUDLEY'S SPORTS PUB	TNC	GW	Very Small	3/1/2002	41	SWTR
7740312	SIR DUDLEY'S SPORTS PUB	TNC	GW	Very Small	4/1/2002	41	SWTR
7740312	SIR DUDLEY'S SPORTS PUB	TNC	GW	Very Small	5/1/2002	41	SWTR
7740312	SIR DUDLEY'S SPORTS PUB	TNC	GW	Very Small	6/1/2002	41	SWTR
7742312	CITY OF STOW	TNC	GW	Very Small	7/1/2002	22	3100
7742312	SILVER SPRINGS PK-PICNIC	TNC	GW	Very Small	10/1/2002	21	3100
7742612	DUKE N DUCHESS #247	TNC	GW	Very Small	10/1/2002	22	3100
7742712	BP OIL STATION #05650	TNC	GW	Very Small	10/1/2002	21	3100
7744012	BRAMBLE EQUIP SERVICES	NTNC	GW	Very Small	10/1/2002	22	3100
7744012	BRAMBLE EQUIP SVC	NTNC	GW	Very Small	9/1/2002	22	3100
7745712	BETHEL LUTHERAN CHURCH	TNC	GW	Very Small	7/1/2002	21	3100
7745712	BETHEL LUTHERAN CHURCH	TNC	GW	Very Small	7/1/2002	22	3100
7745712	BETHEL LUTHERAN CHURCH	TNC	GW	Very Small	10/1/2002	21	3100
7747312	JERRY'S AUTO-HAUS	TNC	GW	Very Small	4/1/2002	21	3100
7747312	JERRYS AUTO-HAUSE	TNC	GW	Very Small	4/1/2002	22	3100
7748012	MESSIAH LUTHERAN CHURCH	TNC	GW	Very Small	7/1/2002	21	3100
7749012	BATH UNITED CHOFCHT-HALL	TNC	GW	Very Small	7/1/2002	22	3100
7752212	DON-EL MOTEL	TNC	GW	Very Small	4/1/2002	22	3100
7753912	DOUG'S DINNER BUCKET	TNC	GW	Very Small	10/1/2002	21	3100
7758012	BURGER KING #394	TNC	GW	Small	4/1/2002	21	3100
7758412	THEO'S	TNC	GW	Very Small	7/1/2002	21	3100
7758412	THEO'S	TNC	GW	Very Small	10/1/2002	21	3100
7765212	PORTAGE LAKES EAGLES	TNC	GW	Very Small	7/1/2002	22	3100
7767012	REDWOOD SWIM CLUB	TNC	GW	Very Small	4/1/2002	22	3100
7767012	REDWOOD SWIM CLUB	TNC	GW	Very Small	7/1/2002	21	3100
7767812	ROSE LOUNGE	TNC	GW	Very Small	7/1/2002	21	3100
7768712		TNC	SW	Very Small	9/1/2002	41	SWTR
7768712	HIDEAWAY,THE	TNC	SW	Very Small	1/1/2002	41	SWTR
7768712	THE SHERWOOD LODGE	TNC	SW	Very Small	10/1/2002	41	SWTR
7768712	THE SHERWOOD LOUNGE	TNC	SW	Very Small	3/1/2002	41	SWTR
7768712	THE SHERWOOD LOUNGE	TNC	SW	Very Small	4/1/2002	41	SWTR
7768712	THE SHERWOOD LOUNGE	TNC	SW	Very Small	5/1/2002	41	SWTR
7768712	THE SHERWOOD LOUNGE	TNC	SW	Very Small	6/1/2002	41	SWTR
7768712	THE SHERWOOD LOUNGE	TNC	SW	Very Small	7/1/2002	41	SWTR
7768712	THE SHERWOOD LOUNGE	TNC	SW	Very Small	8/1/2002	41	SWTR
7768712	THE SHERWOOD LOUNGE	TNC	SW	Very Small	11/1/2002	41	SWTR
7768712	THE SHERWOOD LOUNGE	TNC	SW	Very Small	12/1/2002	41	SWTR
7770312	FRANKLIN PARK CIVIC CTNR	TNC	GW	Very Small	7/1/2002	21	3100
7771412	GREEN VALLEY METHODIST	TNC	GW	Very Small	4/1/2002	22	3100

Appendix B
CY2002 MCL and TT Violations for Ohio

7773412	B&D NIMISILA GARDENS INC	TNC	GW	Very Small	10/1/2002	22	3100
7774312	GREENSBURG CHURCH OF GOD	TNC	GW	Very Small	10/1/2002	21	3100
7782412	THORSON BAKER'S ASSOC.#1	NTNC	GW	Very Small	10/1/2002	22	3100
7786112	PIONEER PLASTICS CORP	NTNC	GW	Very Small	7/1/2002	22	3100
7789412	KING BUFFET	TNC	GW	Very Small	7/1/2002	21	3100
7789412	KING BUFFET	TNC	GW	Very Small	7/1/2002	22	3100
7789412	KING BUFFET	TNC	GW	Very Small	10/1/2002	22	3100
7790612	SPRINGFIELD TWP-TOWN HAL	TNC	GW	Very Small	4/1/2002	22	3100
7793112	SILVER SPRINGS BALL PARK	TNC	GW	Very Small	7/1/2002	22	3100
7793112	SILVER SPRINGS BALL PARK	TNC	GW	Very Small	10/1/2002	22	3100
7794012	GRACE PRESBYTERIAN CHURC	TNC	SW	Very Small	1/1/2002	41	SWTR
7794012	GRACE PRESBYTERIAN CHURC	TNC	SW	Very Small	2/1/2002	41	SWTR
7794112	PANCHO'S SW GRILL	TNC	GW	Very Small	7/1/2002	22	3100
7794112	PANCHO'S SW GRILL	TNC	GW	Very Small	10/1/2002	21	3100
7794112	PANCHO'S SW GRILL	TNC	GW	Very Small	10/1/2002	22	3100
7794412	SPEE-D-FOODS - S MAIN ST	TNC	GW	Very Small	4/1/2002	21	3100
7794412	SPEE-D-FOODS - S MAIN ST	TNC	GW	Very Small	7/1/2002	21	3100
7795212		TNC	SW	Very Small	9/1/2002	41	SWTR
7795212	THOMPSON MEMORIAL	TNC	SW	Very Small	10/1/2002	41	SWTR
7795212	THOMPSON MEMORIAL CHURCH	TNC	SW	Very Small	1/1/2002	41	SWTR
7795212	THOMPSON MEMORIAL CHURCH	TNC	SW	Very Small	2/1/2002	41	SWTR
7795212	THOMPSON MEMORIAL CHURCH	TNC	SW	Very Small	3/1/2002	41	SWTR
7795212	THOMPSON MEMORIAL CHURCH	TNC	SW	Very Small	4/1/2002	41	SWTR
7795212	THOMPSON MEMORIAL CHURCH	TNC	SW	Very Small	5/1/2002	41	SWTR
7795212	THOMPSON MEMORIAL CHURCH	TNC	SW	Very Small	6/1/2002	41	SWTR
7795212	THOMPSON MEMORIAL CHURCH	TNC	SW	Very Small	7/1/2002	41	SWTR
7795212	THOMPSON MEMORIAL CHURCH	TNC	SW	Very Small	8/1/2002	41	SWTR
7795212	THOMPSON MEMORIAL CHURCH	TNC	SW	Very Small	12/1/2002	41	SWTR
7796012	ST FRANCIS CHURCH	TNC	GW	Small	10/1/2002	22	3100
7796512	METROPKS-SILVER CK BATH	TNC	GW	Very Small	7/1/2002	22	3100
7796612	METROPKS-SILVER CR.BOATH	TNC	GW	Very Small	7/1/2002	22	3100
7830212	BELL WICK BOWL	TNC	GW	Very Small	7/1/2002	21	3100
7834412	BADGER MIDDLE SCHOOL	NTNC	GW	Very Small	10/1/2002	22	3100
7842312	HARMONY HILL FAMILY REST	TNC	GW	Very Small	7/1/2002	21	3100
7854212	PIN OAKS CAMPGROUND	TNC	GW	Very Small	4/1/2002	22	3100
7902103	TCMSD - WAINWRIGHT	COMM	PGW	Small	6/1/2002	22	3100
7938719	RUSH CHURCH OF THE NAZA.	TNC	GW	Very Small	1/1/2002	21	3100
7938719	RUSH CHURCH OF THE NAZA.	TNC	GW	Very Small	4/1/2002	21	3100
7941312	HOG HEAVEN	TNC	GW	Very Small	4/1/2002	21	3100
7948412	MARANATHA CHURCH	TNC	GW	Very Small	10/1/2002	21	3100
7948712	MARATHON MFG & SUPPLY CO	NTNC	GW	Very Small	10/1/2002	22	3100
8030412	CALVARY BAPTIST CHURCH	TNC	GW	Very Small	7/1/2002	21	3100
8033612	RAYMOND ELEMENTARY SCH	NTNC	GW	Very Small	4/1/2002	21	3100
8033712	RAYMOND UNITED METH CH	TNC	GW	Very Small	7/1/2002	22	3100
8033712	RAYMOND UNITED METHODIST	TNC	GW	Very Small	4/1/2002	21	3100
8035112	TACK ROOM	TNC	SW	Very Small	7/1/2002	22	3100
8037212	MARYSVILLE JEHOVAHS WTNS	TNC	GW	Very Small	10/1/2002	22	3100
8037512	MAD RIVER EGG FARM	NTNC	GW	Very Small	7/1/2002	21	3100
8037512	MAD RIVER EGG FARM	NTNC	GW	Very Small	7/1/2002	22	3100
8037512	MAD RIVER EGG FARM	NTNC	GW	Very Small	10/1/2002	21	3100

Appendix B
CY2002 MCL and TT Violations for Ohio

8037512	MAD RIVER EGG FARM	NTNC	GW	Very Small	10/1/2002	22	3100
8038312	DAYLAY FARM 3	NTNC	GW	Very Small	7/1/2002	22	3100
8038512	WEIGHT LIFTING FACILITY	TNC	GW	Very Small	7/1/2002	22	3100
8038612	TNT LOGISTICS NORTH AMER	NTNC	GW	Very Small	10/1/2002	22	3100
8038812	THE PIT STOP	TNC	GW	Very Small	1/1/2002	21	3100
8100611	VAN WERT, CITY OF	COMM	SW	Large	12/1/2002	41	SWTR
8132712	COUNTYLINE CAFE	TNC	GW	Very Small	10/1/2002	22	3100
8133012	HUGGY BEAR CAMPGROUND	TNC	GW	Very Small	7/1/2002	22	3100
8136712	ODOT REST AREA 1-28	TNC	GW	Small	7/1/2002	21	3100
8136712	ODOT REST AREA 1-28	TNC	GW	Small	7/1/2002	22	3100
8230412	AUSTIN POWDER-MAIN SYS.	NTNC	GW	Very Small	1/1/2002	22	3100
8300312	THE MEADOWS	COMM	GW	Small	7/1/2002	22	3100
8331212	CARLISLE FAMILY	TNC	SW	Very Small	10/1/2002	21	3100
8331212	CARLISLE FAMILY	TNC	SW	Very Small	10/1/2002	22	3100
8331212	CARLISLE FAMILY	TNC	SW	Very Small	10/1/2002	41	SWTR
8331212	CARLISLE FAMILY PRACTICE	TNC	SW	Very Small	4/1/2002	22	3100
8331212	CARLISLE FAMILY PRACTICE	TNC	SW	Very Small	6/1/2002	41	SWTR
8331212	CARLISLE FAMILY PRACTICE	TNC	SW	Very Small	7/1/2002	41	SWTR
8331212	CARLISLE FAMILY PRACTICE	TNC	SW	Very Small	8/1/2002	41	SWTR
8331212	CARLISLE FAMILY PRACTICE	TNC	SW	Very Small	9/1/2002	41	SWTR
8331212	CARLISLE FAMILY PRACTICE	TNC	SW	Very Small	11/1/2002	41	SWTR
8331212	CARLISLE FAMILY PRACTICE	TNC	SW	Very Small	12/1/2002	41	SWTR
8333012	PALACE BILLIARD	TNC	SW	Very Small	10/1/2002	21	3100
8333012	PALACE BILLIARD	TNC	SW	Very Small	10/1/2002	41	SWTR
8333012	PALACE BILLIARDS	TNC	SW	Very Small	1/1/2002	41	SWTR
8333012	PALACE BILLIARDS	TNC	SW	Very Small	2/1/2002	41	SWTR
8333012	PALACE BILLIARDS	TNC	SW	Very Small	3/1/2002	41	SWTR
8333012	PALACE BILLIARDS	TNC	SW	Very Small	4/1/2002	41	SWTR
8333012	PALACE BILLIARDS	TNC	SW	Very Small	5/1/2002	41	SWTR
8333012	PALACE BILLIARDS	TNC	SW	Very Small	6/1/2002	41	SWTR
8333012	PALACE BILLIARDS	TNC	SW	Very Small	7/1/2002	21	3100
8333012	PALACE BILLIARDS	TNC	SW	Very Small	7/1/2002	22	3100
8333012	PALACE BILLIARDS	TNC	SW	Very Small	7/1/2002	41	SWTR
8333012	PALACE BILLIARDS	TNC	SW	Very Small	8/1/2002	41	SWTR
8333012	PALACE BILLIARDS	TNC	SW	Very Small	9/1/2002	22	3100
8333012	PALACE BILLIARDS	TNC	SW	Very Small	9/1/2002	41	SWTR
8333012	PALACE BILLIARDS	TNC	SW	Very Small	11/1/2002	41	SWTR
8333012	PALACE BILLIARDS	TNC	SW	Very Small	12/1/2002	41	SWTR
8345512	WHITACRES OAK HILL	TNC	GW	Very Small	4/1/2002	21	3100
8360812	KINGSWOOD GOLF COURSE #5	TNC	GW	Very Small	7/1/2002	21	3100
8360812	KINGSWOOD GOLF COURSE #5	TNC	GW	Very Small	10/1/2002	21	3100
8400012	BELPRE	COMM	GW	Medium	2/1/2002	21	3100
8430512	FLOP'S PLACE	TNC	GW	Very Small	1/1/2002	21	3100
8434612	GRANDVIEW TAVERN	TNC	GW	Very Small	4/1/2002	21	3100
8436512	LAKESIDE INC.	TNC	GW	Very Small	10/1/2002	22	3100
8445615	OUR LADY OF MERCY PARISH	TNC	GW	Very Small	10/1/2002	21	3100
8445615	OUR LADY OF MERCY PARISH	TNC	GW	Very Small	10/1/2002	22	3100
8446812	RENO MINI MART	TNC	GW	Very Small	10/1/2002	21	3100
8446812	RENO MINI MART	TNC	GW	Very Small	10/1/2002	22	3100
8531012	BECK'S CAMP BACK WELL	TNC	GW	Very Small	10/1/2002	21	3100

Appendix B
CY2002 MCL and TT Violations for Ohio

8531012	BECK'S CAMP BACK WELL	TNC	GW	Very Small	10/1/2002	22	3100
8533112	CANAAN LUTHERAN CHURCH	TNC	GW	Very Small	7/1/2002	22	3100
8536412	EL RANCHO GRANDE	TNC	GW	Very Small	1/1/2002	22	3100
8538312	GROSS LUMBER INC	NTNC	GW	Very Small	10/1/2002	22	3100
8542312	KEN MILLER SUPPLY INC	NTNC	GW	Very Small	4/1/2002	22	3100
8546712	SALEM MENNONITE CH-WOOST	TNC	GW	Very Small	4/1/2002	21	3100
8546712	SALEM MENNONITE CH-WOOST	TNC	GW	Very Small	7/1/2002	22	3100
8546812	SALEM MENNONITE CH-KIDRO	TNC	GW	Very Small	4/1/2002	22	3100
8547712	STAHL/SCOTT FETZER CO,	NTNC	GW	Very Small	10/1/2002	22	3100
8548212	STERLING FARM EQUIPMENT	TNC	GW	Very Small	1/1/2002	22	3100
8549112	AMISH DOOR, INC.	NTNC	GW	Very Small	10/1/2002	22	3100
8553612	PINE TREE BARN, INC.	NTNC	GW	Very Small	1/1/2002	22	3100
8553612	PINE TREE BARN, INC.	NTNC	GW	Very Small	4/1/2002	22	3100
8557512	MIDWAY CITGO	TNC	GW	Very Small	7/1/2002	22	3100
8557512	MIDWAY CITGO	TNC	GW	Very Small	10/1/2002	22	3100
8559212	HYPONEX CORPORATION	NTNC	GW	Very Small	7/1/2002	21	3100
8560512	ST. MICHAEL'S LUTHERAN	TNC	GW	Very Small	7/1/2002	22	3100
8560612	LEHMAN HARDWARE & APPL	NTNC	GW	Very Small	9/1/2002	22	3100
8561012	STERLING UNITED METH CH	TNC	GW	Very Small	7/1/2002	22	3100
8631912	PULASKI HEAD START	NTNC	GW	Very Small	1/1/2002	22	3100
8632412	ST JOSEPH'S SCHOOL	NTNC	GW	Very Small	1/1/2002	22	3100
8632412	ST JOSEPH'S SCHOOL	NTNC	GW	Very Small	4/1/2002	22	3100
8632412	ST JOSEPH'S SCHOOL	NTNC	GW	Very Small	7/1/2002	22	3100
8634512	CAMP DICLAIR	TNC	GW	Very Small	4/1/2002	22	3100
8636312	LOCKPORT MENNONITE CH	TNC	GW	Very Small	1/1/2002	21	3100
8636312	LOCKPORT MENNONITE CH	TNC	GW	Very Small	1/1/2002	22	3100
8636412	MANUFACTURED HOUSING ENT	NTNC	GW	Very Small	1/1/2002	41	SWTR
8636812	NEW LIFE TEMPLE	TNC	GW	Very Small	7/1/2002	21	3100
8636912	PINE GROVE MENNONITE CH	TNC	GW	Very Small	1/1/2002	21	3100
8641512	NEW HOPE COMMUNITY CHURC	TNC	GW	Small	10/1/2002	21	3100
8738112	GETZ AMLC	TNC	GW	Very Small	4/1/2002	22	3100
8738112	GETZ AMLC	TNC	GW	Very Small	7/1/2002	22	3100
8739712	SYCAMORE GROVE	TNC	GW	Very Small	10/1/2002	22	3100
8740712	WIGWAM RESTAURANT	TNC	GW	Very Small	1/1/2002	21	3100
8746612	FUEL MART #767	TNC	GW	Small	7/1/2002	22	3100
8748912	ST.PAUL'S EV LUTHERAN CH	NTNC	GW	Very Small	7/1/2002	22	3100
8748912	ST.PAUL'S EV LUTHERAN CH	NTNC	GW	Very Small	10/1/2002	21	3100
8750912	ZION LUTHERAN CHURCH	TNC	GW	Very Small	7/1/2002	22	3100
8750912	ZION LUTHERAN CHURCH	TNC	GW	Very Small	10/1/2002	21	3100
8751412	OHIO OPERATING ENGINEERS	TNC	GW	Very Small	10/1/2002	22	3100
8835512	RIDGE CHAPEL CH OF NAZAR	TNC	GW	Very Small	8/1/2002	02	1040
8836612	SPORTSMAN INN	TNC	GW	Very Small	2/1/2002	41	SWTR
8836612	SPORTSMAN INN	TNC	GW	Very Small	3/1/2002	41	SWTR
8836612	SPORTSMAN INN	TNC	GW	Very Small	4/1/2002	41	SWTR
8836612	SPORTSMAN INN	TNC	GW	Very Small	5/1/2002	41	SWTR
8836612	SPORTSMAN INN	TNC	GW	Very Small	6/1/2002	41	SWTR
8836612	SPORTSMAN INN	TNC	GW	Very Small	7/1/2002	41	SWTR
8836612	SPORTSMAN INN	TNC	GW	Very Small	8/1/2002	41	SWTR
8836612	SPORTSMAN INN	TNC	GW	Very Small	9/1/2002	41	SWTR
8836612	SPORTSMAN INN	TNC	GW	Very Small	10/1/2002	41	SWTR

Appendix B
CY2002 MCL and TT Violations for Ohio

8836612	SPORTSMAN INN	TNC	GW	Very Small	11/1/2002	41	SWTR
8836612	SPORTSMAN INN	TNC	GW	Very Small	12/1/2002	41	SWTR
8836612	SPORTSMANN INN	TNC	GW	Very Small	10/1/2002	22	3100