

OHIO's PUBLIC WATER SYSTEMS

ANNUAL COMPLIANCE REPORT

For

CALENDAR YEAR 2005

**Ohio Environmental Protection Agency
Division of Drinking and Ground Waters
July 1, 2006**

TABLE OF CONTENTS

Introduction 1

The Drinking Water Program: An Overview 1

Regulated Public Water Systems in Ohio 2

Annual State PWS Compliance Report 3

Maximum Contaminant Level 4

Treatment Techniques 4

Monitoring 4

Consumer Notification 4

Maximum Residual Disinfectant Level 5

Compliance Table Summary Analysis 5

Organic Contaminants 8

Inorganic Contaminants 11

Radionuclide Contaminants 13

Total Coliform Regulations 14

Surface Water Treatment Regulations 16

Lead and Copper Regulations 18

Consumer Confidence Report Requirements 19

Compliance Summary 20

Ohio EPA’s Public Water System Compliance Assistance 21

Listing of Maximum Contaminant Level and Treatment Technique Violations . 21

Report Availability and Contact Information 22

APPENDIX A: COMPLIANCE SUMMARY TABLE

APPENDIX B: MCL and TT VIOLATION LISTING

List of Tables

Table 1.	Public Water System Summary by Category Type	2
Table 2.	Public Water System Summary by Source Type	3
Table 3.	Public Water System Summary by Population Categories	3
Table 4.	Violation Totals and Compliance Rates per Contaminant Group	5
Table 5.	Violation Totals for 2005	6
Table 6.	Violation Totals and Compliance Rates for Individual MCL Contaminant Group Constituents	7
Table 7.	Enforcement Action Code Types	22

List of Figures

Figure 1.	Percentage Distribution of PWSs with Violations per System Type and Population Served Category	6
Figure 2.	Systems with Organic Contaminant Monitoring/Reporting Violations by Population Categories	10
Figure 3.	Systems with Organic Contaminant Monitoring/Reporting Violations by System Type	10
Figure 4.	Systems with Inorganic Contaminant Monitoring/Reporting Violations by System Type	12
Figure 5.	Systems with Inorganic Contaminant Monitoring/Reporting Violations by Population Categories	13
Figure 6.	Community Systems with Radionuclide Contaminant Monitoring/Reporting Violations by Population Categories	14
Figure 7.	Systems with Total Coliform MCL (Acute and Non-Acute) and Significant Monitoring/Reporting Violations by Population Categories	15
Figure 8.	Systems with Total Coliform MCL (Acute and Non-Acute) and Significant Monitoring/Reporting Violations by System Type	16
Figure 9.	Systems with Surface Water Treatment Rule Monitoring/Reporting and Treatment Technique Violations by System Type	17
Figure 10.	Systems with Surface Water Treatment Rule Monitoring/Reporting and Treatment Technique Violations by Population Categories	17
Figure 11.	Systems with Lead and Copper Significant Initial and Follow-up/Routine Monitoring/Reporting Violations by Population Categories	18
Figure 12.	Systems with Lead and Copper Significant Initial and Follow-up/Routine Monitoring/Reporting Violations by System Type	19
Figure 13.	Systems with Consumer Confidence Report Violations by Population Categories	20

Introduction

The 1996 Amendments to the Safe Drinking Water Act require each State to prepare an Annual Compliance Report summarizing violations incurred by public water systems. The Annual Compliance Report is to be compiled by the State and submitted to U.S. EPA and made available to the public. This report summarizes compliance rates and the number and types of violations generated as a result of various public water systems failing to meet certain Safe Drinking Water Act requirements for calendar year 2005.

Ohio's 2005 Annual Compliance Report contains an overview of the Public Water System Supervision Program in Ohio; provides summary information on the number, types and population served for public water systems; explains the requirements of the Annual Compliance Report; defines the primary categories for which violation information is summarized; a summary table of the number and types of violations; an analysis of public water system compliance with the regulations; and a list of public water system violations for the maximum contaminant level and treatment technique categories.

The Drinking Water Program: An Overview

U.S. EPA established the Public Water System Supervision (PWSS) Program under the authority of the 1974 Safe Drinking Water Act (SDWA). Under the SDWA and the 1986 and 1996 Amendments, U.S. EPA sets national limits on contaminant levels in drinking water to ensure that the water is safe for human consumption. These limits are known as Maximum Contaminant Levels (MCLs). For some regulations, U.S. EPA establishes treatment techniques in lieu of an MCL to control unacceptable levels of contaminants in water by measuring the level of treatment. The Agency also regulates how often public water systems (PWSs) monitor their water for contaminants and report the monitoring results to the States or U.S. EPA. Generally, the larger the population served by a water system, the more frequent the monitoring and reporting (M/R) requirements. However, the M/R requirements vary dependent on which contaminant is being evaluated and the source water used by a system (surface water systems and systems that use ground water under the direct influence of surface water typically monitor more frequently than a ground water system). Finally, public water systems are required to notify the public when they have violated these regulations. The 1986 Amendments and further revisions under the 1996 Amendments to the SDWA require public notification to include a clear and understandable explanation of the nature of the violation, its potential adverse health effects, steps that the public water system is undertaking to correct the violation and the possibility for the need to obtain alternative water supplies during the violation.

The SDWA allows States to seek U.S. EPA approval to administer their own PWSS Programs. The authority to run a PWSS Program is called primacy. To receive primacy, States must meet certain requirements in the SDWA and the regulations, including the adoption of drinking water regulations that are at least as stringent as the Federal regulations and provide a demonstration that they can enforce the program requirements. *Ohio is a primacy state.*

Regulated Public Water Systems in Ohio

In Ohio, a public water system is defined as a system that provides water via piping or other constructed conveyances for human consumption to at least 15 service connections or serves an average of at least 25 people for at least 60 days each year. There are three types of public water systems (PWS):

- community water systems serve at least fifteen service connections used by year-round residents or regularly serve at least twenty-five year-round residents (e.g. cities; mobile home parks)
- nontransient noncommunity systems serve at least twenty-five of the same persons over six months per year (e.g. schools; businesses)
- transient noncommunity systems serves at least 25 different persons over 60 days per year (e.g. rest stops; parks)

These three type of systems use either a ground water source, surface water source, or use ground water under the direct influence of surface water. In addition, Ohio regulates the drinking water systems associated with agricultural migrant labor camps as defined by the Ohio Department of Agriculture even though they may not meet the minimum number of people or service connections. For this report when the acronym “PWS” is used, it means systems of all types unless specified in greater detail. In Ohio, 5,392 public water systems serve approximately 10.8 million people daily with an average production of approximately 1.7 billion gallons of water per day. This yields an average water use of 157 gallons per person per day. Table 1 summarizes the total number and percentage of active public water systems per type with the corresponding total population served daily. Table 2 summarizes the number of public water systems by source type.

The total number and percentage of PWS by population categories are presented in Table 3. An interesting note from this table is that 10 PWS, less than 1 percent of the total systems in the state, serve over 40 percent of the entire Ohio population.

Table 1. Public Water System Summary by Category Type

PWS Category Type	Number of PWS per Category	Percentage of each PWS Type	Total Population Served Daily per Category
Community (CWS)	1,306	24%	10,108,196
Non-Transient Non-Community (NTNC)	936	18%	219,477
Transient Non-Community (TNC)	3,150	58%	462,160
Total	5,392	100%	10,789,833

Table 2. Public Water System Summary by Source Type

PWS Category Type	Surface Waters	Ground Waters	Purchased Surface Waters	Purchased Ground Waters
Community (CWS)	120	917	174	95
Non-Transient Non-Community (NTNC)	6	921	2	7
Transient Non-Community (TNC)	17	3,116	3	14
Total	143	4,954	179	116

Table 3. Public Water System Summary by Population Categories

PWS Populations Categories	Number of PWS per Category	Percentage of the Total PWS for each Category	Total Population Served Daily per Category
Population: 25 - 500	4,417	82%	560,288
Population: 501 - 3,300	663	12.3%	824,490
Population: 3,301 - 10,000	155	2.8%	952,603
Population: 10,001 - 100,000	147	2.7%	3,840,001
Population: Greater than 100,000	10	0.2%	4,612,451
Total	5,392	100%	10,789,833

Annual State PWS Compliance Report

Ohio EPA submits data to U.S. EPA's Safe Drinking Water Information System (SDWIS/FED) on a quarterly basis. The data includes PWS inventory statistics, the incidence of MCL, major monitoring, treatment technique violations, and the enforcement actions taken against violators. This Annual Compliance Report provides a total annual representation of the number of violations for each of the four categories listed in section 1414(c)(3)(A)(i) of the Safe Drinking Water Act re-authorization, as well as consumer notification requirements. This report will analyze violation and compliance information for the 2005 calendar year using four categories: MCLs, treatment techniques, significant monitoring violations, and consumer notifications. This report was generated with the data available in Ohio EPA's database as of June 2006.

1. *Maximum Contaminant Level*

Under the SDWA, U.S. EPA sets national limits on contaminant levels in drinking water to ensure that the water is safe for human consumption. These limits are known as MCLs. When a PWS exceeds an MCL, it is required to notify the public of the violation within 24 hours for acute violations that may pose an acute risk to human health (e.g. nitrate; total coliform), and within 30 days for nonacute MCL violations (e.g. volatile organic chemicals; synthetic organic chemicals). In addition, the water system must continue to monitor regularly, as well as take steps to correct the contamination problem.

2. *Treatment Techniques*

For some regulations, the U.S. EPA establishes treatment techniques (TTs) in lieu of an MCL to control unacceptable levels of certain contaminants by a measurement of the treatment process. Treatment techniques have been established for viruses, some bacteria, turbidity, lead and copper and disinfection by-product precursors.

3. *Monitoring*

A PWS is required to monitor and verify that the levels of contaminants present in the water do not exceed the MCL. If a PWS fails to have its water tested as required, then a monitoring violation occurs. A monitoring violation also includes failure to report test results correctly to the State. These violations occur when a system misses one or more of several sampling events, or samples but does so outside the required time period. When a PWS fails to have its water tested as required, it is required to notify the public of the violation within 30 days. For a system monitoring less frequently than quarterly, it is required to sample for the contaminant(s) missed, in order to return to compliance.

Return to Compliance

As noted in the definition of monitoring violations, systems which monitor less frequently than quarterly can return to compliance. Some systems can return to compliance if they monitor for the missed contaminants or submit reports late. In this report, return to compliance rates were determined for inorganic contaminants; nitrate; nitrite; regulated volatile organic contaminants; synthetic organic contaminants; total trihalomethanes; haloacetic acids; and radiological contaminants, as a group.

Significant Monitoring Violations

For this report, significant monitoring violations are defined as any major monitoring violation that has occurred during the specified report interval. A major monitoring violation occurs when no samples were taken or no results are reported during a compliance period.

4. *Consumer Notification*

Every Community Water System is required to deliver to its customers a brief annual water quality report - a Consumer Confidence Report (CCR). This report is to include some educational material, and will provide information on the source water, the levels of any detected contaminants, and compliance with drinking water regulations.

Significant Consumer Notification Violations

A significant public notification violation occurred if a community water system completely failed to provide its customers the required annual water quality report.

5. *Maximum Residual Disinfectant Level*

U.S. EPA sets national limits on residual levels in drinking water to reduce the risk of exposure to disinfection byproducts formed when PWS add chemical disinfectant for either primary or residual treatment. These limits are known as Maximum Residual Disinfectant Levels (MRDLs).

Compliance Table Summary Analysis

A summary table of PWS compliance rates and violations for the 2005 calendar year is included in Appendix A. The information summarized in the table includes the total number of PWS required to monitor during the 2005 calendar year; total number of violations; total number of systems with a violation; and percent compliance achieved for a particular regulated contaminant in three different violation categories. These violation categories are MCL, Treatment Technique and Monitoring/CCR. The regulatory contaminant categories include: organic contaminants, inorganic contaminants, and radionuclide contaminants, all of which are classified as the MCL contaminant group; total coliform bacteria regulations (TCR); surface water treatment regulations (SWTR); interim enhanced surface water treatment regulations (IESWTR); lead and copper regulations, and CCR notifications.

Violation totals and compliance rates for each of the contaminant groups are presented in Table 4. Compliance rates are based on the total number of systems *required to* comply with each of the contaminant categories. For example, the 92 % CCR compliance rate is based on 1,306 systems required to send notifications with 101 systems failing to comply.

Table 4. Violation Totals and Compliance Rates per Contaminant Group Category

Contaminant Category	MCL			Treatment Technique			Monitoring or CCR notifications		
	Violations	No. of Systems in Violation	Comp. Rate	Violations	No. of Systems in Violation	Comp. Rate	Violations	No. of Systems in Violation	Comp. Rate
MCL Contaminant Group ¹	191	75	99%				2,481	1,129	79%
TCR ²	602	423	92%				1,332	914	83%
SWTR ³				99	25	83%	7	4	97%
Lead and Copper				1	1	94%	131	124	88%
CCR ⁴							108	101	92%
TOC ⁵				8	2	98%	8	6	95%
IESWTR ⁶				15	8	94%	30	11	92%

¹MCL Contaminant Group includes volatile organic, synthetic organic, inorganic, total trihalomethanes, haloacetic acid, nitrate and nitrite chemicals and radiological contaminants

²total coliform rule

³surface water treatment rule

⁴consumer confidence reports


⁵total organic carbon

⁶interim enhanced surface water treatment rule

Table 5. State of Ohio Violation Totals for 2005

	MCL	Monitoring	CCR	Treatment Technique	Totals
Number of Community Systems in Violation	80	447	101	24	652
Number of Community Violations	187	1184	108	62	1541
Number of Nontransient Systems in Violation	75	321	NA	1	397
Number of Nontransient Violations	120	954	NA	3	1078
Number of Transient Systems in Violation	343	1421	NA	11	1775
Number of Transient Violations	483	1858	NA	58	2399
Total Number of Systems in Violation	498	2,189	101	36	2,829
Total Number of Violations	793	3,996	108	123	5,020

Figure 1.

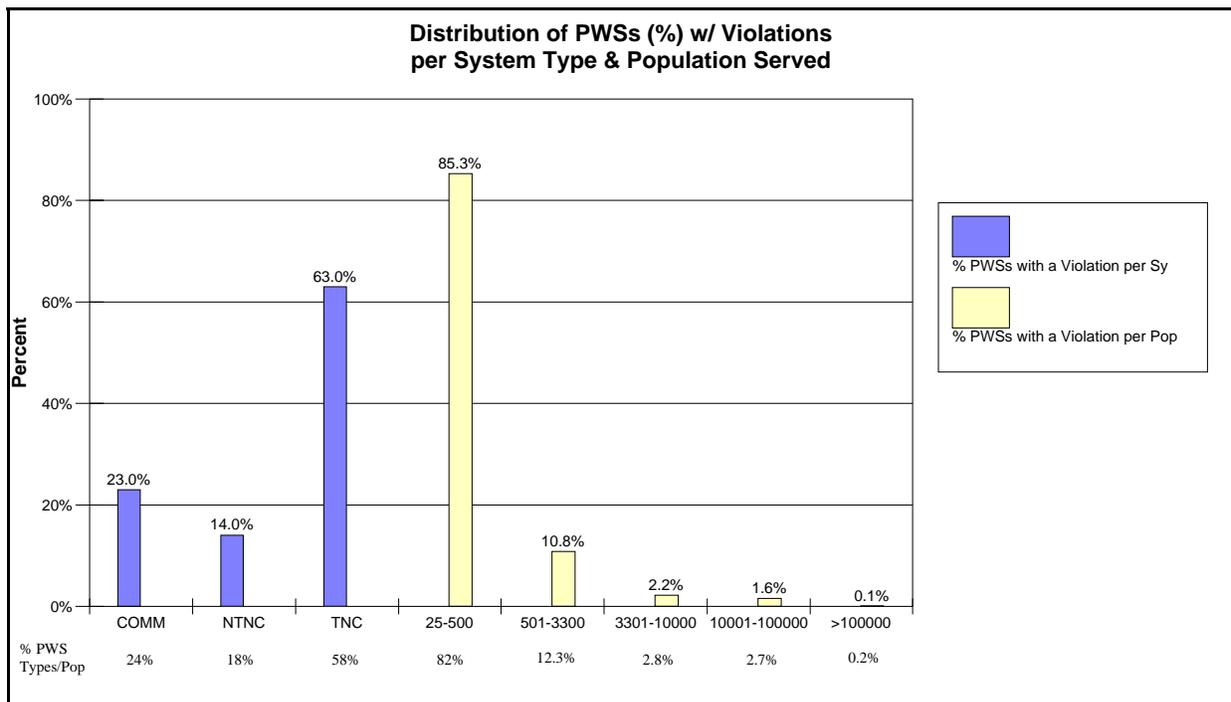

As depicted in Figure 1, of all water systems with at least one violation, 63 percent were associated with TNC water systems, 14 percent with NTNC water systems and 23 percent with CWS. Of the PWS having one or more violations, 85 percent were associated with a population served category of fewer than 500 people per day.

Approximately 80 percent of the violations in Ohio occur because public water systems fail to monitor and report for various required contaminants in the period as specified on an individual system monitoring schedule provided by the Director of Ohio EPA or by rule, or as a result of failing to collect follow-up or repeat samples. An average of 12 percent of systems returned to compliance following their violation(s) (see the definition of “return to compliance” for the list of contaminants included in the calculation). A detailed analysis of each contaminant group and violation category is presented below. When sufficient data was available, charts displaying the number of water systems with a violation per system type and population categories have been prepared and included in this report.

MCL Contaminant Group

The total number of violations and total number of water systems with at least one violation in the MCL Contaminant Group is presented in more detail in Table 6.

Table 6. Violation Totals and Compliance Rates for the Individual MCL Contaminant Group Constituents

Contaminant Category	MCL				Monitoring Requirements			
	Violations	No. of Systems in Violation	No. of Systems Required to Monitor*	Comp. Rate	Violations	No. of Systems in Violation	No. of Systems Required to Monitor*	Comp. Rate
VOCs ¹	2	1	898	99.8%	777	32	898	96.4%
SOCs ²	1	1	1973	99.9%	412	136	1973	93.0%
TTHMs ³	149	53	1500	96.4%	93	90	1500	94.0%
HAAs ⁴	19	10	1500	99.3%	108	105	1500	93.0%
IOCs ⁵	1	1	681	99.7%	257	26	681	96.0%
Nitrate	19	10	5038	99.8%	399	331	5038	93.0%
Nitrite	0	0	3101	100.0%	389	389	3101	87.0%
Rads ⁶	0	0	93	100.0%	46	15	93	84.0%

¹volatile organic chemicals

²synthetic organic chemicals

³total trihalomethanes

⁴haloacetic acids

⁵inorganic chemicals

⁶radiological contaminants

* The number of systems required to monitor for the different IOCs and SOCs varies, but 681 PWS were required to monitor for at least one of the inorganic chemicals, and 1,973 PWS were required to monitor for at least one of the SOCs. See Appendix A for details.

Organic Contaminants

The organic contaminants group summarized in the Compliance Table include: volatile organic chemicals (VOCs); synthetic organic chemicals (SOCs); total trihalomethanes (TTHMs) and haloacetic acids (HAAs).

VOCs are predominantly used as solvents, degreasers, cleaning solutions, dry cleaning fluids, and components of pesticides and plastics. These chemicals are described as volatile because of their tendency to evaporate. They generally enter drinking water systems through spills and improper disposal. VOCs are monitored by all community and nontransient noncommunity PWS (including 2 purchased water systems) on one of three schedules based on source type and past monitoring history: one sample quarterly, one sample annually, or one sample in 3 years. During 2005, 898 public water systems were required to sample at least once for VOCs. A significant difference to note between monitoring for VOCs and other contaminant groups is that every time a PWS samples for VOCs, they are required to have the sample analyzed for all 21 regulated VOC compounds using one analytical method which scans for all of the compounds. So, for each missed VOCs sample, a PWS would have 21 violations for the regulated VOC compounds. This creates an artificially high number of violations for the VOCs group as well as the total number of violations issued in Ohio. There are 777 individual VOC compound M/R violations. This really represents 37 VOCs samples which were not collected. There were 32 of the 898 public water systems required to sample during 2005 that failed to collect one or more samples which resulted in a M/R violation. Overall compliance for the VOC M/R is 96 percent, up from 95 percent in 2004. Approximately 53 percent of the VOC M/R violations were associated with nontransient noncommunity systems. Of those public water systems with a VOC M/R violation, 78 percent were associated with water systems serving less than 500 people. One system exceeded one of the VOC MCLs.

VOC Contaminant Group Highlights

- ▶ 898 public water systems required to collect VOC samples
- ▶ 99.8 percent compliance with all VOC MCLs
- ▶ 96.4 percent of the public water systems are in compliance for the VOC M/R category
- ▶ 777 individual VOC violations
- ▶ 78 percent of the VOC M/R violations occurred at PWS serving less than 500 people

SOCs, which includes primarily pesticides, are monitored by all community and nontransient noncommunity PWS (and 2 purchased water systems). Some of the SOCs are monitored more often than others because they are used in large quantities on Ohio farm fields, like alachlor, atrazine, and simazine. Based on Ohio's pesticide study, some systems are required to monitor more frequently during time periods which are most likely to see occurrence of the contaminants.

Ground water systems monitor for alachlor, atrazine, and simazine at least once every three years. If a ground water system has a detection for one of these SOCs, they are required to monitor at a minimum on a quarterly basis.

Because Ohio's surface water systems are more vulnerable to pesticide contamination, they are required to monitor for alachlor, atrazine, and simazine every year at a much greater frequency, including every-other-week May thru July for systems that have a history of elevated pesticide levels in their finished water.

All systems are required to monitor the remaining 14 SOCs once every three years if they have a mean nitrate measurement greater than 2 mg/L. Nitrate is used as an indicator of a system's susceptibility. Monitoring waivers are granted for systems that have a mean nitrate concentration less than or equal to 2 mg/L. The waivers are granted for a 3-year period and must be renewed when that period lapses.

During the 2005 calendar year, 1,973 public water systems were required to sample for one or more of the SOC compounds. There were 136 public water systems that failed to collect one or more SOC samples which resulted in a M/R violation. One public water system exceeded an SOC MCL during 2005. The overall M/R compliance rate for 2005 is 93 percent. It should be noted that 28 public water systems collected an SOC sample for endothall, but due to a problem at their contracted laboratory, results were not obtained. These systems received M/R violations due to the laboratory problem.

SOC Contaminant Group Highlights

- ▶ 1,973 public water systems required to sample for SOCs
- ▶ 99.9 percent compliance with all SOCs MCLs
- ▶ 93 percent of the public water systems were in compliance for all SOCs M/R
- ▶ 63 percent of the M/R violations occurred at PWS serving less than 500 people

TTHMs are classified as organic disinfection by-products. They are created when organic and inorganic compounds react with the disinfectant added to the water. (It is important to note that disinfectants are an important part of the control of water-borne pathogens.) TTHMs are sampled in the distribution systems of community and noncommunity PWS that treat their water with any combination of chlorine, chloramines, chlorine dioxide or ozone. Community water systems and nontransient noncommunity surface water systems serving less than 10,000 persons, and nontransient noncommunity ground water systems that disinfect were required to sample for TTHMs beginning in 2004.

During the 2005 calendar year, 1500 PWSs were scheduled to monitor quarterly for TTHMs. There were 90 systems that failed to monitor, and 53 systems exceeded the MCL of 0.080 milligrams per liter (mg/L). Compliance with the TTHM MCL is determined by calculating a running annual average at the end of each quarter. Some people who drink water containing TTHMs in excess of the MCL over many years may experience problems with their liver, kidneys, or central nervous system, and may have an increased risk of getting cancer.

HAAs are another class of organic disinfection by-products that form when a disinfectant reacts with organic matter in the water. Community water systems and nontransient noncommunity surface water systems serving less than 10,000 persons, and nontransient noncommunity ground water systems that disinfect were required to sample for HAAs beginning in 2004.

During the 2005 calendar year, 1500 PWSs were scheduled to monitor quarterly for haloacetic acids. There were 105 systems that failed to monitor for haloacetic acids, and 10 systems exceeded the MCL of 0.060 mg/L.

TTHMs and HAAs Contaminant Group Highlights

- ▶ 1500 public water systems required to sample for TTHMs
- ▶ 1500 public water systems required to sample for HAAs
- ▶ 96.4 percent compliance with the TTHMs MCL
- ▶ 99.3 percent compliance with the HAAs MCL
- ▶ 94 percent compliance for TTHMs M/R
- ▶ 93 percent compliance for HAAs M/R

Figures 2 and 3 show VOCs, SOCs, TTHMs, and HAAs violation numbers by population categories and system types, respectively. For specific information on each contaminant, such as the number of PWSs required to sample a contaminant in 2005 and how many violations occurred for that contaminant, please refer to the Appendix A Compliance Table.

Figure 2.


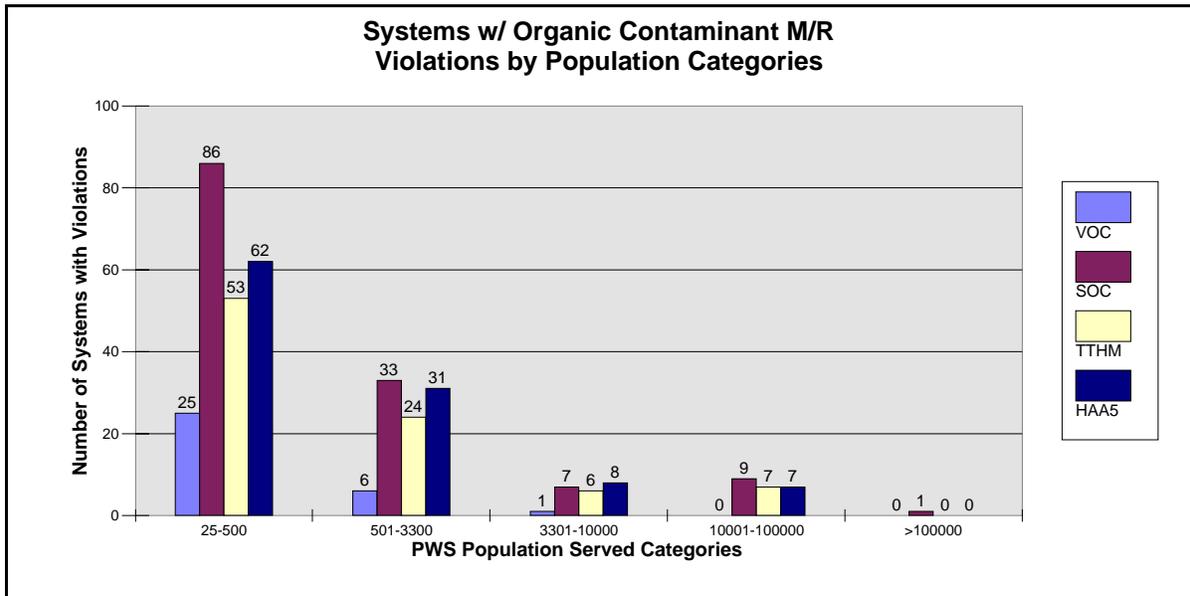


Figure 3.

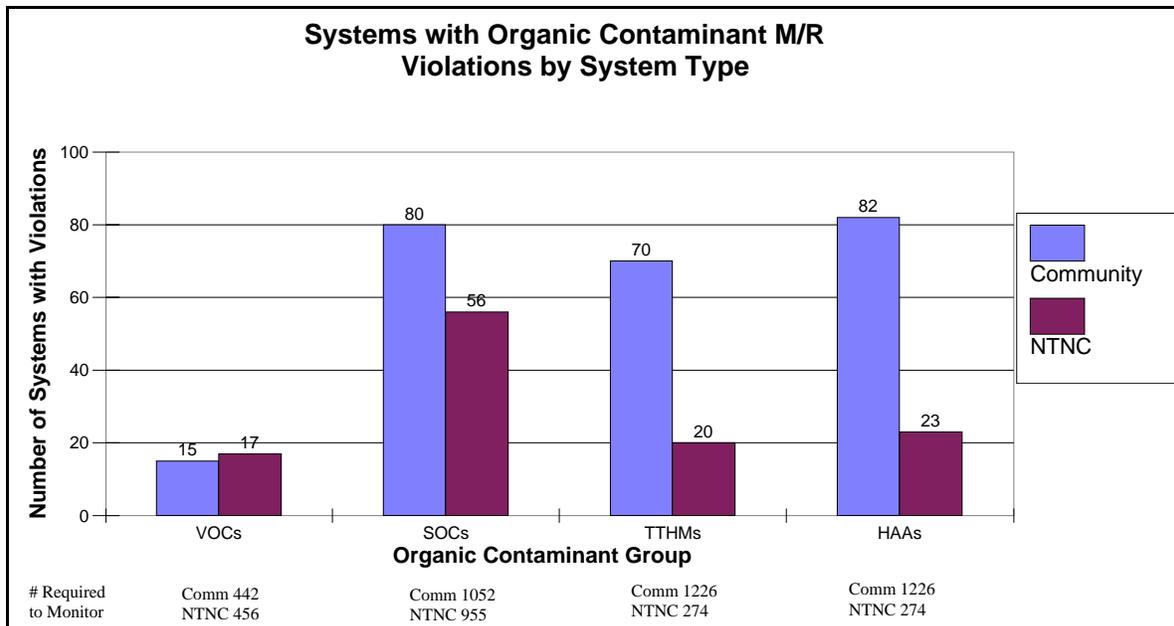

Inorganic Contaminants

The inorganic contaminant group summarized in the Appendix A Compliance Table includes metals (e.g. chromium, cadmium, mercury, etc.) and non-metal contaminants (e.g. asbestos, cyanide, nitrate, etc.). Many of these naturally occurring chemicals are also used in different manufacturing processes. Nitrate

and nitrite are separated out as a group from the other IOCs for monitoring purposes and they are discussed in a separate section below. Both IOCs and Nitrate/Nitrite violation numbers are shown in Figures 4 and 5.

Except for nitrate and nitrite, IOCs are monitored by all community and nontransient noncommunity PWS (and 2 purchased systems). Most IOCs are monitored by surface water systems on an annual basis and by ground water systems once in 3 years. One exception is asbestos, which is monitored once in 9 years. During the 2005 calendar year, 681 public water systems were required to sample for at least one of the 13 individual IOC compounds. The overall M/R compliance rate for the IOCs contaminant group is 96 percent, up from 95 percent in 2004. Of the 26 water systems with an IOCs M/R violation, approximately 58% were community water systems, and 42% were noncommunity water systems. However, 69 percent of all violations were associated with water systems serving less than 500 people. One system exceeded the arsenic MCL (0.05 mg/L). Arsenic is a naturally occurring element that can cause skin damage, circulatory problems and cancer.

IOC Contaminant Group Highlights

- ▶ 681 public water systems were required to sample for at least one IOCs
- ▶ 99.7 percent compliance with all IOCs MCLs
- ▶ 96 percent of the public water systems were in compliance for IOCs M/R
- ▶ 69 percent of the M/R violations were associated with public water systems serving fewer than 500 people

Nitrate/Nitrite

Nitrate contamination of drinking water usually results from runoff of agricultural fertilizers, or from human or animal wastes, such as feedlots or faulty septic systems. Nitrite is the reduced form of nitrate, and is usually found in nature at lower levels than nitrate. Nitrate is monitored by all CWS, NTNC, and TNC PWS (and 2 purchased systems). Nitrate is monitored monthly by surface water systems, ground water systems under the direct influence of surface water, and by systems using treatment to remove nitrate. Ground water systems monitor annually for nitrate. Some ground water systems may be monitoring quarterly for nitrate based upon the levels reported in previous sampling. All transient systems were required to monitor for nitrite during 2005. Occurrence of nitrate, nitrite or nitrate/nitrite may require the systems to do additional monitoring. During the 2005 calendar year, 5,038 water systems were required to monitor for nitrate and 3101 water systems were required to monitor for nitrite.

The compliance rate for nitrate M/R during 2005 is 93 percent (93 percent in 2004), and 87 percent for nitrite (down from 97 percent in 2004). The drop in the nitrite compliance was due to the fact that all transient systems, which have the most difficulty complying with the monitoring requirements, were required to monitor for nitrite in 2005 (community and nontransient systems monitored in 2004). Of the 331 water systems with a nitrate violation during the 2005 calendar year, 86 percent were issued to transient water systems and approximately 94 percent of the violations were associated with systems serving fewer than 500 people.

During the 2005 calendar year, 19 nitrate MCL violations occurred at 10 water systems. There were no MCL violations for nitrite during 2005. Infants below the age of six months who drink water containing nitrate or nitrite in excess of the MCL could become seriously ill and if untreated, may die. Symptoms include shortness of breath and blue-baby syndrome.

Nitrate/Nitrite Contaminant Group Highlights

- ▶ 5038 public water systems were required to sample for nitrate and 3101 for nitrite
- ▶ 99.8 percent compliance rate for nitrate MCLs
- ▶ 100 percent compliance rate for nitrite MCLs
- ▶ 19 nitrate MCL violations occurred at 10 water systems
- ▶ 93 percent of the public water systems were in compliance for nitrate M/R
- ▶ 87 percent of the public water systems required to monitor were in compliance for nitrite M/R
- ▶ 94 percent of the nitrate M/R violations were associated with public water systems serving fewer than 500 people

For specific information on each contaminant, such as the number of PWS required to sample a contaminant in 2005 and how many violations occurred for that contaminant, please refer to Appendix A-Compliance Table.

Figure 4.


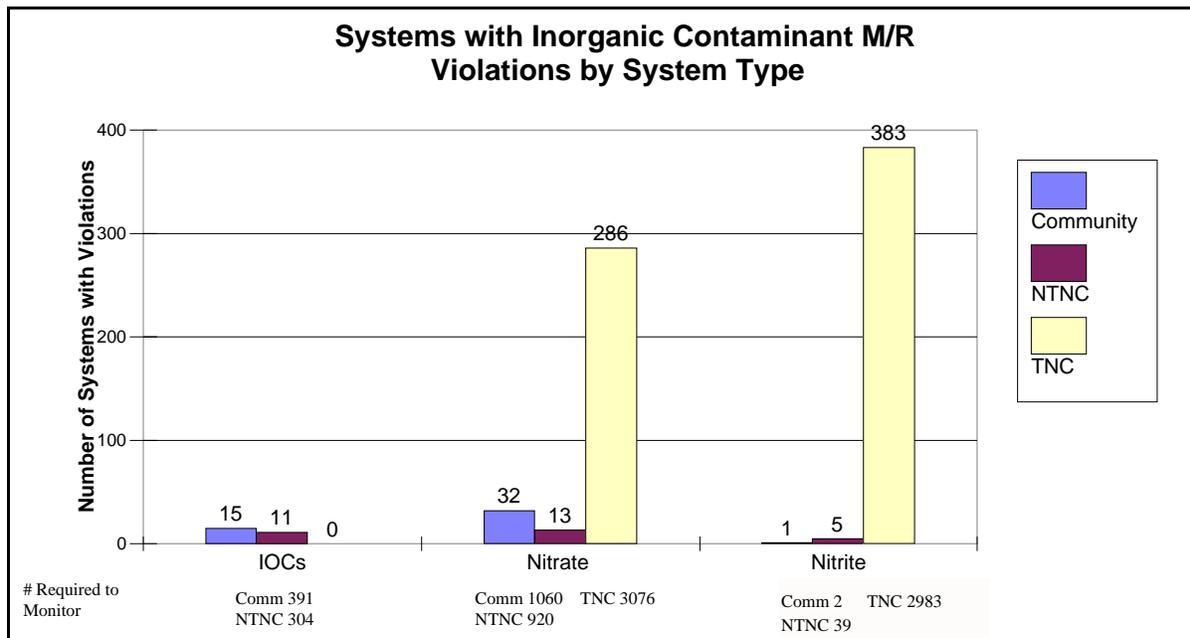


Figure 5.

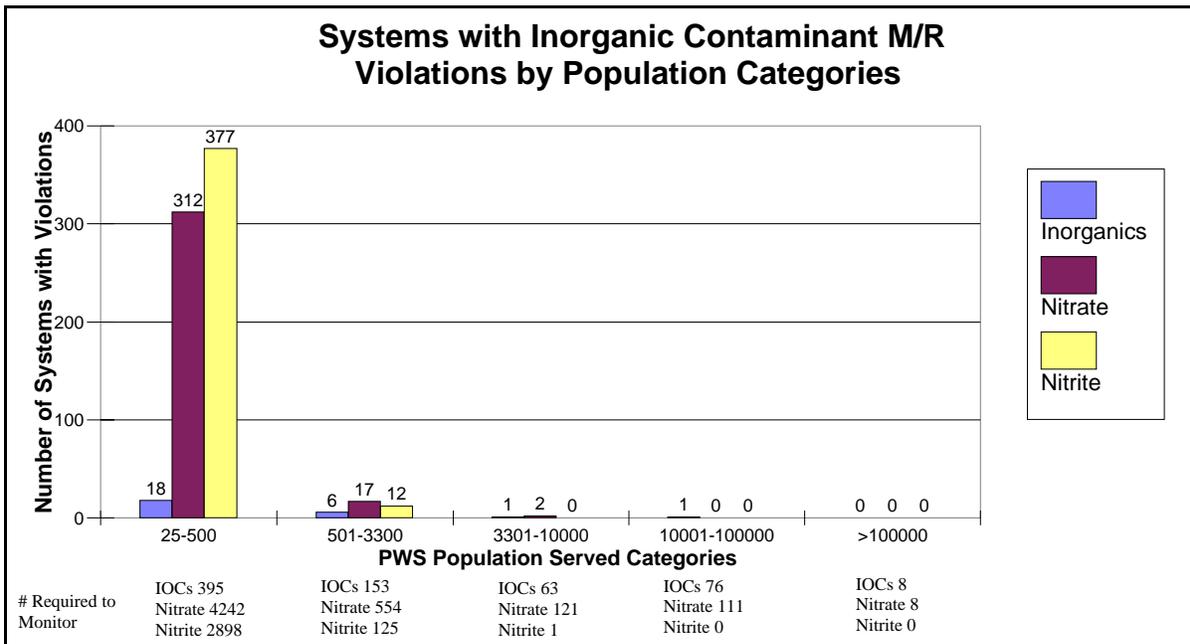

Radionuclide Contaminants

The radionuclide group, which includes the contaminants gross alpha, gross beta, radium-226 and radium-228, and uranium, occurs from the erosion or decay of natural and manmade deposits. Drinking water containing radionuclide contaminants in excess of the MCL may increase the risk of getting cancer. Radium-226 is only monitored individually when a PWS exceeds the gross alpha action level of 5 pCi/L or if the total alpha and radium-226 exceeds 5 pCi/L.


Radionuclides are monitored by all community PWSs (including 2 purchased systems). Initially, systems monitor for radionuclides quarterly, unless they qualified for reduced monitoring at three, six, or nine year intervals. If the MCL is exceeded, systems must perform quarterly monitoring. During the 2005 calendar year, 93 water systems were required to monitor for radionuclides. The overall radionuclide MCL compliance rate is 100 percent. The overall compliance rate for radionuclide M/R is 84 percent. Of the 15 public water systems that had M/R violations during the 2005 calendar year, 93 percent were associated with systems serving fewer than 500 people.

Radionuclides Contaminant Group Highlights

- ▶ 93 public water systems were required to sample for radionuclides
- ▶ 100 percent compliance rate for radionuclide MCLs
- ▶ 84 percent of the water systems were in compliance for radionuclides M/R
- ▶ 93 percent of the M/R violations were associated with public water systems serving fewer than 500 people

For specific information on each contaminant, such as the number of PWSs required to sample a contaminant in 2005 and how many violations occurred for that contaminant, please refer to Appendix A.

Figure 6.

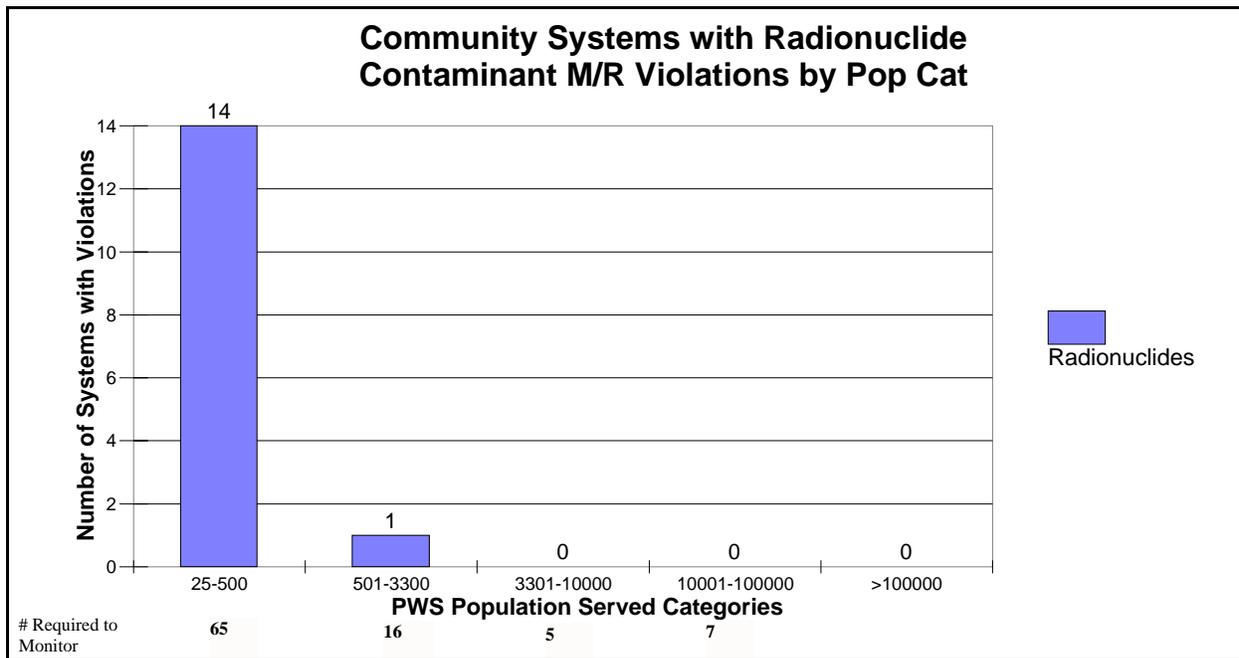

Total Coliform Regulations

Total coliform monitoring is used to determine if microbiological contaminants are present in drinking water. Total coliform is a family of bacteria which contain pathogenic as well as harmless organisms. Fecal coliform and *E. coli* bacteria are specific types of coliform bacteria which are associated with animal waste and present an acute human health threat. Microbiological pathogens can cause gastrointestinal illness and pose a special risk to children, the elderly and those individuals with suppressed immune systems. In Ohio, a total coliform (TC) test is used initially as a screening to indicate whether or not microbiological contaminants may be present. If a sample is TC positive (total coliform bacteria is present), further analysis for either fecal coliform or *E. coli* and the collection of additional samples are required to determine if potentially harmful contamination is present. TC is monitored by all PWSs. The frequency of TC testing and the number of samples collected is dependent upon the type of PWS, the population served and source type. Sampling requirements range from as few as one TC sample per quarter for small TNC water systems to hundreds of TC samples per month for large community water systems. Ohio's minimum monitoring requirements of one sample per quarter can be up to four times as frequent as the federal requirements. Two types of MCL violations, acute and non-acute, are associated with the total coliform regulations. An acute violation occurs when more than one sample is total coliform positive and at least one sample contains *E. coli* or fecal coliform bacteria. An acute violation also occurs in Ohio when an insufficient number of samples are collected following one or more TC positive samples (this is more stringent than federal requirements). Non-acute MCL violations occur when greater than 5 percent (or 2 or more samples if collecting less than 40 samples per month) of all the samples collected during a month are TC positive.

During the 2005 calendar year, the compliance rate for TC acute MCL violations was 96 percent (96% in 2004) and 94 percent for non-acute MCL violations (94% in 2004). Of the 423 water systems with TC MCL violations, 79 percent were associated with TNC water systems, and 93 percent were associated

with water systems serving less than 500 people. The majority of acute MCL violations can be attributed to Ohio assigning an acute MCL violation to a water system failing to collect a sufficient number of samples following a positive total coliform sample. Creating an additional acute MCL violation is most protective of public health, but results in higher numbers of acute MCL violations for Ohio. Of the 5,392 PWSs sampling for total coliform, approximately 96 (or 2 percent) detected *E. coli* or fecal coliform.

Major routine and follow-up M/R violations for the TC regulations are incurred by water systems when they fail to sample or report all of the required samples during a given monitoring period. Of the water systems with one or more major routine and follow-up M/R violations, 81 percent were associated with TNC water systems and 95 percent were associated with water systems serving less than 500 people.

Total Coliform Contaminant Group Highlights

- ▶ 5,392 public water systems were required to sample for TC
- ▶ 96 percent compliance with the acute MCL
- ▶ 94.3 percent compliance with the non-acute MCL
- ▶ 83 percent compliance with the TC M/R requirements (81% in 2004)
- ▶ 95 percent of the M/R violations and 93 percent of MCL violations were associated with public water systems serving fewer than 500 people, mostly TNC water systems

Figure 7.


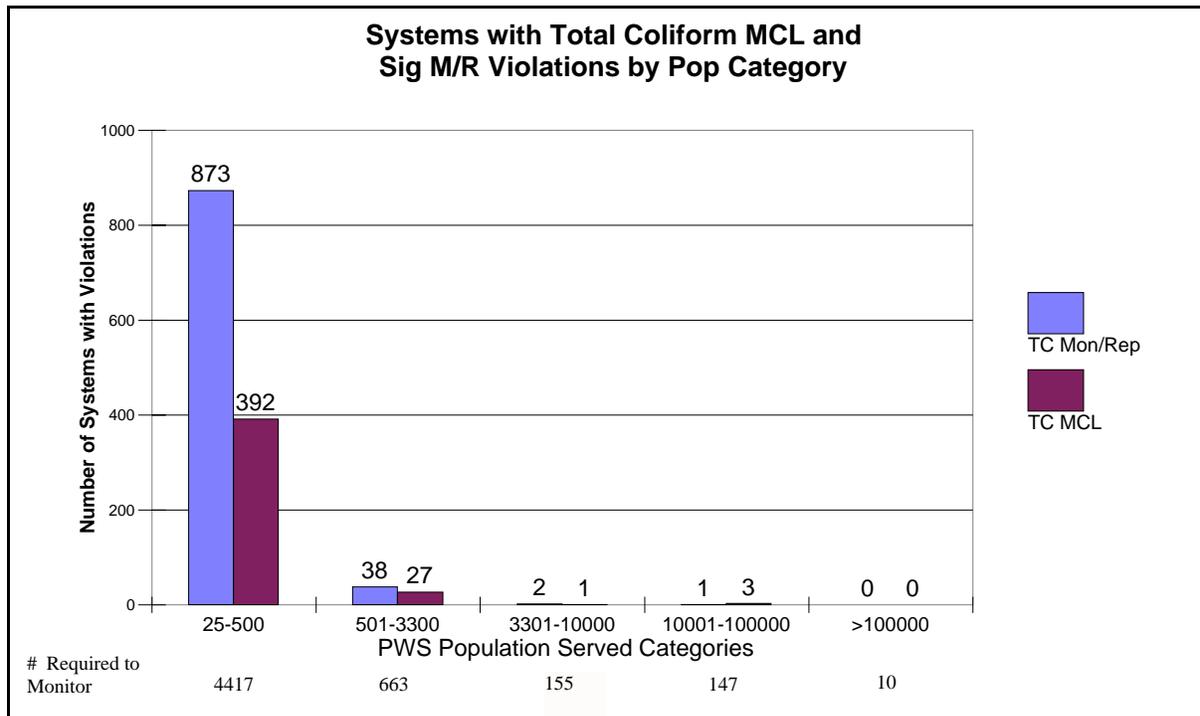


Figure 8.

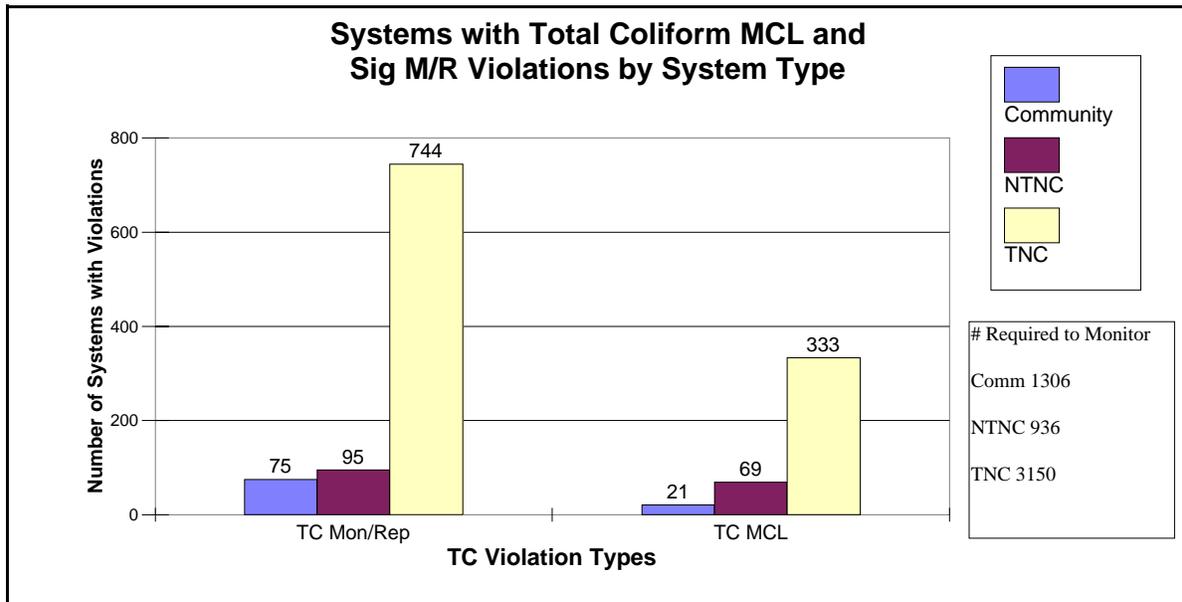

Surface Water Treatment Regulations

The surface water treatment regulations (SWTR) in Ohio establish treatment and monitoring standards for water systems that have sources designated as surface water or ground water under the direct influence of surface water. Ground water under the direct influence (GUDI) of surface water are systems that use wells to obtain their water, but the water quality is subject to the influence of surface water. GUDI systems have 18 months, by rule, to eliminate the causes of the GUDI designation or install surface water treatment. The influence of surface water can be from unacceptably constructed wells to the type of aquifer from which the system is drawing. Public water systems subject to these regulations are required to provide filtration and disinfection of the water. The surface water treatment requirements are designed to inactivate, kill or remove pathogens found in surface water. Microbiological pathogens can cause gastrointestinal illness and pose a special risk to children, the elderly and those individuals with suppressed immune systems. Water quality tests are performed on the water to ensure treatment is being maintained at a level that should prevent contamination. Tests include evaluation and measurement of sufficient chlorination contact time, filtration type and effectiveness, turbidity levels, and residual chlorine levels in the distribution system. Failure to meet one or more of these standards results in a monthly treatment technique (TT) violation. During the 2005 calendar year, 143 water systems were subject to the SWTR TT and M/R requirements. The overall SWTR TT compliance rate is 83 percent (81% in 2004). The majority of water systems with these violations are the systems designated ground water under the direct influence of surface water (GUDI). The overall compliance rate for SWTR M/R is 97 percent. Of the 25 water systems with a TT violation during the 2005 calendar year, 48 percent were associated with systems serving fewer than 500 people.

SWTR Contaminant Group Highlights

- ▶ 143 public water systems were subject to the SWTR monitoring and treatment requirements
- ▶ 83 percent of the public water systems were in compliance with the TT requirements
- ▶ 97 percent of water systems which provide treatment were in compliance with the SWTR M/R requirements
- ▶ 48 percent of the water systems with a TT violations were associated with water systems serving fewer than 500 people

Figure 9.


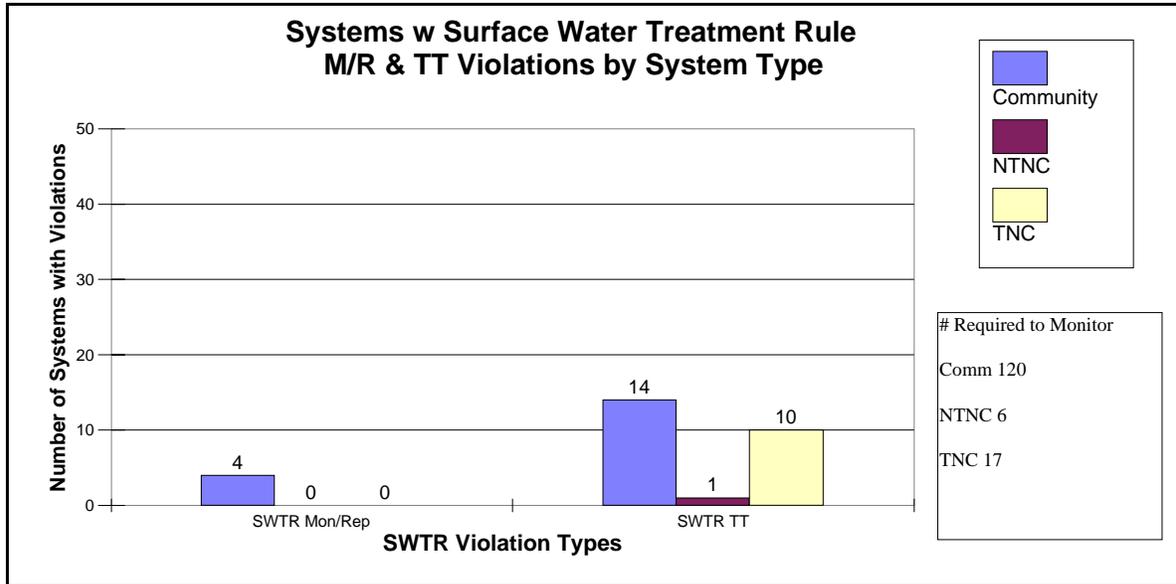


Figure 10.

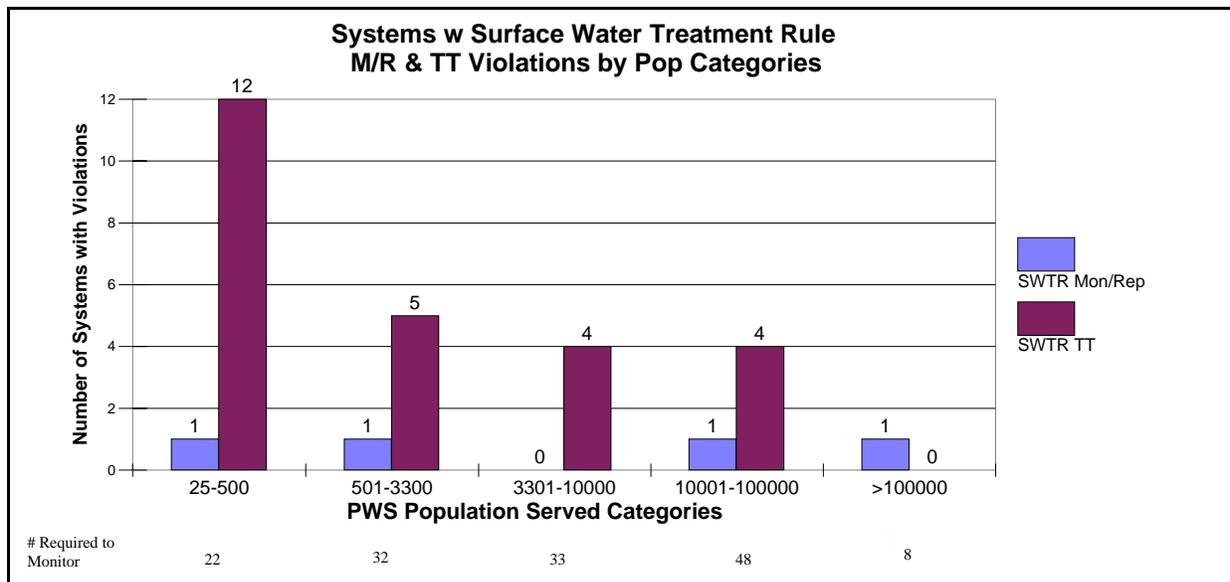

Lead and Copper Regulations

The lead and copper regulations in Ohio establish standards for levels of lead and copper in the distribution systems of community and nontransient noncommunity public water systems. Although lead and copper are found in natural deposits, they typically enter tap water through corrosion of plumbing materials. During the beginning phases of monitoring, these public water systems are required to perform initial monitoring during two consecutive six month periods. Following completion of these periods, routine annual or triennial monitoring periods are required. For the 2005 calendar year, 98 water systems were required to perform initial monitoring and 951 systems were required to perform either annual or triennial monitoring. In addition, 17 systems were required to perform public education notification due to an exceedance of the lead action level. Lead can affect the physical and mental development in children, as well as cause kidney problems and high blood pressure in adults. The overall compliance for lead and copper monitoring is 88 percent. Of the 124 water systems with lead and copper violations, 81 percent were associated with systems serving fewer than 500 people.

Lead and Copper Contaminant Group Highlights

- ▶ 1049 public water systems were required to perform initial, annual or triennial monitoring and public education requirements
- ▶ 88 percent of water systems were in compliance with the lead and copper M/R requirements
- ▶ 81 percent of the water systems with a lead and copper M/R violation were associated with public water systems serving fewer than 500 people
- ▶ 2 percent of water systems exceeded the lead action level

Figure 11.


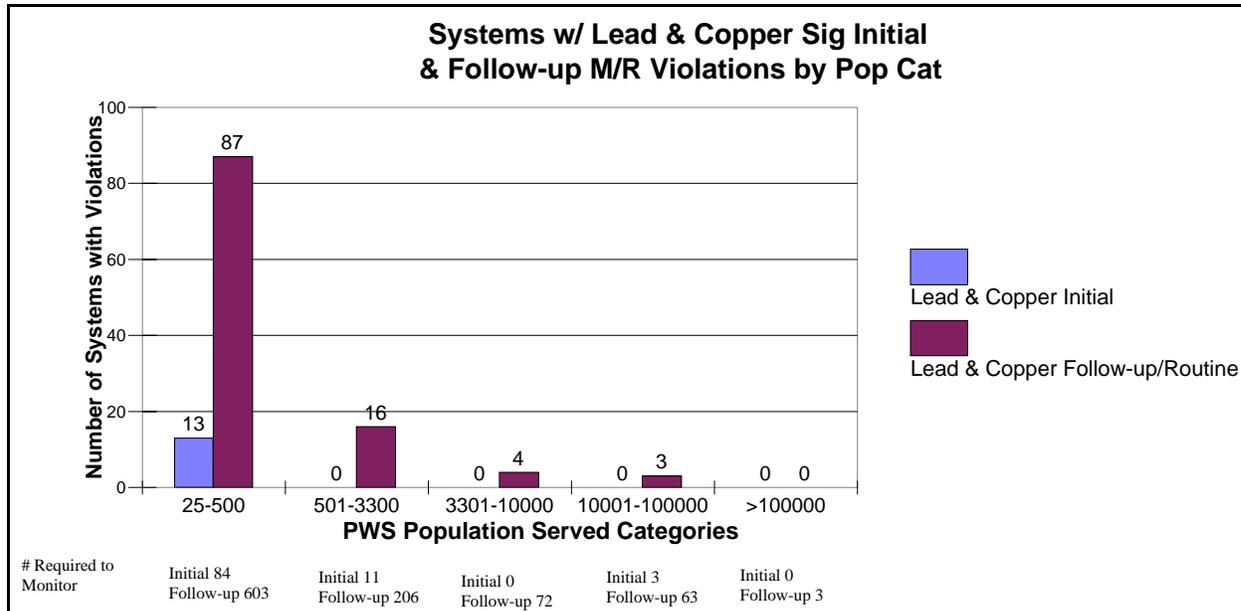


Figure 12.

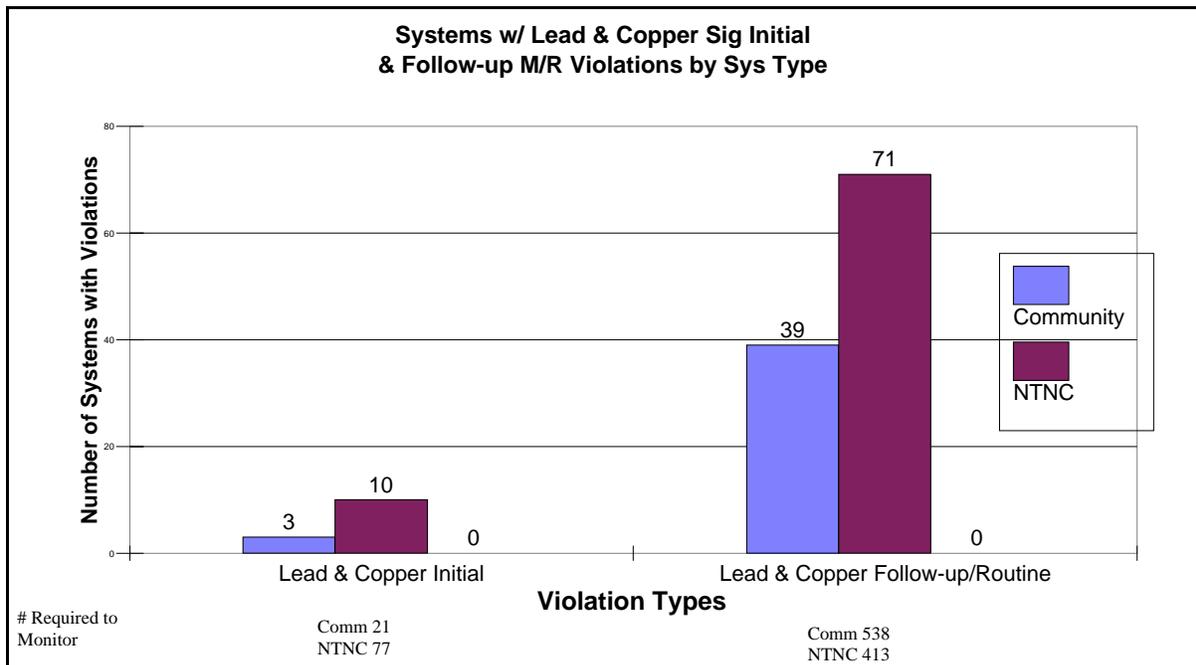


Consumer Confidence Reports

Every Community Water System is required to deliver to its customers a Consumer Confidence Report (CCR). This report is to include some educational material, provide information on the source water, levels of any detected contaminants, and compliance with drinking water regulations. A significant public notification violation occurred if a community water system completely failed to provide its customers the required annual water quality report. A total of 1,306 community water systems were required to provide their customers with a CCR. For the 2005 calendar year, 38 systems failed to provide this report in violation of these requirements, and 70 systems that provided a CCR did not include all the required content which resulted in a violation. Of the 101 systems failing to meet these requirements, 50 percent were communities serving less than 500 people. Figure 13 shows the breakdown of community water systems in violation by population served. The overall compliance for CCR requirements is 92 percent (91% in 2004).

Consumer Confidence Report Highlights

- ▶ 1,306 public water systems were subject CCR requirements
- ▶ 92 percent of the water systems were in compliance with the requirements
- ▶ 50 percent of the systems that had CCR notification violations were associated with systems serving less than 500 people

Figure 13.

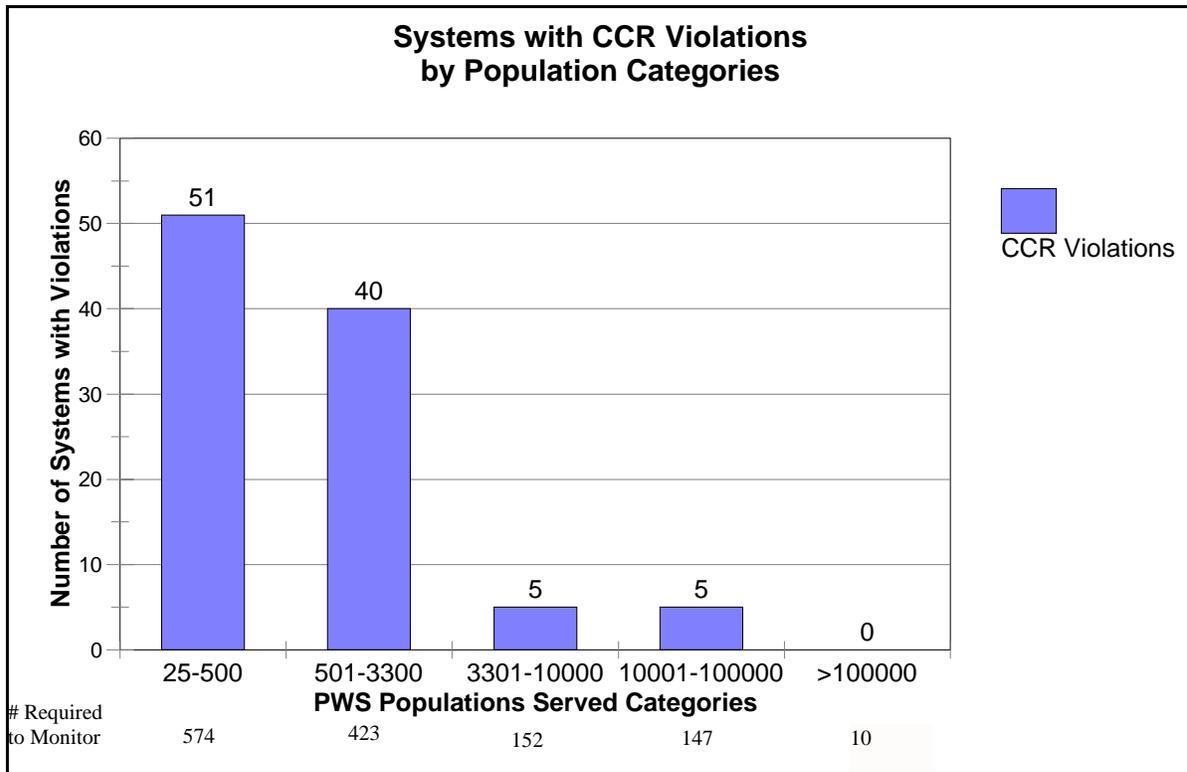

Compliance Summary

The large majority of Ohio’s public water systems continued to comply with federal health-based standards for drinking water in 2005. Overall compliance rates were similar or better than the compliance rates in 2004. Highlights for 2005 include:

- Ninety-nine percent of all public water systems met the chemical standards (99% in 2004);
- Ninety-two percent of all public water systems met the bacteriological standards (91% in 2004);
- Seventy-nine percent of all public water systems met their chemical monitoring/reporting requirements (89% in 2004);
- Eighty-three percent of all public water systems met their bacteriological monitoring/reporting requirements (81% in 2004);
- Eighty percent of the violations that occurred during 2005 were the result of public water systems failing to monitor or report in a timely fashion.
- Approximately eighty-five percent of the violations occurred at water systems serving fewer than 500 individuals.

- Sixty-three percent of the violations occurred at transient noncommunity systems (e.g. campgrounds; gas stations)
- Twelve percent of systems that monitor less frequently than quarterly submitted results after receiving a violation.

Ohio EPA's Public Water System Compliance Assistance

Ohio EPA employs various methods to assist public water systems in achieving compliance with the Safe Drinking Water Act regulations. Some of the methods that may be used include: providing a sampling and monitoring schedule for each public water system; offering technical assistance during facility inspections (sanitary surveys) and follow-up visits; assisting in investigations of contamination; performing investigatory monitoring; providing off-site assistance through phone calls and meetings; providing outreach training sessions for new rules and treatment; assistance in finding funding for projects; providing operator and laboratory personnel training sessions; distributing reminder postcards and/or contacting the water systems towards the end of the monitoring period to ensure collection of the required samples; and sending notice of violation letters for failure to meet the requirements for each specific regulation. The use of these methods is based on the availability of Ohio EPA personnel and resources.

In 2005, Ohio EPA expanded its technical assistance to small water systems. The reminder postcard program, which helped raise chemical monitoring compliance rates, was expanded to the bacteriological program. Ohio EPA continued using an automatic email system and the internet to head off violations before they were generated through contacts with the laboratories and public water systems. Ohio EPA is also looking at other ways to use its enforcement tools to address violations at the very small systems. Based on the differing needs of public water systems, Ohio EPA began a re-structuring of its program to better address compliance issues for community and noncommunity systems. These efforts are targeted to reducing the number of monitoring and reporting violations. As this report demonstrates, monitoring and reporting violations are the majority of Ohio's public water system violations. Ohio is working on improving its compliance, enforcement and inspection processes to specifically target and address non-compliant public water systems. Ohio anticipates implementation of the program improvements will eventually increase public water system compliance. However, it will take time to see the benefits of the improvements.

Listing of Maximum Contaminant Level and Treatment Technique Violations

Appendix B contains a listing of all violation types related to the MCL and TT regulation categories. The listing is ordered by water system identification number and violation date. Violation type or contaminant codes associated with the violations are defined in the Appendix A Compliance Summary Table. Included in the violation listing are enforcement action type codes (e.g. A, E, G, etc) associated with each violation. These are the particular actions the State of Ohio took to address each violation with the water system. Table 7 describes the enforcement action type codes used in Appendix B. Not all violations are required to have a compliance achieved enforcement action type code associated with them when a public water system has returned to compliance. In particular, the total coliform (code 3100) MCL violations listed do not have the returned to compliance enforcement code associated violations while almost all systems have returned to compliance. A return to compliance for these violations is determined by lack of subsequent on-going violations.

Table 7. Enforcement Action Type Code Descriptions

Enforcement Action Type Code	Description
A	Notice of Violation Letter sent to Public Water System
C	Technical Assistance Visit, Meeting, or Investigation
E	Request for System to Public Notice
F	Public Notice received from Public Water System
G	Ohio EPA News Release (Public Notice)
H	Boil Water Order
J	Division, Notice of Violation Warning Letter
K	Bilateral Compliance Agreement Signed
L	Administrative Order without penalty
O	Administrative Order with penalty
Q	Civil Case Filed
R	State Consent Decree or Consent Judgement
X	Compliance Achieved
9	Civil Case Referred to Attorney Generals Office

A list of violations can also be viewed using the Internet at U.S. EPA's site known as "Envirofacts". This Internet site provides access to a subset of data available from U.S. EPA's Safe Drinking Water Information System (SDWIS). Using the Envirofacts website allows the user to select by state, county, public system name, public water system identification number and population size to obtain general facility information and violation information for public water systems in Ohio. The Internet address for this Envirofacts site is http://www.epa.gov/enviro/html/sdwis/sdwis_query.html.

Summary and Report Availability & Contact Information

Ohio EPA will provide copies of the 2005 Annual Compliance Report to U.S.EPA, as well as post the report on the Division's web page at <http://www.epa.state.oh.us/ddagw/annualreports.html>. Copies of the 2005 annual report may also be obtained by writing to the State of Ohio at: PWS Annual Compliance Report, Ohio EPA - DDAGW, P.O. Box 1049, Columbus, OH 43216-1049.

In compliance with U.S. EPA's requirements, Ohio EPA will also notify the public of the availability of a summary of the 2005 annual report through the Drinking Water Advisory Committee, the Division of Drinking and Ground Waters rule list serve, and by making the summary available on the Division of Drinking Waters web site.

For further information concerning this report, you may contact Rick Magni or Todd Kelleher with the Ohio EPA Division of Drinking and Ground Waters at (614) 644-2752. If you have questions concerning the specific violations associated with individual water systems, contact your local Ohio EPA District Office in your region.

Scot Foltz
Ohio EPA
Central District Office
122 S Front Street
Columbus, Ohio 43215
(614) 728-3778

Janet Barth
Ohio EPA
Southeast District Office
2195 Front Street
Logan, Ohio 43138
(740) 385-8501

Jeff Davidson
Ohio EPA
Southwest District Office
401 East 5TH Street
Dayton, Ohio 45402
(937) 285-6357

Doug Scharp
Ohio EPA
Northwest District Office
347 N. Dunbridge Road
Bowling Green, Ohio 43402
(419) 352-8461

Nancy Rice
Ohio EPA
Northeast District Office
2110 E. Aurora Road
Twinsburg, Ohio 44087
(330) 963-1200

APPENDIX A:

COMPLIANCE SUMMARY TABLE

State: OHIO
Reporting JANUARY 1, 2005 - Interval: DECEMBER 31, 2005

SDWIS Codes	Contaminant	MCL (mg/L) ¹	Number of Systems Required to Sample during 2005	MCLs			Significant Monitoring/Reporting					
				Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance			
	Organic Contaminants											
2981	1,1,1-Trichloroethane	0.2	898	0	0	100.0%				37	32	96.4%
2977	1,1-Dichloroethylene	0.007	898	0	0	100.0%				37	32	96.4%
2985	1,1,2-Trichloroethane	0.005	898	0	0	100.0%				37	32	96.4%
2378	1,2,4-Trichlorobenzene	0.07	898	0	0	100.0%				37	32	96.4%
2931	1,2-Dibromo-3-chloropropane (DBCP)	0.0002	0	N/A	N/A	N/A				N/A	N/A	N/A
2980	1,2-Dichloroethane	0.005	898	0	0	100.0%				37	32	96.4%
2983	1,2-Dichloropropane	0.005	898	0	0	100.0%				37	32	96.4%
2063	2,3,7,8-TCDD (Dioxin)	3x10 ⁻⁸	0	N/A	N/A	N/A				N/A	N/A	N/A
2110	2,4,5-TP	0.05	0	N/A	N/A	N/A				N/A	N/A	N/A
2105	2,4-D	0.07	1	0	0	100.0%				0	0	100.0%
2265	Acrylamide						N/A	N/A	N/A			
2051	Alachlor	0.002	1973	0	0	100.0%				104	89	95.5%
2050	Atrazine	0.003	1973	0	0	100.0%				105	89	95.5%
2990	Benzene	0.005	898	0	0	100.0%				37	32	96.4%
2306	Benzo[a]pyrene	0.0002	182	0	0	100.0%				19	19	89.6%
2046	Carbofuran	0.04	0	N/A	N/A	N/A				N/A	N/A	N/A
2982	Carbon tetrachloride	0.005	898	0	0	100.0%				37	32	96.4%
2959	Chlordane	0.002	0	N/A	N/A	N/A				N/A	N/A	N/A
2380	cis-1,2-Dichloroethylene	0.07	898	0	0	100.0%				37	32	96.4%
2031	Dalapon	0.2	0	N/A	N/A	N/A				N/A	N/A	N/A
2035	Di(2-ethylhexyl)adipate	0.4	183	0	0	100.0%				19	19	89.6%
2039	Di(2-ethylhexyl)phthalate	0.006	222	0	0	100.0%				19	19	91.4%
2964	Dichloromethane	0.005	898	0	0	100.0%				37	32	96.4%
2041	Dinoseb	0.007	0	N/A	N/A	N/A				N/A	N/A	N/A
2032	Diquat	0.02	3	0	0	100.0%				0	0	100.0%
2033	Endothall	0.1	182	0	0	100.0%				43	43	76.4%

State: OHIO
Reporting JANUARY 1, 2005 - Interval: DECEMBER 31, 2005

SDWIS Codes	Contaminant	MCL (mg/L) ¹	Number of Systems Required to Sample during 2005	MCLs			Significant Monitoring/Reporting					
				Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance			
2005	Endrin	0.002	0	N/A	N/A	N/A				N/A	N/A	N/A
2257	Epichlorohydrin						N/A	N/A	N/A			
2992	Ethylbenzene	0.7	898	0	0	100.0%				37	32	96.4%
2946	Ethylene dibromide	0.00005	0	N/A	N/A	N/A				N/A	N/A	N/A
2034	Glyphosate	0.7	0	N/A	N/A	N/A				N/A	N/A	N/A
2065	Heptachlor	0.0004	0	N/A	N/A	N/A				N/A	N/A	N/A
2067	Heptachlor epoxide	0.0002	0	N/A	N/A	N/A				N/A	N/A	N/A
2274	Hexachlorobenzene	0.001	0	N/A	N/A	N/A				N/A	N/A	N/A
2042	Hexachlorocyclopentadiene	0.05	0	N/A	N/A	N/A				N/A	N/A	N/A
2010	Lindane	0.0002	0	N/A	N/A	N/A				N/A	N/A	N/A
2015	Methoxychlor	0.04	0	N/A	N/A	N/A				N/A	N/A	N/A
2989	Monochlorobenzene	0.1	898	0	0	100.0%				37	32	96.4%
2968	o-Dichlorobenzene	0.6	898	0	0	100.0%				37	32	96.4%
2969	p-Dichlorobenzene	0.075	898	0	0	100.0%				37	32	96.4%
2383	Total polychlorinated biphenyls	0.0005	1	1	1	0.0%				0	0	100.0%
2326	Pentachlorophenol	0.001	2	0	0	100.0%				0	0	100.0%
2987	Tetrachloroethylene	0.005	898	2	1	99.9%				37	32	96.4%
2984	Trichloroethylene	0.005	898	0	0	100.0%				37	32	96.4%
2996	Styrene	0.1	898	0	0	100.0%				37	32	96.4%
2991	Toluene	1	898	0	0	100.0%				37	32	96.4%
2979	trans-1,2-Dichloroethylene	0.1	898	0	0	100.0%				37	32	96.4%
2955	Xylenes (total)	10	898	0	0	100.0%				37	32	96.4%
2020	Toxaphene	0.003	0	N/A	N/A	N/A				N/A	N/A	N/A
2036	Oxamyl (Vydate)	0.2	0	N/A	N/A	N/A				N/A	N/A	N/A
2040	Picloram	0.5	0	N/A	N/A	N/A				N/A	N/A	N/A
2037	Simazine	0.004	1973	0	0	100.0%				103	88	95.5%
2976	Vinyl chloride	0.002	898	0	0	100.0%				37	32	96.4%

State: OHIO
Reporting JANUARY 1, 2005 - Interval: DECEMBER 31, 2005

SDWIS Codes	Contaminant	MCL (mg/L) ¹	Number of Systems Required to Sample during 2005	MCLs			Significant Monitoring/Reporting					
				Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance
2920	Total Organic Carbon		117				8	2	98.3%	8	6	94.9%
2456	Haloacetic Acids (HAA5)	0.60	1500	19	10	99.3%				108	105	93.0%
2950	Total trihalomethanes	0.800	1500	149	53	96.5%				93	90	94.0%
	Inorganic Contaminants											
1074	Antimony	0.006	677	0	0	100.0%				21	21	96.9%
1005	Arsenic	0.05	680	1	1	99.9%				22	21	96.9%
1094	Asbestos	7 million fibers/L greater than or equal to 10 um long	1	0	0	100.0%				1	1	0.0%
1010	Barium	2	679	0	0	100.0%				21	21	96.9%
1075	Beryllium	0.004	677	0	0	100.0%				22	22	96.8%
1015	Cadmium	0.005	677	0	0	100.0%				21	21	96.9%
1020	Chromium	0.1	677	0	0	100.0%				21	21	96.9%
1024	Cyanide (as free cyanide)	0.2	677	0	0	100.0%				22	22	96.8%
1025	Fluoride	4.0	677	0	0	100.0%				23	23	96.6%
1035	Mercury	0.002	677	0	0	100.0%				21	21	96.9%
1040	Nitrate	10 (as Nitrogen)	5038	19	10	99.8%				399	331	93.4%
1041	Nitrite	1 (as Nitrogen)	3101	0	0	100.0%				389	389	87.5%
1045	Selenium	0.05	677	0	0	100.0%				21	21	96.9%
1085	Thallium	0.002	677	0	0	100.0%				21	21	96.9%
1038	Total nitrate and nitrite	10 (as Nitrogen)	N/A	N/A	N/A	N/A				N/A	N/A	N/A
	Radionuclide MCLs											
4000	Gross alpha	15 pCi/L	93	0	0	100.0%				23	15	83.9%
4010	Radium-Total (226, 228)	5 pCi/L	93	0	0	100.0%				0	0	100.0%
4030	Radium 228	N/A	N/A	N/A	N/A	N/A				N/A	N/A	N/A

State: OHIO
Reporting JANUARY 1, 2005 - Interval: DECEMBER 31, 2005

SDWIS Codes	Contaminant	MCL (mg/L) ¹	Number of Systems Required to Sample during 2005	MCLs			Significant Monitoring/Reporting					
				Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance
4006	Uranium	30 ug/L	0	N/A	N/A	N/A				N/A	N/A	N/A
4100	Gross beta	4 mrem/yr	0	N/A	N/A	N/A				N/A	N/A	N/A
	All Chemical Groups Totals		5392	191	75	98.6%				2487	1129	79.1%

Total Coliform Rule												
21	Acute MCL violation	Presence	5392	235	214	96.0%						
22	Non-acute MCL violation	Presence	5392	367	307	94.3%						
23, 25	Major routine and follow up monitoring		5392							1332	914	83.0%
28	Sanitary survey ²									N/A	N/A	N/A
	TCR Totals		5392	602	423	92.2%				1332	914	83.0%

Surface Water Treatment												
Filtered systems												
36	Monitoring		143							7	4	97.2%
41	Treatment techniques		143				87	19	86.7%			
Unfiltered systems												
31	Monitoring		143							1	1	99.3%
42	Failure to filter		143				12	6	95.8%			
	SWTR Totals		143				99	25	82.5%	7	4	97.2%
Interim Enhanced SWTR												
44	Treatment techniques		143				15	8	94.4%			
38	Monitoring		143							30	11	92.3%
	IESWTR Totals		143				15	8	94.4%	30	11	92.3%

Lead and Copper Rule												

State: OHIO
Reporting JANUARY 1, 2005 - Interval: DECEMBER 31, 2005

SDWIS Codes	Contaminant	MCL (mg/L) ¹	Number of Systems Required to Sample during 2005	MCLs			Significant Monitoring/Reporting					
				Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance			
51	Initial lead and copper tap M/R		98						21	15	84.7%	
52	Follow-up or routine lead and copper tap M/R		951						110	109	88.5%	
58, 62	Treatment Installation		NA				NA	NA	NA			
65	Public education		17				1	1	94.1%			
	Lead & Copper Totals		1066				1	1	94.1%	131	124	88.0%

SDWIS Codes	MCL (mg/L) ¹	Systems Required to Sample during 2004	CCR Notifications		
			Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance
	Consumer Confidence Report (CCR):				
71	Report Violation	1,306	38	38	97.1%
72	Adequacy, Delivery, Content	1,306	70	70	94.6%
	CCR Totals	1,306	108	101	92.3%

1. Values are in milligrams per liter (mg/L), unless otherwise specified.
2. Number of major monitoring violations for sanitary survey under the Total Coliform Rule.

Definitions for Violations Table

The following definitions apply to the Summary of Violations table.

NA: Not Applicable, no requirements for 2005, compliance rate is not calculated.

State: OHIO
Reporting JANUARY 1, 2005 - Interval: DECEMBER 31, 2005

SDWIS Codes	Contaminant	MCL (mg/L) ¹	Number of Systems Required to Sample during 2005	MCLs			Significant Monitoring/Reporting					
				Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance

Consumer Confidence Report: Requires every Community Water System to deliver to its customers a brief annual water quality report. This report is to include some educational material, and will provide information on the source water, the levels of any detected contaminants, and compliance with drinking water regulations.

Significant Consumer Notification Violations: SDWIS Violation Code 71 occurs when a community water system completely fails to provide its customers the required annual water quality report.

Filtered Systems: Water systems that have installed filtration treatment [40 CFR 141, Subpart H].

Inorganic Contaminants: Non-carbon-based compounds such as metals, nitrates, and asbestos. These contaminants are naturally-occurring in some water, but can get into water through farming, chemical manufacturing, and other human activities. EPA has established MCLs for 15 inorganic contaminants [40 CFR 141.62].

Lead and Copper Rule: This rule established national limits on lead and copper in drinking water [40 CFR 141.80-91]. Lead and copper corrosion pose various health risks when ingested at any level, and can enter drinking water from household pipes and plumbing fixtures. States report violations of the Lead and Copper Rule in the following six categories:

Initial lead and copper tap M/R: SDWIS Violation Code 51 indicates that a system did not meet initial lead and copper testing requirements, or failed to report the results of those tests to the State.

Follow-up or routine lead and copper tap M/R: SDWIS Violation Code 52 indicates that a system did not meet follow-up or routine lead and copper tap testing requirements, or failed to report the results.

Treatment installation: SDWIS Violation Codes 58 AND 62 indicate a failure to install optimal corrosion control treatment system (58) or source water treatment system (62) which would reduce lead and copper levels in water at the tap. [One number is to be reported for the sum of violations in these two categories].

Public education: SDWIS Violation Code 65 shows that a system did not provide required public education about reducing or avoiding lead intake from water.

Maximum Contaminant Level (MCL): The highest amount of a contaminant that EPA allows in drinking water. MCLs ensure that drinking water does not pose either a short-term or long-term health risk. MCLs are defined in milligrams per liter (parts per million) unless otherwise specified.

Monitoring: EPA specifies which water testing methods the water systems must use, and sets schedules for the frequency of testing. A water system that does not follow EPA's schedule or methodology is in violation [40 CFR 141].

State: OHIO
Reporting JANUARY 1, 2005 - Interval: DECEMBER 31, 2005

SDWIS Codes	Contaminant	MCL (mg/L) ¹	Number of Systems Required to Sample during 2005	MCLs			Significant Monitoring/Reporting					
				Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance

States must report monitoring violations that are significant as determined by the EPA Administrator and in consultation with the States. For purposes of this report, significant monitoring violations are major violations and they occur when no samples are taken or no results are reported during a compliance period. A major monitoring violation for the surface water treatment rule occurs when at least 90% of the required samples are not taken or results are not reported during the compliance period.

Organic Contaminants: Carbon-based compounds, such as industrial solvents and pesticides. These contaminants generally get into water through runoff from cropland or discharge from factories. EPA has set legal limits on 54 organic contaminants that are to be reported [40 CFR 141.61].

Radionuclides: Radioactive particles which can occur naturally in water or result from human activity. EPA has set legal limits on the following types of radionuclides: radium-226 and radium-228 (combined), gross alpha, beta particle/photon radioactivity; and uranium [40 CFR 141]. Violations for these contaminants are to be reported using the following three categories:

Gross alpha: SDWIS Contaminant Code 4000 for alpha radiation above MCL of 15 picocuries/liter. Gross alpha includes radium-226 but excludes radon and uranium.

Combined radium-226 and radium-228: SDWIS Contaminant Code 4010 for combined radiation from these two isotopes above MCL of 5 pCi/L.

Gross beta: SDWIS Contaminant Code 4101 for beta particle and photon radioactivity from man-made radionuclides above 4 millirem/year.

Reporting Interval: The reporting interval for violations to be included in the PWS Annual Compliance Report is from January 1, 2005 through December 31, 2005.

SDWIS Code: Specific numeric codes from the Safe Drinking Water Information System (SDWIS) have been assigned to each violation type included in this report. The violations to be reported include exceeding contaminant MCLs, failure to comply with treatment requirements, and failure to meet monitoring and reporting requirements. Four-digit SDWIS Contaminant Codes have also been included in the chart for specific MCL contaminants.

Surface Water Treatment Rule: The Surface Water Treatment Rule establishes criteria under which water systems supplied by surface water sources, or ground water sources under the direct influence of surface water, must filter and disinfect their water [40 CFR 141, Subpart H]. Violations of the "Surface Water Treatment Rule" are to be reported for the following four categories:

Monitoring, routine/repeat (for filtered systems): SDWIS Violation Code 36 indicates a system's failure to carry out required tests, or to report the results of those tests.

Treatment techniques (for filtered systems): SDWIS Violation Code 41 shows a system's failure to properly treat its water.

State: OHIO
Reporting JANUARY 1, 2005 - Interval: DECEMBER 31, 2005

SDWIS Codes	Contaminant	MCL (mg/L) ¹	Number of Systems Required to Sample during 2005	MCLs			Significant Monitoring/Reporting					
				Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance

Monitoring, routine/repeat (for unfiltered systems): SDWIS Violation Code 31 indicates a system's failure to carry out required water tests, or to report the results of those tests.

Failure to filter (for unfiltered systems): SDWIS Violation Code 42 shows a system's failure to properly treat its water. Data for this violation code will be supplied to the States by EPA.

Total Coliform Rule (TCR): The Total Coliform Rule establishes regulations for microbiological contaminants in drinking water. These contaminants can cause short-term health problems. If no samples are collected during the one month compliance period, a significant monitoring violation occurs. States are to report four categories of violations:

Acute MCL violation: SDWIS Violation Code 21 indicates that the system found fecal coliform or E. coli, potentially harmful bacteria, in its water, thereby violating the rule.

Non-acute MCL violation: SDWIS Violation Code 22 indicates that the system found total coliform in samples of its water at a frequency or at a level that violates the rule. For systems collecting fewer than 40 samples per month, more than one positive sample for total coliform is a violation. For systems collecting 40 or more samples per month, more than 5% of the samples positive for total coliform is a violation.

Major routine and follow-up monitoring: SDWIS Violation Codes 23 AND 25 show that a system did not perform any monitoring. [One number is to be reported for the sum of violations in these two categories.]

Sanitary Survey: SDWIS Violation Code 28 indicates a major monitoring violation if a system fails to collect 5 routine monthly samples if sanitary survey is not performed.

Treatment Techniques: A water disinfection process that EPA requires instead of an MCL for contaminants that laboratories cannot adequately measure. Failure to meet other operational and system requirements under the Surface Water Treatment and the Lead and Copper Rules have also been included in this category of violation for purposes of this report.

Unfiltered Systems: Water systems that do not need to filter their water before disinfecting it because the source is very clean [40 CFR, Subpart H].

Violation: A failure to meet any state or federal drinking water regulation.

APPENDIX B:

MCL and TT VIOLATION LISTING

**APPENDIX B
CY2005 MCL AND TT VIOLATIONS FOR OHIO**

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant
200503	Elida Water Treatment Plant	COMM	PSW	Medium	7/1/2005	02	2950
200503	Elida Water Treatment Plant	COMM	PSW	Medium	4/1/2005	02	2950
200503	Elida Water Treatment Plant	COMM	PSW	Medium	1/1/2005	02	2950
300411	Cinnamon Lake Utilities Assoc Inc PWS	COMM	SW	Small	10/1/2005	02	2950
300411	Cinnamon Lake Utilities Assoc Inc PWS	COMM	SW	Small	7/1/2005	02	2950
300411	Cinnamon Lake Utilities Assoc Inc PWS	COMM	SW	Small	1/1/2005	02	2950
300411	Cinnamon Lake Utilities Assoc Inc PWS	COMM	SW	Small	4/1/2005	02	2950
336612	River Run Family Campground #1 PWS	TNC	GW	Very Small	7/1/2005	21	3100
338412	Coburn Inc	NTNC	GW	Very Small	7/1/2005	22	3100
342212	Hawley-Zonkers Inc	TNC	GW	Small	7/1/2005	21	3100
343112	Church of Jesus Christ Latter Day Saints PWS	TNC	GW	Very Small	10/1/2005	22	3100
343112	Church of Jesus Christ Latter Day Saints PWS	TNC	GW	Very Small	10/1/2005	21	3100
401111	Rock Creek Village PWS	COMM	SW	Small	7/1/2005	02	2950
401111	Rock Creek Village PWS	COMM	SW	Small	10/1/2005	02	2950
401111	Rock Creek Village PWS	COMM	SW	Small	1/1/2005	02	2950
401111	Rock Creek Village PWS	COMM	SW	Small	8/1/2005	41	SWTR
401111	Rock Creek Village PWS	COMM	SW	Small	4/1/2005	02	2950
401111	Rock Creek Village PWS	COMM	SW	Small	7/1/2005	02	2456
401111	Rock Creek Village PWS	COMM	SW	Small	10/1/2005	02	2456
433422	Camp Koinonia #2	TNC	GW	Very Small	10/1/2005	21	3100
437112	Jefferson Lanes	TNC	GW	Very Small	10/1/2005	22	3100
500403	Bishopville Water & Sewer District	COMM	PSW	Small	1/1/2005	02	2950
501311	Burr Oak Regional Water District	COMM	SW	Very Small	4/1/2005	46	2920
501311	Burr Oak Regional Water District	COMM	SW	Very Small	7/1/2005	46	2920
501311	Burr Oak Regional Water District	COMM	SW	Very Small	6/1/2005	46	2920
501311	Burr Oak Regional Water District	COMM	SW	Very Small	1/1/2005	46	2920
501503	Sunday Creek Valley Water PWS	COMM	PSW	Medium	1/1/2005	02	2950
501503	Sunday Creek Valley Water PWS	COMM	PSW	Medium	7/1/2005	02	2950
501503	Sunday Creek Valley Water PWS	COMM	PSW	Medium	4/1/2005	02	2950

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant
633112	Buckland United Church of Christ PWS	TNC	GW	Very Small	7/1/2005	22	3100
633112	Buckland United Church of Christ PWS	TNC	GW	Very Small	7/1/2005	21	3100
633412	Walnut Grove United Methodist Church	TNC	GW	Very Small	10/1/2005	22	3100
635312	New Hampshire Nazarene	TNC	GW	Very Small	4/1/2005	22	3100
635312	New Hampshire Nazarene	TNC	GW	Very Small	7/1/2005	22	3100
735022	4-H Camp Piedmont Well 2 PWS	TNC	GW	Very Small	7/1/2005	22	3100
800811	Waynoka Regional Water & Sewer District	COMM	SW	Small	4/1/2005	02	2950
934612	J&E Rootbeer	TNC	GW	Very Small	7/1/2005	21	3100
934612	J&E Rootbeer	TNC	GW	Very Small	7/1/2005	22	3100
938412	Ross Chevron	TNC	GW	Small	1/1/2005	22	3100
939012	Millis Transfer Inc PWS	TNC	GW	Very Small	10/1/2005	22	3100
1033512	Spring Hill Campground	TNC	GW	Very Small	4/1/2005	22	3100
1033512	Spring Hill Campground	TNC	GW	Very Small	4/1/2005	21	3100
1037912	MWCD Leesville N Fork L-9	TNC	GW	Very Small	7/1/2005	22	3100
1040012	Sherrodsville Lions Club	TNC	GW	Very Small	4/1/2005	21	3100
1040012	Sherrodsville Lions Club	TNC	GW	Very Small	4/1/2005	22	3100
1130912	ODNR-Kiser Lake State Park-3 PWS	TNC	GW	Very Small	7/1/2005	21	3100
1132212	Graham High School	NTNC	GW	Small	7/1/2005	22	3100
1132212	Graham High School	NTNC	GW	Small	4/1/2005	22	3100
1132212	Graham High School	NTNC	GW	Small	10/1/2005	22	3100
1133812	Graham North Elementary	NTNC	GW	Small	4/1/2005	22	3100
1135312	Saint Paris Church of Nazarene PWS	TNC	GW	Very Small	1/1/2005	22	3100
1135312	Saint Paris Church of Nazarene PWS	TNC	GW	Very Small	10/1/2005	21	3100
1135312	Saint Paris Church of Nazarene PWS	TNC	GW	Very Small	10/1/2005	22	3100
1135312	Saint Paris Church of Nazarene PWS	TNC	GW	Very Small	4/1/2005	21	3100
1135312	Saint Paris Church of Nazarene PWS	TNC	GW	Very Small	4/1/2005	22	3100
1201312	Clearview Mobile Home Park	COMM	SW	Very Small	1/1/2005	41	SWTR
1201312	Clearview Mobile Home Park	COMM	SW	Very Small	2/1/2005	41	SWTR
1201312	Clearview Mobile Home Park	COMM	SW	Very Small	6/1/2005	41	SWTR
1201312	Clearview Mobile Home Park	COMM	SW	Very Small	5/1/2005	41	SWTR
1201312	Clearview Mobile Home Park	COMM	SW	Very Small	3/1/2005	41	SWTR
1201312	Clearview Mobile Home Park	COMM	SW	Very Small	4/1/2005	41	SWTR
1205112	Enon Beach Campground	TNC	GW	Very Small	4/1/2005	22	3100
1205112	Enon Beach Campground	TNC	GW	Very Small	4/1/2005	21	3100
1205312	Crawford's Market Campground PWS	TNC	GW	Very Small	7/1/2005	22	3100

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant
1231212	F O E #3491	TNC	GW	Very Small	10/1/2005	22	3100
1231212	F O E #3491	TNC	GW	Very Small	7/1/2005	21	3100
1232712	Kone Korner	TNC	GW	Very Small	1/1/2005	02	1040
1232712	Kone Korner	TNC	GW	Very Small	4/1/2005	02	1040
1232912	Century Lanes	TNC	GW	Very Small	1/1/2005	22	3100
1237012	Fent's Dairy PWS	TNC	GW	Very Small	4/1/2005	21	3100
1237912	Kaffenbarger Truck Equipment	NTNC	GW	Very Small	10/1/2005	21	3100
1240112	V F W Post 9684	TNC	GW	Very Small	4/1/2005	22	3100
1241012	Sutphen Corporation-Chassis Division PWS	NTNC	GW	Very Small	10/1/2005	21	3100
1243512	Tomorrows Stars - Back	TNC	GW	Very Small	4/1/2005	22	3100
1244612	Scarff's Nursery Camp PWS	TNC	GW	Very Small	4/1/2005	22	3100
1246512	Sugar Isle Snack Shop	TNC	GW	Very Small	10/1/2005	22	3100
1251012	Beatty Freewill Baptist PWS	TNC	GW	Very Small	7/1/2005	21	3100
1300612	Felicity Village PWS	COMM	GW	Small	3/1/2005	22	3100
1300612	Felicity Village PWS	COMM	GW	Small	3/1/2005	21	3100
1400912	Sabina Village PWS	COMM	GW	Small	7/1/2005	22	3100
1400912	Sabina Village PWS	COMM	GW	Small	7/1/2005	21	3100
1434012	Beechwood Acres	TNC	GW	Very Small	7/1/2005	21	3100
1501512	Lisbon Village	COMM	SW	Small	9/1/2005	41	SWTR
1501512	Lisbon Village	COMM	SW	Small	12/1/2005	41	SWTR
1501512	Lisbon Village	COMM	SW	Small	4/1/2005	41	SWTR
1501512	Lisbon Village	COMM	SW	Small	3/1/2005	41	SWTR
1501512	Lisbon Village	COMM	SW	Small	1/1/2005	41	SWTR
1501512	Lisbon Village	COMM	SW	Small	10/1/2005	41	SWTR
1501512	Lisbon Village	COMM	SW	Small	11/1/2005	41	SWTR
1501512	Lisbon Village	COMM	SW	Small	2/1/2005	41	SWTR
1501512	Lisbon Village	COMM	SW	Small	5/1/2005	41	SWTR
1501512	Lisbon Village	COMM	SW	Small	8/1/2005	41	SWTR
1501512	Lisbon Village	COMM	SW	Small	6/1/2005	41	SWTR
1502111	Salineville Village	COMM	SW	Small	10/1/2005	41	SWTR
1502111	Salineville Village	COMM	SW	Small	4/1/2005	41	SWTR
1502111	Salineville Village	COMM	SW	Small	7/1/2005	41	SWTR
1502111	Salineville Village	COMM	SW	Small	8/1/2005	41	SWTR
1502111	Salineville Village	COMM	SW	Small	6/1/2005	41	SWTR
1502111	Salineville Village	COMM	SW	Small	1/1/2005	43	0300

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant
1502111	Salineville Village	COMM	SW	Small	12/1/2005	41	SWTR
1502111	Salineville Village	COMM	SW	Small	1/1/2005	44	0300
1502111	Salineville Village	COMM	SW	Small	5/1/2005	41	SWTR
1502111	Salineville Village	COMM	SW	Small	11/1/2005	41	SWTR
1503512	Breezeway Mobile Manor	COMM	GW	Very Small	4/1/2005	22	3100
1534112	Norm's BBQ Corral PWS	TNC	GW	Very Small	10/1/2005	21	3100
1541412	Forest Lanes	TNC	GW	Very Small	7/1/2005	22	3100
1544412	Farmer Bill's Carry-Out PWS	TNC	GW	Very Small	10/1/2005	21	3100
1544412	Farmer Bill's Carry-Out PWS	TNC	GW	Very Small	10/1/2005	22	3100
1546412	Hanoverton Church of Christ	TNC	GW	Very Small	7/1/2005	22	3100
1549812	Winona Friends Church	TNC	GW	Very Small	1/1/2005	22	3100
1552112	Copeland Hills Golf	TNC	GW	Very Small	7/1/2005	21	3100
1554812	Damascus Friends Church	TNC	GW	Very Small	7/1/2005	22	3100
1600811	Echoing Hills Village	COMM	SW	Very Small	1/31/2005	02	2456
1630212	Canal Lewisville Church	TNC	GW	Very Small	7/1/2005	02	1040
1635812	New Guilford Church	TNC	GW	Very Small	4/1/2005	22	3100
1635812	New Guilford Church	TNC	GW	Very Small	7/1/2005	22	3100
1700411	New Washington Village PWS	COMM	SW	Small	8/1/2005	43	0300
1700411	New Washington Village PWS	COMM	SW	Small	8/1/2005	43	0300
1836812	Cleveland Metroparks/Albion Woods Picnic	TNC	GW	Very Small	4/1/2005	22	3100
1932512	Third Base Bar	TNC	GW	Very Small	10/1/2005	22	3100
1932512	Third Base Bar	TNC	GW	Very Small	10/1/2005	21	3100
1932512	Third Base Bar	TNC	GW	Very Small	7/1/2005	21	3100
1932512	Third Base Bar	TNC	GW	Very Small	7/1/2005	22	3100
1933212	E & R Pub	TNC	GW	Very Small	1/1/2005	22	3100
1933212	E & R Pub	TNC	GW	Very Small	1/1/2005	21	3100
1948912	Dowa's Bar & Grill	TNC	GW	Very Small	7/1/2005	21	3100
1949612	Coletown Market PWS	TNC	GW	Very Small	10/1/2005	22	3100
1949612	Coletown Market PWS	TNC	GW	Very Small	10/1/2005	21	3100
2000111	Defiance Water Treatment Plant	COMM	SW	Large	4/1/2005	02	2950
2000111	Defiance Water Treatment Plant	COMM	SW	Large	10/1/2005	02	2950
2000111	Defiance Water Treatment Plant	COMM	SW	Large	1/1/2005	02	2950
2000111	Defiance Water Treatment Plant	COMM	SW	Large	7/1/2005	02	2950
2000111	Defiance Water Treatment Plant	COMM	SW	Large	5/1/2005	41	SWTR
2000903	Ayersville Water & Sewer District	COMM	PSW	Small	10/1/2005	02	2950

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant
2000903	Ayersville Water & Sewer District	COMM	PSW	Small	7/1/2005	02	2950
2001003	Christi Water System Inc	COMM	PSW	Very Small	1/1/2005	65	5000
2001103	Brunersburg Water District	COMM	PSW	Small	1/1/2005	02	2950
2001103	Brunersburg Water District	COMM	PSW	Small	7/1/2005	02	2950
2001103	Brunersburg Water District	COMM	PSW	Small	4/1/2005	02	2950
2001103	Brunersburg Water District	COMM	PSW	Small	10/1/2005	02	2950
2001203	Defiance Co-Brunersburg/Evansport Water System	COMM	PSW	Very Small	10/1/2005	02	2950
2001203	Defiance Co-Brunersburg/Evansport Water System	COMM	PSW	Very Small	1/1/2005	02	2950
2001203	Defiance Co-Brunersburg/Evansport Water System	COMM	PSW	Very Small	7/1/2005	02	2950
2001203	Defiance Co-Brunersburg/Evansport Water System	COMM	PSW	Very Small	4/1/2005	02	2950
2100711	Lake of the Woods Water Company	COMM	SW	Very Small	4/1/2005	02	2950
2101111	Sunbury Village PWS	COMM	SW	Small	1/1/2005	02	2950
2101111	Sunbury Village PWS	COMM	SW	Small	4/1/2005	02	2950
2201011	Huron Water Treatment Plant	COMM	SW	Medium	8/1/2005	41	SWTR
2201411	Sandusky Water Treatment Plant	COMM	SW	Large	1/1/2005	41	SWTR
2234812	Parkertown Restaurant	TNC	GW	Very Small	11/1/2005	02	1040
2234812	Parkertown Restaurant	TNC	GW	Very Small	1/1/2005	02	1040
2234812	Parkertown Restaurant	TNC	GW	Very Small	10/1/2005	21	3100
2303103	Rushville Village PWS	COMM	PGW	Very Small	9/1/2005	22	3100
2331012	Collegeview Acres-Pool	TNC	GW	Very Small	2/1/2005	22	3100
2331012	Collegeview Acres-Pool	TNC	GW	Very Small	10/1/2005	22	3100
2331012	Collegeview Acres-Pool	TNC	GW	Very Small	9/1/2005	22	3100
2332312	Geneva Hills-Lodge	TNC	GW	Very Small	10/1/2005	22	3100
2332912	Jackson Lake Park-Tent Area	TNC	GW	Very Small	10/1/2005	21	3100
2333412	Lakeview Park Campground	TNC	GW	Very Small	7/1/2005	02	1040
2333412	Lakeview Park Campground	TNC	GW	Very Small	1/1/2005	02	1040
2336012	Allegheny West Conf Camp	TNC	GW	Very Small	7/1/2005	21	3100
2336112	Allegheny W Conf Camp-North Camp	TNC	GW	Very Small	7/1/2005	21	3100
2340812	Small Wonders Day Care PWS	NTNC	GW	Very Small	11/1/2005	21	3100
2344812	Geneva Hills-Pool	TNC	GW	Very Small	9/1/2005	22	3100
2344812	Geneva Hills-Pool	TNC	GW	Very Small	6/1/2005	21	3100
2344812	Geneva Hills-Pool	TNC	GW	Very Small	8/1/2005	22	3100
2344812	Geneva Hills-Pool	TNC	GW	Very Small	7/1/2005	22	3100
2344812	Geneva Hills-Pool	TNC	GW	Very Small	9/1/2005	21	3100
2345612	Chestnut Ridge Metro Park Shop PWS	TNC	GW	Very Small	10/1/2005	22	3100

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant
2345812	CuDaJos PWS	TNC	SW	Very Small	10/1/2005	41	SWTR
2347512	Allegheny West Dorms PWS	TNC	SW	Very Small	1/1/2005	42	SWTR
2347712	Triple S Camp PWS	TNC	GW	Very Small	6/1/2005	22	3100
2348012	Shalom United Methodist Church PWS	NTNC	GW	Very Small	8/1/2005	22	3100
2348012	Shalom United Methodist Church PWS	NTNC	GW	Very Small	7/1/2005	22	3100
2348312	Tri County Family Physicians Inc PWS	NTNC	GW	Very Small	6/1/2005	22	3100
2348612	Lancaster Sport Cycles PWS	TNC	GW	Very Small	10/1/2005	22	3100
2348612	Lancaster Sport Cycles PWS	TNC	GW	Very Small	9/1/2005	22	3100
2348912	Church on the Frontline PWS	TNC	GW	Very Small	9/1/2005	22	3100
2348912	Church on the Frontline PWS	TNC	GW	Very Small	9/1/2005	21	3100
2349412	Allegheny Campground Multipurpose Bldg PWS	TNC	GW	Very Small	7/1/2005	21	3100
2349812	United Landmark PWS	TNC	GW	Very Small	4/1/2005	41	SWTR
2349812	United Landmark PWS	TNC	GW	Very Small	10/1/2005	41	SWTR
2349812	United Landmark PWS	TNC	GW	Very Small	1/1/2005	42	SWTR
2350212	Berne Station PWS	TNC	GW	Very Small	10/1/2005	21	3100
2351112	Airport Gun Club PWS	TNC	GW	Very Small	11/1/2005	21	3100
2435812	Wayne Elementary School	NTNC	GW	Very Small	10/1/2005	21	3100
2435812	Wayne Elementary School	NTNC	GW	Very Small	10/1/2005	22	3100
2435812	Wayne Elementary School	NTNC	GW	Very Small	9/1/2005	22	3100
2435812	Wayne Elementary School	NTNC	GW	Very Small	6/1/2005	22	3100
2435812	Wayne Elementary School	NTNC	GW	Very Small	8/1/2005	21	3100
2435812	Wayne Elementary School	NTNC	GW	Very Small	8/1/2005	22	3100
2547112	Indian Ridge Area-North PWS	TNC	GW	Very Small	7/1/2005	22	3100
2547112	Indian Ridge Area-North PWS	TNC	GW	Very Small	10/1/2005	22	3100
2554312	Anchor Baptist Church	TNC	GW	Very Small	9/1/2005	22	3100
2554312	Anchor Baptist Church	TNC	GW	Very Small	10/1/2005	22	3100
2554312	Anchor Baptist Church	TNC	GW	Very Small	10/1/2005	21	3100
2555412	Cypress Christian School	NTNC	GW	Very Small	9/1/2005	22	3100
2556012	Wesleyan Ministry Center	TNC	GW	Very Small	5/1/2005	22	3100
2557412	White Star Farm PWS	TNC	GW	Very Small	5/1/2005	22	3100
2564212	Dublin Arts Council PWS	TNC	GW	Very Small	8/1/2005	22	3100
2565112	Certified Oil Station #270 PWS	TNC	GW	Very Small	10/1/2005	22	3100
2565312	Certified Oil Station #217 PWS	TNC	GW	Very Small	10/1/2005	22	3100
2600111	Wauseon Water Treatment Plant	COMM	SW	Medium	10/1/2005	02	2950
2600111	Wauseon Water Treatment Plant	COMM	SW	Medium	4/1/2005	02	2950

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant
2600111	Wauseon Water Treatment Plant	COMM	SW	Medium	7/1/2005	02	2950
2600111	Wauseon Water Treatment Plant	COMM	SW	Medium	1/1/2005	02	2950
2600311	Delta Village PWS	COMM	SW	Small	1/1/2005	02	2950
2600311	Delta Village PWS	COMM	SW	Small	7/1/2005	02	2950
2600311	Delta Village PWS	COMM	SW	Small	10/1/2005	02	2950
2600311	Delta Village PWS	COMM	SW	Small	6/1/2005	44	0300
2600311	Delta Village PWS	COMM	SW	Small	4/1/2005	02	2950
2600311	Delta Village PWS	COMM	SW	Small	6/1/2005	43	0300
2600311	Delta Village PWS	COMM	SW	Small	7/1/2005	44	0300
2600603	Lyons Village PWS	COMM	PSW	Small	7/1/2005	02	2950
2600603	Lyons Village PWS	COMM	PSW	Small	10/1/2005	02	2950
2600603	Lyons Village PWS	COMM	PSW	Small	1/1/2005	02	2950
2600603	Lyons Village PWS	COMM	PSW	Small	4/1/2005	02	2950
2600711	Metamora Village PWS	COMM	SW	Small	10/1/2005	02	2950
2600711	Metamora Village PWS	COMM	SW	Small	1/1/2005	02	2950
2600711	Metamora Village PWS	COMM	SW	Small	7/1/2005	02	2950
2600711	Metamora Village PWS	COMM	SW	Small	4/1/2005	02	2950
2601011	Swanton Village PWS	COMM	SW	Medium	1/1/2005	02	2950
2601011	Swanton Village PWS	COMM	SW	Medium	10/1/2005	02	2950
2601011	Swanton Village PWS	COMM	SW	Medium	7/1/2005	02	2950
2601011	Swanton Village PWS	COMM	SW	Medium	4/1/2005	02	2950
2630912	McDonnall Farms Inc AMLC	TNC	GW	Very Small	10/1/2005	21	3100
2633312	Old Pines Golf Club	TNC	GW	Very Small	10/1/2005	21	3100
2636212	Yoder & Frey, Inc.	TNC	GW	Very Small	4/1/2005	22	3100
2800212	Blossom Hill Care Center	COMM	GW	Very Small	10/1/2005	22	3100
2801112	Big Creek PWS	COMM	GW	Very Small	1/1/2005	02	2950
2802612	Terrace Glen Estates	COMM	GW	Very Small	1/1/2005	02	2950
2830512	Camp Anisfield	TNC	GW	Very Small	7/1/2005	21	3100
2832712	Burton Assembly of God	NTNC	GW	Very Small	10/1/2005	22	3100
2834112	John Anthony of Novelty, Inc. PWS	TNC	GW	Very Small	7/1/2005	22	3100
2834112	John Anthony of Novelty, Inc. PWS	TNC	GW	Very Small	10/1/2005	22	3100
2834212	Junction Auto Sales, Inc	NTNC	GW	Very Small	5/1/2005	22	3100
2834512	Dr. Novak, DVM	TNC	GW	Very Small	10/1/2005	22	3100
2834512	Dr. Novak, DVM	TNC	GW	Very Small	7/1/2005	22	3100
2834512	Dr. Novak, DVM	TNC	GW	Very Small	10/1/2005	21	3100

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant
2834712	Ledgemont High School	NTNC	GW	Very Small	10/1/2005	22	3100
2834712	Ledgemont High School	NTNC	GW	Very Small	7/1/2005	22	3100
2849312	DistTech Motor Terminal PWS	NTNC	GW	Very Small	10/1/2005	22	3100
2855112	Washington Square Plaza	TNC	GW	Very Small	4/1/2005	22	3100
2855112	Washington Square Plaza	TNC	GW	Very Small	4/1/2005	21	3100
2859712	Bainbridge Township Building	TNC	GW	Very Small	10/1/2005	22	3100
2860212	West Geauga Plaza-Main	NTNC	GW	Very Small	10/1/2005	02	2987
2860212	West Geauga Plaza-Main	NTNC	GW	Very Small	7/1/2005	02	2987
2860412	Pilgrim Lake Colony Inc	TNC	GW	Very Small	7/1/2005	22	3100
2861412	Creative Mold and Machine PWS	NTNC	GW	Very Small	7/1/2005	21	3100
2863812	Church of Jesus Christ of LDS-Munson	TNC	GW	Very Small	10/1/2005	21	3100
2865312	Gauga Parks - The Rookery PWS	TNC	GW	Very Small	7/1/2005	22	3100
2865512	Windrush Hollow-Concession	TNC	GW	Very Small	4/1/2005	22	3100
2866912	First Claridon Congregational Church	TNC	GW	Very Small	7/1/2005	22	3100
2868412	Circle K 5277 PWS	TNC	GW	Very Small	10/1/2005	22	3100
2868412	Circle K 5277 PWS	TNC	GW	Very Small	7/1/2005	22	3100
2868812	Federated Church Family Life Center	TNC	GW	Very Small	1/1/2005	02	1040
2868812	Federated Church Family Life Center	TNC	GW	Very Small	4/1/2005	02	1040
2868812	Federated Church Family Life Center	TNC	GW	Very Small	10/1/2005	02	1040
2869012	Montessori Farm School	NTNC	GW	Very Small	7/1/2005	22	3100
2871112	Cianfaglione Family Partnership PWS	TNC	GW	Very Small	10/1/2005	22	3100
2871512	Laurel School - North Lodge Well PWS	TNC	GW	Very Small	7/1/2005	22	3100
2871512	Laurel School - North Lodge Well PWS	TNC	GW	Very Small	10/1/2005	21	3100
2872012	Bainbridge Township Police Station PWS	NTNC	GW	Very Small	7/1/2005	22	3100
2872812	Gauga Parks-Big Creek Aspen Grove PWS	TNC	GW	Very Small	10/1/2005	22	3100
2873012	Gauga Parks - Walter C Best PWS	TNC	GW	Very Small	7/1/2005	22	3100
2932712	Eastgate Ford, Inc.	NTNC	GW	Very Small	10/1/2005	21	3100
2934012	Glen Helen Outdoor Education Center	TNC	GW	Very Small	10/1/2005	21	3100
2934412	Grandpa's Cafe PWS	TNC	GW	Very Small	10/1/2005	22	3100
2943112	Grace Baptist Church	TNC	GW	Very Small	10/1/2005	22	3100
2947612	Harvest Church	TNC	GW	Very Small	7/1/2005	21	3100
2954812	Fairfield Rd Physician Offices	TNC	GW	Very Small	10/1/2005	21	3100
2958012	Blue Jacket Drama PWS	TNC	GW	Very Small	10/1/2005	22	3100
3000111	Cambridge City PWS	COMM	SW	Large	9/1/2005	22	3100
3000212	Cumberland Village PWS	COMM	SW	Very Small	1/1/2005	46	2920

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant
3000212	Cumberland Village PWS	COMM	SW	Very Small	7/1/2005	46	2920
3000212	Cumberland Village PWS	COMM	SW	Very Small	4/1/2005	46	2920
3000212	Cumberland Village PWS	COMM	SW	Very Small	6/1/2005	46	2420
3000212	Cumberland Village PWS	COMM	SW	Very Small	7/1/2005	02	2950
3000212	Cumberland Village PWS	COMM	SW	Very Small	10/1/2005	46	2920
3000212	Cumberland Village PWS	COMM	SW	Very Small	10/1/2005	02	2950
3000212	Cumberland Village PWS	COMM	SW	Very Small	4/1/2005	02	2950
3033612	Paradise Valley Park	TNC	GW	Very Small	10/1/2005	21	3100
3033712	MWCD Piedmont Camp P2 PWS	TNC	GW	Very Small	7/1/2005	22	3100
3052811	ODNR-Salt Fork St Park	NTNC	SW	Very Small	7/1/2005	02	2950
3052811	ODNR-Salt Fork St Park	NTNC	SW	Very Small	4/1/2005	02	2950
3052811	ODNR-Salt Fork St Park	NTNC	SW	Very Small	1/1/2005	02	2950
3052811	ODNR-Salt Fork St Park	NTNC	SW	Very Small	1/1/2005	02	2456
3052811	ODNR-Salt Fork St Park	NTNC	SW	Very Small	10/1/2005	02	2456
3052811	ODNR-Salt Fork St Park	NTNC	SW	Very Small	10/1/2005	02	2950
3101312	Lotton Mobile Home Park PWS	COMM	GW	Very Small	4/1/2005	21	3100
3101312	Lotton Mobile Home Park PWS	COMM	GW	Very Small	3/1/2005	21	3100
3101312	Lotton Mobile Home Park PWS	COMM	GW	Very Small	4/1/2005	22	3100
3139312	Anderson Twp Practice Range PWS	TNC	GW	Very Small	1/1/2005	22	3100
3139312	Anderson Twp Practice Range PWS	TNC	GW	Very Small	10/1/2005	22	3100
3139312	Anderson Twp Practice Range PWS	TNC	GW	Very Small	1/1/2005	21	3100
3200903	Arcadia Water Pumping Station	COMM	PSW	Small	1/1/2005	02	2950
3200903	Arcadia Water Pumping Station	COMM	PSW	Small	4/1/2005	02	2950
3237412	Mt Cory Village Park	TNC	GW	Very Small	10/1/2005	21	3100
3237412	Mt Cory Village Park	TNC	GW	Very Small	10/1/2005	22	3100
3240112	Shadylake Campground Water System	TNC	GW	Very Small	4/1/2005	22	3100
3244012	ODOT-Rest Area 1-26 SB PWS	TNC	GW	Small	7/1/2005	21	3100
3244512	Liberty Baptist Chapel	TNC	GW	Very Small	1/1/2005	22	3100
3244512	Liberty Baptist Chapel	TNC	GW	Very Small	7/1/2005	22	3100
3245812	Hancock Park District-Meadows Pavilion PWS	TNC	GW	Very Small	7/1/2005	22	3100
3330812	First Church of God - Ridgeway PWS	TNC	GW	Very Small	10/1/2005	22	3100
3330912	Bullwinkle's Bar & Grill PWS	TNC	GW	Very Small	1/1/2005	21	3100
3335112	Ohio Fresh Eggs, LLC-Mt Victory	NTNC	GW	Very Small	1/1/2005	21	3100
3400214	Cadiz Village PWS	COMM	SW	Medium	4/1/2005	02	2950
3431312	Camp Tippecanoe	TNC	GW	Very Small	7/1/2005	22	3100

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant
3500112	Deshler Village PWS	COMM	GW	Small	4/1/2005	02	2950
3500603	Liberty Center Village PWS	COMM	PSW	Small	4/1/2005	02	2950
3500603	Liberty Center Village PWS	COMM	PSW	Small	7/1/2005	02	2950
3500603	Liberty Center Village PWS	COMM	PSW	Small	1/1/2005	02	2950
3500603	Liberty Center Village PWS	COMM	PSW	Small	10/1/2005	02	2950
3500711	McClure Village PWS	COMM	SW	Small	7/1/2005	02	2950
3500711	McClure Village PWS	COMM	SW	Small	1/1/2005	02	2950
3500711	McClure Village PWS	COMM	SW	Small	7/1/2005	02	2456
3500711	McClure Village PWS	COMM	SW	Small	10/1/2005	02	2456
3500711	McClure Village PWS	COMM	SW	Small	4/1/2005	02	2456
3500711	McClure Village PWS	COMM	SW	Small	4/1/2005	02	2950
3500711	McClure Village PWS	COMM	SW	Small	10/1/2005	02	2950
3500811	Napoleon City PWS	COMM	SW	Medium	10/1/2005	02	2950
3501203	Florida Village PWS	COMM	PSW	Very Small	7/1/2005	02	2950
3501203	Florida Village PWS	COMM	PSW	Very Small	1/1/2005	02	2950
3501203	Florida Village PWS	COMM	PSW	Very Small	10/1/2005	02	2950
3501203	Florida Village PWS	COMM	PSW	Very Small	4/1/2005	02	2950
3501403	Malinta Village PWS	COMM	PSW	Very Small	1/1/2005	02	2950
3501403	Malinta Village PWS	COMM	PSW	Very Small	10/1/2005	02	2950
3501403	Malinta Village PWS	COMM	PSW	Very Small	7/1/2005	02	2950
3501403	Malinta Village PWS	COMM	PSW	Very Small	4/1/2005	02	2950
3530712	American Legion Post 454	TNC	GW	Very Small	10/1/2005	21	3100
3532012	Emanuel's United Church of Christ PWS	TNC	GW	Very Small	7/1/2005	21	3100
3532012	Emanuel's United Church of Christ PWS	TNC	GW	Very Small	7/1/2005	22	3100
3532012	Emanuel's United Church of Christ PWS	TNC	GW	Very Small	10/1/2005	22	3100
3532112	J & W's Country Corner PWS	TNC	GW	Very Small	10/1/2005	22	3100
3700103	Carbon Hill Water Association	COMM	PSW	Small	1/1/2005	02	2950
3700103	Carbon Hill Water Association	COMM	PSW	Small	4/1/2005	02	2950
3730112	Antioch Alliance Church	TNC	GW	Very Small	7/1/2005	21	3100
3737912	The Inn at Cedar Falls	TNC	GW	Very Small	1/1/2005	22	3100
3737912	The Inn at Cedar Falls	TNC	GW	Very Small	1/1/2005	21	3100
3738112	South Bloomingville Tavern	TNC	GW	Very Small	4/1/2005	22	3100
3738112	South Bloomingville Tavern	TNC	GW	Very Small	10/1/2005	22	3100
3739012	Jehovahs Witness Kingdom	TNC	GW	Very Small	7/1/2005	21	3100
3739012	Jehovahs Witness Kingdom	TNC	GW	Very Small	7/1/2005	22	3100

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant
3739412	Ash Cave Cabins PWS	TNC	GW	Very Small	10/1/2005	22	3100
3739412	Ash Cave Cabins PWS	TNC	GW	Very Small	10/1/2005	21	3100
3740312	Hocking Hills Flea Market PWS	NTNC	GW	Very Small	11/1/2005	21	3100
3740312	Hocking Hills Flea Market PWS	NTNC	GW	Very Small	12/1/2005	22	3100
3740312	Hocking Hills Flea Market PWS	NTNC	GW	Very Small	7/1/2005	22	3100
3800312	Glenmont Village PWS	COMM	GW	Very Small	11/1/2005	22	3100
3831012	Camp Toodik PWS	TNC	GW	Very Small	7/1/2005	21	3100
3831012	Camp Toodik PWS	TNC	GW	Very Small	7/1/2005	22	3100
3835312	October Hill Camplot Own	TNC	GW	Very Small	7/1/2005	22	3100
3836812	Skyview Baptist Ranch	TNC	GW	Very Small	1/1/2005	22	3100
3839412	Zion Christian School	NTNC	GW	Very Small	7/1/2005	21	3100
3839812	Bethany Mennonite Church	TNC	GW	Very Small	7/1/2005	21	3100
3840612	Hopewell Presbyterian Church	TNC	GW	Very Small	1/1/2005	22	3100
3844412	Grace Brethren Church	TNC	GW	Very Small	1/1/2005	21	3100
3844812	Millersburg United Methodist Church	TNC	GW	Very Small	1/1/2005	22	3100
3844912	Mohican River Lodge	TNC	GW	Very Small	10/1/2005	22	3100
3844912	Mohican River Lodge	TNC	GW	Very Small	7/1/2005	22	3100
3845212	Bauer's Camp South Well PWS	TNC	GW	Very Small	10/1/2005	22	3100
3848212	Black Diamond Golf Course PWS	TNC	GW	Very Small	10/1/2005	21	3100
3849112	Valley View Oak LLC PWS	NTNC	GW	Very Small	7/1/2005	21	3100
4000303	Jackson Co. Water-Well D PWS	COMM	PSW	Small	4/1/2005	02	2950
4001003	Jackson Co. Water-Well G PWS	COMM	PSW	Small	10/1/2005	02	2456
4001003	Jackson Co. Water-Well G PWS	COMM	PSW	Small	7/1/2005	02	2950
4001003	Jackson Co. Water-Well G PWS	COMM	PSW	Small	4/1/2005	02	2950
4001203	Jackson Co. Water Company-E PWS	COMM	PSW	Medium	7/1/2005	22	3100
4001912	Wellston Public Water System	COMM	SW	Medium	11/1/2005	43	0300
4200912	Mount Vernon Academy	NTNC	GW	Very Small	7/1/2005	22	3100
4200912	Mount Vernon Academy	NTNC	GW	Very Small	7/1/2005	21	3100
4200912	Mount Vernon Academy	NTNC	GW	Very Small	6/1/2005	22	3100
4231212	Mt. Vernon Country Club, Ltd. PWS	TNC	GW	Very Small	5/1/2005	21	3100
4231212	Mt. Vernon Country Club, Ltd. PWS	TNC	GW	Very Small	5/1/2005	22	3100
4232812	Camp Mohaven	TNC	GW	Very Small	10/1/2005	21	3100
4232812	Camp Mohaven	TNC	GW	Very Small	10/1/2005	22	3100
4239812	Mt Vernon Church of God	TNC	GW	Very Small	5/1/2005	21	3100
4239812	Mt Vernon Church of God	TNC	GW	Very Small	5/1/2005	22	3100

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant
4239812	Mt Vernon Church of God	TNC	GW	Very Small	6/1/2005	22	3100
4240012	Chapel Hill Golf Course	TNC	GW	Very Small	10/1/2005	22	3100
4240012	Chapel Hill Golf Course	TNC	GW	Very Small	8/1/2005	21	3100
4240012	Chapel Hill Golf Course	TNC	GW	Very Small	10/1/2005	21	3100
4240012	Chapel Hill Golf Course	TNC	GW	Very Small	8/1/2005	22	3100
4240312	Hot Rods Sunoco	TNC	SW	Small	7/1/2005	42	SWTR
4240312	Hot Rods Sunoco	TNC	SW	Small	9/1/2005	22	3100
4240312	Hot Rods Sunoco	TNC	SW	Small	4/1/2005	42	SWTR
4240312	Hot Rods Sunoco	TNC	SW	Small	1/1/2005	42	SWTR
4240312	Hot Rods Sunoco	TNC	SW	Small	10/1/2005	42	SWTR
4240312	Hot Rods Sunoco	TNC	SW	Small	10/1/2005	22	3100
4240312	Hot Rods Sunoco	TNC	SW	Small	7/1/2005	22	3100
4241712	Goetzman Chrysler PWS	TNC	GW	Very Small	8/1/2005	22	3100
4241712	Goetzman Chrysler PWS	TNC	GW	Very Small	10/1/2005	22	3100
4241812	Mid-Ohio PWS	TNC	GW	Very Small	7/1/2005	22	3100
4242412	Glen Hill Orchard - Ag Camp PWS	TNC	GW	Very Small	6/1/2005	22	3100
4242412	Glen Hill Orchard - Ag Camp PWS	TNC	GW	Very Small	6/1/2005	21	3100
4243112	Cochran's Lit-le Lambs Learning Ctr PWS	NTNC	GW	Very Small	3/1/2005	22	3100
4243112	Cochran's Lit-le Lambs Learning Ctr PWS	NTNC	GW	Very Small	3/1/2005	21	3100
4243312	Joy of Living Ministries Inc PWS	TNC	GW	Very Small	10/1/2005	21	3100
4331012	Jennifer's Country Kitchen PWS	TNC	GW	Very Small	4/1/2005	22	3100
4531412	Papa Boo's PWS	TNC	GW	Very Small	10/1/2005	21	3100
4535812	Our Lady of Mt. Carmel Church	TNC	GW	Very Small	10/1/2005	22	3100
4538612	Buckeye Lake KOA Kampground	TNC	GW	Very Small	7/1/2005	22	3100
4538612	Buckeye Lake KOA Kampground	TNC	GW	Very Small	10/1/2005	21	3100
4542612	Taco Bell-Buckeye Lake	TNC	GW	Very Small	1/1/2005	22	3100
4545612	Ralph Maltby Enterprises	NTNC	GW	Very Small	1/1/2005	22	3100
4545612	Ralph Maltby Enterprises	NTNC	GW	Very Small	2/1/2005	22	3100
4545612	Ralph Maltby Enterprises	NTNC	GW	Very Small	3/1/2005	22	3100
4547212	Willow Run Golf Course	TNC	GW	Very Small	6/1/2005	21	3100
4547212	Willow Run Golf Course	TNC	GW	Very Small	8/1/2005	22	3100
4547512	Burning Tree Golf Course	TNC	GW	Very Small	10/1/2005	21	3100
4549312	BSA Camp Falling Rock-Upper	TNC	GW	Very Small	4/1/2005	41	SWTR
4549312	BSA Camp Falling Rock-Upper	TNC	GW	Very Small	1/1/2005	42	SWTR
4549312	BSA Camp Falling Rock-Upper	TNC	GW	Very Small	7/1/2005	42	SWTR

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant
4549622	4-H Camp Ohio-Pool	TNC	GW	Very Small	9/1/2005	22	3100
4551112	Kyber Run Golf Course	TNC	GW	Very Small	10/1/2005	22	3100
4551112	Kyber Run Golf Course	TNC	GW	Very Small	10/1/2005	21	3100
4551812	Captain Woodys PWS	TNC	GW	Very Small	9/1/2005	21	3100
4553712	Louie's Corner House PWS	TNC	GW	Very Small	6/1/2005	21	3100
4555112	MPW Industrial Services	NTNC	GW	Very Small	1/1/2005	21	3100
4555112	MPW Industrial Services	NTNC	GW	Very Small	9/1/2005	22	3100
4555512	Bowerston Shale Company	NTNC	GW	Very Small	8/1/2005	21	3100
4555512	Bowerston Shale Company	NTNC	GW	Very Small	10/1/2005	22	3100
4555512	Bowerston Shale Company	NTNC	GW	Very Small	9/1/2005	22	3100
4557312	Citgo Buckeye Lake PWS	TNC	GW	Small	10/1/2005	21	3100
4557312	Citgo Buckeye Lake PWS	TNC	GW	Small	7/1/2005	22	3100
4557312	Citgo Buckeye Lake PWS	TNC	GW	Small	8/1/2005	22	3100
4559412	Tricounty Church Nazarene	TNC	GW	Very Small	1/1/2005	22	3100
4559612	The Links at Echo Spring PWS	TNC	GW	Very Small	9/1/2005	21	3100
4559612	The Links at Echo Spring PWS	TNC	GW	Very Small	9/1/2005	22	3100
4560712	The Herb-N-Ewe	TNC	GW	Very Small	10/1/2005	21	3100
4561812	National Trail Raceway G	TNC	GW	Very Small	8/1/2005	21	3100
4602212	Russells Point Village PWS	COMM	GW	Small	4/1/2005	02	2456
4602212	Russells Point Village PWS	COMM	GW	Small	4/1/2005	02	2950
4602212	Russells Point Village PWS	COMM	GW	Small	7/1/2005	02	2950
4602212	Russells Point Village PWS	COMM	GW	Small	7/1/2005	02	2456
4602212	Russells Point Village PWS	COMM	GW	Small	10/1/2005	02	2456
4602212	Russells Point Village PWS	COMM	GW	Small	10/1/2005	02	2950
4631712	Camp Wesley-Middle	TNC	GW	Very Small	10/1/2005	22	3100
4631712	Camp Wesley-Middle	TNC	GW	Very Small	10/1/2005	21	3100
4634412	Marmon Valley Farm	TNC	GW	Very Small	1/1/2005	22	3100
4637612	Turkeyfoot Resort	TNC	GW	Very Small	7/1/2005	21	3100
4637612	Turkeyfoot Resort	TNC	GW	Very Small	4/1/2005	21	3100
4637612	Turkeyfoot Resort	TNC	GW	Very Small	7/1/2005	22	3100
4643812	Miami Valley Camp	TNC	GW	Very Small	7/1/2005	22	3100
4644412	Geronimo Campground	TNC	GW	Very Small	7/1/2005	22	3100
4647412	Tree Links GC-Clubhouse PWS	TNC	GW	Very Small	7/1/2005	22	3100
4648212	Huntsville Marastop PWS	TNC	GW	Small	10/1/2005	22	3100
4648412	Brother's Bar and Grill PWS	TNC	GW	Very Small	7/1/2005	22	3100

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant
4648412	Brother's Bar and Grill PWS	TNC	GW	Very Small	10/1/2005	22	3100
4648612	Blackhawk Inn PWS	TNC	GW	Very Small	7/1/2005	21	3100
4650312	The Happy Butcher	TNC	GW	Very Small	1/1/2005	21	3100
4700711	Lorain City PWS	COMM	SW	Large	3/1/2005	41	SWTR
4700911	Oberlin Water Department	COMM	SW	Medium	5/1/2005	41	SWTR
4700911	Oberlin Water Department	COMM	SW	Medium	1/1/2005	41	SWTR
4701511	Wellington Village PWS	COMM	SW	Medium	3/1/2005	41	0200
4838512	Oak Openings Mertopark- Evergreen Lake	TNC	GW	Very Small	1/1/2005	22	3100
4840512	Oak Openings-Boy Scout C	TNC	GW	Very Small	7/1/2005	22	3100
4843212	ODNR-Crane Creek State Park 2 PWS	TNC	GW	Small	7/1/2005	21	3100
4900212	Choctaw Utilities, Inc.	COMM	GW	Small	11/1/2005	22	3100
4932212	Fairhaven School	NTNC	GW	Very Small	10/1/2005	21	3100
4934112	Matco Industries	NTNC	GW	Very Small	7/1/2005	21	3100
4934112	Matco Industries	NTNC	GW	Very Small	7/1/2005	22	3100
4936812	Henry's Restaurant	TNC	GW	Very Small	10/1/2005	21	3100
4937312	Somerford Elementary School PWS	TNC	GW	Very Small	4/1/2005	22	3100
4939912	United Bethel Mennonite Church	TNC	SW	Very Small	4/1/2005	41	SWTR
4939912	United Bethel Mennonite Church	TNC	SW	Very Small	11/1/2005	41	SWTR
4939912	United Bethel Mennonite Church	TNC	SW	Very Small	10/1/2005	41	SWTR
4939912	United Bethel Mennonite Church	TNC	SW	Very Small	1/1/2005	42	SWTR
4939912	United Bethel Mennonite Church	TNC	SW	Very Small	12/1/2005	41	SWTR
4943512	M.H. Eby, Inc. PWS	NTNC	GW	Very Small	2/1/2005	22	3100
4944812	Prairie Oaks South PWS	TNC	GW	Very Small	10/1/2005	22	3100
4945512	Big Darby Baptist Church PWS	TNC	GW	Very Small	9/1/2005	22	3100
5001911	Sebring Village PWS	COMM	SW	Medium	1/1/2005	02	2950
5033712	Depot Lounge	TNC	SW	Very Small	2/1/2005	41	SWTR
5033712	Depot Lounge	TNC	SW	Very Small	1/1/2005	41	SWTR
5033712	Depot Lounge	TNC	SW	Very Small	3/1/2005	41	SWTR
5033712	Depot Lounge	TNC	SW	Very Small	6/1/2005	41	SWTR
5033712	Depot Lounge	TNC	SW	Very Small	8/1/2005	41	SWTR
5033712	Depot Lounge	TNC	SW	Very Small	7/1/2005	41	SWTR
5033712	Depot Lounge	TNC	SW	Very Small	9/1/2005	41	SWTR
5033712	Depot Lounge	TNC	SW	Very Small	12/1/2005	41	SWTR
5033712	Depot Lounge	TNC	SW	Very Small	11/1/2005	41	SWTR
5033712	Depot Lounge	TNC	SW	Very Small	10/1/2005	41	SWTR

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant
5033712	Depot Lounge	TNC	SW	Very Small	5/1/2005	41	SWTR
5033812	Barbara's Cozy Corner	TNC	GW	Very Small	4/1/2005	22	3100
5040112	Arnold's Lounge	TNC	GW	Very Small	4/1/2005	22	3100
5043322	Green Acres-South Well PWS	TNC	GW	Very Small	10/1/2005	21	3100
5043912	Aut Mori Grotto (Shangri-La)	TNC	GW	Very Small	10/1/2005	21	3100
5043912	Aut Mori Grotto (Shangri-La)	TNC	GW	Very Small	4/1/2005	22	3100
5044112	VFW Post #7600	TNC	GW	Very Small	4/1/2005	22	3100
5045312	American Legion Post 737	TNC	GW	Very Small	7/1/2005	21	3100
5046912	North Benton United Presbyterian Church	TNC	GW	Very Small	7/1/2005	22	3100
5047612	Advantage Spinal & Rehab Center	TNC	SW	Very Small	1/1/2005	41	SWTR
5047612	Advantage Spinal & Rehab Center	TNC	SW	Very Small	3/1/2005	41	SWTR
5047612	Advantage Spinal & Rehab Center	TNC	SW	Very Small	9/1/2005	41	SWTR
5047612	Advantage Spinal & Rehab Center	TNC	SW	Very Small	7/1/2005	41	SWTR
5047612	Advantage Spinal & Rehab Center	TNC	SW	Very Small	8/1/2005	41	SWTR
5047612	Advantage Spinal & Rehab Center	TNC	SW	Very Small	12/1/2005	41	SWTR
5047612	Advantage Spinal & Rehab Center	TNC	SW	Very Small	11/1/2005	41	SWTR
5047612	Advantage Spinal & Rehab Center	TNC	SW	Very Small	10/1/2005	41	SWTR
5047612	Advantage Spinal & Rehab Center	TNC	SW	Very Small	6/1/2005	41	SWTR
5047612	Advantage Spinal & Rehab Center	TNC	SW	Very Small	5/1/2005	41	SWTR
5047612	Advantage Spinal & Rehab Center	TNC	SW	Very Small	2/1/2005	41	SWTR
5050612	Old Springfld Church of Christ	TNC	GW	Very Small	10/1/2005	21	3100
5131712	Hickory Grove Lake Campground	TNC	GW	Very Small	7/1/2005	22	3100
5131712	Hickory Grove Lake Campground	TNC	GW	Very Small	7/1/2005	21	3100
5135612	Timothy Lutheran Church	TNC	GW	Very Small	10/1/2005	21	3100
5135612	Timothy Lutheran Church	TNC	GW	Very Small	10/1/2005	22	3100
5137812	Enterprise Baptist Church	TNC	GW	Very Small	10/1/2005	22	3100
5143012	Raceway Mini Mart PWS	TNC	GW	Very Small	10/1/2005	21	3100
5143112	Marion International Farm & Flea Mkt PWS	TNC	GW	Very Small	10/1/2005	22	3100
5230112	Ridge Road Marathon	TNC	GW	Very Small	7/1/2005	21	3100
5237412	Kingdom Hall of Jehovah's Witnesses	TNC	GW	Very Small	7/1/2005	21	3100
5243012	Rawiga Country Club	TNC	GW	Very Small	10/1/2005	22	3100
5243012	Rawiga Country Club	TNC	GW	Very Small	10/1/2005	21	3100
5244112	Seville Service Station	TNC	GW	Very Small	7/1/2005	21	3100
5245312	Hinckley Plaza	TNC	GW	Very Small	10/1/2005	21	3100
5253812	Sundance Saloon PWS	TNC	GW	Very Small	7/1/2005	22	3100

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant
5258212	Pearl Hollow Plaza	TNC	GW	Very Small	7/1/2005	22	3100
5258212	Pearl Hollow Plaza	TNC	GW	Very Small	7/1/2005	21	3100
5258512	Maple Hill Mennonite Church	TNC	GW	Very Small	10/1/2005	22	3100
5258512	Maple Hill Mennonite Church	TNC	GW	Very Small	10/1/2005	21	3100
5260112	Skyview Lodge PWS	TNC	GW	Very Small	7/1/2005	22	3100
5400011	Celina Municipal Utilities	COMM	SW	Large	7/1/2005	02	2950
5400011	Celina Municipal Utilities	COMM	SW	Large	1/1/2005	02	2950
5400011	Celina Municipal Utilities	COMM	SW	Large	10/1/2005	02	2950
5400011	Celina Municipal Utilities	COMM	SW	Large	4/1/2005	02	2950
5402012	Club Island Association	COMM	GW	Very Small	10/1/2005	22	3100
5435412	St. Joe Store	TNC	GW	Very Small	4/1/2005	22	3100
5436412	Zion Lutheran Church - Rockford	TNC	GW	Very Small	10/1/2005	21	3100
5440312	S&K Products Company	NTNC	GW	Very Small	10/1/2005	22	3100
5536812	Brushcreek Church Of God	TNC	GW	Very Small	10/1/2005	22	3100
5536812	Brushcreek Church Of God	TNC	GW	Very Small	10/1/2005	21	3100
5542712	Fraternal Order of Eagles PWS	TNC	GW	Very Small	7/1/2005	22	3100
5542712	Fraternal Order of Eagles PWS	TNC	GW	Very Small	10/1/2005	22	3100
5542712	Fraternal Order of Eagles PWS	TNC	GW	Very Small	7/1/2005	21	3100
5544612	Starfire Express- Troy	TNC	GW	Small	10/1/2005	21	3100
5545812	Rolling Hills Girl Scout	TNC	GW	Very Small	7/1/2005	22	3100
5549512	Ginghamsburg UMC-North PWS	NTNC	GW	Small	1/1/2005	21	3100
5549512	Ginghamsburg UMC-North PWS	NTNC	GW	Small	7/1/2005	22	3100
5550212	Kingdom Hall Jehovah Witness-New Carlisle PWS	TNC	GW	Very Small	10/1/2005	22	3100
5550512	Friendship Community Church	TNC	GW	Very Small	7/1/2005	22	3100
5551512	Kingdom Hall of Jehovah's Witnesses-Troy & Piqua	TNC	GW	Very Small	1/1/2005	21	3100
5551512	Kingdom Hall of Jehovah's Witnesses-Troy & Piqua	TNC	GW	Very Small	4/1/2005	21	3100
5551512	Kingdom Hall of Jehovah's Witnesses-Troy & Piqua	TNC	GW	Very Small	1/1/2005	22	3100
5551512	Kingdom Hall of Jehovah's Witnesses-Troy & Piqua	TNC	GW	Very Small	4/1/2005	22	3100
5551812	Noah's Ark Kids Academy PWS	NTNC	GW	Very Small	10/1/2005	22	3100
5552412	Piqua Fish & Game Club PWS	TNC	GW	Very Small	10/1/2005	22	3100
5552612	Karen's Country Market	TNC	GW	Very Small	10/1/2005	21	3100
5600711	Woodsfield Village PWS	COMM	SW	Small	10/1/2005	44	0300
5700812	Englewood City PWS	COMM	GW	Large	3/1/2005	22	3100
5730312	Aullwood Audubon Nature Center PWS	TNC	GW	Very Small	1/1/2005	22	3100
5731012	Butler Asphalt Co., Inc.	TNC	GW	Very Small	1/1/2005	21	3100

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant
5734812	Old Troy Pike Community Church	TNC	GW	Very Small	10/1/2005	21	3100
5740412	Temple Baptist Church	TNC	GW	Very Small	1/1/2005	21	3100
5740812	Timber Lanes PWS	TNC	GW	Very Small	10/1/2005	22	3100
5740912	High Spirits	TNC	GW	Very Small	10/1/2005	21	3100
5741612	Wolohan Lumber Company	TNC	GW	Very Small	7/1/2005	22	3100
5742012	Anchor Fabricators	NTNC	GW	Very Small	7/1/2005	21	3100
5744112	Cricket Holler Scout Reserve	TNC	GW	Very Small	7/1/2005	21	3100
5745012	Brookville Church of The Nazarene PWS	TNC	GW	Very Small	10/1/2005	21	3100
5745612	Blessed Hope Baptist Church	TNC	GW	Very Small	10/1/2005	22	3100
5746312	Fellowship Alliance Chapel	TNC	GW	Very Small	7/1/2005	21	3100
5746912	Miami Valley Hunt & Polo	TNC	GW	Very Small	10/1/2005	21	3100
5746912	Miami Valley Hunt & Polo	TNC	GW	Very Small	10/1/2005	22	3100
5747612	Christ Cathedral Church	TNC	GW	Very Small	10/1/2005	21	3100
5747612	Christ Cathedral Church	TNC	GW	Very Small	10/1/2005	22	3100
5749112	Brantwood Baptist Church PWS	TNC	GW	Very Small	7/1/2005	22	3100
5831112	Miba Bearings US LLC	NTNC	GW	Very Small	1/1/2005	22	3100
5836712	Morgan Ace Hardware	TNC	GW	Very Small	10/1/2005	21	3100
6001411	Maysville Regional Water	COMM	SW	Medium	5/1/2005	43	0300
6037212	Green's Tea Room PWS	TNC	GW	Very Small	7/1/2005	21	3100
6037212	Green's Tea Room PWS	TNC	GW	Very Small	4/1/2005	21	3100
6037212	Green's Tea Room PWS	TNC	GW	Very Small	7/1/2005	22	3100
6041511	ODNR-Blue Rock State Park	TNC	SW	Very Small	7/1/2005	43	0300
6044412	B&B Grocery	TNC	GW	Very Small	7/1/2005	22	3100
6044812	Gentle Touch Child Care PWS	NTNC	GW	Very Small	1/1/2005	02	1040
6044912	Canaan Mennonite Church & School PWS	NTNC	GW	Very Small	10/1/2005	21	3100
6044912	Canaan Mennonite Church & School PWS	NTNC	GW	Very Small	10/1/2005	22	3100
6100103	Clear Water Corporation	COMM	PSW	Small	7/1/2005	02	2950
6100103	Clear Water Corporation	COMM	PSW	Small	1/1/2005	02	2456
6100103	Clear Water Corporation	COMM	PSW	Small	1/1/2005	02	2950
6100103	Clear Water Corporation	COMM	PSW	Small	10/1/2005	02	2950
6100103	Clear Water Corporation	COMM	PSW	Small	4/1/2005	02	2950
6100303	Pure Water Corporation	COMM	PSW	Small	10/1/2005	02	2950
6100303	Pure Water Corporation	COMM	PSW	Small	4/1/2005	02	2950
6100303	Pure Water Corporation	COMM	PSW	Small	7/1/2005	02	2950
6100303	Pure Water Corporation	COMM	PSW	Small	1/1/2005	02	2950

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant
6100503	Noble County Water Authority PWS	COMM	PSW	Small	10/1/2005	02	2950
6100503	Noble County Water Authority PWS	COMM	PSW	Small	4/1/2005	02	2950
6100503	Noble County Water Authority PWS	COMM	PSW	Small	7/1/2005	02	2950
6100503	Noble County Water Authority PWS	COMM	PSW	Small	1/1/2005	02	2950
6201312	Greenwood Mobile Home Pk	COMM	GW	Very Small	1/1/2005	21	3100
6201312	Greenwood Mobile Home Pk	COMM	GW	Very Small	12/1/2005	21	3100
6201312	Greenwood Mobile Home Pk	COMM	GW	Very Small	1/1/2005	22	3100
6205011	Ottawa County Regional	COMM	SW	Large	6/1/2005	41	SWTR
6205111	Carroll Water & Sewer	COMM	SW	Small	1/31/2005	02	2456
6238012	St John Lutheran Church	TNC	GW	Very Small	7/1/2005	21	3100
6247311	Erie Industrial Park Assoc LLC PWS	NTNC	SW	Very Small	4/1/2005	02	2950
6247311	Erie Industrial Park Assoc LLC PWS	NTNC	SW	Very Small	1/1/2005	02	2950
6247412	African Safari Wildlife	TNC	GW	Very Small	10/1/2005	02	2950
6258712	J.F. Walleye Micro-Brewery	TNC	GW	Very Small	7/1/2005	21	3100
6258712	J.F. Walleye Micro-Brewery	TNC	GW	Very Small	4/1/2005	21	3100
6258712	J.F. Walleye Micro-Brewery	TNC	GW	Very Small	7/1/2005	22	3100
6300312	Oakwood Village PWS	COMM	GW	Small	1/1/2005	22	3100
6300411	Paulding Water Treatment Plant	COMM	SW	Medium	5/1/2005	44	0300
6300411	Paulding Water Treatment Plant	COMM	SW	Medium	10/1/2005	02	2950
6300411	Paulding Water Treatment Plant	COMM	SW	Medium	4/1/2005	02	2950
6300411	Paulding Water Treatment Plant	COMM	SW	Medium	6/1/2005	44	0300
6300411	Paulding Water Treatment Plant	COMM	SW	Medium	7/1/2005	02	2950
6300411	Paulding Water Treatment Plant	COMM	SW	Medium	1/1/2005	02	2950
6300411	Paulding Water Treatment Plant	COMM	SW	Medium	4/1/2005	44	0300
6300411	Paulding Water Treatment Plant	COMM	SW	Medium	9/1/2005	43	0300
6300411	Paulding Water Treatment Plant	COMM	SW	Medium	7/1/2005	44	0300
6330612	The Depot	TNC	GW	Very Small	10/1/2005	21	3100
6400003	Corning Village PWS	COMM	PSW	Small	4/1/2005	02	2950
6400003	Corning Village PWS	COMM	PSW	Small	1/1/2005	02	2950
6400411	New Lexington City PWS	COMM	SW	Medium	1/1/2005	02	2950
6400411	New Lexington City PWS	COMM	SW	Medium	7/1/2005	02	2950
6400411	New Lexington City PWS	COMM	SW	Medium	4/1/2005	02	2950
6401111	Somerset Village PWS	COMM	SW	Small	4/1/2005	02	2950
6401111	Somerset Village PWS	COMM	SW	Small	7/1/2005	02	2950
6401111	Somerset Village PWS	COMM	SW	Small	1/1/2005	02	2950

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant
6401111	Somerset Village PWS	COMM	SW	Small	2/1/2005	41	SWTR
6401403	Old Straitsville Water Association	COMM	PSW	Small	10/1/2005	02	2950
6401403	Old Straitsville Water Association	COMM	PSW	Small	4/1/2005	02	2950
6401403	Old Straitsville Water Association	COMM	PSW	Small	7/1/2005	02	2950
6401403	Old Straitsville Water Association	COMM	PSW	Small	1/1/2005	02	2950
6401603	South Perry County Water-Congo PWS	COMM	PSW	Medium	4/1/2005	02	2950
6401603	South Perry County Water-Congo PWS	COMM	PSW	Medium	7/1/2005	02	2950
6401603	South Perry County Water-Congo PWS	COMM	PSW	Medium	1/1/2005	02	2950
6402303	Portersville Water Co.	COMM	PSW	Small	4/1/2005	02	2950
6402303	Portersville Water Co.	COMM	PSW	Small	7/1/2005	02	2950
6402303	Portersville Water Co.	COMM	PSW	Small	1/1/2005	02	2950
6402303	Portersville Water Co.	COMM	PSW	Small	10/1/2005	02	2950
6431912	Rushcreek Golf Course	TNC	GW	Very Small	10/1/2005	21	3100
6502412	Sunset Mobile Home Park	COMM	GW	Very Small	6/1/2005	42	SWTR
6502412	Sunset Mobile Home Park	COMM	GW	Very Small	5/1/2005	42	SWTR
6502412	Sunset Mobile Home Park	COMM	GW	Very Small	4/1/2005	42	SWTR
6531212	Frostie's Bait and Tackle PWS	TNC	GW	Very Small	9/1/2005	22	3100
6539412	Slate Run-Buzzards Roost	TNC	GW	Very Small	6/1/2005	21	3100
6539412	Slate Run-Buzzards Roost	TNC	GW	Very Small	7/1/2005	22	3100
6539412	Slate Run-Buzzards Roost	TNC	GW	Very Small	8/1/2005	22	3100
6540412	The Landings at Rickenbacker	TNC	GW	Very Small	10/1/2005	22	3100
6542512	Circleville Camping Center PWS	TNC	GW	Very Small	6/1/2005	22	3100
6633312	Long's Retreat #11 Well PWS	TNC	GW	Very Small	4/1/2005	22	3100
6705812	Kellimar Court Apartment	COMM	GW	Very Small	10/1/2005	02	2950
6705812	Kellimar Court Apartment	COMM	GW	Very Small	10/1/2005	02	2456
6705812	Kellimar Court Apartment	COMM	GW	Very Small	4/1/2005	02	2456
6705812	Kellimar Court Apartment	COMM	GW	Very Small	7/1/2005	02	2456
6705812	Kellimar Court Apartment	COMM	GW	Very Small	7/1/2005	02	2950
6705812	Kellimar Court Apartment	COMM	GW	Very Small	1/1/2005	02	2456
6749412	Countryside Campground	TNC	GW	Very Small	7/1/2005	22	3100
6749612	Paradise Lake Golf & Banquet Center	TNC	GW	Very Small	10/1/2005	22	3100
6750712	Settlers Inn	TNC	GW	Very Small	10/1/2005	22	3100
6755212	The Outpost	TNC	GW	Very Small	4/1/2005	22	3100
6759912	Vaughn's Market 43 PWS	TNC	GW	Very Small	10/1/2005	22	3100
6762912	Save 4 Store	TNC	GW	Very Small	10/1/2005	21	3100

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant
6762912	Save 4 Store	TNC	GW	Very Small	10/1/2005	22	3100
6767112	ODNR-Nelson Ledges State Park	TNC	GW	Very Small	7/1/2005	21	3100
6767512	ODOT Rest Area 4-36	TNC	GW	Small	1/1/2005	22	3100
6767612	ODOT Rest Area 4-35 PWS	TNC	GW	Small	4/1/2005	22	3100
6772212	Twin Lakes Country Club	TNC	GW	Very Small	1/1/2005	22	3100
6778612	Camp Asbury- Shaw	TNC	GW	Very Small	7/1/2005	22	3100
6782112	Tiger Tech Day Care	NTNC	GW	Very Small	10/1/2005	22	3100
6782912	Ravenna Christian Missionary Alliance	TNC	GW	Very Small	10/1/2005	21	3100
6782912	Ravenna Christian Missionary Alliance	TNC	GW	Very Small	10/1/2005	22	3100
6830612	W.A. Christian Day Care	NTNC	GW	Very Small	10/1/2005	22	3100
6831512	ODOT-Rest Area 8-39 PWS	TNC	GW	Small	7/1/2005	21	3100
6831512	ODOT-Rest Area 8-39 PWS	TNC	GW	Small	7/1/2005	22	3100
6831612	ODOT-Rest Area 8-40 PWS	TNC	GW	Small	7/1/2005	21	3100
6831612	ODOT-Rest Area 8-40 PWS	TNC	GW	Small	7/1/2005	22	3100
6835512	Farmer's Market PWS	TNC	GW	Small	1/1/2005	21	3100
6900012	Stonehedge LLC Mobile Home Community	COMM	GW	Very Small	8/1/2005	21	3100
6901412	Country Acres Golf Club Water System	COMM	GW	Very Small	5/1/2005	22	3100
6901603	Putnam County-North Ottawa	COMM	PSW	Very Small	4/1/2005	02	2950
6932012	Columbus Grove Pool Tower PWS	TNC	GW	Very Small	7/1/2005	21	3100
6932012	Columbus Grove Pool Tower PWS	TNC	GW	Very Small	7/1/2005	22	3100
6932812	Dupont Service Company	TNC	GW	Very Small	7/1/2005	21	3100
6941712	St Johns Mennonite Church	TNC	GW	Very Small	7/1/2005	21	3100
6941712	St Johns Mennonite Church	TNC	GW	Very Small	7/1/2005	22	3100
6943012	Unverferth Manufacturing Company Inc	NTNC	GW	Very Small	7/1/2005	21	3100
6943012	Unverferth Manufacturing Company Inc	NTNC	GW	Very Small	7/1/2005	22	3100
7002914	Mansfield City PWS	COMM	SW	Large	4/1/2005	21	3100
7004511	Shelby Water Treatment Plant	COMM	SW	Medium	10/1/2005	02	2950
7004511	Shelby Water Treatment Plant	COMM	SW	Medium	4/1/2005	02	2950
7004511	Shelby Water Treatment Plant	COMM	SW	Medium	1/1/2005	02	2950
7004511	Shelby Water Treatment Plant	COMM	SW	Medium	7/1/2005	02	2950
7036312	Apostolic Christian Church	TNC	GW	Very Small	7/1/2005	22	3100
7046112	Springmill Church of God PWS	TNC	GW	Very Small	1/1/2005	22	3100
7047512	Ohio Edison-Mansfield SE	NTNC	GW	Very Small	10/1/2005	22	3100
7049112	Park Ave Professional	TNC	GW	Very Small	1/1/2005	21	3100
7049112	Park Ave Professional	TNC	GW	Very Small	7/1/2005	21	3100

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant
7049112	Park Ave Professional	TNC	GW	Very Small	7/1/2005	22	3100
7050512	Camp Avery Hand (BSA) Main Well	TNC	GW	Very Small	1/1/2005	02	1040
7050512	Camp Avery Hand (BSA) Main Well	TNC	GW	Very Small	10/1/2005	02	1040
7133012	Hopetown Market PWS	TNC	GW	Very Small	7/1/2005	22	3100
7136112	Hirn's Corner PWS	TNC	GW	Very Small	10/1/2005	21	3100
7136112	Hirn's Corner PWS	TNC	GW	Very Small	7/1/2005	02	1040
7136112	Hirn's Corner PWS	TNC	GW	Very Small	10/1/2005	02	1040
7136112	Hirn's Corner PWS	TNC	GW	Very Small	10/1/2005	22	3100
7232212	Knipp Farms, Inc. AMLC	TNC	GW	Very Small	10/1/2005	21	3100
7236412	Keller Chevrolet, Inc.	TNC	GW	Very Small	10/1/2005	22	3100
7255612	Crystal Arbor Banquet Hall PWS	TNC	GW	Very Small	10/1/2005	22	3100
7256512	Tractor Supply Company - Fremont	TNC	GW	Very Small	7/1/2005	22	3100
7258812	S W Chung MD	TNC	GW	Very Small	4/1/2005	22	3100
7258812	S W Chung MD	TNC	GW	Very Small	10/1/2005	22	3100
7258812	S W Chung MD	TNC	GW	Very Small	10/1/2005	21	3100
7400011	Attica Village Water Treatment Plant	COMM	SW	Small	4/1/2005	02	2950
7400011	Attica Village Water Treatment Plant	COMM	SW	Small	1/1/2005	02	2950
7400011	Attica Village Water Treatment Plant	COMM	SW	Small	7/1/2005	02	2950
7400011	Attica Village Water Treatment Plant	COMM	SW	Small	10/1/2005	02	2950
7431612	Carter Lumber Company	TNC	GW	Very Small	10/1/2005	21	3100
7437012	Moose Lodge 872	TNC	GW	Very Small	10/1/2005	21	3100
7445412	Christ's Church of Tiffin PWS	TNC	GW	Very Small	4/1/2005	22	3100
7447412	Michael G Scherer D.O.	TNC	GW	Very Small	10/1/2005	21	3100
7448612	Walnut Grove Campground	TNC	GW	Very Small	10/1/2005	21	3100
7449212	Alvada Construction Complex PWS	NTNC	GW	Very Small	7/1/2005	22	3100
7501712	Lehmkuhl's Landing-North PWS	TNC	GW	Very Small	10/1/2005	21	3100
7530112	Arrowhead Park Golf Club	TNC	GW	Very Small	10/1/2005	21	3100
7530112	Arrowhead Park Golf Club	TNC	GW	Very Small	10/1/2005	22	3100
7532312	Keyhole Tavern	TNC	GW	Very Small	7/1/2005	21	3100
7539712	Lehmkuhl Landing-South	TNC	GW	Very Small	10/1/2005	21	3100
7602112	Gaslite Villa Health Care	COMM	GW	Very Small	10/1/2005	22	3100
7630612	Baylor Beach Park, Inc. PWS	TNC	GW	Very Small	10/1/2005	02	1040
7631912	Bud's Corner PWS	TNC	GW	Very Small	1/1/2005	22	3100
7631912	Bud's Corner PWS	TNC	GW	Very Small	7/1/2005	22	3100
7631912	Bud's Corner PWS	TNC	GW	Very Small	7/1/2005	21	3100

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant
7637412	Circle K 5390 PWS	TNC	GW	Very Small	10/1/2005	22	3100
7638512	Marlboro Mfg Inc	NTNC	GW	Very Small	10/1/2005	22	3100
7640012	Northwest High School	NTNC	GW	Small	10/1/2005	21	3100
7640812	Beach City Bible Methodist	TNC	GW	Very Small	7/1/2005	22	3100
7644112	Walker Elementary School	NTNC	GW	Small	1/1/2005	22	3100
7645712	Fergy's PWS	TNC	GW	Very Small	2/1/2005	41	SWTR
7645712	Fergy's PWS	TNC	GW	Very Small	1/1/2005	41	SWTR
7645712	Fergy's PWS	TNC	GW	Very Small	3/1/2005	41	SWTR
7645712	Fergy's PWS	TNC	GW	Very Small	4/1/2005	41	SWTR
7645712	Fergy's PWS	TNC	GW	Very Small	6/1/2005	41	SWTR
7645712	Fergy's PWS	TNC	GW	Very Small	5/1/2005	41	SWTR
7645712	Fergy's PWS	TNC	GW	Very Small	6/1/2005	21	3100
7646512	Meadowlake Golf & Swim	TNC	SW	Very Small	2/1/2005	41	SWTR
7646512	Meadowlake Golf & Swim	TNC	SW	Very Small	1/1/2005	41	SWTR
7646512	Meadowlake Golf & Swim	TNC	SW	Very Small	3/1/2005	41	SWTR
7646512	Meadowlake Golf & Swim	TNC	SW	Very Small	7/1/2005	41	SWTR
7646512	Meadowlake Golf & Swim	TNC	SW	Very Small	8/1/2005	41	SWTR
7646512	Meadowlake Golf & Swim	TNC	SW	Very Small	9/1/2005	41	SWTR
7646512	Meadowlake Golf & Swim	TNC	SW	Very Small	12/1/2005	41	SWTR
7646512	Meadowlake Golf & Swim	TNC	SW	Very Small	11/1/2005	41	SWTR
7646512	Meadowlake Golf & Swim	TNC	SW	Very Small	10/1/2005	41	SWTR
7646512	Meadowlake Golf & Swim	TNC	SW	Very Small	5/1/2005	41	SWTR
7646512	Meadowlake Golf & Swim	TNC	SW	Very Small	4/1/2005	41	SWTR
7646512	Meadowlake Golf & Swim	TNC	SW	Very Small	6/1/2005	41	SWTR
7646812	Jim & Cathy's Musical Inn	TNC	GW	Very Small	10/1/2005	22	3100
7648312	Spud's Corner PWS	TNC	GW	Very Small	7/1/2005	22	3100
7655712	Kaufman Center	TNC	GW	Very Small	7/1/2005	22	3100
7657612	New Baltimore Church & School	NTNC	GW	Very Small	10/1/2005	22	3100
7663412	Amvets Post 12	TNC	GW	Very Small	10/1/2005	22	3100
7670712	Koch Knight LLC	NTNC	GW	Very Small	1/1/2005	22	3100
7670712	Koch Knight LLC	NTNC	GW	Very Small	7/1/2005	22	3100
7671212	The Chapel In Marlboro	TNC	GW	Small	1/1/2005	22	3100
7673012	New Hope Chapel PWS	TNC	GW	Very Small	7/1/2005	22	3100
7674012	Army Navy Garrison #2003 PWS	TNC	GW	Very Small	7/1/2005	22	3100
7674812	Maple Grove Mennonite Church PWS	TNC	GW	Very Small	7/1/2005	22	3100

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant
7675112	Miller Weld Master PWS	NTNC	GW	Very Small	7/1/2005	21	3100
7700001	Clinton Machine PWS	NTNC	GW	Very Small	7/1/2005	22	3100
7700003	Friendly Express PWS	TNC	GW	Very Small	10/1/2005	22	3100
7720212	Wills Trucking	TNC	GW	Very Small	1/1/2005	22	3100
7720212	Wills Trucking	TNC	GW	Very Small	10/1/2005	22	3100
7720212	Wills Trucking	TNC	GW	Very Small	4/1/2005	22	3100
7720412	Subway-Manchester Rd. PWS	TNC	GW	Very Small	4/1/2005	22	3100
7720912	Dug Out	TNC	GW	Very Small	10/1/2005	22	3100
7721212	Rite Aid - #2456	TNC	GW	Very Small	1/1/2005	22	3100
7721212	Rite Aid - #2456	TNC	GW	Very Small	10/1/2005	22	3100
7721212	Rite Aid - #2456	TNC	GW	Very Small	10/1/2005	21	3100
7721412	Merchant Service Center PWS	NTNC	SW	Very Small	2/1/2005	41	SWTR
7721412	Merchant Service Center PWS	NTNC	SW	Very Small	1/1/2005	41	SWTR
7721412	Merchant Service Center PWS	NTNC	SW	Very Small	3/31/2005	41	SWTR
7724112	Steve's Motel PWS	TNC	GW	Very Small	10/1/2005	21	3100
7726112	CVS Pharmacy #3092	TNC	GW	Very Small	1/1/2005	22	3100
7728012	Mogadore Christian Academy PWS	NTNC	GW	Very Small	4/1/2005	22	3100
7728612	Vineyard City Church PWS	TNC	GW	Very Small	4/1/2005	21	3100
7728612	Vineyard City Church PWS	TNC	GW	Very Small	7/1/2005	22	3100
7728612	Vineyard City Church PWS	TNC	GW	Very Small	10/1/2005	22	3100
7728712	Manchester Church of Christ PWS	TNC	GW	Very Small	10/1/2005	21	3100
7728712	Manchester Church of Christ PWS	TNC	GW	Very Small	10/1/2005	22	3100
7729212	West Akron ACC Nazarean Church PWS	TNC	GW	Very Small	7/1/2005	22	3100
7729212	West Akron ACC Nazarean Church PWS	TNC	GW	Very Small	10/1/2005	22	3100
7735012	Grill Elementary School	NTNC	GW	Very Small	1/1/2005	22	3100
7737612	Occasions Party Centre	TNC	GW	Very Small	4/1/2005	21	3100
7738012	Meridian Sun Temple	TNC	GW	Very Small	7/1/2005	21	3100
7742712	BP Oil Station #22489 PWS	TNC	GW	Very Small	10/1/2005	22	3100
7743612	Trinity Church of Nazarene	TNC	GW	Very Small	7/1/2005	22	3100
7743612	Trinity Church of Nazarene	TNC	GW	Very Small	10/1/2005	22	3100
7745212	East Liberty Assembly of God	TNC	GW	Very Small	1/1/2005	21	3100
7747312	JAH, Inc.	TNC	GW	Very Small	7/1/2005	21	3100
7757012	Akron Yacht Club	TNC	GW	Very Small	10/1/2005	21	3100
7758912	DBA: Clearview Inn PWS	TNC	GW	Very Small	1/1/2005	22	3100
7762612	Manchester Tavern PWS	TNC	GW	Very Small	4/1/2005	21	3100

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant
7765212	Portage Lake Eagles #273	TNC	GW	Very Small	10/1/2005	21	3100
7765212	Portage Lake Eagles #273	TNC	GW	Very Small	10/1/2005	22	3100
7769412	Stancatos Cafe of Richfield	TNC	GW	Very Small	10/1/2005	21	3100
7769412	Stancatos Cafe of Richfield	TNC	GW	Very Small	10/1/2005	22	3100
7770312	Franklin Park Civic Center	TNC	GW	Very Small	7/1/2005	21	3100
7770312	Franklin Park Civic Center	TNC	GW	Very Small	10/1/2005	21	3100
7770912	Turkeyfoot Lanes	TNC	GW	Very Small	10/1/2005	21	3100
7770912	Turkeyfoot Lanes	TNC	GW	Very Small	10/1/2005	22	3100
7774312	Greensburg Church of God	TNC	GW	Very Small	10/1/2005	22	3100
7776112	The Falcon Lounge	TNC	GW	Very Small	10/1/2005	21	3100
7783912	Copley United Methodist	TNC	GW	Very Small	10/1/2005	22	3100
7784512	Harvest Bible Church	TNC	GW	Very Small	7/1/2005	22	3100
7789012	North Canton Transfer	NTNC	GW	Very Small	10/1/2005	21	3100
7789412	Lion Garden	TNC	GW	Very Small	7/1/2005	22	3100
7792512	Ryan's Family Steak PWS	NTNC	GW	Very Small	10/1/2005	21	3100
7793512	Karman Rubber Co.	NTNC	GW	Very Small	7/1/2005	22	3100
7798412	Holland Oil #51	TNC	GW	Very Small	10/1/2005	21	3100
7799112	Clarke Ford-Show Room	NTNC	GW	Very Small	10/1/2005	22	3100
7800712	Briarfield of Cortland	COMM	GW	Very Small	8/1/2005	22	3100
7833012	Hole In The Wall	TNC	GW	Very Small	7/1/2005	21	3100
7835212	Bloomfield High School	NTNC	GW	Very Small	1/1/2005	02	1005
7839812	Mecca Cones & Coneys	TNC	GW	Very Small	7/1/2005	22	3100
7840012	The Lake Tavern	TNC	GW	Very Small	1/1/2005	22	3100
7842312	Harmony Hill Family Restaurant & Lounge, Inc.	TNC	GW	Very Small	10/1/2005	22	3100
7845112	Riverview Golf-Clubhouse	TNC	GW	Very Small	10/1/2005	22	3100
7902303	Village of Roswell PWS	COMM	PGW	Very Small	9/1/2005	21	3100
7902303	Village of Roswell PWS	COMM	PGW	Very Small	9/1/2005	22	3100
7942112	Zion Lutheran Church	TNC	GW	Very Small	7/1/2005	21	3100
8034412	St. Pauls Lutheran School	NTNC	GW	Very Small	9/1/2005	21	3100
8035112	Lee Dogs Saloon & Grill	TNC	GW	Very Small	2/1/2005	21	3100
8035112	Lee Dogs Saloon & Grill	TNC	GW	Very Small	1/1/2005	21	3100
8035112	Lee Dogs Saloon & Grill	TNC	GW	Very Small	2/1/2005	22	3100
8035112	Lee Dogs Saloon & Grill	TNC	GW	Very Small	1/1/2005	22	3100
8036412	United Rotary Brush Co Inc	NTNC	GW	Very Small	10/1/2005	21	3100
8037012	Allied Systems	NTNC	GW	Very Small	9/1/2005	21	3100

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant
8037012	Allied Systems	NTNC	GW	Very Small	10/1/2005	21	3100
8037012	Allied Systems	NTNC	GW	Very Small	9/1/2005	22	3100
8037512	Mad River Egg Farm	NTNC	GW	Very Small	10/1/2005	22	3100
8037512	Mad River Egg Farm	NTNC	GW	Very Small	9/1/2005	22	3100
8038312	Daylay Farm 3	NTNC	GW	Very Small	10/1/2005	21	3100
8038312	Daylay Farm 3	NTNC	GW	Very Small	10/1/2005	22	3100
8038312	Daylay Farm 3	NTNC	GW	Very Small	9/1/2005	22	3100
8131312	Countryside Chapel U.M.	TNC	GW	Very Small	10/1/2005	22	3100
8133012	Huggy Bear Campground	TNC	GW	Very Small	7/1/2005	22	3100
8134912	Salem Presbyterian Church	TNC	GW	Very Small	7/1/2005	22	3100
8136612	ODOT-Rest Area 1-27 PWS	TNC	GW	Small	10/1/2005	21	3100
8136712	ODOT- Rest Area 1-28 PWS	TNC	GW	Small	7/1/2005	22	3100
8136712	ODOT- Rest Area 1-28 PWS	TNC	GW	Small	10/1/2005	22	3100
8137312	Camp Clay Nature Center PWS	TNC	GW	Very Small	10/1/2005	22	3100
8137312	Camp Clay Nature Center PWS	TNC	GW	Very Small	7/1/2005	21	3100
8137312	Camp Clay Nature Center PWS	TNC	GW	Very Small	10/1/2005	21	3100
8200603	Vinton County Water Comp	COMM	PSW	Small	1/1/2005	02	2456
8231311	Chief Logan/BSA	TNC	GW	Very Small	1/1/2005	21	3100
8231311	Chief Logan/BSA	TNC	GW	Very Small	1/1/2005	22	3100
8231311	Chief Logan/BSA	TNC	GW	Very Small	3/1/2005	22	3100
8344312	Frontier Campground	TNC	GW	Very Small	8/1/2005	21	3100
8344312	Frontier Campground	TNC	GW	Very Small	7/1/2005	21	3100
8344312	Frontier Campground	TNC	GW	Very Small	10/1/2005	22	3100
8361212	Little Miami Canoe Rental PWS	TNC	GW	Very Small	7/1/2005	22	3100
8446412	Smurfit-Stone Corporation	NTNC	GW	Very Small	7/1/2005	22	3100
8446812	Reno Mini Mart	TNC	GW	Very Small	7/1/2005	21	3100
8446812	Reno Mini Mart	TNC	GW	Very Small	4/1/2005	22	3100
8530312	Apostolic Christian Church - Rittman	TNC	GW	Small	4/1/2005	21	3100
8531012	Beck's Family Camp	TNC	GW	Very Small	10/1/2005	21	3100
8531212	Bethany Christian Day School	NTNC	GW	Very Small	1/1/2005	22	3100
8535012	Shorty's Market	TNC	GW	Very Small	10/1/2005	22	3100
8535112	County Line Mennonite Church	TNC	GW	Very Small	1/1/2005	22	3100
8535112	County Line Mennonite Church	TNC	GW	Very Small	8/24/2005	22	3100
8535812	Caskeys Inc	TNC	GW	Very Small	10/1/2005	21	3100
8542612	Mohican Church of the Brethren	TNC	GW	Very Small	7/1/2005	22	3100

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant
8546012	Putnam Post House	TNC	GW	Very Small	10/1/2005	21	3100
8546012	Putnam Post House	TNC	GW	Very Small	10/1/2005	22	3100
8546512	Rock of Ages School	NTNC	GW	Very Small	7/1/2005	22	3100
8550412	Wayne Presbyterian Church	TNC	GW	Very Small	7/1/2005	21	3100
8554612	CNC Metal Products (Global Body & Equip)	NTNC	GW	Very Small	7/1/2005	21	3100
8554612	CNC Metal Products (Global Body & Equip)	NTNC	GW	Very Small	10/1/2005	21	3100
8554612	CNC Metal Products (Global Body & Equip)	NTNC	GW	Very Small	7/1/2005	22	3100
8554612	CNC Metal Products (Global Body & Equip)	NTNC	GW	Very Small	10/1/2005	22	3100
8557012	Hartzler Family Dairy	TNC	GW	Very Small	10/1/2005	22	3100
8557412	Gas & Oil Inc No. 18 PWS	TNC	GW	Very Small	1/1/2005	21	3100
8557412	Gas & Oil Inc No. 18 PWS	TNC	GW	Very Small	10/1/2005	21	3100
8560512	St. Michael's Lutheran Church PWS	TNC	GW	Very Small	10/1/2005	21	3100
8560512	St. Michael's Lutheran Church PWS	TNC	GW	Very Small	10/1/2005	22	3100
8560812	Hartland Party Center PWS	TNC	GW	Very Small	7/1/2005	22	3100
8601312	Pioneer Village PWS	COMM	GW	Small	9/1/2005	22	3100
8630312	Kunkle Farms AMLC	TNC	GW	Very Small	10/1/2005	21	3100
8632412	St Joseph's School PWS	NTNC	GW	Very Small	4/1/2005	22	3100
8633612	Anderson Vreeland	NTNC	GW	Very Small	10/1/2005	22	3100
8633612	Anderson Vreeland	NTNC	GW	Very Small	7/1/2005	22	3100
8636712	Orchard Hills Country Club	TNC	GW	Very Small	10/1/2005	22	3100
8640812	Kunkle United Baptist In Christ Church PWS	TNC	GW	Very Small	4/1/2005	22	3100
8701611	North Baltimore WTP	COMM	SW	Medium	4/1/2005	02	2950
8701611	North Baltimore WTP	COMM	SW	Medium	1/1/2005	02	2950
8703211	Northwestern W & S Dist - Weston Area	COMM	PSW	Small	7/1/2005	02	2950
8703211	Northwestern W & S Dist - Weston Area	COMM	PSW	Small	10/1/2005	02	2950
8732212	Edgewood Inn	TNC	GW	Very Small	7/1/2005	21	3100
8738612	Inland Property Mgmt	TNC	GW	Very Small	10/1/2005	22	3100
8739212	St Louis Catholic School	NTNC	GW	Very Small	2/1/2005	21	3100
8739212	St Louis Catholic School	NTNC	GW	Very Small	1/1/2005	21	3100
8739212	St Louis Catholic School	NTNC	GW	Very Small	1/1/2005	22	3100
8743412	Webster Elementary School	NTNC	GW	Very Small	10/1/2005	22	3100
8745412	Pioneer Hi Bred International	NTNC	GW	Very Small	1/1/2005	22	3100
8745412	Pioneer Hi Bred International	NTNC	GW	Very Small	4/1/2005	22	3100
8748912	St. Paul's Evangenlist Lutheran Church PWS	NTNC	GW	Very Small	7/1/2005	21	3100
8748912	St. Paul's Evangenlist Lutheran Church PWS	NTNC	GW	Very Small	10/1/2005	21	3100

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant
8748912	St. Paul's Evangenlist Lutheran Church PWS	NTNC	GW	Very Small	10/1/2005	22	3100
8748912	St. Paul's Evangenlist Lutheran Church PWS	NTNC	GW	Very Small	7/1/2005	22	3100
8749112	Hosanna Lutheran Church	TNC	GW	Very Small	7/1/2005	21	3100
8750912	Zion Lutheran Church - Luckey	TNC	GW	Very Small	10/1/2005	22	3100
8800511	Upper Sandusky City PWS	COMM	SW	Medium	1/1/2005	41	SWTR
8834512	ODNR-Killdeer Plains #2 PWS	TNC	GW	Very Small	7/1/2005	22	3100
8835112	Pentecostal Church of God PWS	TNC	GW	Very Small	10/1/2005	21	3100
8835112	Pentecostal Church of God PWS	TNC	GW	Very Small	10/1/2005	22	3100
8835512	Ridge Chapel Church of Nazarene PWS	TNC	GW	Very Small	4/1/2005	02	1040
8836712	Saint Joseph Catholic Church PWS	TNC	GW	Very Small	10/1/2005	21	3100
8836712	Saint Joseph Catholic Church PWS	TNC	GW	Very Small	10/1/2005	22	3100
8841112	Carey Conservation Campground PWS	TNC	GW	Very Small	4/1/2005	21	3100