

**OHIO'S PUBLIC WATER SYSTEMS
ANNUAL COMPLIANCE REPORT**

FOR

CALENDAR YEAR 2006

**OHIO ENVIRONMENTAL PROTECTION AGENCY
DIVISION OF DRINKING AND GROUND WATERS
OCTOBER 1, 2007**

TABLE OF CONTENTS

Introduction 1

The Drinking Water Program: An Overview 1

Regulated Public Water Systems in Ohio 2

Annual State PWS Compliance Report 3

Maximum Contaminant Level 3

Treatment Techniques 4

Monitoring 4

Consumer Notification 4

Maximum Residual Disinfectant Level 4

Compliance Table Summary Analysis 5

Organic Contaminants 8

Inorganic Contaminants 11

Radionuclide Contaminants 13

Total Coliform Regulations 14

Surface Water Treatment Regulations 16

Lead and Copper Regulations 18

Consumer Confidence Report Requirements 19

Compliance Summary 20

Ohio EPA’s Public Water System Compliance Assistance 21

Listing of Maximum Contaminant Level and Treatment Technique Violations . 21

Report Availability and Contact Information 22

APPENDIX A: COMPLIANCE SUMMARY TABLE

APPENDIX B: MCL and TT VIOLATION LISTING

List of Tables

Table 1.	Public Water System Summary by Category Type	2
Table 2.	Public Water System Summary by Source Type	3
Table 3.	Public Water System Summary by Population Categories	3
Table 4.	Violation Totals and Compliance Rates per Contaminant Group	5
Table 5.	Violation Totals for 2006	6
Table 6.	Violation Totals and Compliance Rates for Individual MCL Contaminant Group Constituents	7
Table 7.	Enforcement Action Code Types	22

List of Figures

Figure 1.	Percentage Distribution of PWSs with Violations per System Type and Population Served Category	6
Figure 2.	Systems with Organic Contaminant Monitoring/Reporting Violations by Population Categories	10
Figure 3.	Systems with Organic Contaminant Monitoring/Reporting Violations by System Type	10
Figure 4.	Systems with Inorganic Contaminant Monitoring/Reporting Violations by System Type	12
Figure 5.	Systems with Inorganic Contaminant Monitoring/Reporting Violations by Population Categories	13
Figure 6.	Community Systems with Radionuclide Contaminant Monitoring/Reporting Violations by Population Categories	14
Figure 7.	Systems with Total Coliform MCL (Acute and Non-Acute) and Significant Monitoring/Reporting Violations by Population Categories	15
Figure 8.	Systems with Total Coliform MCL (Acute and Non-Acute) and Significant Monitoring/Reporting Violations by System Type	16
Figure 9.	Systems with Surface Water Treatment Rule Monitoring/Reporting and Treatment Technique Violations by System Type	17
Figure 10.	Systems with Surface Water Treatment Rule Monitoring/Reporting and Treatment Technique Violations by Population Categories	17
Figure 11.	Systems with Lead and Copper Significant Initial and Follow-up/Routine Monitoring/Reporting Violations by Population Categories	18
Figure 12.	Systems with Lead and Copper Significant Initial and Follow-up/Routine Monitoring/Reporting Violations by System Type	19
Figure 13.	Systems with Consumer Confidence Report Violations by Population Categories	20

Introduction

The 1996 Amendments to the Safe Drinking Water Act require each State to prepare an Annual Compliance Report summarizing violations incurred by public water systems. The Annual Compliance Report is to be compiled by the State and submitted to U.S. EPA and made available to the public. This report summarizes compliance rates and the number and types of violations generated as a result of various public water systems failing to meet certain Safe Drinking Water Act requirements for calendar year 2006.

Ohio's 2006 Annual Compliance Report contains an overview of the Public Water System Supervision Program in Ohio; provides summary information on the number, types and population served for public water systems; explains the requirements of the Annual Compliance Report; defines the primary categories for which violation information is summarized; a summary table of the number and types of violations; an analysis of public water system compliance with the regulations; and a list of public water system violations for the maximum contaminant level and treatment technique categories.

The method of calculating compliance rates for this report has been adjusted from the method used in previous years to be consistent with the expectations of U.S. EPA to measure progress toward meeting a series of compliance goals for the public water supply program. Compliance rates for this report are based on the number of violations or number of public water systems in violation compared to the total number of water systems subject the specific monitoring/reporting requirement or health standard of interest. In past years, Ohio's Annual Compliance Report has compared violations to the number of water systems subject to specific monitoring/reporting requirements during that specific calendar year. Because some water systems are not required to monitor for certain contaminants every calendar year, the different methods yield different compliance rates in some categories.

The Drinking Water Program: An Overview

U.S. EPA established the Public Water System Supervision (PWSS) Program under the authority of the 1974 Safe Drinking Water Act (SDWA). Under the SDWA and the 1986 and 1996 Amendments, U.S. EPA sets national limits on contaminant levels in drinking water to ensure that the water is safe for human consumption. These limits are known as Maximum Contaminant Levels (MCLs). For some regulations, U.S. EPA establishes treatment techniques in lieu of an MCL to control unacceptable levels of contaminants in water by measuring the level of treatment. The Agency also regulates how often public water systems (PWSs) monitor their water for contaminants and report the monitoring results to the States or U.S. EPA. Generally, the larger the population served by a water system, the more frequent the monitoring and reporting (M/R) requirements. However, the M/R requirements vary dependent on which contaminant is being evaluated and the source water used by a system (surface water systems and systems that use ground water under the direct influence of surface water typically monitor more frequently than a ground water system). Finally, public water systems are required to notify the public when they have violated these regulations. The 1986 Amendments and further revisions under the 1996 Amendments to the SDWA require public notification to include a clear and understandable explanation of the nature of the violation, its potential adverse health effects, steps that the public water system is undertaking to correct the violation and the possibility for the need to obtain alternative water supplies during the violation.

The SDWA allows States to seek U.S. EPA approval to administer their own PWSS Programs. The authority to run a PWSS Program is called primacy. To receive primacy, States must meet certain requirements in the SDWA and the regulations, including the adoption of drinking water regulations that are at least as stringent as the Federal regulations and provide a demonstration that they can enforce the program requirements. *Ohio is a primacy state.*

Regulated Public Water Systems in Ohio

In Ohio, a public water system is defined as a system that provides water via piping or other constructed conveyances for human consumption to at least 15 service connections or serves an average of at least 25 people for at least 60 days each year. There are three types of public water systems (PWS):

- community water systems serve at least fifteen service connections used by year-round residents or regularly serve at least twenty-five year-round residents (e.g. cities; mobile home parks)
- nontransient noncommunity systems serve at least twenty-five of the same persons over six months per year (e.g. schools; businesses)
- transient noncommunity systems serves at least 25 different persons over 60 days per year (e.g. rest stops; parks)

These three type of systems use either a ground water source, surface water source, or use ground water under the direct influence of surface water. In addition, Ohio regulates the drinking water systems associated with agricultural migrant labor camps as defined by the Ohio Department of Agriculture even though they may not meet the minimum number of people or service connections. For this report when the acronym “PWS” is used, it means systems of all types unless specified in greater detail. In Ohio, 5,369 public water systems serve approximately 10.8 million people daily with an average production of approximately 1.7 billion gallons of water per day. This yields an average water use of 157 gallons per person per day. Table 1 summarizes the total number and percentage of active public water systems per type with the corresponding total population served daily. Table 2 summarizes the number of public water systems by source type.

The total number and percentage of PWS by population categories are presented in Table 3. An interesting note from this table is that 11 PWS, less than 1 percent of the total systems in the state, serve over 40 percent of the entire Ohio population.

Table 1. Public Water System Summary by Category Type

PWS Category Type	Number of PWS per Category	Percentage of each PWS Type	Total Population Served Daily per Category
Community (CWS)	1,297	24%	10,147,830
Non-Transient Non-Community (NTNC)	913	17%	220,479
Transient Non-Community (TNC)	3,159	59%	458,322
Total	5,369	100%	10,826,631

Table 2. Public Water System Summary by Source Type

PWS Category Type	Surface Waters	Ground Waters	Purchased Surface Waters	Purchased Ground Waters
Community (CWS)	118	908	163	108
Non-Transient Non-Community (NTNC)	6	897	2	8
Transient Non-Community (TNC)	18	3,119	8	14
Total	142	4,924	173	130

Table 3. Public Water System Summary by Population Categories

PWS Populations Categories	Number of PWS per Category	Percentage of the Total PWS for each Category	Total Population Served Daily per Category
Population: 25 - 500	4,395	81.8%	556,127
Population: 501 - 3,300	660	12.3%	823,403
Population: 3,301 - 10,000	156	3%	948,678
Population: 10,001 - 100,000	147	2.7%	3,772,129
Population: Greater than 100,000	11	0.2%	4,726,294
Total	5,369	100%	10,826,631

Annual State PWS Compliance Report

Ohio EPA submits data to U.S. EPA's Safe Drinking Water Information System (SDWIS/FED) on a quarterly basis. The data includes PWS inventory statistics, the incidence of MCL, major monitoring, treatment technique violations, and the enforcement actions taken against violators. This Annual Compliance Report provides a total annual representation of the number of violations for each of the four categories listed in section 1414(c)(3)(A)(i) of the Safe Drinking Water Act re-authorization, as well as consumer notification requirements. This report will analyze violation and compliance information for the 2006 calendar year using four categories: MCLs, treatment techniques, significant monitoring violations, and consumer notifications. This report was generated with the data available in Ohio EPA's database as of September 2007.

1. *Maximum Contaminant Level*

Under the SDWA, U.S. EPA sets national limits on contaminant levels in drinking water to ensure that the water is safe for human consumption. These limits are known as MCLs. When a PWS exceeds an MCL, it is required to notify the public of the violation within 24 hours for acute violations that may pose an acute risk to human health (e.g. nitrate; total coliform), and within 30

days for nonacute MCL violations (e.g. volatile organic chemicals; synthetic organic chemicals). In addition, the water system must continue to monitor regularly, as well as take steps to correct the contamination problem.

2. *Treatment Techniques*

For some regulations, the U.S. EPA establishes treatment techniques (TTs) in lieu of an MCL to control unacceptable levels of certain contaminants by a measurement of the treatment process. Treatment techniques have been established for viruses, some bacteria, turbidity, lead and copper and disinfection by-product precursors.

3. *Monitoring*

A PWS is required to monitor and verify that the levels of contaminants present in the water do not exceed the MCL. If a PWS fails to have its water tested as required, then a monitoring violation occurs. A monitoring violation also includes failure to report test results correctly to the State. These violations occur when a system misses one or more of several sampling events, or samples but does so outside the required time period. When a PWS fails to have its water tested as required, it is required to notify the public of the violation. For a system monitoring less frequently than quarterly, it is required to sample for the contaminant(s) missed, in order to return to compliance.

Return to Compliance

As noted in the definition of monitoring violations, systems which monitor less frequently than quarterly can return to compliance. Some systems can return to compliance if they monitor for the missed contaminants or submit reports late. In this report, return to compliance rates were determined for inorganic contaminants; nitrate; nitrite; regulated volatile organic contaminants; synthetic organic contaminants; total trihalomethanes; haloacetic acids; and radiological contaminants, as a group.

Significant Monitoring Violations

For this report, significant monitoring violations are defined as any major monitoring violation that has occurred during the specified report interval. A major monitoring violation occurs when no samples were taken or no results are reported during a compliance period.

4. *Consumer Notification*

Every Community Water System is required to deliver to its customers a brief annual water quality report - a Consumer Confidence Report (CCR). This report is to include some educational material, and provide information on the source water, the levels of any detected contaminants, and compliance with drinking water regulations.

Significant Consumer Notification Violations

A significant consumer notification violation occurred if a community water system completely failed to provide its customers the required annual water quality report.

5. *Maximum Residual Disinfectant Level*

U.S. EPA sets national limits on residual levels of disinfectants in drinking water to reduce the risk of exposure to disinfection byproducts formed when PWSs add chemical disinfectants for either primary or residual treatment. These limits are known as Maximum Residual Disinfectant Levels (MRDLs).

Compliance Table Summary Analysis

A summary table of PWS compliance rates and violations for the 2006 calendar year is included in Appendix A. The information summarized in the table includes the total number of PWS required to comply with individual contaminant requirements; total number of violations; total number of systems with a violation; and percent compliance achieved for a particular regulated contaminant in three different violation categories. These violation categories are MCL, Treatment Technique and Monitoring/CCR. The regulatory contaminant categories include: organic contaminants, inorganic contaminants, and radionuclide contaminants, all of which are classified as the MCL contaminant group; total coliform bacteria regulations (TCR); surface water treatment regulations (SWTR); interim enhanced surface water treatment regulations (IESWTR); lead and copper regulations, and CCR notifications.

Violation totals and compliance rates for each of the contaminant groups are presented in Table 4. Compliance rates are based on the total number of systems required to comply with each of the contaminant categories. For example, the 89 % SWTR compliance rate is based on 142 systems required to meet surface water treatment requirements with 16 systems failing to fully comply during some portion of the year.

Table 4. Violation Totals and Compliance Rates per Contaminant Group Category

Contaminant Category	MCL			Treatment Technique			Monitoring or CCR notifications		
	Violations	No. of Systems in Violation	Comp. Rate	Violations	No. of Systems in Violation	Comp. Rate	Violations	No. of Systems in Violation	Comp. Rate
MCL Contaminant Group ¹	247	122	98%				1,595	630	88%
TCR ²	689	467	91%				1,487	1,035	81%
SWTR ³				80	16	89%	3	2	99%
Lead and Copper				1	1	99%	26	26	99%
CCR ⁴							95	95	93%
TOC ⁵				4	2	99%	3	2	99%
IESWTR ⁶ and LTI ⁷				18	7	95%	5	3	98%

¹MCL Contaminant Group includes volatile organic, synthetic organic, inorganic, total trihalomethanes, haloacetic acid, nitrate and nitrite chemicals and radiological contaminants

²Total Coliform Rule

³SurfaceWwater Treatment Rule

⁴consumer confidence reports

⁵total organic carbon


⁶Interim Enhanced Surface Water Treatment Rule

⁷Long Term Enhanced Surface Water Treatment Rule

Table 5. State of Ohio Violation Totals for 2006

	MCL	Monitoring	CCR	Treatment Technique	Totals
Number of Community Systems in Violation	100	241	95	16	351
Number of Community Violations	211	530	95	51	887
Number of Nontransient Systems in Violation	143	222	NA	1	260
Number of Nontransient Violations	212	907	NA	1	1,120
Number of Transient Systems in Violation	346	1,320	NA	11	1,188
Number of Transient Violations	513	1,868	NA	58	2,439
Total Number of Systems in Violation	578	1,447	95	25	1,799
Total Number of Violations	936	3,305	95	110	4,446

Figure 1.

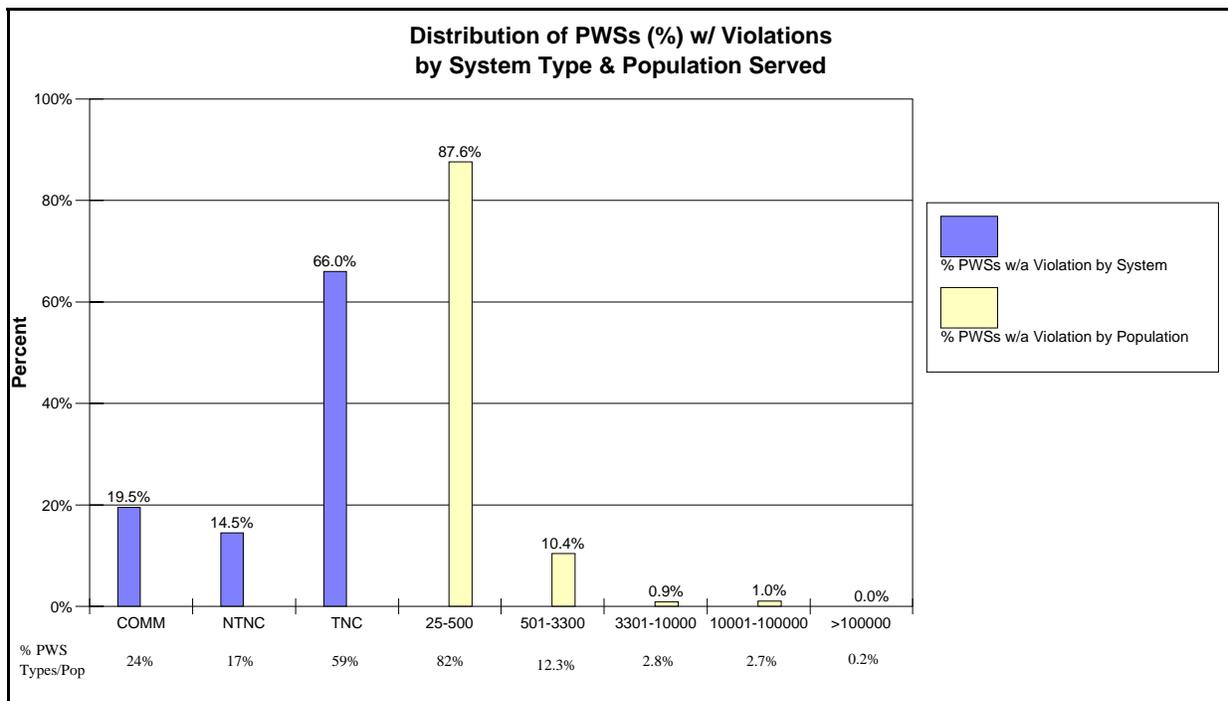

As depicted in Figure 1, of all water systems with at least one violation, nearly 66 percent were associated with TNC water systems, 14.5 percent with NTNC water systems and 19.5 percent with CWS. Of the PWS having one or more violations, 87.6 percent were associated with a population served category of fewer than 500 people per day.

Approximately 74 percent of the violations in Ohio occur because public water systems fail to monitor and report for various required contaminants in the period as specified on an individual system monitoring schedule provided by the Director of Ohio EPA or by rule, or as a result of failing to collect follow-up or repeat samples. An average of 52 percent of systems returned to compliance following their violation(s) (see the definition of “return to compliance” for the list of contaminants included in the calculation). A detailed analysis of each contaminant group and violation category is presented below. When sufficient data was available, charts displaying the number of water systems with a violation per system type and population categories have been prepared and included in this report.

MCL Contaminant Group

The total number of violations and total number of water systems with at least one violation in the MCL Contaminant Group is presented in more detail in Table 6.

Table 6. Violation Totals and Compliance Rates for the Individual MCL Contaminant Group Constituents

Contaminant Category	MCL				Monitoring Requirements			
	Violations	No. of Systems in Violation	No. of Systems Required to Monitor	Comp. Rate	Violations	No. of Systems in Violation	No. of Systems Required to Monitor	Comp. Rate
VOCs ¹	4	1	1929	99.9%	714	27	1929	98.0%
SOCs ²	0	0	1929	100.0%	102	29	1929	98.0%
TTHMs ³	107	42	1483	96.0%	33	30	1483	97.0%
HAAs ⁴	30	15	1483	98.0%	38	34	1483	97.0%
IOCs ⁵	94	64	1929	97.0%	163	65	1929	97.0%
Nitrate	12	9	5066	99.8%	517	456	5066	91.0%
Nitrite	0	0	5066	100.0%	4	4	5066	99.0%
Rads ⁶	0	0	1026	100.0%	24	12	1026	99.0%

¹volatile organic chemicals

²synthetic organic chemicals

³total trihalomethanes

⁴haloacetic acids

⁵inorganic chemicals

⁶radiological contaminants

Organic Contaminants

The organic contaminants group summarized in the Compliance Table include: volatile organic chemicals (VOCs); synthetic organic chemicals (SOCs); total trihalomethanes (TTHMs) and haloacetic acids (HAAs).

VOCs are predominantly used as solvents, degreasers, cleaning solutions, dry cleaning fluids, and components of pesticides and plastics. These chemicals are described as volatile because of their tendency to evaporate. They generally enter drinking water systems through spills and improper disposal. VOCs are monitored by all community and nontransient noncommunity PWS are placed on one of three schedules based on source type and past monitoring history: one sample quarterly, one sample annually, or one sample in 3 years. During the three year compliance period from 2005 through 2007, approximately 1,929 public water systems are required to sample at least once for VOCs. A significant difference to note between monitoring for VOCs and other contaminant groups is that every time a PWS samples for VOCs, they are required to have the sample analyzed for 21 regulated VOC compounds using one analytical method which scans for all of the compounds. So, for each missed VOCs sample, a PWS would have 21 violations for the regulated VOC compounds. This creates an artificially high number of violations for the VOCs group as well as the total number of violations issued in Ohio. For 2006, there are 714 individual VOC compound M/R violations. This really represents 34 VOCs samples which were not collected. During 2006, 27 of the approximately 1,929 public water systems required to sample during the three year compliance period from 2005 through 2007 failed to collect one or more samples which resulted in a M/R violation. Overall compliance for the VOC M/R is 98 percent. Approximately 85 percent of the VOC M/R violations were associated with nontransient noncommunity systems and all of the VOC M/R violations were attributed to systems serving 3,300 or fewer persons. One system, currently in enforcement, exceeded one of the VOC MCLs.

VOC Contaminant Group Highlights

- ▶ 1,929 public water systems required to collect VOC samples
- ▶ 99.9 percent compliance with all VOC MCLs
- ▶ 98 percent of the public water systems are in compliance for the VOC M/R category
- ▶ 714 individual VOC violations
- ▶ 100 percent of the VOC M/R violations occurred at PWS serving less than 3,300 people

SOCs, which includes primarily pesticides, are monitored by all community and nontransient noncommunity PWS. Some of the SOC are monitored more often than others because they are used in large quantities on Ohio farm fields, like alachlor, atrazine, and simazine. Based on Ohio's pesticide study, some systems are required to monitor more frequently during time periods which are most likely to see occurrence of the contaminants.

Ground water systems monitor for alachlor, atrazine, and simazine at least once every three years. If a ground water system has a detection for one of these SOC, they are required to monitor at a minimum on a quarterly basis.

Because Ohio's surface water systems are more vulnerable to pesticide contamination, they typically are required to monitor for alachlor, atrazine, and simazine every year at a much greater frequency than ground water systems, including every-other-week May thru July for systems that have a history of elevated pesticide levels in their finished water.

All systems are required to monitor the remaining 14 SOC once every three years if they have a mean nitrate measurement greater than 2 mg/L. Nitrate is used as an indicator of a system's susceptibility.

Monitoring waivers are granted for systems that have a mean nitrate concentration less than or equal to 2 mg/L. The waivers are granted for a 3-year period and must be renewed when that period lapses.

Approximately 1,929 public water systems were required to sample for one or more of the SOC compounds during the three year compliance period from 2005 through 2007. During 2006, there were 29 public water systems that failed to collect one or more SOC samples which resulted in a M/R violation. No public water systems exceeded an SOC MCL during 2006. The overall M/R compliance rate for 2006 was 98.5 percent.

SOC Contaminant Group Highlights

- ▶ 1,929 public water systems required to sample for SOCs
- ▶ 100 percent compliance with all SOCs MCLs
- ▶ 98.5 percent of the public water systems were in compliance for all SOCs M/R
- ▶ 59 percent of the M/R violations occurred at PWS serving less than 500 people

TTHMs are classified as organic disinfection by-products. They are created when organic and inorganic compounds react with the disinfectant added to the water. (It is important to note that disinfectants are an important part of the control of water-borne pathogens.) TTHMs are sampled in the distribution systems of community and noncommunity PWS that treat their water with any combination of chlorine, chloramines, chlorine dioxide or ozone. Community water systems and nontransient noncommunity surface water systems serving less than 10,000 persons, and nontransient noncommunity ground water systems that disinfect were required to sample for TTHMs beginning in 2004.

During the three year compliance period from 2005 through 2007, approximately 1,483 PWSs were required to monitor for TTHMs. During the 2006 calendar year, there were 30 systems that failed to monitor, and 42 systems exceeded the MCL of 0.080 milligrams per liter (mg/L). Compliance with the TTHM MCL is determined by calculating a running annual average at the end of each quarter. Some people who drink water containing TTHMs in excess of the MCL over many years may experience problems with their liver, kidneys, or central nervous system, and may have an increased risk of getting cancer.

HAAs are another class of organic disinfection by-products that form when a disinfectant reacts with organic matter in the water. Community water systems and nontransient noncommunity surface water systems serving less than 10,000 persons, and nontransient noncommunity ground water systems that disinfect were required to sample for HAAs beginning in 2004.

Approximately 1,483 PWSs were required to monitor quarterly for haloacetic acids during the three year compliance period from 2005 through 2007. For 2006, there were 34 systems that failed to monitor for haloacetic acids, and 15 systems exceeded the MCL of 0.060 mg/L.

TTHMs and HAAs Contaminant Group Highlights

- ▶ 1,483 public water systems required to sample for TTHMs during the 3 year compliance period
- ▶ 1,483 public water systems required to sample for HAAs during the 3 year compliance period
- ▶ 96 percent compliance with the TTHMs MCL
- ▶ 98 percent compliance with the HAAs MCL
- ▶ 97 percent compliance for TTHMs and HAAs M/R
- ▶ 73 percent of the TTHM/HAAs M/R violations occurred at PWS serving less than 500 people

Figures 2 and 3 show VOCs, SOCs, TTHMs, and HAAs violation numbers by population categories and system types, respectively. For specific information on each contaminant, such as the number of PWSs required to sample a contaminant in 2006 and how many violations occurred for that contaminant, please refer to the Appendix A Compliance Table.

Figure 2.


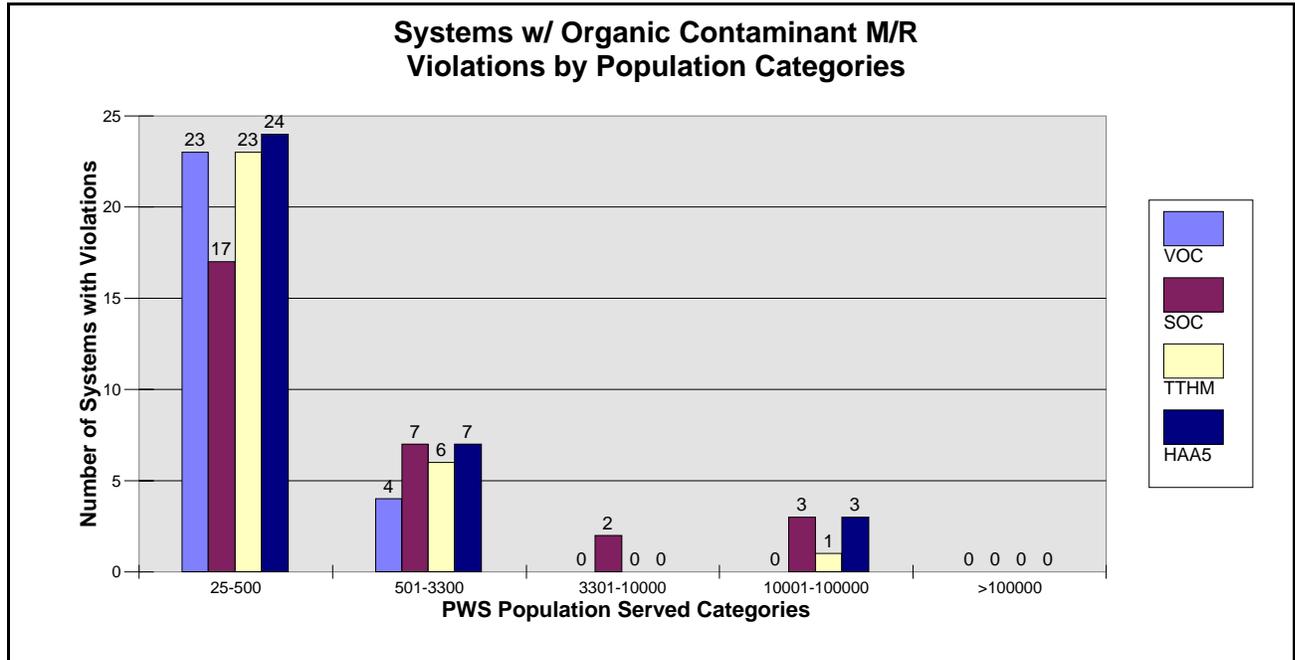


Figure 3.

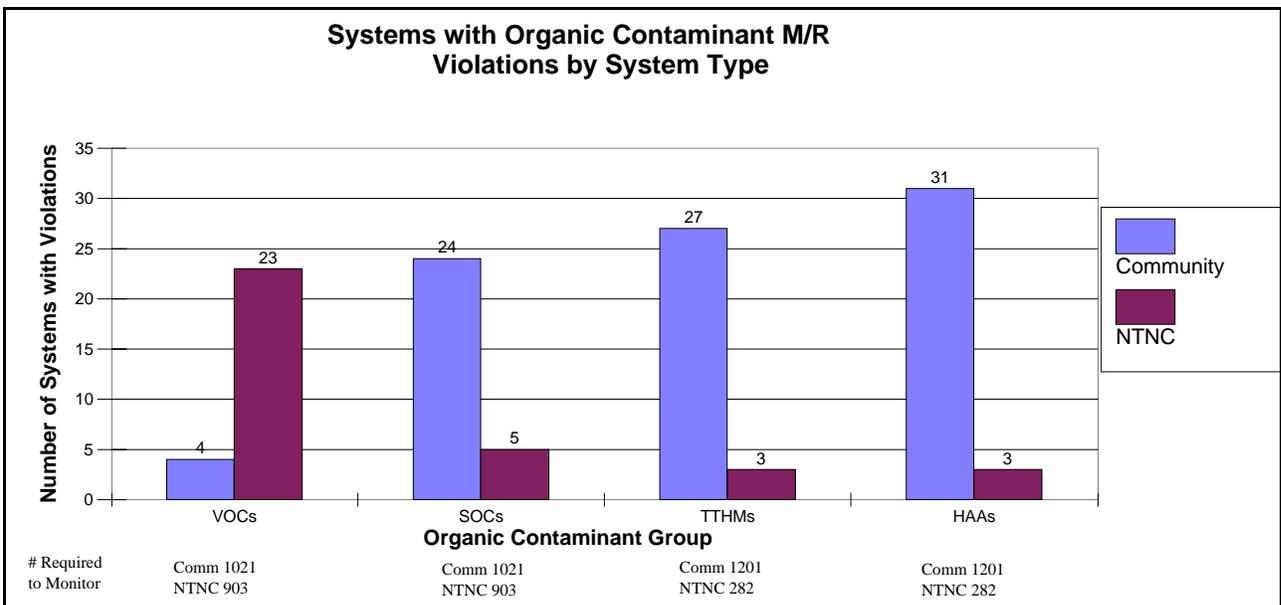

Inorganic Contaminants

The inorganic contaminant group summarized in the Appendix A Compliance Table includes metals (e.g. chromium, cadmium, mercury, etc.) and non-metal contaminants (e.g. asbestos, cyanide, nitrate, etc.). Many of these naturally occurring chemicals are also used in different manufacturing processes. Nitrate and nitrite are separated out as a group from the other IOCs for monitoring purposes and they are discussed in a separate section below. Both IOCs and Nitrate/Nitrite violation numbers are shown in Figures 4 and 5.

Except for nitrate and nitrite, IOCs are monitored by all community and nontransient noncommunity PWS. Most IOCs are monitored by surface water systems on an annual basis and by ground water systems once in 3 years. One exception is asbestos, which is monitored once in 9 years. During the three year compliance period from 2005 through 2007, approximately 1,929 public water systems are required to sample for at least one of the 12 individual IOC chemicals. The overall M/R compliance rate for the IOCs contaminant group is 97 percent. Of the 65 water systems with an IOCs M/R violation, approximately 46 percent were community water systems, and 54 percent were noncommunity water systems. However, 80 percent of all M/R violations were associated with water systems serving less than 500 people. Beginning on January 1, 2006, the MCL for arsenic, a naturally occurring element that can cause skin damage, circulatory problems and cancer, was reduced from 0.05 mg/L to 0.010 mg/L. Sixty-four water systems exceeded the new arsenic MCL during 2006. Only one of these water systems had violated the arsenic MCL during 2005 when it was five times higher than it is currently.

IOC Contaminant Group Highlights

- ▶ 1,929 public water systems were required to sample for at least one IOC during the 2005 - 2007 compliance period
- ▶ 96.7 percent compliance with all IOCs MCLs
- ▶ 96.6 percent of the public water systems were in compliance for IOCs M/R
- ▶ 80 percent of the M/R violations were associated with public water systems serving fewer than 500 people

Nitrate/Nitrite

Nitrate contamination of drinking water usually results from runoff of agricultural fertilizers, or from human or animal wastes, such as feedlots or faulty septic systems. Nitrite is the reduced form of nitrate, and is usually found in nature at lower levels than nitrate. Nitrate is monitored by all CWS, NTNC, and TNC PWS. Nitrate is monitored monthly by surface water systems, ground water systems under the direct influence of surface water, and by systems using treatment to remove nitrate. Ground water systems monitor annually for nitrate. Some ground water systems may be monitoring quarterly for nitrate based upon the levels reported in previous sampling. After initial monitoring shows that nitrite levels are less than one half of the MCL, many water systems are required to monitor for nitrite only once every nine years. Occurrence of nitrate, nitrite or nitrate/nitrite may require the systems to do additional monitoring. Approximately 5,066 water systems were required to monitor for nitrate and nitrite during the three year compliance period from 2005 through 2007.

The compliance rate for nitrate M/R during 2006 is 91 percent and 99 percent for nitrite. Of the 456 water systems with a nitrate M/R violation during the 2006 calendar year, 88 percent were issued to transient water systems and approximately 95 percent of the violations were associated with systems serving fewer than 500 people.

During the 2006 calendar year, 12 nitrate MCL violations occurred at 9 different water systems. There were no MCL violations for nitrite during 2006. Infants below the age of six months who drink water

containing nitrate or nitrite in excess of the MCL could become seriously ill and if untreated, may die. Symptoms include shortness of breath and a bluish tint to the skin from a condition known as blue-baby syndrome.

Nitrate/Nitrite Contaminant Group Highlights

- ▶ 5,066 water systems were required to monitor for nitrate and nitrite during the three year compliance period from 2005 through 2007
- ▶ 99.8 percent compliance rate for nitrate MCLs
- ▶ 100 percent compliance rate for nitrite MCLs
- ▶ 12 nitrate MCL violations occurred at 9 water systems
- ▶ 56 percent of the MCL violations occurred at public water systems serving fewer than 500 people

- ▶ 91 percent of the public water systems were in compliance for nitrate M/R
- ▶ 99 percent of the public water systems required to monitor were in compliance for nitrite M/R
- ▶ 95 percent of the nitrate M/R violations were associated with public water systems serving fewer than 500 people

For specific information on each contaminant, such as the number of PWS required to sample a contaminant in 2006 and how many violations occurred for that contaminant, please refer to Appendix A-Compliance Table.

Figure 4.


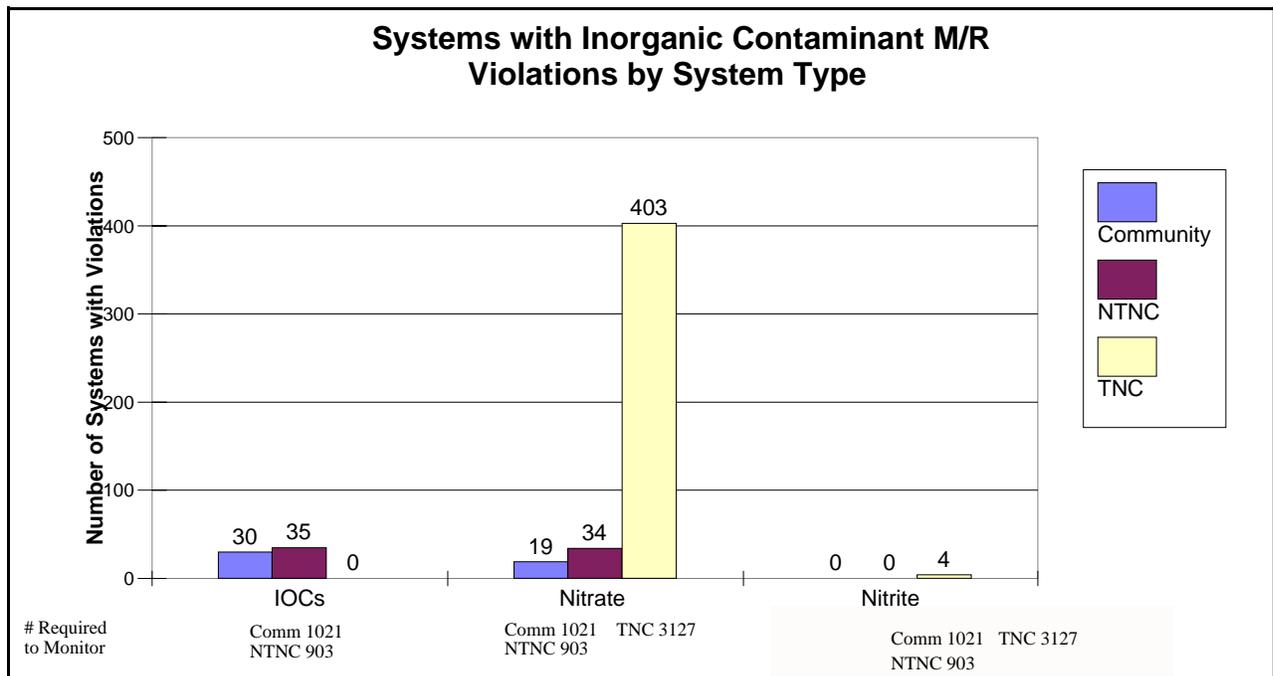


Figure 5.

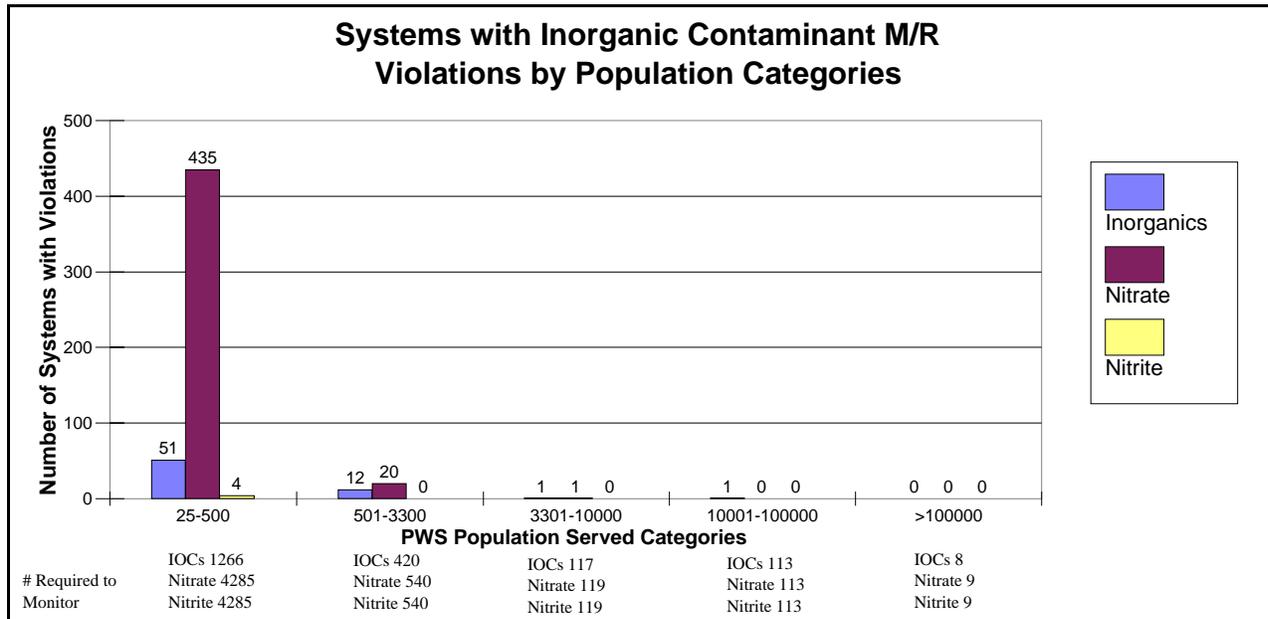

Radionuclide Contaminants

The radionuclide group, which includes the contaminants gross alpha, gross beta, radium-226 and radium-228, and uranium, occurs from the erosion or decay of natural and manmade deposits. Drinking water containing radionuclide contaminants in excess of the MCL may increase the risk of getting cancer. Radium-226 is only monitored individually when a PWS exceeds the gross alpha action level of 5 pCi/L or if the total alpha and radium-226 exceeds 5 pCi/L.


Radionuclides are monitored by approximately 1,026 community PWSs. Initially, systems monitor for radionuclides quarterly, unless they qualified for reduced monitoring at three, six, or nine year intervals. If the MCL is exceeded, systems must perform quarterly monitoring. The overall radionuclide MCL compliance rate is 100 percent. The overall compliance rate for radionuclide M/R is 99 percent. Of the 12 public water systems that had M/R violations during the 2006 calendar year, 83 percent were associated with systems serving fewer than 500 people.

Radionuclides Contaminant Group Highlights

- ▶ 1,026 community public water systems are required to sample for radionuclides
- ▶ 100 percent compliance rate for radionuclide MCLs
- ▶ 99 percent of the water systems were in compliance for radionuclides M/R
- ▶ 83 percent of the M/R violations were associated with public water systems serving fewer than 500 people

For specific information on each contaminant, such as the number of PWSs required to sample a contaminant in 2006 and how many violations occurred for that contaminant, please refer to Appendix A.

Figure 6.

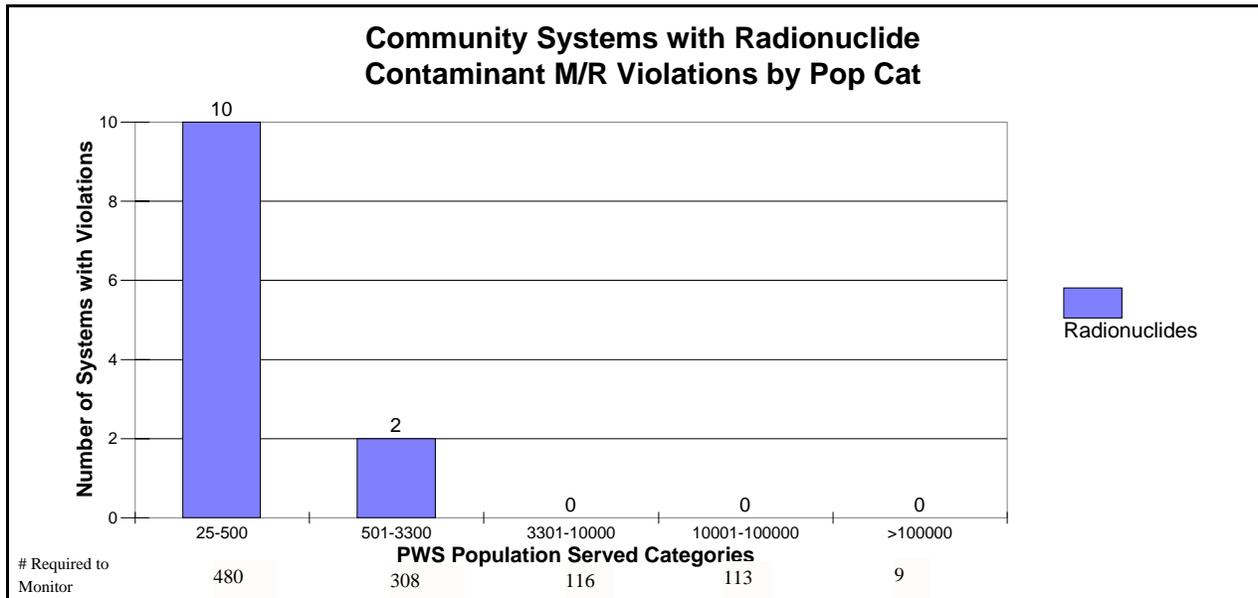

Total Coliform Regulations

Total coliform monitoring is used to determine if microbiological contaminants are present in drinking water. Total coliform is a family of bacteria which contain pathogenic as well as harmless organisms. Fecal coliform and *E. coli* bacteria are specific types of coliform bacteria which are associated with animal waste and present an acute human health threat. Microbiological pathogens can cause gastrointestinal illness and pose a special risk to children, the elderly and those individuals with suppressed immune systems. In Ohio, a total coliform (TC) test is used initially as a screening to indicate whether or not microbiological contaminants may be present. If a sample is TC positive (total coliform bacteria is present), further analysis for either fecal coliform or *E. coli* and the collection of additional samples are required to determine if potentially harmful contamination is present. TC is monitored by all PWSs. The frequency of TC testing and the number of samples collected is dependent upon the type of PWS, the population served and source type. Sampling requirements range from as few as one TC sample per quarter for small TNC water systems to hundreds of TC samples per month for large community water systems. Ohio's minimum monitoring requirements of one sample per quarter can be up to four times as frequent as the federal requirements. Two types of MCL violations, acute and non-acute, are associated with the total coliform regulations. An acute violation occurs when more than one sample is total coliform positive and at least one sample contains *E. coli* or fecal coliform bacteria. An acute violation also occurs in Ohio when an insufficient number of samples are collected following one or more TC positive samples (this is more stringent than federal requirements). Non-acute MCL violations occur when greater than 5 percent (or 2 or more samples if collecting less than 40 samples per month) of all the samples collected during a month are TC positive.

During the 2006 calendar year, the compliance rate for the TC acute MCL was 97 percent and 93 percent for the TC non-acute MCL. Of the 467 water systems with TC MCL violations, 73 percent were associated with TNC water systems, and 93 percent were associated with water systems serving less than 500 people. The majority of acute MCL violations can be attributed to Ohio assigning an acute MCL violation to a water system failing to collect a sufficient number of samples following a positive total coliform sample. Creating an additional acute MCL violation is most protective of public health, but

results in higher numbers of acute MCL violations for Ohio. Of the 5,369 PWSs sampling for total coliform, approximately 34 (less than 1 percent) detected *E. coli* or fecal coliform.

Major routine and follow-up M/R violations for the TC regulations are incurred by water systems when they fail to sample or report all of the required samples during a given monitoring period. Of the water systems with one or more major routine and follow-up M/R violations, 83 percent were associated with TNC water systems and 95 percent were associated with water systems serving less than 500 people.

Total Coliform Contaminant Group Highlights

- ▶ 5,369 public water systems were required to sample for TC
- ▶ 97 percent compliance with the acute MCL
- ▶ 91 percent compliance with the non-acute MCL
- ▶ 79 percent compliance with the TC M/R requirements
- ▶ 95 percent of the M/R violations and 93 percent of MCL violations were associated with public water systems serving fewer than 500 people, mostly TNC water systems

Figure 7.


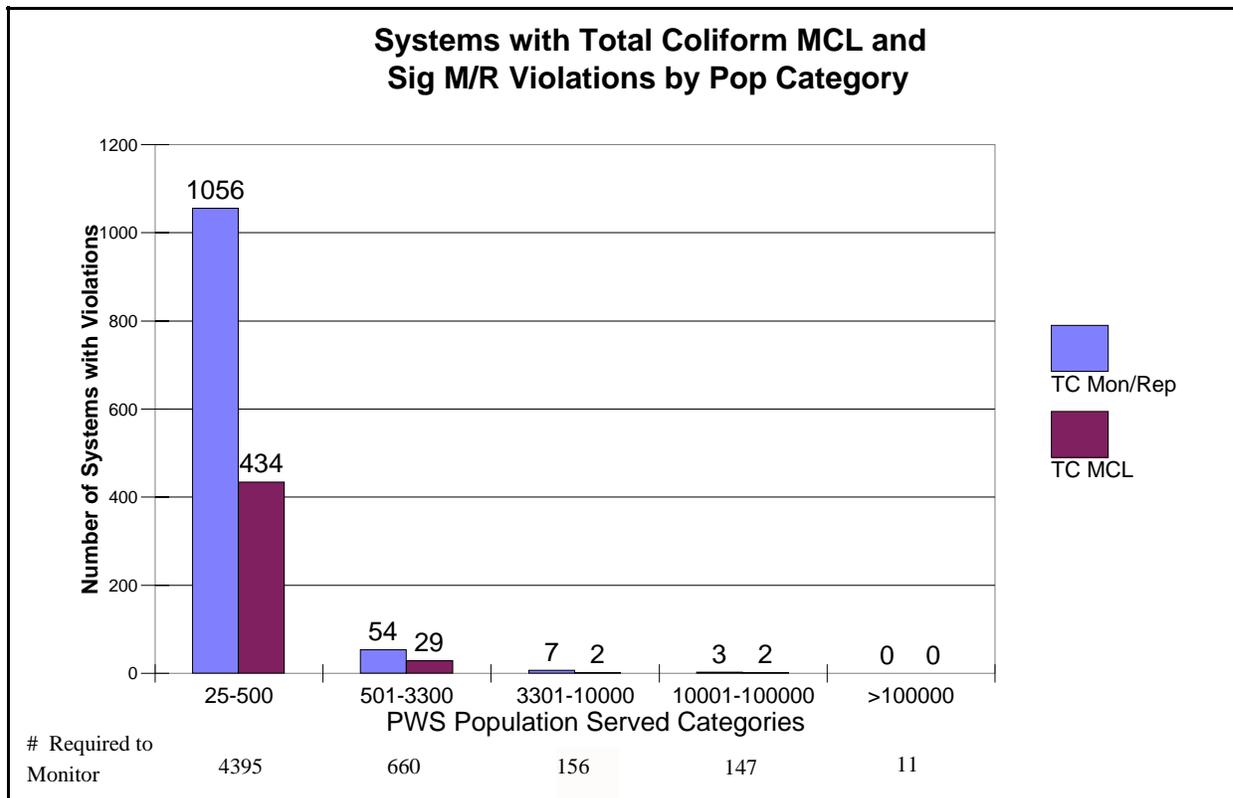


Figure 8.

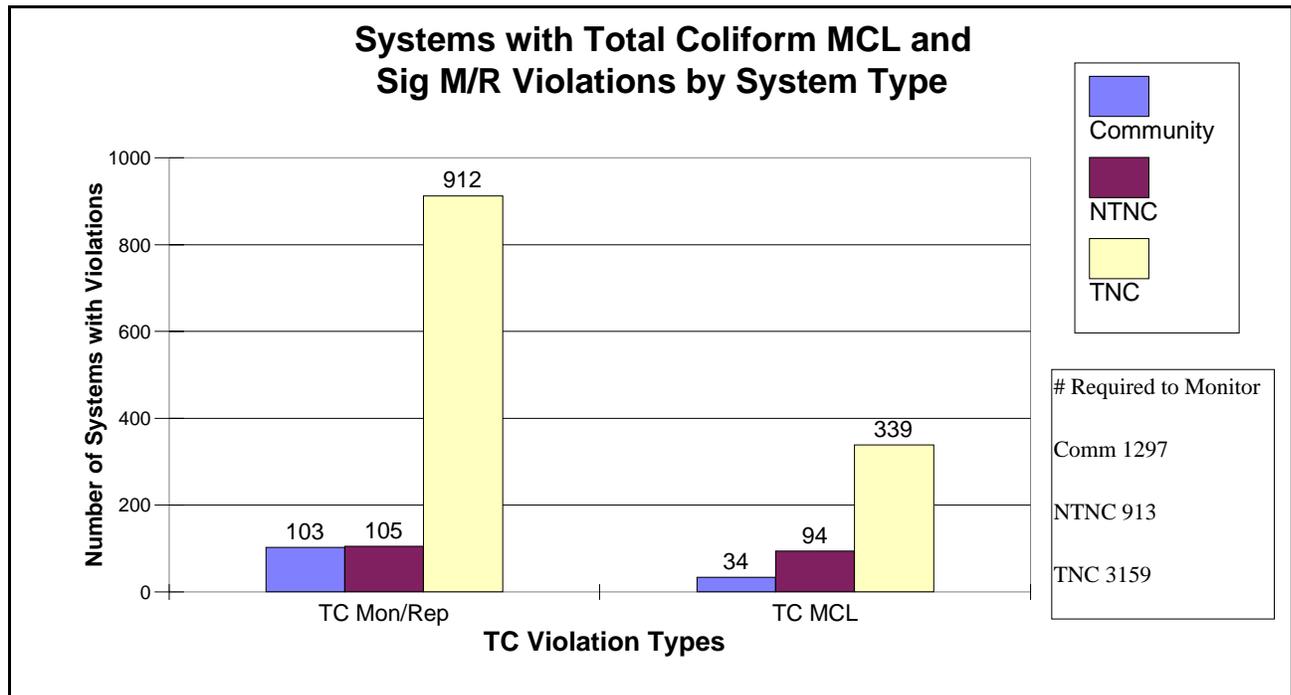

Surface Water Treatment Regulations

The Surface Water Treatment Rule (SWTR), Interim Enhanced Surface Water Treatment Rule (IESWTR), and Long Term 1 Enhanced Surface Water Treatment Rule (LT1) establish treatment and monitoring standards for water systems that have sources designated as surface water or ground water under the direct influence of surface water. Ground water under the direct influence (GUDI) of surface water are systems that use wells to obtain their water, but the water quality is subject to the influence of surface water. GUDI systems have 18 months, by rule, to eliminate the causes of the GUDI designation or install surface water treatment. The influence of surface water can be from unacceptably constructed wells to the type of aquifer from which the system is drawing. Public water systems subject to these regulations are required to provide filtration and disinfection of the water. The surface water treatment requirements are designed to inactivate, kill or remove pathogens found in surface water. Microbiological pathogens can cause gastrointestinal illness and pose a special risk to children, the elderly and those individuals with suppressed immune systems. Water quality tests are performed on the water to ensure treatment is being maintained at a level that should prevent contamination. Tests include evaluation and measurement of sufficient chlorination contact time, filtration type and effectiveness, turbidity levels, and residual chlorine levels in the distribution system. Failure to meet one or more of these standards results in a monthly treatment technique (TT) violation. During the 2006 calendar year, 142 water systems were subject to the surface water TT and M/R requirements. The overall TT compliance rate is 85 percent. The overall compliance rate for M/R is 96 percent. Of the 21 water systems with a TT violation during the 2006 calendar year, 43 percent were associated with systems serving fewer than 500 people.

SWTR/IESWTR/LT1 Contaminant Group Highlights

- ▶ 142 public water systems were subject to the surface water monitoring and treatment requirements
- ▶ 85 percent of the public water systems were in compliance with the TT requirements
- ▶ 96 percent of water systems which provide treatment were in compliance with the M/R requirements
- ▶ 43 percent of the water systems with a TT violations were associated with water systems serving fewer than 500 people

Figure 9.


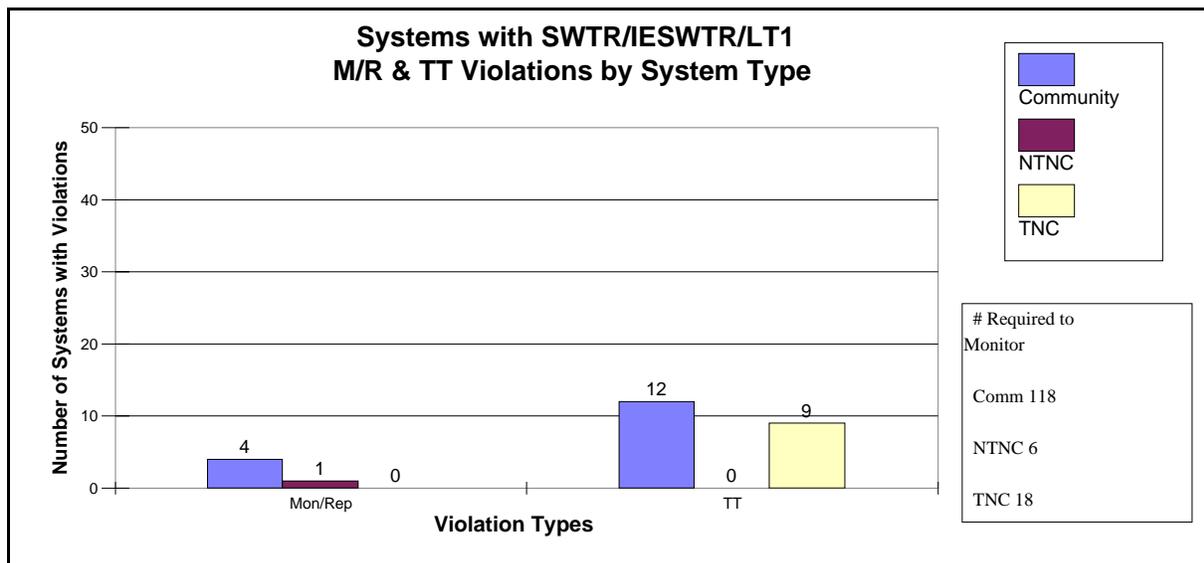


Figure 10.

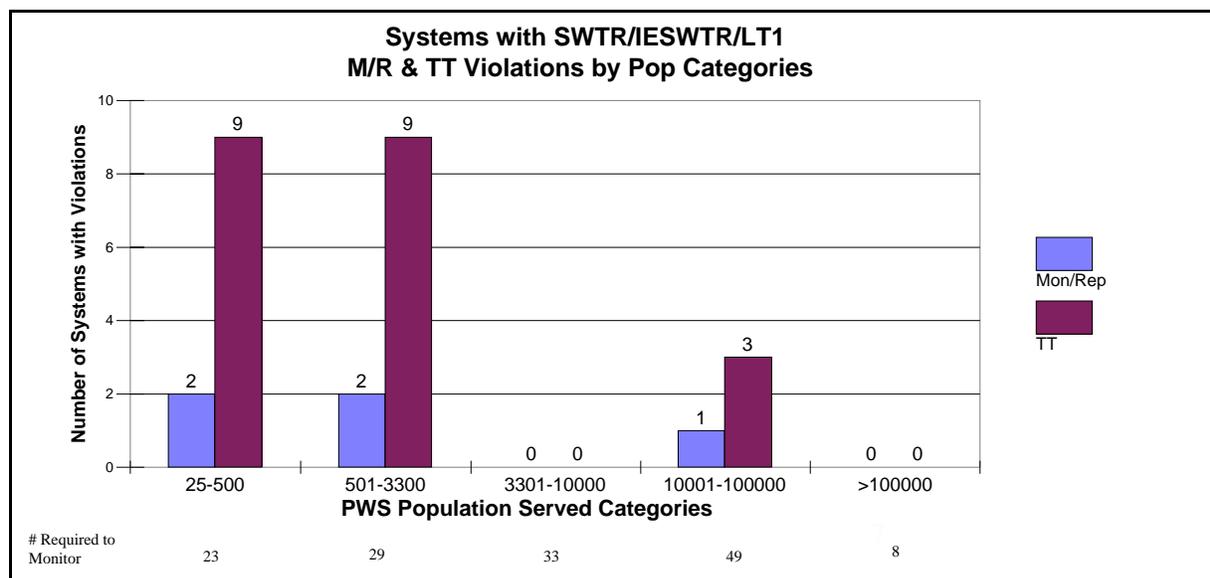

Lead and Copper Regulations

The lead and copper regulations in Ohio establish standards for levels of lead and copper in the distribution systems of community and nontransient noncommunity public water systems. Although lead and copper are found in natural deposits, they typically enter tap water through corrosion of plumbing materials. During the beginning phases of monitoring, these public water systems are required to perform initial monitoring during two consecutive six month periods. Following completion of these periods, routine annual or triennial monitoring periods are required. A total of 1,929 water systems are required to monitor for lead and copper during the three year compliance period from 2005 through 2007. Lead can affect the physical and mental development in children, as well as cause kidney problems and high blood pressure in adults. The overall compliance for lead and copper monitoring is 99 percent. Of the 26 water systems with lead and copper violations, 88 percent were associated with systems serving fewer than 500 people.

Lead and Copper Contaminant Group Highlights

- ▶ 1,929 public water systems required to perform initial, annual or triennial monitoring and public education requirements
- ▶ 99 percent of water systems were in compliance with the lead and copper M/R requirements
- ▶ 88 percent of the water systems with a lead and copper M/R violation were associated with public water systems serving fewer than 500 people

Figure 11.


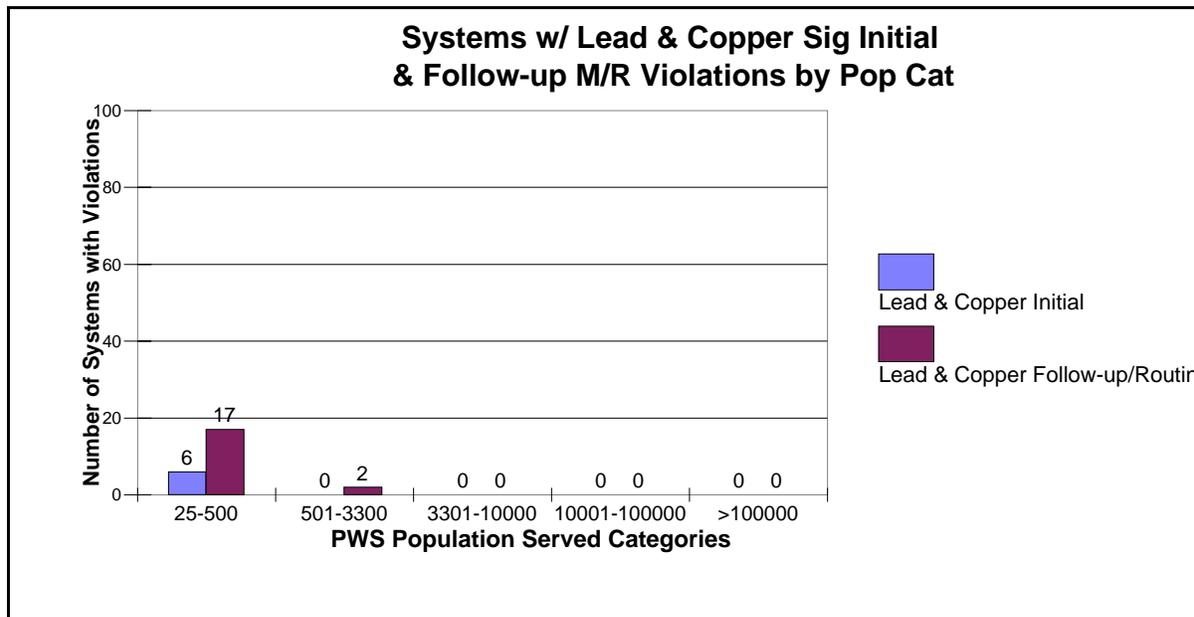


Figure 12.

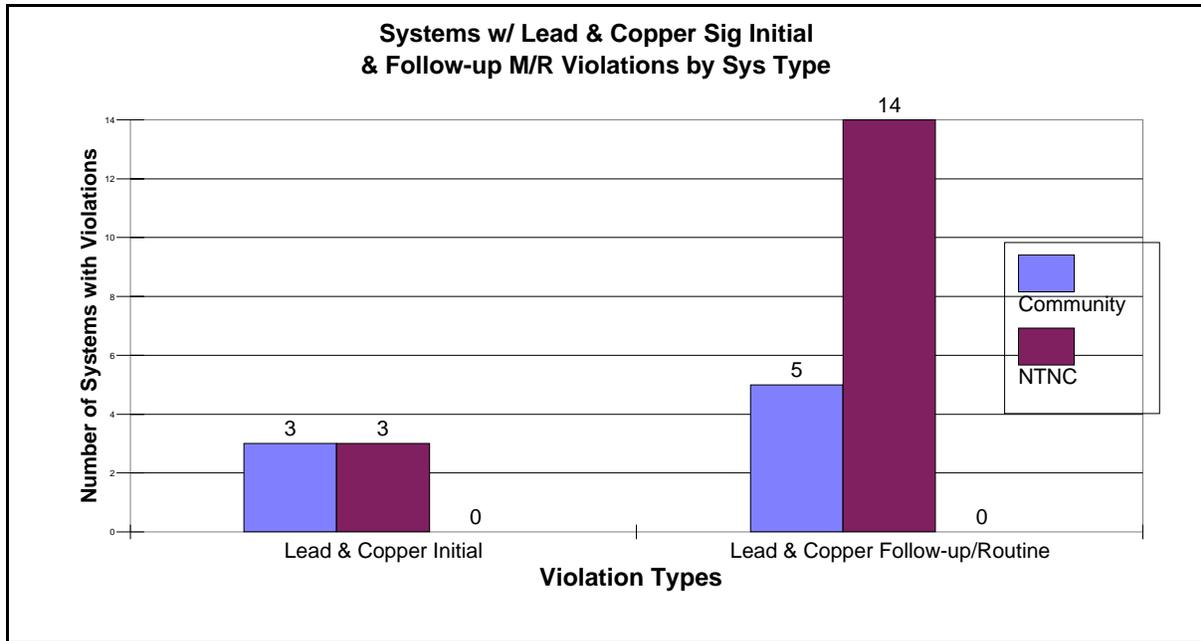


Consumer Confidence Reports

Every Community Water System is required to deliver to its customers a Consumer Confidence Report (CCR). This report is to include some educational material, provide information on the source water, levels of any detected contaminants, and compliance with drinking water regulations. A significant public notification violation occurred if a community water system completely failed to provide its customers the required annual water quality report. A total of 1,297 community water systems were required to provide their customers with a CCR. For the 2006 calendar year, 26 systems failed to provide this report in violation of these requirements, and 69 systems that provided a CCR did not include all the required content which resulted in a violation. The overall compliance for CCR requirements is 93 percent.

Consumer Confidence Report Highlights

- ▶ 1,297 public water systems were subject CCR requirements
- ▶ 93 percent of the water systems were in compliance with the requirements

Figure 13.

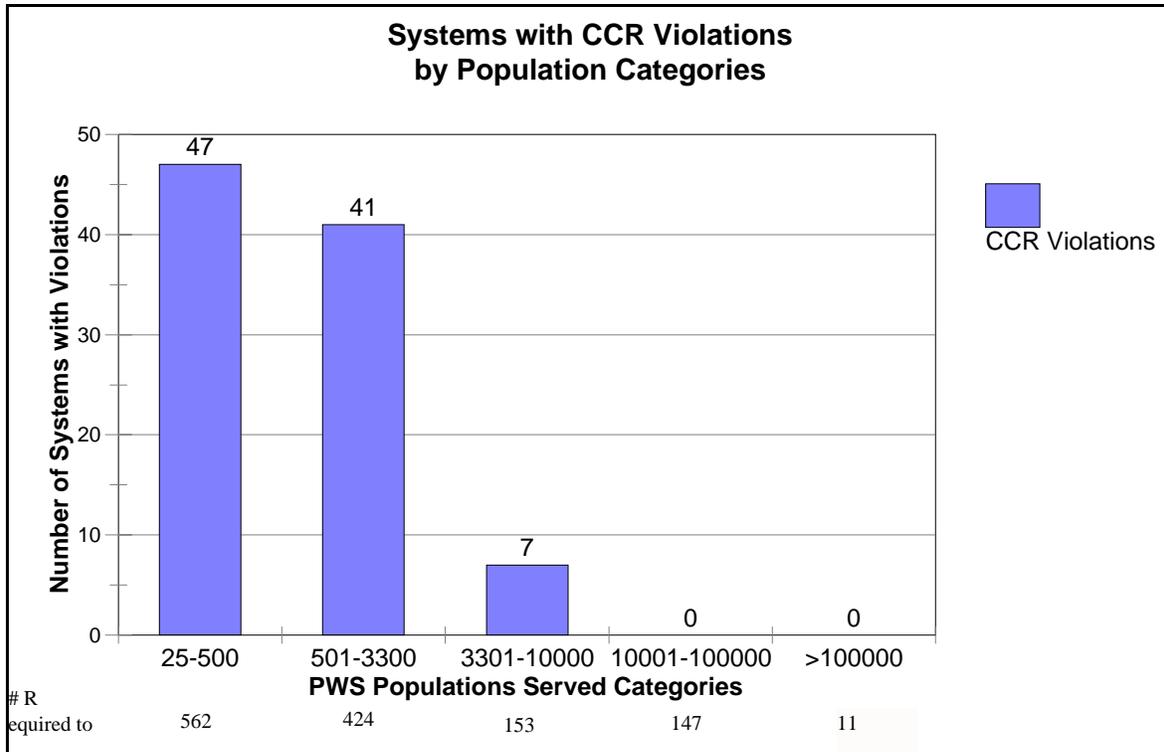

Compliance Summary

The large majority of Ohio’s public water systems continued to comply with federal health-based standards for drinking water in 2006. Highlights for 2006 include:

- Ninety-eight percent of all public water systems met the chemical standards;
- Ninety-one percent of all public water systems met the bacteriological standards;
- Eighty-eight percent of all public water systems met their chemical monitoring/reporting requirements;
- Eighty-one percent of all public water systems met their bacteriological monitoring/reporting requirements;
- Seventy-four percent of the violations that occurred during 2006 were the result of public water systems failing to monitor or report in a timely fashion;
- Approximately eighty-eight percent of the violations occurred at water systems serving fewer than 500 individuals;

- Sixty-six percent of the violations occurred at transient noncommunity systems (e.g. campgrounds; gas stations);
- Fifty-two percent of systems that monitor less frequently than quarterly submitted results after receiving a violation.

Ohio EPA's Public Water System Compliance Assistance

Ohio EPA employs various methods to assist public water systems in achieving compliance with the Safe Drinking Water Act regulations. Some of the methods that may be used include: providing a monitoring schedule for each public water system; offering technical assistance during facility inspections (sanitary surveys) and follow-up visits; assisting in investigations of contamination; performing investigatory monitoring; providing off-site assistance through phone calls and meetings; providing outreach training sessions for new rules and treatment; assistance in finding funding for projects; providing operator and laboratory personnel training sessions; distributing reminder postcards and/or contacting the water systems towards the end of the monitoring period to ensure collection of the required samples; and sending notice of violation letters for failure to meet the requirements for each specific regulation. The use of these methods is based on the availability of Ohio EPA personnel and resources.

In 2006, Ohio EPA awarded a contract to prepare and provide training and examination for uncertified small system operators. The training was offered beginning in September 2006. Both classroom and electronic training formats were developed. The contractor used ABC's very small systems water examination for this project. During calendar year 2006 approximately 225 individuals attended the training and took the examination. The overall passing rate for the Class A training and testing program was greater than 92%. Ohio EPA considers the program to be an enormous success. The success was due to a well organized and informative classroom course and aggressive marketing of the program. Ohio EPA believes having trained certified operators at small public water systems will assist in increasing compliance rates.

Listing of Maximum Contaminant Level and Treatment Technique Violations

Appendix B contains a listing of all violation types related to the MCL and TT regulation categories. The listing is ordered by water system identification number and violation date. Violation type or contaminant codes associated with the violations are defined in the Appendix A Compliance Summary Table. Included in the violation listing are enforcement action type codes (e.g. A, E, G, etc) associated with each violation. These are the particular actions the State of Ohio took to address each violation with the water system. Table 7 describes the enforcement action type codes used in Appendix B. Not all violations are required to have a compliance achieved enforcement action type code associated with them when a public water system has returned to compliance. In particular, the total coliform (code 3100) MCL violations listed do not have the returned to compliance enforcement code associated violations while almost all systems have returned to compliance. A return to compliance for these violations is determined by lack of subsequent on-going violations.

Table 7. Enforcement Action Type Code Descriptions

Enforcement Action Type Code	Description
A	Notice of Violation Letter sent to Public Water System
C	Technical Assistance Visit, Meeting, or Investigation
E	Request for System to Public Notice
F	Public Notice received from Public Water System
G	Ohio EPA News Release (Public Notice)
H	Boil Water Order
J	Division, Notice of Violation Warning Letter
K	Bilateral Compliance Agreement Signed
L	Administrative Order without penalty
O	Administrative Order with penalty
Q	Civil Case Filed
R	State Consent Decree or Consent Judgement
X	Compliance Achieved
9	Civil Case Referred to Attorney Generals Office

A list of violations can also be viewed using the Internet at U.S. EPA's site known as "Envirofacts". This Internet site provides access to a subset of data available from U.S. EPA's Safe Drinking Water Information System (SDWIS). Using the Envirofacts website allows the user to select by state, county, public system name, public water system identification number and population size to obtain general facility information and violation information for public water systems in Ohio. The Internet address for this Envirofacts site is http://www.epa.gov/enviro/html/sdwis/sdwis_query.html.

Summary and Report Availability & Contact Information

Ohio EPA will provide copies of the 2006 Annual Compliance Report to U.S.EPA, as well as post the report on the Division's web page at <http://www.epa.state.oh.us/ddagw/annualreports.html>. Copies of the 2006 annual report may also be obtained by writing to the State of Ohio at: PWS Annual Compliance Report, Ohio EPA - DDAGW, P.O. Box 1049, Columbus, OH 43216-1049.

In compliance with U.S. EPA's requirements, Ohio EPA will also notify the public of the availability of a summary of the 2006 annual report through the Drinking Water Advisory Committee, the Division of Drinking and Ground Waters rule list serve, and by making the summary available on the Division of Drinking Waters web site.

For further information concerning this report, you may contact Beth Messer, Mark Sheahan, or Todd Kelleher with the Ohio EPA Division of Drinking and Ground Waters at (614) 644-2752. If you have questions concerning the specific violations associated with individual water systems, contact your local Ohio EPA District Office in your region.

Scot Foltz
Ohio EPA
Central District Office
122 South Front Street
Columbus, Ohio 43215
(614) 728-3778

Janet Barth
Ohio EPA
Southeast District Office
2195 Front Street
Logan, Ohio 43138
(740) 385-8501

Jeff Davidson
Ohio EPA
Southwest District Office
401 East 5TH Street
Dayton, Ohio 45402
(937) 285-6357

Ellen Gerber
Ohio EPA
Northwest District Office
347 N. Dunbridge Road
Bowling Green, Ohio 43402
(419) 352-8461

Nancy Rice
Ohio EPA
Northeast District Office
2110 E. Aurora Road
Twinsburg, Ohio 44087
(330) 963-1200

APPENDIX A:

COMPLIANCE SUMMARY TABLE

APPENDIX B:

MCL and TT VIOLATION LISTING

State: OHIO
Reporting JANUARY 1, 2006 -
Interval: DECEMBER 31, 2006

SDWIS Codes	Contaminant	MCL (mg/L) ¹	# of Systems Required to Comply 2005-2007	MCLs			Significant Monitoring/Reporting					
				Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance
	Organic Contaminants											
2981	1,1,1-Trichloroethane	0.2	1929	0	0	100.0%				34	27	98.6%
2977	1,1-Dichloroethylene	0.007	1929	0	0	100.0%				34	27	98.6%
2985	1,1,2-Trichloroethane	0.005	1929	0	0	100.0%				34	27	98.6%
2378	1,2,4-Trichlorobenzene	0.07	1929	0	0	100.0%				34	27	98.6%
2931	1,2-Dibromo-3-chloropropane (DBCP)	0.0002	0	N/A	N/A	N/A				N/A	N/A	N/A
2980	1,2-Dichloroethane	0.005	1929	0	0	100.0%				34	27	98.6%
2983	1,2-Dichloropropane	0.005	1929	0	0	100.0%				34	27	98.6%
2063	2,3,7,8-TCDD (Dioxin)	3x10 ⁻⁸	1929	0	0	100.0%				0	0	100.0%
2110	2,4,5-TP	0.05	0	N/A	N/A	N/A				N/A	N/A	N/A
2105	2,4-D	0.07	1929	0	0	100.0%				0	0	100.0%
2265	Acrylamide						N/A	N/A	N/A			
2051	Alachlor	0.002	1929	0	0	100.0%				11	11	99.4%
2050	Atrazine	0.003	1929	0	0	100.0%				11	11	99.4%
2990	Benzene	0.005	1929	0	0	100.0%				34	27	98.6%
2306	Benzo[a]pyrene	0.0002	1929	0	0	100.0%				0	0	100.0%
2046	Carbofuran	0.04	1929	0	0	100.0%				0	0	100.0%
2982	Carbon tetrachloride	0.005	1929	0	0	100.0%				34	27	98.6%
2959	Chlordane	0.002	0	N/A	N/A	N/A				N/A	N/A	N/A
2380	cis-1,2-Dichloroethylene	0.07	1929	0	0	100.0%				34	27	98.6%
2031	Dalapon	0.2	0	N/A	N/A	N/A				N/A	N/A	N/A
2035	Di(2-ethylhexyl)adipate	0.4	1929	0	0	100.0%				0	0	100.0%
2039	Di(2-ethylhexyl)phthalate	0.006	1929	0	0	100.0%				1	1	99.9%
2964	Dichloromethane	0.005	1929	0	0	100.0%				34	27	98.6%
2041	Dinoseb	0.007	0	N/A	N/A	N/A				N/A	N/A	N/A
2032	Diquat	0.02	1929	0	0	100.0%				14	14	99.3%
2033	Endothall	0.1	1929	0	0	100.0%				0	0	100.0%

State: OHIO
Reporting JANUARY 1, 2006 - Interval: DECEMBER 31, 2006

SDWIS Codes	Contaminant	MCL (mg/L) ¹	# of Systems Required to Comply 2005-2007	MCLs			Significant Monitoring/Reporting					
				Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance
2005	Endrin	0.002	0	N/A	N/A	N/A				N/A	N/A	N/A
2257	Epichlorohydrin						N/A	N/A	N/A			
2992	Ethylbenzene	0.7	1929	0	0	100.0%				34	27	98.6%
2946	Ethylene dibromide	0.00005	0	N/A	N/A	N/A				N/A	N/A	N/A
2034	Glyphosate	0.7	1929	0	0	100.0%				12	12	99.4%
2065	Heptachlor	0.0004	0	N/A	N/A	N/A				N/A	N/A	N/A
2067	Heptachlor epoxide	0.0002	0	N/A	N/A	N/A				N/A	N/A	N/A
2274	Hexachlorobenzene	0.001	0	N/A	N/A	N/A				N/A	N/A	N/A
2042	Hexachlorocyclopentadiene	0.05	0	N/A	N/A	N/A				N/A	N/A	N/A
2010	Lindane	0.0002	1929	0	0	100.0%				14	14	99.3%
2015	Methoxychlor	0.04	1929	0	0	100.0%				15	15	99.2%
2989	Monochlorobenzene	0.1	1929	0	0	100.0%				34	27	98.6%
2968	o-Dichlorobenzene	0.6	1929	0	0	100.0%				34	27	98.6%
2969	p-Dichlorobenzene	0.075	1929	0	0	100.0%				34	27	98.6%
2383	Total polychlorinated biphenyls	0.0005	1929	0	0	100.0%				14	14	99.3%
2326	Pentachlorophenol	0.001	1929	0	0	100.0%				0	0	100.0%
2987	Tetrachloroethylene	0.005	1929	4	1	99.9%				34	27	98.6%
2984	Trichloroethylene	0.005	1929	0	0	100.0%				34	27	98.6%
2996	Styrene	0.1	1929	0	0	100.0%				34	27	98.6%
2991	Toluene	1	1929	0	0	100.0%				34	27	98.6%
2979	trans-1,2-Dichloroethylene	0.1	1929	0	0	100.0%				34	27	98.6%
2955	Xylenes (total)	10	1929	0	0	100.0%				34	27	98.6%
2020	Toxaphene	0.003	0	N/A	N/A	N/A				N/A	N/A	N/A
2036	Oxamyl (Vydate)	0.2	1929	0	0	100.0%				0	0	100.0%
2040	Picloram	0.5	1929	0	0	100.0%				0	0	100.0%
2037	Simazine	0.004	1929	0	0	100.0%				10	10	99.5%
2976	Vinyl chloride	0.002	1929	0	0	100.0%				34	27	98.6%

State: OHIO
Reporting JANUARY 1, 2006 - Interval: DECEMBER 31, 2006

SDWIS Codes	Contaminant	MCL (mg/L) ¹	# of Systems Required to Comply 2005-2007	MCLs			Significant Monitoring/Reporting					
				Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance
2920	Total Organic Carbon		142				4	2	98.6%	3	2	98.6%
2456	Haloacetic Acids (HAA5)	0.60	1483	30	15	99.0%				38	34	97.7%
2950	Total trihalomethanes	0.800	1483	107	42	97.2%				33	30	98.0%
	Inorganic Contaminants											
1074	Antimony	0.006	1929	0	0	100.0%				8	8	99.6%
1005	Arsenic	0.01	1929	94	64	96.7%				71	59	96.9%
1094	Asbestos	7 million fibers/L greater than or equal to 10 um long	1929	0	0	100.0%				0	0	100.0%
1010	Barium	2	1929	0	0	100.0%				8	8	99.6%
1075	Beryllium	0.004	1929	0	0	100.0%				8	8	99.6%
1015	Cadmium	0.005	1929	0	0	100.0%				8	8	99.6%
1020	Chromium	0.1	1929	0	0	100.0%				8	8	99.6%
1024	Cyanide (as free cyanide)	0.2	1929	0	0	100.0%				9	9	99.5%
1025	Fluoride	4.0	1929	0	0	100.0%				9	9	99.5%
1035	Mercury	0.002	1929	0	0	100.0%				10	10	99.5%
1040	Nitrate	10 (as Nitrogen)	5066	12	9	99.8%				517	456	91.0%
1041	Nitrite	1 (as Nitrogen)	5066	0	0	100.0%				4	4	99.9%
1045	Selenium	0.05	1929	0	0	100.0%				8	8	99.6%
1085	Thallium	0.002	1929	0	0	100.0%				8	8	99.6%
1038	Total nitrate and nitrite	10 (as Nitrogen)	N/A	N/A	N/A	N/A				N/A	N/A	N/A
	Radionuclide MCLs											
4000	Gross alpha	15 pCi/L	1021	0	0	100.0%				12	9	99.1%
4010	Radium-Total (226, 228)	5 pCi/L	1021	0	0	100.0%				6	3	99.7%
4030	Radium 228	N/A	N/A	N/A	N/A	N/A				N/A	N/A	N/A

State: OHIO
Reporting JANUARY 1, 2006 - Interval: DECEMBER 31, 2006

SDWIS Codes	Contaminant	MCL (mg/L) ¹	# of Systems Required to Comply 2005-2007	MCLs			Significant Monitoring/Reporting					
				Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance
4006	Uranium	30 ug/L	1021	0	0	100.0%				0	0	100.0%
4100	Gross beta	4 mrem/yr	1021	0	0	100.0%				0	0	100.0%
	All Chemical Groups Totals		5369	247	122	97.7%				1595	630	88.3%

Total Coliform Rule												
21	Acute MCL violation	Presence	5369	205	180	96.6%						
22	Non-acute MCL violation	Presence	5369	484	385	92.8%						
23, 25	Major routine and follow up monitoring		5369							1487	1035	80.7%
28	Sanitary survey ²									N/A	N/A	N/A
	TCR Totals		5369	689	467	91.3%				1487	1035	80.7%

Surface Water Treatment												
	Filtered systems											
36	Monitoring		142							2	1	99.3%
41	Treatment techniques		142				84	15	89.4%			
	Unfiltered systems											
31	Monitoring		142							1	1	99.3%
42	Failure to filter		142				3	3	97.9%			
	SWTR Totals		142				87	18	87.3%	3	2	98.6%
	Interim Enhanced SWTR											
44	Treatment techniques		143				18	7	95.1%			
38	Monitoring		143							5	3	97.9%
	IESWTR Totals		143				18	7	95.1%	5	3	97.9%

Lead and Copper Rule												

State: OHIO
Reporting JANUARY 1, 2006 - Interval: DECEMBER 31, 2006

SDWIS Codes	Contaminant	MCL (mg/L) ¹	# of Systems Required to Comply 2005-2007	MCLs			Significant Monitoring/Reporting					
				Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance
51	Initial lead and copper tap M/R		1929							6	6	99.7%
52	Follow-up or routine lead and copper tap M/R		1929							19	19	99.0%
58, 62	Treatment Installation		NA				NA	NA	NA			
65	Public education		1929				0	0	100.0%			
	Lead & Copper Totals		1929				0	0	100.0%	25	25	98.7%

SDWIS Codes		MCL (mg/L) ¹	# Systems Required to Comply 2005-2007	CCR Notifications		
				Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance
	Consumer Confidence Report (CCR):					
71	Report Violation		1,297	26	26	98.0%
72	Adequacy, Delivery, Content		1,297	69	69	94.7%
	CCR Totals		1,297	95	95	92.7%

1. Values are in milligrams per liter (mg/L), unless otherwise specified.
2. Number of major monitoring violations for sanitary survey under the Total Coliform Rule.

Definitions for Violations Table

The following definitions apply to the Summary of Violations table.

NA: Not Applicable, no requirements for 2006, compliance rate is not calculated.

State: OHIO
Reporting JANUARY 1, 2006 - Interval: DECEMBER 31, 2006

SDWIS Codes	Contaminant	MCL (mg/L) ¹	# of Systems Required to Comply 2005-2007	MCLs			Significant Monitoring/Reporting					
				Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance

Consumer Confidence Report: Requires every Community Water System to deliver to its customers a brief annual water quality report. This report is to include some educational material, and will provide information on the source water, the levels of any detected contaminants, and compliance with drinking water regulations.

Significant Consumer Notification Violations: SDWIS Violation Code 71 occurs when a community water system completely fails to provide its customers the required annual water quality report.

Filtered Systems: Water systems that have installed filtration treatment [40 CFR 141, Subpart H].

Inorganic Contaminants: Non-carbon-based compounds such as metals, nitrates, and asbestos. These contaminants are naturally-occurring in some water, but can get into water through farming, chemical manufacturing, and other human activities. EPA has established MCLs for 15 inorganic contaminants [40 CFR 141.62].

Lead and Copper Rule: This rule established national limits on lead and copper in drinking water [40 CFR 141.80-91]. Lead and copper corrosion pose various health risks when ingested at any level, and can enter drinking water from household pipes and plumbing fixtures. States report violations of the Lead and Copper Rule in the following six categories:

Initial lead and copper tap M/R: SDWIS Violation Code 51 indicates that a system did not meet initial lead and copper testing requirements, or failed to report the results of those tests to the State.

Follow-up or routine lead and copper tap M/R: SDWIS Violation Code 52 indicates that a system did not meet follow-up or routine lead and copper tap testing requirements, or failed to report the results.

Treatment installation: SDWIS Violation Codes 58 AND 62 indicate a failure to install optimal corrosion control treatment system (58) or source water treatment system (62) which would reduce lead and copper levels in water at the tap. [One number is to be reported for the sum of violations in these two categories].

Public education: SDWIS Violation Code 65 shows that a system did not provide required public education about reducing or avoiding lead intake from water.

Maximum Contaminant Level (MCL): The highest amount of a contaminant that EPA allows in drinking water. MCLs ensure that drinking water does not pose either a short-term or long-term health risk. MCLs are defined in milligrams per liter (parts per million) unless otherwise specified.

Monitoring: EPA specifies which water testing methods the water systems must use, and sets schedules for the frequency of testing. A water system that does not follow EPA's schedule or methodology is in violation [40 CFR 141].

State: OHIO
Reporting JANUARY 1, 2006 - Interval: DECEMBER 31, 2006

SDWIS Codes	Contaminant	MCL (mg/L) ¹	# of Systems Required to Comply 2005-2007	MCLs			Significant Monitoring/Reporting					
				Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance

States must report monitoring violations that are significant as determined by the EPA Administrator and in consultation with the States. For purposes of this report, significant monitoring violations are major violations and they occur when no samples are taken or no results are reported during a compliance period. A major monitoring violation for the surface water treatment rule occurs when at least 90% of the required samples are not taken or results are not reported during the compliance period.

Organic Contaminants: Carbon-based compounds, such as industrial solvents and pesticides. These contaminants generally get into water through runoff from cropland or discharge from factories. EPA has set legal limits on 54 organic contaminants that are to be reported [40 CFR 141.61].

Radionuclides: Radioactive particles which can occur naturally in water or result from human activity. EPA has set legal limits on the following types of radionuclides: radium-226 and radium-228 (combined), gross alpha, beta particle/photon radioactivity; and uranium [40 CFR 141]. Violations for these contaminants are to be reported using the following three categories:

Gross alpha: SDWIS Contaminant Code 4000 for alpha radiation above MCL of 15 picocuries/liter. Gross alpha includes radium-226 but excludes radon and uranium.

Combined radium-226 and radium-228: SDWIS Contaminant Code 4010 for combined radiation from these two isotopes above MCL of 5 pCi/L.

Gross beta: SDWIS Contaminant Code 4101 for beta particle and photon radioactivity from man-made radionuclides above 4 millirem/year.

Reporting Interval: The reporting interval for violations to be included in the PWS Annual Compliance Report is from January 1, 2006 through December 31, 2006.

SDWIS Code: Specific numeric codes from the Safe Drinking Water Information System (SDWIS) have been assigned to each violation type included in this report. The violations to be reported include exceeding contaminant MCLs, failure to comply with treatment requirements, and failure to meet monitoring and reporting requirements. Four-digit SDWIS Contaminant Codes have also been included in the chart for specific MCL contaminants.

Surface Water Treatment Rule: The Surface Water Treatment Rule establishes criteria under which water systems supplied by surface water sources, or ground water sources under the direct influence of surface water, must filter and disinfect their water [40 CFR 141, Subpart H]. Violations of the "Surface Water Treatment Rule" are to be reported for the following four categories:

Monitoring, routine/repeat (for filtered systems): SDWIS Violation Code 36 indicates a system's failure to carry out required tests, or to report the results of those tests.

Treatment techniques (for filtered systems): SDWIS Violation Code 41 shows a system's failure to properly treat its water.

State: OHIO
Reporting JANUARY 1, 2006 - Interval: DECEMBER 31, 2006

SDWIS Codes	Contaminant	MCL (mg/L) ¹	# of Systems Required to Comply 2005-2007	MCLs			Significant Monitoring/Reporting					
				Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance	Number of Violations	Number of Systems With Violations	Percent of Systems in Compliance

Monitoring, routine/repeat (for unfiltered systems): SDWIS Violation Code 31 indicates a system's failure to carry out required water tests, or to report the results of those tests.

Failure to filter (for unfiltered systems): SDWIS Violation Code 42 shows a system's failure to properly treat its water. Data for this violation code will be supplied to the States by EPA.

Total Coliform Rule (TCR): The Total Coliform Rule establishes regulations for microbiological contaminants in drinking water. These contaminants can cause short-term health problems. If no samples are collected during the one month compliance period, a significant monitoring violation occurs. States are to report four categories of violations:

Acute MCL violation: SDWIS Violation Code 21 indicates that the system found fecal coliform or E. coli, potentially harmful bacteria, in its water, thereby violating the rule.

Non-acute MCL violation: SDWIS Violation Code 22 indicates that the system found total coliform in samples of its water at a frequency or at a level that violates the rule. For systems collecting fewer than 40 samples per month, more than one positive sample for total coliform is a violation. For systems collecting 40 or more samples per month, more than 5% of the samples positive for total coliform is a violation.

Major routine and follow-up monitoring: SDWIS Violation Codes 23 AND 25 show that a system did not perform any monitoring. [One number is to be reported for the sum of violations in these two categories.]

Sanitary Survey: SDWIS Violation Code 28 indicates a major monitoring violation if a system fails to collect 5 routine monthly samples if sanitary survey is not performed.

Treatment Techniques: A water disinfection process that EPA requires instead of an MCL for contaminants that laboratories cannot adequately measure. Failure to meet other operational and system requirements under the Surface Water Treatment and the Lead and Copper Rules have also been included in this category of violation for purposes of this report.

Unfiltered Systems: Water systems that do not need to filter their water before disinfecting it because the source is very clean [40 CFR, Subpart H].

Violation: A failure to meet any state or federal drinking water regulation.

APPENDIX B
CY2006 MCL AND TT VIOLATIONS FOR OHIO

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant Type
OH0631312	KOSSUTH ZION UNITED METHODIST CHURCH	NC	GW	Very Small	10/1/2006	22	3100
OH0633412	WALNUT GROVE UNITED METHODIST CHURCH	NC	GW	Very Small	1/1/2006	22	3100
OH0635312	NEW HAMPSHIRE NAZARENE	NC	GW	Very Small	4/1/2006	22	3100
OH0635312	NEW HAMPSHIRE NAZARENE	NC	GW	Very Small	7/1/2006	21	3100
OH0331312	ASHLAND COUNTY AGRICULTURE & FAMILY CTR	NC	GW	Very Small	7/1/2006	21	3100
OH0337412	MAVERICK INNOVATIVE SOLUTIONS, LLC	NTNC	GW	Very Small	10/1/2006	02	1005
OH0337412	MAVERICK INNOVATIVE SOLUTIONS, LLC	NTNC	GW	Very Small	7/1/2006	02	1005
OH0342212	HAWLEY-ZONKERS INC	NC	GW	Small	7/1/2006	21	3100
OH0342212	HAWLEY-ZONKERS INC	NC	GW	Small	7/1/2006	22	3100
OH1034212	WESTERN GRILL	NC	GW	Very Small	4/1/2006	22	3100
OH1036412	ELKHORN VALLEY CHRISTIAN CAMP	NC	GW	Very Small	7/1/2006	22	3100
OH1037912	MWCD LEESVILLE N FORK L-9	NC	GW	Very Small	7/1/2006	22	3100
OH1038212	MWCD LEESVILLE S FORK L-1	NC	GW	Very Small	7/1/2006	22	3100
OH1038411	MWCD-ATWOOD PARK	NC	SW	Small	11/1/2006	41	0200
OH1038411	MWCD-ATWOOD PARK	NC	SW	Small	10/1/2006	41	0200
OH1130112	BLUEGILLS BAR & GRILL PWS	NP		Very Small	10/1/2006	22	3100
OH1042112	CATHYS KITCHEN PWS	NC	GW	Very Small	7/1/2006	22	3100
OH1042412	J & BS STEAKHOUSE PWS	NC	GW	Very Small	4/1/2006	22	3100
OH0800811	WAYNOKA REGIONAL WATER & SEWER DISTRICT	C	SW	Small	1/1/2006	02	2950
OH1201312	CLEARVIEW MOBILE HOME PARK	C	GU	Very Small	11/1/2006	41	0200
OH1201312	CLEARVIEW MOBILE HOME PARK	C	GU	Very Small	10/1/2006	41	0200
OH1201312	CLEARVIEW MOBILE HOME PARK	C	GU	Very Small	6/1/2006	41	0200
OH1201312	CLEARVIEW MOBILE HOME PARK	C	GU	Very Small	3/1/2006	41	0200
OH1201512	LA HACIENDA APARTMENTS	C	GW	Very Small	10/1/2006	02	1005
OH1203012	SPRINGFIELD MEADOWS MHP	C	GW	Very Small	10/1/2006	02	1005
OH1203012	SPRINGFIELD MEADOWS MHP	C	GW	Very Small	7/1/2006	02	1005
OH0637412	CHURCH OF CHRIST OF AUGLAIZE COUNTY PWS	NC	GW	Very Small	11/1/2006	22	3100
OH0637412	CHURCH OF CHRIST OF AUGLAIZE COUNTY PWS	NC	GW	Very Small	10/1/2006	22	3100
OH0735012	4-H CAMP PIEDMONT PWS	NC	GW	Very Small	7/1/2006	21	3100
OH1236612	SPRINGFIELD FORD INC.	NTNC	GW	Very Small	10/1/2006	22	3100
OH1237912	KAFFENBARGER TRUCK EQUIPMENT	NTNC	GW	Very Small	10/1/2006	02	1005

APPENDIX B
CY2006 MCL AND TT VIOLATIONS FOR OHIO

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant Type
OH1032512	PERRY POST	NC	GW	Very Small	4/1/2006	22	3100
OH0134112	DAYTON POWER & LIGHT/JM STUART PLANT PWS	NTNC	GW	Very Small	1/1/2006	22	3100
OH0232012	BIGGIES COAST TO COAST	NC	GW	Very Small	10/1/2006	22	3100
OH0233312	CONGREGATIONAL CHRISTIAN CHURCH	NC	GW	Very Small	10/1/2006	22	3100
OH0233312	CONGREGATIONAL CHRISTIAN CHURCH	NC	GW	Very Small	7/1/2006	22	3100
OH0233312	CONGREGATIONAL CHRISTIAN CHURCH	NC	GW	Very Small	7/1/2006	21	3100
OH0236412	ROBINS NEST CAMPGROUND	NC	GW	Very Small	7/1/2006	22	3100
OH0248212	PIKE MENNONITE CHURCH	NC	GW	Very Small	7/1/2006	21	3100
OH0248212	PIKE MENNONITE CHURCH	NC	GW	Very Small	7/1/2006	22	3100
OH0300411	CINNAMON LAKE UTILITIES ASSOC INC PWS	C	SW	Small	10/1/2006	02	2950
OH0300411	CINNAMON LAKE UTILITIES ASSOC INC PWS	C	SW	Small	7/1/2006	02	2950
OH0300411	CINNAMON LAKE UTILITIES ASSOC INC PWS	C	SW	Small	4/1/2006	02	2950
OH0300411	CINNAMON LAKE UTILITIES ASSOC INC PWS	C	SW	Small	1/1/2006	02	2950
OH0300411	CINNAMON LAKE UTILITIES ASSOC INC PWS	C	SW	Small	4/1/2006	41	0200
OH0900612	EDGEWOOD MOBILE HOME PARK	C	GW	Very Small	7/1/2006	21	3100
OH0900612	EDGEWOOD MOBILE HOME PARK	C	GW	Very Small	6/1/2006	21	3100
OH0439512	PYMATUNING LAKE DRIVE-IN-THEATER	NC	GW	Very Small	7/1/2006	22	3100
OH0442612	WINDSOR COMMUNITY CENTER	NC	GW	Very Small	7/1/2006	21	3100
OH0442612	WINDSOR COMMUNITY CENTER	NC	GW	Very Small	7/1/2006	22	3100
OH0938212	THE NEW BEGINNING TABERNACLE	NC	GW	Very Small	10/1/2006	22	3100
OH0938412	ROSS CHEVRON	NC	GW	Small	1/1/2006	22	3100
OH0939012	MILLIS TRANSFER INC PWS	NC	GW	Very Small	1/1/2006	21	3100
OH0939012	MILLIS TRANSFER INC PWS	NC	GW	Very Small	1/1/2006	22	3100
OH0939512	WESTSIDE PIZZA PWS	NC	GW	Very Small	7/1/2006	22	3100
OH0345312	RIVER RUN FAMILY CAMPGROUND 3 PWS	NC	GW	Very Small	4/1/2006	21	3100
OH0735022	4-H CAMP PIEDMONT WELL 2 PWS	NC	GW	Very Small	7/1/2006	21	3100
OH0401111	ROCK CREEK VILLAGE	C	SWP	Small	10/1/2006	02	2950
OH0401111	ROCK CREEK VILLAGE	C	SWP	Small	10/1/2006	02	2456
OH0401111	ROCK CREEK VILLAGE	C	SWP	Small	7/1/2006	02	2456
OH0401111	ROCK CREEK VILLAGE	C	SWP	Small	7/1/2006	02	2950
OH0401111	ROCK CREEK VILLAGE	C	SWP	Small	4/1/2006	02	2950

APPENDIX B
CY2006 MCL AND TT VIOLATIONS FOR OHIO

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant Type
OH0401111	ROCK CREEK VILLAGE	C	SWP	Small	4/1/2006	02	2456
OH0401111	ROCK CREEK VILLAGE	C	SWP	Small	1/1/2006	02	2950
OH0401111	ROCK CREEK VILLAGE	C	SWP	Small	1/1/2006	02	2456
OH1230412	CARMICHAEL MACHINE CORP	NTNC	GW	Very Small	10/1/2006	22	3100
OH1230412	CARMICHAEL MACHINE CORP	NTNC	GW	Very Small	10/1/2006	21	3100
OH1230412	CARMICHAEL MACHINE CORP	NTNC	GW	Very Small	7/1/2006	22	3100
OH1233312	NORTHWESTERN ELEMENTARY, JUNIOR HIGH SC	NTNC	GW	Small	10/1/2006	02	1005
OH1243512	TOMORROWS STARS - BACK	NC	GW	Very Small	4/1/2006	22	3100
OH1243612	WOODROW CORPORATION	NTNC	GW	Very Small	10/1/2006	02	1005
OH1243612	WOODROW CORPORATION	NTNC	GW	Very Small	7/1/2006	02	1005
OH1243612	WOODROW CORPORATION	NTNC	GW	Very Small	7/1/2006	22	3100
OH1244012	CARTER PLUMBING & HEATING	NC	GW	Very Small	7/1/2006	21	3100
OH1233412	NORTHEASTERN HIGH SCHOOL	NTNC	GW	Small	10/1/2006	22	3100
OH1135312	SAINT PARIS CHURCH OF NAZARENE PWS	NC	GW	Very Small	10/1/2006	22	3100
OH1135312	SAINT PARIS CHURCH OF NAZARENE PWS	NC	GW	Very Small	7/1/2006	21	3100
OH1135312	SAINT PARIS CHURCH OF NAZARENE PWS	NC	GW	Very Small	7/1/2006	22	3100
OH1558012	STONERIDGE TERRACE	NC	GW	Very Small	10/1/2006	22	3100
OH1561812	LISBON ASSEMBLY OF GOD	NC	GW	Very Small	7/1/2006	22	3100
OH1300712	LAKE REMINGTON MOBLE HOME PARK	C	GW	Very Small	6/1/2006	22	3100
OH1501512	LISBON VILLAGE	C	GU	Small	11/1/2006	41	0200
OH1501512	LISBON VILLAGE	C	GU	Small	10/1/2006	41	0200
OH1501512	LISBON VILLAGE	C	GU	Small	12/1/2006	41	0200
OH1501512	LISBON VILLAGE	C	GU	Small	7/1/2006	41	0200
OH1501512	LISBON VILLAGE	C	GU	Small	9/1/2006	41	0200
OH1501512	LISBON VILLAGE	C	GU	Small	8/1/2006	41	0200
OH1501512	LISBON VILLAGE	C	GU	Small	6/1/2006	41	0200
OH1501512	LISBON VILLAGE	C	GU	Small	5/1/2006	41	0200
OH1501512	LISBON VILLAGE	C	GU	Small	4/1/2006	41	0200
OH1501512	LISBON VILLAGE	C	GU	Small	2/1/2006	41	0200
OH1501512	LISBON VILLAGE	C	GU	Small	1/1/2006	41	0200
OH1501512	LISBON VILLAGE	C	GU	Small	3/1/2006	41	0200

APPENDIX B
CY2006 MCL AND TT VIOLATIONS FOR OHIO

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant Type
OH1502111	SALINEVILLE VILLAGE	C	SW	Small	11/1/2006	44	0300
OH1502111	SALINEVILLE VILLAGE	C	SW	Small	12/1/2006	43	0300
OH1502111	SALINEVILLE VILLAGE	C	SW	Small	10/1/2006	44	0300
OH1502111	SALINEVILLE VILLAGE	C	SW	Small	10/1/2006	43	0300
OH1502111	SALINEVILLE VILLAGE	C	SW	Small	7/1/2006	43	0300
OH1502111	SALINEVILLE VILLAGE	C	SW	Small	7/1/2006	41	0200
OH1502111	SALINEVILLE VILLAGE	C	SW	Small	6/1/2006	43	0300
OH1502111	SALINEVILLE VILLAGE	C	SW	Small	4/1/2006	41	0200
OH1502111	SALINEVILLE VILLAGE	C	SW	Small	6/1/2006	41	0200
OH1502111	SALINEVILLE VILLAGE	C	SW	Small	5/1/2006	41	0200
OH1502111	SALINEVILLE VILLAGE	C	SW	Small	2/1/2006	41	0200
OH1564712	SALEM BIBLE CHURCH	NC	GW	Very Small	10/1/2006	22	3100
OH1245412	SPRINGFIELD NEW LIFE CHURCH	NC	GW	Very Small	7/1/2006	22	3100
OH1248012	DAVIDSON INTERPRETIVE CENTER	NC	GW	Very Small	7/1/2006	22	3100
OH1248412	POSSUM RD CHURCH OF GOD FELLOWSHIP HAL	NC	GW	Very Small	7/1/2006	22	3100
OH1248412	POSSUM RD CHURCH OF GOD FELLOWSHIP HAL	NC	GW	Very Small	7/1/2006	21	3100
OH1248912	ROCKY LAKES GOLF COURSE PWS	NC	GW	Very Small	10/1/2006	22	3100
OH1248912	ROCKY LAKES GOLF COURSE PWS	NC	GW	Very Small	7/1/2006	22	3100
OH1248912	ROCKY LAKES GOLF COURSE PWS	NC	GW	Very Small	7/1/2006	21	3100
OH1249712	CHRIST CHAPEL KIDDIE CARE	NTNC	GW	Very Small	10/1/2006	02	1005
OH1531112	GRACE CHAPEL CHURCH	NC	GW	Very Small	10/1/2006	22	3100
OH1531112	GRACE CHAPEL CHURCH	NC	GW	Very Small	7/1/2006	22	3100
OH1531912	ALLIANCE DUCHESS SHOP 165 PWS	NC	GW	Small	7/1/2006	22	3100
OH1544412	FARMER BILLS CARRY-OUT PWS	NC	GW	Very Small	7/1/2006	22	3100
OH1544412	FARMER BILLS CARRY-OUT PWS	NC	GW	Very Small	7/1/2006	21	3100
OH1935912	SILVER SPUR BAR & RESTAURANT	NC	GW	Very Small	7/1/2006	21	3100
OH1565112	RANDIS RAY OF SUNSHINE PWS	NTNC	GW	Very Small	4/1/2006	22	3100
OH1565112	RANDIS RAY OF SUNSHINE PWS	NTNC	GW	Very Small	4/1/2006	21	3100
OH1565112	RANDIS RAY OF SUNSHINE PWS	NTNC	GW	Very Small	1/1/2006	21	3100
OH1565112	RANDIS RAY OF SUNSHINE PWS	NTNC	GW	Very Small	7/1/2006	22	3100
OH1600811	ECHOING HILLS VILLAGE	C	SW	Very Small	10/1/2006	02	2456

APPENDIX B
CY2006 MCL AND TT VIOLATIONS FOR OHIO

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant Type
OH1630212	CANAL LEWISVILLE CHURCH	NC	GW	Very Small	10/1/2006	02	1040
OH1630212	CANAL LEWISVILLE CHURCH	NC	GW	Very Small	1/1/2006	02	1040
OH1637712	KEENE UNITED METHODIST CHURCH PWS	NC	GW	Very Small	7/1/2006	22	3100
OH1637712	KEENE UNITED METHODIST CHURCH PWS	NC	GW	Very Small	7/1/2006	21	3100
OH1554812	DAMASCUS FRIENDS CHURCH	NC	GW	Very Small	10/1/2006	22	3100
OH1839912	BETHLEHEM CHRISTIAN SCHOOL (PRE-K THRU 2	NTNC	GW	Very Small	1/1/2006	22	3100
OH1930612	ARCANUM-BUTLER MIDDLE SCHOOL	NTNC	GW	Very Small	10/1/2006	22	3100
OH1931012	BGS RESTAURANT PWS	NC	GW	Very Small	7/1/2006	21	3100
OH1945312	STILLWATER VALLEY GOLF CLUB	NC	GW	Very Small	10/1/2006	22	3100
OH1945312	STILLWATER VALLEY GOLF CLUB	NC	GW	Very Small	7/1/2006	22	3100
OH1700411	NEW WASHINGTON VILLAGE PWS	C	SW	Small	10/1/2006	02	2950
OH1700411	NEW WASHINGTON VILLAGE PWS	C	SW	Small	7/1/2006	02	2950
OH1700411	NEW WASHINGTON VILLAGE PWS	C	SW	Small	8/1/2006	43	0300
OH1700411	NEW WASHINGTON VILLAGE PWS	C	SW	Small	8/1/2006	44	0300
OH1700411	NEW WASHINGTON VILLAGE PWS	C	SW	Small	7/1/2006	44	0300
OH1700411	NEW WASHINGTON VILLAGE PWS	C	SW	Small	4/1/2006	02	2950
OH1700411	NEW WASHINGTON VILLAGE PWS	C	SW	Small	1/1/2006	02	2950
OH2400612	JEFFERSONVILLE VILLAGE PWS	C	GW	Small	10/1/2006	22	3100
OH2400612	JEFFERSONVILLE VILLAGE PWS	C	GW	Small	9/1/2006	22	3100
OH2346912	GRACE BRETHERN CHURCH OF PICKERINGTON	NC	GW	Very Small	10/1/2006	22	3100
OH2348012	SHALOM UNITED METHODIST CHURCH PWS	NTNC	GW	Very Small	10/1/2006	22	3100
OH2348012	SHALOM UNITED METHODIST CHURCH PWS	NTNC	GW	Very Small	7/1/2006	22	3100
OH2348012	SHALOM UNITED METHODIST CHURCH PWS	NTNC	GW	Very Small	7/1/2006	21	3100
OH2348312	TRI COUNTY FAMILY PHYSICIANS INC PWS	NTNC	GW	Very Small	7/1/2006	21	3100
OH2348312	TRI COUNTY FAMILY PHYSICIANS INC PWS	NTNC	GW	Very Small	7/1/2006	22	3100
OH2348812	ZANE TRACE STATION PWS	NC	GW	Very Small	4/1/2006	21	3100
OH2349512	BUCKEYE HONDA PWS	NC	GW	Very Small	7/1/2006	22	3100
OH2349512	BUCKEYE HONDA PWS	NC	GW	Very Small	7/1/2006	21	3100
OH2349612	AALLPRO DRIVETRAIN SPECIALISTS PWS	NC	GW	Very Small	7/1/2006	21	3100
OH2349812	UNITED LANDMARK PWS	NC	GW	Very Small	7/1/2006	42	0200
OH2349812	UNITED LANDMARK PWS	NC	GW	Very Small	2/1/2006	41	0200

APPENDIX B
CY2006 MCL AND TT VIOLATIONS FOR OHIO

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant Type
OH2349812	UNITED LANDMARK PWS	NC	GW	Very Small	3/1/2006	41	0200
OH2349812	UNITED LANDMARK PWS	NC	GW	Very Small	1/1/2006	41	0200
OH2349912	CHILDS PLAY LEARNING CENTER PWS	NTNC	GW	Very Small	10/1/2006	02	1005
OH2349912	CHILDS PLAY LEARNING CENTER PWS	NTNC	GW	Very Small	10/1/2006	22	3100
OH2350212	BERNE STATION PWS	NC	GW	Very Small	4/1/2006	21	3100
OH2400012	VILLAGE OF BLOOMINGBURG	C	GW	Small	2/1/2006	22	3100
OH2400012	VILLAGE OF BLOOMINGBURG	C	GW	Small	2/1/2006	21	3100
OH2433312	MADISON MILLS ELEMENTARY	NTNC	GW	Very Small	10/1/2006	02	1005
OH2000111	DEFIANCE WATER TREATMENT PLANT	C	SW	Large	5/1/2006	02	1040
OH2000903	AYERSVILLE WATER & SEWER DISTRICT	C	SWP	Small	1/1/2006	02	2950
OH2001103	BRUNERSBURG WATER DISTRICT	C	SWP	Small	4/1/2006	02	2950
OH2001103	BRUNERSBURG WATER DISTRICT	C	SWP	Small	1/1/2006	02	2950
OH2030812	BETHLEHEM LUTHERAN CHURCH	NC	GW	Very Small	7/1/2006	21	3100
OH2031012	SCOTTYS CLUB 111 PWS	NC	GW	Very Small	7/1/2006	22	3100
OH2032112	JEWELL COMMUNITY CENTER	NC	GW	Very Small	7/1/2006	21	3100
OH1733812	SULPHUR SPRINGS ELEMENTARY SCHOOL PWS	C	GW	Very Small	7/1/2006	22	3100
OH1736412	BU E COMP., INC	NTNC	GW	Very Small	1/1/2006	22	3100
OH1831812	BETHLEHEM CHRISTIAN SCHOOL (3RD THRU 8TH	NTNC	GW	Very Small	10/1/2006	22	3100
OH1837512	GUILD INTERNATIONAL, INC.	NTNC	GW	Very Small	5/1/2006	22	3100
OH2133412	TREE HAVEN CAMPGROUND INC	NC	GW	Very Small	4/1/2006	21	3100
OH2201011	HURON WATER TREATMENT PLANT	C	SW	Medium	10/1/2006	22	3100
OH2201411	SANDUSKY WATER TREATMENT PLANT	C	SW	Large	8/1/2006	44	0300
OH2201411	SANDUSKY WATER TREATMENT PLANT	C	SW	Large	8/1/2006	41	0200
OH2230411	CAMP PATMOS	NC	SW	Very Small	9/1/2006	44	0300
OH2234812	PARKERTOWN RESTAURANT	NC	GW	Very Small	1/1/2006	02	1040
OH1732612	ST. BERNARD SCHOOL AT NORTH AUBURN	NTNC	GW	Very Small	7/1/2006	22	3100
OH2558012	NORTHWEST CHAPEL PWS	NTNC	GW	Very Small	10/1/2006	02	1005
OH2565112	CERTIFIED OIL STATION 270 PWS	NC	GU	Very Small	1/1/2006	21	3100
OH2637012	MENNONITE CHURCH OF THE GOOD SHEPHERD	NC	GW	Very Small	7/1/2006	21	3100
OH2800012	BEAVER CREEK ESTATES	C	GW	Very Small	9/1/2006	22	3100
OH2800012	BEAVER CREEK ESTATES	C	GW	Very Small	8/1/2006	21	3100

APPENDIX B
CY2006 MCL AND TT VIOLATIONS FOR OHIO

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant Type
OH2800012	BEAVER CREEK ESTATES	C	GW	Very Small	8/1/2006	22	3100
OH2503312	ROLLING RIDGE WATER CO.	C	GW	Very Small	10/1/2006	02	2456
OH2503312	ROLLING RIDGE WATER CO.	C	GW	Very Small	10/1/2006	02	2950
OH2332312	GENEVA HILLS-LODGE	NC	GW	Very Small	10/1/2006	22	3100
OH2332312	GENEVA HILLS-LODGE	NC	GW	Very Small	7/1/2006	22	3100
OH2332312	GENEVA HILLS-LODGE	NC	GW	Very Small	7/1/2006	21	3100
OH2332312	GENEVA HILLS-LODGE	NC	GW	Very Small	1/1/2006	21	3100
OH2333012	JACKSON LAKE PARK-SHELTER 4	NC	GW	Very Small	7/1/2006	22	3100
OH2333012	JACKSON LAKE PARK-SHELTER 4	NC	GW	Very Small	4/1/2006	22	3100
OH2333012	JACKSON LAKE PARK-SHELTER 4	NC	GW	Very Small	4/1/2006	21	3100
OH2334412	PINE LAKE ESTATES	NC	GW	Very Small	7/1/2006	21	3100
OH2336312	THE 256 PLAZA	NTNC	GW	Very Small	10/1/2006	22	3100
OH2337612	STARLITE PWS	NC	GW	Very Small	7/1/2006	21	3100
OH2337612	STARLITE PWS	NC	GW	Very Small	6/1/2006	21	3100
OH2340812	SMALL WONDERS DAY CARE PWS	NTNC	GW	Very Small	10/1/2006	22	3100
OH2340812	SMALL WONDERS DAY CARE PWS	NTNC	GW	Very Small	9/1/2006	21	3100
OH2340812	SMALL WONDERS DAY CARE PWS	NTNC	GW	Very Small	9/1/2006	22	3100
OH2343212	BREMEN HOLINESS SCHOOL	NC	GW	Very Small	7/1/2006	21	3100
OH2343412	E.C. BABBERT, INC.	NP		Very Small	10/1/2006	02	1005
OH2343412	E.C. BABBERT, INC.	NP		Very Small	7/1/2006	02	1005
OH2800412	CHARDON CITY PWS	C	GW	Medium	10/1/2006	02	1005
OH2800412	CHARDON CITY PWS	C	GW	Medium	7/1/2006	02	1005
OH2436112	WILSON ELEMENTARY SCHOOL	NTNC	GW	Very Small	10/1/2006	02	1005
OH2436112	WILSON ELEMENTARY SCHOOL	NTNC	GW	Very Small	7/1/2006	02	1005
OH2504012	JEFFERSON WATER & SEWER DISTRICT PWS	C	GW	Medium	5/1/2006	21	3100
OH2504412	COLUMBUS PUBLIC WATER SYSTEM	C	SW	Very Large	5/1/2006	02	1040
OH2530512	BROWN ELEMENTARY SCHOOL	NTNC	GW	Very Small	10/1/2006	02	1005
OH2530512	BROWN ELEMENTARY SCHOOL	NTNC	GW	Very Small	7/1/2006	02	1005
OH2530812	DARBYDALE ELEMENTARY SCHOOL	NTNC	GW	Very Small	10/1/2006	02	1005
OH2533912	OUT POST INN	NC	GW	Very Small	10/1/2006	22	3100
OH2533912	OUT POST INN	NC	GW	Very Small	7/1/2006	22	3100

APPENDIX B
CY2006 MCL AND TT VIOLATIONS FOR OHIO

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant Type
OH2533912	OUT POST INN	NC	GW	Very Small	7/1/2006	21	3100
OH2500612	COUNTRY SIDE MOBILE HOME	C	GW	Very Small	10/1/2006	02	1005
OH2500612	COUNTRY SIDE MOBILE HOME	C	GW	Very Small	7/1/2006	02	1005
OH2345312	FISH AND GAME SHACK	NC	GW	Very Small	7/1/2006	21	3100
OH2345312	FISH AND GAME SHACK	NC	GW	Very Small	4/1/2006	22	3100
OH2345312	FISH AND GAME SHACK	NC	GW	Very Small	4/1/2006	21	3100
OH2345712	BEACHCOMBER	NC	GW	Very Small	11/1/2006	22	3100
OH2345712	BEACHCOMBER	NC	GW	Very Small	9/1/2006	22	3100
OH2345812	CUDAJOS PWS	NC	GU	Very Small	7/1/2006	42	0200
OH2345812	CUDAJOS PWS	NC	GU	Very Small	1/1/2006	41	0200
OH2345812	CUDAJOS PWS	NC	GU	Very Small	2/1/2006	41	0200
OH2345812	CUDAJOS PWS	NC	GU	Very Small	3/1/2006	41	0200
OH2556412	BROOKSIDE GOLF & COUNTRY CLUB PWS	NTNC	GW	Very Small	10/1/2006	02	1005
OH2600311	DELTA VILLAGE PWS	C	SW	Small	10/1/2006	02	2950
OH2600311	DELTA VILLAGE PWS	C	SW	Small	7/1/2006	02	2950
OH2600311	DELTA VILLAGE PWS	C	SW	Small	8/1/2006	43	0300
OH2600311	DELTA VILLAGE PWS	C	SW	Small	8/1/2006	44	0300
OH2600311	DELTA VILLAGE PWS	C	SW	Small	7/1/2006	44	0300
OH2600311	DELTA VILLAGE PWS	C	SW	Small	4/1/2006	02	2950
OH2600311	DELTA VILLAGE PWS	C	SW	Small	7/1/2006	43	0300
OH2600311	DELTA VILLAGE PWS	C	SW	Small	1/1/2006	02	2950
OH2600311	DELTA VILLAGE PWS	C	SW	Small	1/1/2006	44	0300
OH2600603	LYONS VILLAGE PWS	C	SWP	Small	10/1/2006	02	2950
OH2600603	LYONS VILLAGE PWS	C	SWP	Small	7/1/2006	02	2950
OH2600603	LYONS VILLAGE PWS	C	SWP	Small	4/1/2006	02	2950
OH2600603	LYONS VILLAGE PWS	C	SWP	Small	1/1/2006	02	2950
OH2600711	METAMORA VILLAGE PWS	C	SW	Small	10/1/2006	02	2950
OH2600711	METAMORA VILLAGE PWS	C	SW	Small	7/1/2006	02	2950
OH2600711	METAMORA VILLAGE PWS	C	SW	Small	4/1/2006	02	2950
OH2600711	METAMORA VILLAGE PWS	C	SW	Small	1/1/2006	02	2950
OH2601011	SWANTON VILLAGE PWS	C	SW	Medium	7/1/2006	02	2950

APPENDIX B
CY2006 MCL AND TT VIOLATIONS FOR OHIO

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant Type
OH2601011	SWANTON VILLAGE PWS	C	SW	Medium	4/1/2006	02	2950
OH2601011	SWANTON VILLAGE PWS	C	SW	Medium	1/1/2006	02	2950
OH2630912	MCDONNALL FARMS INC AMLC	NC	GW	Very Small	1/1/2006	21	3100
OH2631212	WHITE CITY RESTAURANT PWS	NC	GW	Very Small	11/1/2006	22	3100
OH2631212	WHITE CITY RESTAURANT PWS	NC	GW	Very Small	10/1/2006	22	3100
OH2631212	WHITE CITY RESTAURANT PWS	NC	GW	Very Small	7/1/2006	22	3100
OH2631212	WHITE CITY RESTAURANT PWS	NC	GW	Very Small	7/1/2006	21	3100
OH2632912	FRANKLIN ELEMENTARY SCHOOL - ARCHBOLD	NTNC	GW	Very Small	7/1/2006	21	3100
OH2632912	FRANKLIN ELEMENTARY SCHOOL - ARCHBOLD	NTNC	GW	Very Small	7/1/2006	22	3100
OH2557012	RAGER ROAD CHURCH OF CHRIST PWS	NC	GW	Very Small	10/1/2006	22	3100
OH2547112	INDIAN RIDGE AREA-NORTH PWS	NC	GW	Very Small	10/1/2006	22	3100
OH2548912	OAKHURST COUNTRY CLUB	NTNC	GW	Very Small	10/1/2006	22	3100
OH2549512	DUBLIN MILLWORK INC	NTNC	GW	Very Small	7/1/2006	22	3100
OH2550112	DARBYDALE NAZARENE CHURCH	NTNC	GW	Very Small	10/1/2006	02	1005
OH2550112	DARBYDALE NAZARENE CHURCH	NTNC	GW	Very Small	7/1/2006	02	1005
OH2550712	CHURCH OF GOD AT BERWICK PWS	NC	GW	Very Small	10/1/2006	22	3100
OH2550712	CHURCH OF GOD AT BERWICK PWS	NC	GW	Very Small	7/1/2006	22	3100
OH2553012	ELAM ENVIRONMENTAL CENTER	NC	GW	Very Small	7/1/2006	22	3100
OH2554312	ANCHOR BAPTIST CHURCH	NC	GW	Very Small	7/1/2006	21	3100
OH2554312	ANCHOR BAPTIST CHURCH	NC	GW	Very Small	7/1/2006	22	3100
OH2554312	ANCHOR BAPTIST CHURCH	NC	GW	Very Small	4/1/2006	22	3100
OH2555312	CYPRESS WESLEYAN CHURCH	NTNC	GW	Very Small	10/1/2006	02	1005
OH2861812	RPR VILLAGE - G SECTION PWS	NC	GW	Small	7/1/2006	22	3100
OH2861812	RPR VILLAGE - G SECTION PWS	NC	GW	Small	7/1/2006	21	3100
OH2862012	WASTE MANAGEMENT	NTNC	GW	Very Small	10/1/2006	02	1005
OH2862112	GEAUGA PARKS-BEARTOWN LAKES-NO POINT	NC	GW	Very Small	10/1/2006	22	3100
OH2862212	SHELL-CHESTERLAND	NC	GW	Very Small	4/1/2006	22	3100
OH2862212	SHELL-CHESTERLAND	NC	GW	Very Small	4/1/2006	21	3100
OH2862312	SHELL-NOVELTY	NC	GW	Very Small	4/1/2006	22	3100
OH2831012	CENTERVILLE MILLS PARK PWS	NTNC	GW	Very Small	7/1/2006	21	3100
OH2832312	FOWLERS INN	NC	GW	Very Small	7/1/2006	22	3100

APPENDIX B
CY2006 MCL AND TT VIOLATIONS FOR OHIO

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant Type
OH2833412	GURNEY ELEMENTARY SCHOOL	NTNC	GW	Small	7/1/2006	22	3100
OH2834112	JOHN ANTHONY OF NOVELTY, INC. PWS	NC	GW	Very Small	10/1/2006	22	3100
OH2834112	JOHN ANTHONY OF NOVELTY, INC. PWS	NC	GW	Very Small	7/1/2006	22	3100
OH2834512	DR. NOVAK, DVM	NC	GW	Very Small	7/1/2006	22	3100
OH2835812	NASHS RESTAURANT	NC	GW	Very Small	7/1/2006	22	3100
OH2863812	CHURCH OF JESUS CHRIST OF LDS-MUNSON	NC	GW	Very Small	7/1/2006	22	3100
OH2864512	ALPINE VALLEY SKI AREA	NC	GW	Very Small	10/1/2006	22	3100
OH2864512	ALPINE VALLEY SKI AREA	NC	GW	Very Small	7/1/2006	22	3100
OH2848512	VALLEY PRESBYTERIAN CHURCH	NTNC	GW	Very Small	1/1/2006	22	3100
OH2865612	FOWLERS MILL GOLF CLUBHOUSE	NC	GW	Very Small	10/1/2006	22	3100
OH2865612	FOWLERS MILL GOLF CLUBHOUSE	NC	GW	Very Small	7/1/2006	22	3100
OH2866212	MAYFIELD SAND RIDGE GOLF CLUB	NC	GW	Very Small	7/1/2006	22	3100
OH2866312	TROY HILL GOLF CENTER	NC	GW	Very Small	10/1/2006	22	3100
OH2866612	FIELDSTONE FARM THERAPEUTIC RIDING CENTE	NC	GW	Very Small	7/1/2006	22	3100
OH2868012	BROWN BARN BANQUET CENTER	NC	GW	Very Small	4/1/2006	22	3100
OH2868012	BROWN BARN BANQUET CENTER	NC	GW	Very Small	1/1/2006	21	3100
OH2868412	CIRCLE K 5277 PWS	NC	GW	Very Small	7/1/2006	22	3100
OH2868812	FEDERATED CHURCH FAMILY LIFE CENTER	NC	GW	Very Small	10/1/2006	22	3100
OH2868812	FEDERATED CHURCH FAMILY LIFE CENTER	NC	GW	Very Small	4/1/2006	02	1040
OH2868812	FEDERATED CHURCH FAMILY LIFE CENTER	NC	GW	Very Small	1/1/2006	02	1040
OH2802012	MIDDLEFIELD VILLAGE PWS	C	GW	Small	10/1/2006	02	1005
OH2841712	RPR VILLAGE - MAIN WELL	NC	GW	Small	7/1/2006	21	3100
OH2841712	RPR VILLAGE - MAIN WELL	NC	GW	Small	7/10/2006	22	3100
OH2841712	RPR VILLAGE - MAIN WELL	NC	GW	Small	4/1/2006	21	3100
OH2843012	WEST GEAUGA CAMPUS	NTNC	GW	Small	7/1/2006	22	3100
OH2843812	GEAUGA LAKE - WAVE POOL	NC	GW	Very Small	10/1/2006	02	1005
OH2860712	GEAUGA LAKE - WESTERN VILLAGE	NC	GW	Very Small	10/1/2006	02	1005
OH2860712	GEAUGA LAKE - WESTERN VILLAGE	NC	GW	Very Small	4/1/2006	22	3100
OH2861512	CENTERVILLE MILLS TEEN CENTER PWS	NC	GW	Very Small	1/1/2006	22	3100
OH2871512	LAUREL SCHOOL - NORTH LODGE WELL PWS	NC	GW	Very Small	10/1/2006	22	3100
OH2871812	MORNING STAR EVANGELICAL FRIENDS CHURCH	NC	GW	Small	7/1/2006	22	3100

APPENDIX B
CY2006 MCL AND TT VIOLATIONS FOR OHIO

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant Type
OH2872012	BAINBRIDGE TOWNSHIP POLICE STATION PWS	NTNC	GW	Very Small	7/1/2006	22	3100
OH2854112	METZENBAUM SHELTERED IND	NTNC	GW	Very Small	10/1/2006	02	1005
OH2854112	METZENBAUM SHELTERED IND	NTNC	GW	Very Small	7/1/2006	02	1005
OH2857812	ASM INTERNATIONAL	NTNC	GW	Very Small	10/1/2006	21	3100
OH2857812	ASM INTERNATIONAL	NTNC	GW	Very Small	10/1/2006	22	3100
OH2858512	MAYFIELD ENTERPRISES	NC	GW	Very Small	10/1/2006	22	3100
OH2859712	BAINBRIDGE TOWNSHIP BUILDING	NC	GW	Very Small	10/1/2006	22	3100
OH2859712	BAINBRIDGE TOWNSHIP BUILDING	NC	GW	Very Small	7/1/2006	22	3100
OH2958012	BLUE JACKET DRAMA PWS	NC	GW	Very Small	4/1/2006	22	3100
OH3000212	CUMBERLAND VILLAGE	C	GU	Very Small	10/1/2006	02	2950
OH3000212	CUMBERLAND VILLAGE	C	GU	Very Small	7/1/2006	02	2950
OH3000212	CUMBERLAND VILLAGE	C	GU	Very Small	4/1/2006	02	2950
OH3000212	CUMBERLAND VILLAGE	C	GU	Very Small	1/1/2006	02	2950
OH3000212	CUMBERLAND VILLAGE	C	GU	Very Small	4/1/2006	46	2920
OH3000212	CUMBERLAND VILLAGE	C	GU	Very Small	4/1/2006	41	0200
OH3000212	CUMBERLAND VILLAGE	C	GU	Very Small	2/1/2006	41	0200
OH3000212	CUMBERLAND VILLAGE	C	GU	Very Small	3/1/2006	41	0200
OH3000212	CUMBERLAND VILLAGE	C	GU	Very Small	1/1/2006	46	2920
OH3000212	CUMBERLAND VILLAGE	C	GU	Very Small	1/1/2006	41	0200
OH2957212	SEBASTIAN HILLS GOLF COURSE PWS	NC	GW	Very Small	1/1/2006	21	3100
OH3100112	RED WOOD MOBILE HOME PARK	C	GW	Very Small	10/1/2006	22	3100
OH2872412	TEAGUE BROTHERS PROFESSIONAL BLDG PWS	NC	GW	Very Small	10/1/2006	22	3100
OH2872412	TEAGUE BROTHERS PROFESSIONAL BLDG PWS	NC	GW	Very Small	7/1/2006	22	3100
OH2872612	GEAUGA PARKS-BIG CREEK DEEP WOODS PWS	NC	GW	Very Small	7/1/2006	22	3100
OH2950712	ODNR-JOHN BRYAN STATE PARK 2 PWS	NC	GW	Very Small	10/1/2006	22	3100
OH3530712	AMERICAN LEGION POST 454	NC	GW	Very Small	7/1/2006	21	3100
OH3531411	CAMPBELL SOUP SUPPLY CO	NTNC	SW	Small	5/1/2006	02	1040
OH3300212	DUNKIRK WATER TREATMENT PLANT	C	GW	Small	8/1/2006	22	3100
OH3636812	GOOD SHEPHERD U B CHURCH PWS	NC	GW	Very Small	10/1/2006	22	3100
OH3636812	GOOD SHEPHERD U B CHURCH PWS	NC	GW	Very Small	7/1/2006	21	3100
OH3636812	GOOD SHEPHERD U B CHURCH PWS	NC	GW	Very Small	1/1/2006	21	3100

APPENDIX B
CY2006 MCL AND TT VIOLATIONS FOR OHIO

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant Type
OH3636812	GOOD SHEPHERD U B CHURCH PWS	NC	GW	Very Small	1/1/2006	22	3100
OH3636912	LEESBURG AMISH SCHOOL	NC	GW	Very Small	7/1/2006	21	3100
OH3730112	ANTIOCH ALLIANCE CHURCH	NC	GW	Very Small	7/1/2006	21	3100
OH3138412	CINCINNATI TEST SYSTEMS 2	NTNC	GW	Very Small	10/1/2006	22	3100
OH3200411	MCCOMB WATER TREATMENT PLANT	C	SW	Small	7/1/2006	02	2950
OH3200411	MCCOMB WATER TREATMENT PLANT	C	SW	Small	8/1/2006	44	0300
OH3200411	MCCOMB WATER TREATMENT PLANT	C	SW	Small	4/1/2006	02	2950
OH3200903	ARCADIA WATER PUMPING STATION	C	SWP	Small	4/1/2006	02	2950
OH3052811	ODNR-SALT FORK ST PARK	NTNC	SW	Very Small	10/1/2006	02	2950
OH3052811	ODNR-SALT FORK ST PARK	NTNC	SW	Very Small	7/1/2006	02	2950
OH3052811	ODNR-SALT FORK ST PARK	NTNC	SW	Very Small	4/1/2006	02	2950
OH3052811	ODNR-SALT FORK ST PARK	NTNC	SW	Very Small	1/1/2006	02	2950
OH2860212	WEST GEAUGA PLAZA-MAIN	NTNC	GW	Very Small	7/1/2006	02	2987
OH2860212	WEST GEAUGA PLAZA-MAIN	NTNC	GW	Very Small	10/1/2006	02	2987
OH2860212	WEST GEAUGA PLAZA-MAIN	NTNC	GW	Very Small	4/1/2006	02	2987
OH2860212	WEST GEAUGA PLAZA-MAIN	NTNC	GW	Very Small	1/1/2006	02	2987
OH2902012	WRIGHT STATE UNIVERSITY	C	GW	Large	6/1/2006	22	3100
OH2934412	GRANDPAS CAFE PWS	NC	GW	Very Small	12/1/2006	22	3100
OH2934412	GRANDPAS CAFE PWS	NC	GW	Very Small	10/1/2006	22	3100
OH2934412	GRANDPAS CAFE PWS	NC	GW	Very Small	7/1/2006	22	3100
OH2940912	COUNTY LINE BAPTIST CHURCH	NC	GW	Very Small	7/1/2006	22	3100
OH3237412	MT CORY VILLAGE PARK	NC	GW	Very Small	4/1/2006	21	3100
OH3237412	MT CORY VILLAGE PARK	NC	GW	Very Small	4/1/2006	22	3100
OH3240112	SHADYLAKE CAMPGROUND WATER SYSTEM	NC	GW	Very Small	4/1/2006	22	3100
OH3240112	SHADYLAKE CAMPGROUND WATER SYSTEM	NC	GW	Very Small	7/1/2006	21	3100
OH3243812	ODOT REST AREA 1-25 NB	NC	GW	Small	6/1/2006	22	3100
OH3244012	ODOT REST AREA 1-26 SB	NC	GW	Small	6/1/2006	22	3100
OH3244012	ODOT REST AREA 1-26 SB	NC	GW	Small	7/1/2006	22	3100
OH3244012	ODOT REST AREA 1-26 SB	NC	GW	Small	8/1/2006	21	3100
OH3245812	HANCOCK PRK DIS-RIVERBEND MEADOWS	NC	GW	Very Small	7/1/2006	22	3100
OH3247412	SULPHUR LAKE CAMPGROUND	NC	GW	Very Small	4/1/2006	21	3100

APPENDIX B
CY2006 MCL AND TT VIOLATIONS FOR OHIO

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant Type
OH3247612	ALLEN TOWNSHIP CENTER	NC	GW	Very Small	7/1/2006	22	3100
OH3436512	USACE-CLEDENING DAM	NC	GW	Very Small	7/1/2006	22	3100
OH3500603	LIBERTY CENTER VILLAGE PWS	C	SWP	Small	10/1/2006	02	2950
OH3500603	LIBERTY CENTER VILLAGE PWS	C	SWP	Small	7/1/2006	02	2950
OH3500603	LIBERTY CENTER VILLAGE PWS	C	SWP	Small	4/1/2006	02	2950
OH3500603	LIBERTY CENTER VILLAGE PWS	C	SWP	Small	1/1/2006	02	2950
OH3500711	MCCLURE VILLAGE PWS	C	SW	Small	10/1/2006	02	2950
OH3500711	MCCLURE VILLAGE PWS	C	SW	Small	7/1/2006	02	2950
OH3500711	MCCLURE VILLAGE PWS	C	SW	Small	4/1/2006	02	2950
OH3500711	MCCLURE VILLAGE PWS	C	SW	Small	4/1/2006	02	2456
OH3500711	MCCLURE VILLAGE PWS	C	SW	Small	6/1/2006	41	0200
OH3500711	MCCLURE VILLAGE PWS	C	SW	Small	1/1/2006	02	2950
OH3500711	MCCLURE VILLAGE PWS	C	SW	Small	4/1/2006	41	0200
OH3500811	NAPOLEON CITY PWS	C	SW	Medium	10/1/2006	02	2950
OH3500811	NAPOLEON CITY PWS	C	SW	Medium	7/1/2006	02	2950
OH3500811	NAPOLEON CITY PWS	C	SW	Medium	4/1/2006	02	2950
OH3500811	NAPOLEON CITY PWS	C	SW	Medium	1/1/2006	02	2950
OH3849012	HOLMES BY PRODUCTS PWS	NTNC	GW	Very Small	7/1/2006	22	3100
OH3849012	HOLMES BY PRODUCTS PWS	NTNC	GW	Very Small	7/1/2006	21	3100
OH3849112	VALLEY VIEW OAK LLC PWS	NTNC	GW	Very Small	7/1/2006	22	3100
OH3935212	LYME ELEMENTARY SCHOOL	NTNC	SWP	Very Small	10/1/2006	02	2950
OH3300712	MCGUFFEY VILLAGE WATER	C	GW	Small	8/1/2006	22	3100
OH3300712	MCGUFFEY VILLAGE WATER	C	GW	Small	7/1/2006	22	3100
OH3330912	BULLWINKLES BAR & GRILL PWS	NC	GW	Very Small	10/1/2006	22	3100
OH3330912	BULLWINKLES BAR & GRILL PWS	NC	GW	Very Small	7/1/2006	21	3100
OH3330912	BULLWINKLES BAR & GRILL PWS	NC	GW	Very Small	7/1/2006	22	3100
OH3333412	ST JOHNS LUTHERAN CHURCH	NC	GW	Very Small	10/1/2006	22	3100
OH3333412	ST JOHNS LUTHERAN CHURCH	NC	GW	Very Small	7/1/2006	22	3100
OH3334212	WALNUT GROVE UNITED METHODIST CHURCH P	NC	GW	Very Small	10/1/2006	22	3100
OH3334212	WALNUT GROVE UNITED METHODIST CHURCH P	NC	GW	Very Small	7/1/2006	22	3100
OH3334212	WALNUT GROVE UNITED METHODIST CHURCH P	NC	GW	Very Small	7/1/2006	21	3100

APPENDIX B
CY2006 MCL AND TT VIOLATIONS FOR OHIO

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant Type
OH3335212	VETERANS MEMORIAL PARK	NC	GW	Very Small	10/1/2006	22	3100
OH3335212	VETERANS MEMORIAL PARK	NC	GW	Very Small	11/1/2006	22	3100
OH3335212	VETERANS MEMORIAL PARK	NC	GW	Very Small	7/1/2006	21	3100
OH3430112	ASBURY CHAPEL	NC	GW	Very Small	7/1/2006	22	3100
OH3501203	FLORIDA VILLAGE PWS	C	SWP	Very Small	4/1/2006	02	2950
OH3501203	FLORIDA VILLAGE PWS	C	SWP	Very Small	1/1/2006	02	2950
OH3938612	WAREHOUSE TIRE COMPANY	NC	GW	Very Small	10/1/2006	22	3100
OH3938612	WAREHOUSE TIRE COMPANY	NC	GW	Very Small	7/1/2006	22	3100
OH3938612	WAREHOUSE TIRE COMPANY	NC	GW	Very Small	7/1/2006	21	3100
OH4001912	WELLSTON PUBLIC WATER SYSTEM	C	SW	Medium	7/1/2006	46	2920
OH4001912	WELLSTON PUBLIC WATER SYSTEM	C	SW	Medium	4/1/2006	46	2920
OH4001003	JACKSON COUNTY WATER CO-G	C	SWP	Small	10/1/2006	02	2456
OH4001003	JACKSON COUNTY WATER CO-G	C	SWP	Small	7/1/2006	02	2456
OH4001003	JACKSON COUNTY WATER CO-G	C	SWP	Small	1/1/2006	02	2456
OH3501403	MALINTA VILLAGE PWS	C	SWP	Very Small	10/1/2006	02	2950
OH3501403	MALINTA VILLAGE PWS	C	SWP	Very Small	7/1/2006	02	2950
OH3501403	MALINTA VILLAGE PWS	C	SWP	Very Small	4/1/2006	02	2950
OH3501403	MALINTA VILLAGE PWS	C	SWP	Very Small	1/1/2006	02	2950
OH3844812	MILLERSBURG UNITED METHODIST CHURCH	NC	GW	Very Small	7/1/2006	22	3100
OH3844912	MOHICAN RIVER LODGE	NC	GW	Very Small	7/1/2006	22	3100
OH3845612	CHARM COUNTRYVIEW INN	NC	GW	Very Small	7/1/2006	21	3100
OH3846412	KILLBUCK VALLEY CHRISTIAN CHURCH	NC	GW	Very Small	7/1/2006	22	3100
OH3846412	KILLBUCK VALLEY CHRISTIAN CHURCH	NC	GW	Very Small	7/1/2006	21	3100
OH3846412	KILLBUCK VALLEY CHRISTIAN CHURCH	NC	GW	Very Small	1/1/2006	21	3100
OH3846912	SKIPS TRAIL DEPOT STOP	NC	GW	Very Small	10/1/2006	22	3100
OH3846912	SKIPS TRAIL DEPOT STOP	NC	GW	Very Small	7/1/2006	22	3100
OH3848012	3M ASSOCIATES LTD PWS	NTNC	GW	Very Small	10/1/2006	22	3100
OH3848012	3M ASSOCIATES LTD PWS	NTNC	GW	Very Small	7/1/2006	21	3100
OH3848012	3M ASSOCIATES LTD PWS	NTNC	GW	Very Small	7/1/2006	22	3100
OH3738112	SOUTH BLOOMINGVILLE TAVERN	NC	GW	Very Small	1/1/2006	22	3100
OH3740312	HOCKING HILLS FLEA MARKET PWS	NTNC	GW	Small	8/1/2006	21	3100

APPENDIX B
CY2006 MCL AND TT VIOLATIONS FOR OHIO

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant Type
OH3800412	HILLTOP GROUP HOME INC. PWS	C	GW	Very Small	7/1/2006	21	3100
OH3830212	HOMESTEAD RESTAURANT	NC	GW	Very Small	1/1/2006	21	3100
OH3833614	KEIM LUMBER	NTNC	GW	Very Small	7/1/2006	22	3100
OH3833614	KEIM LUMBER	NTNC	GW	Very Small	7/1/2006	21	3100
OH3834312	LONG LAKE PARK & CAMPGROUND EAST	NC	GW	Very Small	10/1/2006	22	3100
OH3835412	YODER LUMBER CO. - BUCKHORN DIVISION PWS	NTNC	GW	Very Small	10/1/2006	22	3100
OH3840012	COUNTRY SIDE CHAPEL	NC	GW	Very Small	7/1/2006	21	3100
OH3841512	LIVING WORD FELLOWSHIP PWS	NC	GW	Very Small	4/1/2006	21	3100
OH3842112	PENIEL FELLOWSHIP CHURCH	NC	GW	Very Small	7/1/2006	21	3100
OH3842112	PENIEL FELLOWSHIP CHURCH	NC	GW	Very Small	7/1/2006	22	3100
OH3842212	HOLMESVILLE ELEMENTARY	NTNC	GW	Very Small	10/1/2006	22	3100
OH3842412	COLLINS & AIKMAN PWS	NTNC	GW	Very Small	10/1/2006	22	3100
OH3842412	COLLINS & AIKMAN PWS	NTNC	GW	Very Small	7/1/2006	22	3100
OH3842512	LIGHT IN THE VALLEY CHURCH	NC	GW	Very Small	7/1/2006	22	3100
OH3842512	LIGHT IN THE VALLEY CHURCH	NC	GW	Very Small	7/1/2006	21	3100
OH4535912	PERRY ELEMENTARY SCHOOL	NTNC	GW	Very Small	10/1/2006	22	3100
OH4537412	VELVET ICE CREAM COMPANY	NTNC	GW	Very Small	10/1/2006	02	1005
OH4102411	STEUBENVILLE, CITY OF	C	SW	Large	12/1/2006	41	0200
OH4102411	STEUBENVILLE, CITY OF	C	SW	Large	7/1/2006	02	2950
OH4132712	ROADSIDE INN	NC	GW	Very Small	7/1/2006	21	3100
OH4132712	ROADSIDE INN	NC	GW	Very Small	7/1/2006	22	3100
OH4132712	ROADSIDE INN	NC	GW	Very Small	4/1/2006	21	3100
OH3844412	GRACE BRETHERN CHURCH	NC	GW	Very Small	10/1/2006	22	3100
OH4501912	MAPLE HEIGHTS MOBILE HOME PARK PWS	C	GW	Very Small	10/1/2006	02	1005
OH4502112	LEISURE VILLAGE MHP PWS	C	GW	Very Small	10/1/2006	02	1005
OH4504612	PINE KIRK CARE CENTER	C	GW	Very Small	10/1/2006	22	3100
OH4504612	PINE KIRK CARE CENTER	C	GW	Very Small	9/1/2006	21	3100
OH4504612	PINE KIRK CARE CENTER	C	GW	Very Small	9/1/2006	22	3100
OH4533812	KAISER ALUMINUM CORP.	NTNC	GW	Very Small	10/1/2006	02	1005
OH4534212	KIRKERSVILLE ELEMENTARY	NTNC	GW	Very Small	10/1/2006	22	3100
OH4534612	LICKING RURAL ELECTRIC	NTNC	GW	Very Small	10/1/2006	02	1005

APPENDIX B
CY2006 MCL AND TT VIOLATIONS FOR OHIO

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant Type
OH4534812	LICKING VALLEY JR HIGH	NTNC	GW	Small	10/1/2006	02	1005
OH4534812	LICKING VALLEY JR HIGH	NTNC	GW	Small	7/1/2006	02	1005
OH4200912	MOUNT VERNON ACADEMY	NTNC	GW	Very Small	10/1/2006	22	3100
OH4200912	MOUNT VERNON ACADEMY	NTNC	GW	Very Small	7/1/2006	22	3100
OH4231212	MT. VERNON COUNTRY CLUB, LTD. PWS	NP		Very Small	10/1/2006	22	3100
OH4231212	MT. VERNON COUNTRY CLUB, LTD. PWS	NP		Very Small	7/1/2006	22	3100
OH4231212	MT. VERNON COUNTRY CLUB, LTD. PWS	NP		Very Small	7/1/2006	21	3100
OH4631712	CAMP WESLEY-MIDDLE	NC	GW	Very Small	10/1/2006	22	3100
OH4632912	GEM SPORTSWEAR MFG INC.	NTNC	GW	Very Small	10/1/2006	22	3100
OH4633912	ODNR INDIAN LAKE ST PK - CAMPGROUND	NC	GW	Small	10/1/2006	22	3100
OH4643812	MIAMI VALLEY CAMP	NC	GW	Very Small	7/1/2006	21	3100
OH4240312	HOT RODS SUNOCO	NC	GU	Small	7/1/2006	22	3100
OH4240312	HOT RODS SUNOCO	NC	GU	Small	8/1/2006	22	3100
OH4240312	HOT RODS SUNOCO	NC	GU	Small	9/1/2006	22	3100
OH4240312	HOT RODS SUNOCO	NC	GU	Small	9/1/2006	21	3100
OH4240312	HOT RODS SUNOCO	NC	GU	Small	7/1/2006	42	0200
OH4240312	HOT RODS SUNOCO	NC	GU	Small	7/1/2006	21	3100
OH4240312	HOT RODS SUNOCO	NC	GU	Small	5/1/2006	22	3100
OH4240312	HOT RODS SUNOCO	NC	GU	Small	6/1/2006	22	3100
OH4240312	HOT RODS SUNOCO	NC	GU	Small	6/1/2006	21	3100
OH4240312	HOT RODS SUNOCO	NC	GU	Small	5/1/2006	21	3100
OH4240312	HOT RODS SUNOCO	NC	GU	Small	2/1/2006	22	3100
OH4240312	HOT RODS SUNOCO	NC	GU	Small	1/1/2006	41	0200
OH4240312	HOT RODS SUNOCO	NC	GU	Small	2/1/2006	41	0200
OH4240312	HOT RODS SUNOCO	NC	GU	Small	3/1/2006	41	0200
OH4240612	BREEZE INN	NC	GW	Very Small	2/1/2006	21	3100
OH4241712	GOETZMAN CHRYSLER PWS	NC	GW	Very Small	10/1/2006	22	3100
OH4241712	GOETZMAN CHRYSLER PWS	NC	GW	Very Small	4/1/2006	22	3100
OH4241812	MID-OHIO PWS	NC	GW	Very Small	7/1/2006	22	3100
OH4243112	COCHRANS LIT-LE LAMBS LEARNING CTR PWS	NTNC	GW	Very Small	10/1/2006	02	1005
OH4243112	COCHRANS LIT-LE LAMBS LEARNING CTR PWS	NTNC	GW	Very Small	7/1/2006	02	1005

APPENDIX B
CY2006 MCL AND TT VIOLATIONS FOR OHIO

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant Type
OH4602212	RUSSELLS POINT VILLAGE PWS	C	GW	Small	10/1/2006	02	2456
OH4602212	RUSSELLS POINT VILLAGE PWS	C	GW	Small	10/1/2006	02	2950
OH4602212	RUSSELLS POINT VILLAGE PWS	C	GW	Small	7/1/2006	02	2456
OH4602212	RUSSELLS POINT VILLAGE PWS	C	GW	Small	7/1/2006	02	2950
OH4602212	RUSSELLS POINT VILLAGE PWS	C	GW	Small	4/1/2006	02	2950
OH4602212	RUSSELLS POINT VILLAGE PWS	C	GW	Small	1/1/2006	02	2950
OH4602312	SHAWNEE ISLAND CONDO	NC	GW	Very Small	7/1/2006	22	3100
OH4602312	SHAWNEE ISLAND CONDO	NC	GW	Very Small	4/1/2006	22	3100
OH4637612	TURKEYFOOT RESORT	NC	GW	Very Small	4/1/2006	22	3100
OH4639312	YMCA WILLSON CENTER-SHOWER PWS	NC	GW	Very Small	10/1/2006	22	3100
OH4639312	YMCA WILLSON CENTER-SHOWER PWS	NC	GW	Very Small	7/1/2006	22	3100
OH4643012	MIDWEST EXPRESS 3 EAST	NTNC	GW	Very Small	10/1/2006	22	3100
OH4235112	HIDDEN HILLS GOLF COURSE	NC	GW	Very Small	7/1/2006	21	3100
OH4235712	MOHICAN WILDERNESS CAMP	NC	GW	Very Small	10/1/2006	22	3100
OH4237112	WYANDOT GOLF COURSE	NC	GW	Very Small	4/1/2006	21	3100
OH4240012	CHAPEL HILL GOLF COURSE	NC	GW	Very Small	7/1/2006	21	3100
OH4240012	CHAPEL HILL GOLF COURSE	NC	GW	Very Small	4/1/2006	21	3100
OH8037912	MADE FROM SCRATCH PWS	NTNC	GW	Very Small	10/1/2006	02	1005
OH8037912	MADE FROM SCRATCH PWS	NTNC	GW	Very Small	7/1/2006	02	1005
OH8745412	PIONEER HI BRED INTERNATIONAL	NTNC	GW	Very Small	4/1/2006	22	3100
OH7257612	MEMORIAL HOSPITAL MEDICAL BUILDING	NC	GW	Very Small	10/1/2006	22	3100
OH7258812	C M SCHERMERHORN MD	NC	GW	Very Small	10/1/2006	22	3100
OH8640712	LIVING WATERS INTERNATIONAL CHURCH	NC	GW	Very Small	10/1/2006	22	3100
OH8640712	LIVING WATERS INTERNATIONAL CHURCH	NC	GW	Very Small	7/1/2006	22	3100
OH8640712	LIVING WATERS INTERNATIONAL CHURCH	NC	GW	Very Small	1/1/2006	21	3100
OH8640712	LIVING WATERS INTERNATIONAL CHURCH	NC	GW	Very Small	1/1/2006	22	3100
OH5233612	GASKO FABRICATED PRODUCTS	NTNC	GW	Very Small	7/1/2006	02	1005
OH5239712	RCE MIDWAY TAVERN, INC.	NC	GW	Very Small	7/1/2006	21	3100
OH5142312	TRINITY LUTHERAN EDUCATIONAL BUILDING P	NC	GW	Very Small	10/1/2006	22	3100
OH5143012	RACEWAY MINI MART PWS	NC	GW	Very Small	10/1/2006	22	3100
OH7663912	CLEARVIEW GOLF COURSE	NC	GW	Very Small	4/1/2006	22	3100

APPENDIX B
CY2006 MCL AND TT VIOLATIONS FOR OHIO

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant Type
OH6037212	GREENS TEA ROOM PWS	NC	GW	Very Small	7/1/2006	21	3100
OH7654512	LAKE ELEMENTARY SCHOOL	NTNC	GW	Small	10/1/2006	22	3100
OH7047512	OHIO EDISON-MANSFIELD SE	NTNC	GW	Very Small	7/1/2006	22	3100
OH8540112	KIDRON, INC. WELL 3	NTNC	GW	Very Small	7/1/2006	22	3100
OH8751812	RISING SUN COMMUNITY CHRISTIAN SCHOOL PW	NTNC	GW	Very Small	10/1/2006	22	3100
OH8751812	RISING SUN COMMUNITY CHRISTIAN SCHOOL PW	NTNC	GW	Very Small	7/1/2006	21	3100
OH8752112	INDIAN MOTORCYCLE WESTON PWS	NC	GW	Very Small	10/1/2006	22	3100
OH8835512	RIDGE CHAPEL CHURCH OF NAZARENE PWS	NC	GW	Very Small	10/1/2006	22	3100
OH7840012	THE LAKE TAVERN	NC	GW	Very Small	1/1/2006	22	3100
OH7720812	BEST STOP PWS	NC	GW	Very Small	7/1/2006	21	3100
OH6785212	GREAT LAKES ENERGY PARTNERS LLC PWS	NTNC	GW	Very Small	4/1/2006	22	3100
OH6785312	KIDS AHEAD-EAST PWS	NTNC	GW	Very Small	7/1/2006	22	3100
OH4840712	THE ROADHOUSE PWS	NC	GW	Very Small	7/1/2006	21	3100
OH4845812	WILKINS UNITED METHODIST CHURCH PWS	NC	GW	Very Small	10/1/2006	21	3100
OH4845812	WILKINS UNITED METHODIST CHURCH PWS	NC	GW	Very Small	10/1/2006	22	3100
OH4845812	WILKINS UNITED METHODIST CHURCH PWS	NC	GW	Very Small	7/1/2006	22	3100
OH4845812	WILKINS UNITED METHODIST CHURCH PWS	NC	GW	Very Small	1/1/2006	21	3100
OH4934112	MATCO INDUSTRIES	NTNC	GW	Very Small	10/1/2006	02	1005
OH4934112	MATCO INDUSTRIES	NTNC	GW	Very Small	7/1/2006	02	1005
OH4934112	MATCO INDUSTRIES	NTNC	GW	Very Small	7/1/2006	22	3100
OH4935112	MIDWAY ELEMENTARY SCHOOL	NTNC	GW	Very Small	10/1/2006	02	1005
OH7762612	MANCHESTER TAVERN PWS	NC	GW	Very Small	10/1/2006	22	3100
OH7763912	ODNR NIMISILA RES-CAMP-1	NC	GW	Very Small	10/1/2006	22	3100
OH7765212	PORTAGE LAKE EAGLES 273 PWS	NC	GW	Very Small	7/1/2006	22	3100
OH7765212	PORTAGE LAKE EAGLES 273 PWS	NC	GW	Very Small	7/1/2006	21	3100
OH8735412	CROWN INN MOTEL	NC	GW	Very Small	7/1/2006	22	3100
OH7756912	AKRON AUTO AUCTION	NC	GW	Very Small	4/1/2006	22	3100
OH5254012	BLUE BEACON TRUCK WASH	NC	GW	Very Small	7/1/2006	22	3100
OH7640812	BEACH CITY BIBLE METHODIST	NC	GW	Very Small	7/1/2006	21	3100
OH7644112	WALKER ELEMENTARY SCHOOL	NTNC	GW	Small	4/1/2006	21	3100
OH7645812	LAMOORES BAR & GRILLE PWS	NC	GW	Very Small	7/1/2006	22	3100

APPENDIX B
CY2006 MCL AND TT VIOLATIONS FOR OHIO

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant Type
OH6537612	FOXFIRE GOLF CLUB	NTNC	GW	Very Small	9/1/2006	22	3100
OH6537912	OHIO WILLOW WOOD CO	NTNC	GW	Very Small	10/1/2006	02	1005
OH6538212	SLATE RUN-SHADY GROVE	NC	GW	Very Small	7/1/2006	22	3100
OH6538212	SLATE RUN-SHADY GROVE	NC	GW	Very Small	4/1/2006	22	3100
OH6538712	KA SIMS ENTERPRISES PWS	NC	GW	Very Small	7/1/2006	22	3100
OH6230612	BLACKBERRY CORNERS	NC	GW	Very Small	10/1/2006	21	3100
OH6230612	BLACKBERRY CORNERS	NC	GW	Very Small	10/1/2006	22	3100
OH4937712	TRAVEL CENTERS OF AMERICA	NTNC	GW	Very Small	10/1/2006	02	1005
OH4937712	TRAVEL CENTERS OF AMERICA	NTNC	GW	Very Small	7/1/2006	02	1005
OH4939912	UNITED BETHEL MENNONITE CHURCH	NC	GW	Very Small	2/1/2006	41	0200
OH4939912	UNITED BETHEL MENNONITE CHURCH	NC	GW	Very Small	3/1/2006	41	0200
OH4939912	UNITED BETHEL MENNONITE CHURCH	NC	GW	Very Small	1/1/2006	41	0200
OH4941112	KNIGHTS INN	NC	GW	Very Small	10/1/2006	22	3100
OH4941112	KNIGHTS INN	NC	GW	Very Small	12/1/2006	22	3100
OH4941112	KNIGHTS INN	NC	GW	Very Small	7/1/2006	22	3100
OH4942312	TACO BELL	NC	GW	Very Small	10/1/2006	22	3100
OH5043412	WESTERN RESERVE PARK BATHHOUSE PWS	NC	GW	Very Small	7/1/2006	22	3100
OH5043512	PARADISE COVE CAMPGROUND	NC	GW	Very Small	10/1/2006	22	3100
OH7728912	ROSEANNE DILAURO MD BLDG PWS	NC	GW	Very Small	7/1/2006	22	3100
OH7728912	ROSEANNE DILAURO MD BLDG PWS	NC	GW	Very Small	7/1/2006	21	3100
OH7664912	WHINERY ELM INN PWS	NC	GW	Very Small	7/1/2006	22	3100
OH7664912	WHINERY ELM INN PWS	NC	GW	Very Small	7/1/2006	21	3100
OH7666112	LYONS DEN GOLF PWS	NC	GW	Very Small	7/1/2006	21	3100
OH7666112	LYONS DEN GOLF PWS	NC	GW	Very Small	7/1/2006	22	3100
OH6735112	CHURCH OF JESUS CHRIST OF LDS-ROOTSTOWN	NC	GW	Very Small	10/1/2006	22	3100
OH6735112	CHURCH OF JESUS CHRIST OF LDS-ROOTSTOWN	NC	GW	Very Small	11/1/2006	22	3100
OH7674212	CALVARY BAPTIST CHURCH PWS	NC	GW	Very Small	7/1/2006	22	3100
OH7674212	CALVARY BAPTIST CHURCH PWS	NC	GW	Very Small	7/1/2006	21	3100
OH7675112	MILLER WELD MASTER PWS	NTNC	GW	Very Small	10/1/2006	22	3100
OH7675112	MILLER WELD MASTER PWS	NTNC	GW	Very Small	10/1/2006	21	3100
OH7675112	MILLER WELD MASTER PWS	NTNC	GW	Very Small	4/1/2006	22	3100

APPENDIX B
CY2006 MCL AND TT VIOLATIONS FOR OHIO

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant Type
OH7675112	MILLER WELD MASTER PWS	NTNC	GW	Very Small	4/1/2006	21	3100
OH7675112	MILLER WELD MASTER PWS	NTNC	GW	Very Small	1/1/2006	22	3100
OH7700003	FRIENDLY EXPRESS PWS	NC	GW	Very Small	7/1/2006	22	3100
OH7667012	GRACE PETROLEUM - FOHL ROAD SHELL PWS	NC	GW	Very Small	7/1/2006	21	3100
OH6100103	CLEAR WATER CORPORATION	C	SWP	Small	10/1/2006	02	2456
OH6100103	CLEAR WATER CORPORATION	C	SWP	Small	10/1/2006	02	2950
OH6100303	PURE WATER CORPORATION	C	SWP	Small	10/1/2006	02	2456
OH6100303	PURE WATER CORPORATION	C	SWP	Small	10/1/2006	02	2950
OH6100303	PURE WATER CORPORATION	C	SWP	Small	7/1/2006	02	2456
OH6100303	PURE WATER CORPORATION	C	SWP	Small	7/1/2006	02	2950
OH6100303	PURE WATER CORPORATION	C	SWP	Small	4/1/2006	02	2456
OH6100303	PURE WATER CORPORATION	C	SWP	Small	4/1/2006	02	2950
OH6100503	NOBLE COUNTY WATER AUTHORITY PWS	C	SWP	Small	10/1/2006	02	2456
OH6100503	NOBLE COUNTY WATER AUTHORITY PWS	C	SWP	Small	7/1/2006	02	2456
OH6200412	CATAWBA SHORES M H COURT	NC	GW	Very Small	7/1/2006	22	3100
OH8739212	ST LOUIS CATHOLIC SCHOOL	NTNC	GW	Very Small	1/1/2006	21	3100
OH6835312	PILOT CORPORATION - EATON 286	NTNC	GW	Very Small	10/1/2006	02	1005
OH6835312	PILOT CORPORATION - EATON 286	NTNC	GW	Very Small	7/1/2006	02	1005
OH6835412	IAMS COMPANY	NTNC	GW	Very Small	7/1/2006	22	3100
OH6835912	ARCHWAY CAMPGROUND	NC	GW	Very Small	10/1/2006	22	3100
OH6837112	TINAS LAMPOST	NC	GW	Very Small	4/1/2006	22	3100
OH6837112	TINAS LAMPOST	NC	GW	Very Small	4/1/2006	21	3100
OH5046912	NORTH BENTON UNITED PRESBYTERIAN CHURC	NC	GW	Very Small	10/1/2006	22	3100
OH5047612	ADVANTAGE SPINAL & REHAB CENTER	NC	GU	Very Small	12/1/2006	41	0200
OH5047612	ADVANTAGE SPINAL & REHAB CENTER	NC	GU	Very Small	11/1/2006	41	0200
OH5047612	ADVANTAGE SPINAL & REHAB CENTER	NC	GU	Very Small	10/1/2006	41	0200
OH5047612	ADVANTAGE SPINAL & REHAB CENTER	NC	GU	Very Small	8/1/2006	41	0200
OH5047612	ADVANTAGE SPINAL & REHAB CENTER	NC	GU	Very Small	9/1/2006	41	0200
OH5047612	ADVANTAGE SPINAL & REHAB CENTER	NC	GU	Very Small	7/1/2006	41	0200
OH5047612	ADVANTAGE SPINAL & REHAB CENTER	NC	GU	Very Small	5/1/2006	41	0200
OH5047612	ADVANTAGE SPINAL & REHAB CENTER	NC	GU	Very Small	6/1/2006	41	0200

APPENDIX B
CY2006 MCL AND TT VIOLATIONS FOR OHIO

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant Type
OH5047612	ADVANTAGE SPINAL & REHAB CENTER	NC	GU	Very Small	4/1/2006	41	0200
OH5047612	ADVANTAGE SPINAL & REHAB CENTER	NC	GU	Very Small	1/1/2006	41	0200
OH5047612	ADVANTAGE SPINAL & REHAB CENTER	NC	GU	Very Small	2/1/2006	41	0200
OH5047612	ADVANTAGE SPINAL & REHAB CENTER	NC	GU	Very Small	3/1/2006	41	0200
OH5047812	LOCUST GROVE BAPTIST CHURCH	NC	GW	Very Small	10/1/2006	22	3100
OH5050612	OLD SPRINGFLD CHURCH OF CHRIST	NC	GW	Very Small	7/1/2006	22	3100
OH5051012	BISTRO 62 PWS	NC	GW	Very Small	7/1/2006	21	3100
OH5052512	BAIRD BROTHERS SAWMILL	NTNC	GW	Very Small	7/1/2006	22	3100
OH7050512	CAMP AVERY HAND (BSA) MAIN WELL	NC	GW	Very Small	10/1/2006	02	1040
OH7639612	CANAAN ACRES CHURCH CAMP	NC	GW	Very Small	10/1/2006	22	3100
OH7639612	CANAAN ACRES CHURCH CAMP	NC	GW	Very Small	4/1/2006	22	3100
OH5743012	GERMANTOWN METROPARK NATURE CENTER P	NC	GW	Very Small	10/1/2006	22	3100
OH5744312	FAIR VALLEY COUNTRY CLUB	NC	GW	Very Small	7/1/2006	21	3100
OH5745612	BLESSED HOPE BAPTIST CHURCH	NC	GW	Very Small	4/1/2006	22	3100
OH5746912	MIAMI VALLEY HUNT & POLO	NC	GW	Very Small	10/1/2006	22	3100
OH5746912	MIAMI VALLEY HUNT & POLO	NC	GW	Very Small	7/1/2006	22	3100
OH5702603	VANDALIA CITY PWS	C	SWP	Large	6/1/2006	22	3100
OH8741612	PRINCIPLE BUSINESS ENTERPRISES, INC	NTNC	GW	Very Small	1/1/2006	59	5000
OH8743312	NORTHWEST OHIO SERRC	NC	GW	Very Small	10/1/2006	22	3100
OH8743312	NORTHWEST OHIO SERRC	NC	GW	Very Small	7/1/2006	22	3100
OH8743412	WEBSTER ELEMENTARY SCHOOL	NTNC	GW	Very Small	4/1/2006	22	3100
OH7743112	CLARKE FORD-KIA BUILDING	NC	GW	Very Small	7/1/2006	21	3100
OH7743612	TRINITY CHURCH OF NAZARENE	NC	GW	Very Small	7/1/2006	21	3100
OH7743612	TRINITY CHURCH OF NAZARENE	NC	GW	Very Small	7/1/2006	22	3100
OH7793512	KARMAN RUBBER CO.	NTNC	GW	Very Small	7/1/2006	22	3100
OH6247311	ERIE INDUSTRIAL PARK ASSOC LLC PWS	NTNC	SW	Very Small	10/1/2006	02	2950
OH8703211	NORTHWESTERN W & SD -WESTON	C	SWP	Small	7/1/2006	02	2950
OH8703211	NORTHWESTERN W & SD -WESTON	C	SWP	Small	4/1/2006	02	2950
OH8703211	NORTHWESTERN W & SD -WESTON	C	SWP	Small	1/1/2006	02	2950
OH7732112	CAMP Y NOAH	NC	GW	Very Small	7/1/2006	22	3100
OH7773412	B&D NIMISILA GARDENS INC	NC	GW	Very Small	7/1/2006	21	3100

APPENDIX B
CY2006 MCL AND TT VIOLATIONS FOR OHIO

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant Type
OH7773412	B&D NIMISILA GARDENS INC	NC	GW	Very Small	7/1/2006	22	3100
OH7774312	GREENSBURG CHURCH OF GOD	NC	GW	Very Small	1/1/2006	22	3100
OH8300312	THE MEADOWS	C	GW	Very Small	3/1/2006	22	3100
OH8549112	AMISH DOOR, INC.	NTNC	GW	Very Small	4/1/2006	22	3100
OH8630312	KUNKLE FARMS AMLC	NC	GW	Very Small	4/1/2006	22	3100
OH5542712	FRATERNAL ORDER OF EAGLES PWS	NC	GW	Very Small	10/1/2006	22	3100
OH5543312	ST. TERESA OF INFANT JESUS PWS	NC	GW	Very Small	4/1/2006	21	3100
OH5543312	ST. TERESA OF INFANT JESUS PWS	NC	GW	Very Small	3/1/2006	22	3100
OH5545812	ROLLING HILLS GIRL SCOUT	NC	GW	Very Small	7/1/2006	22	3100
OH5547412	PATHWAY SCHOOL INC	NTNC	GW	Very Small	10/1/2006	22	3100
OH5547712	GINGHAMSBURG UMC SOUTH PWS	NC	GW	Very Small	7/1/2006	22	3100
OH5548012	WREN INDUSTRIES	NTNC	GW	Very Small	10/1/2006	02	1005
OH5243212	REMSEN RD CHRISTIAN CHURCH	NC	GW	Very Small	7/1/2006	22	3100
OH8557812	AMERICAN LEGION POST 68	NC	GW	Very Small	10/1/2006	22	3100
OH8557812	AMERICAN LEGION POST 68	NC	GW	Very Small	10/1/2006	21	3100
OH8134712	SAINT PAULS UNITED CHURCH OF CHRIST PWS	NC	GW	Very Small	7/1/2006	21	3100
OH8134712	SAINT PAULS UNITED CHURCH OF CHRIST PWS	NC	GW	Very Small	1/1/2006	21	3100
OH6783012	MANGIAMO PWS	NC	GW	Very Small	7/1/2006	22	3100
OH6783012	MANGIAMO PWS	NC	GW	Very Small	4/1/2006	22	3100
OH8556012	RAYCO MANUFACTURING, INC - BUILDING 1 PW	NTNC	GW	Very Small	10/1/2006	02	1005
OH8556012	RAYCO MANUFACTURING, INC - BUILDING 1 PW	NTNC	GW	Very Small	7/1/2006	02	1005
OH8560512	ST. MICHAELS LUTHERAN CHURCH PWS	NC	GW	Very Small	4/1/2006	21	3100
OH8560512	ST. MICHAELS LUTHERAN CHURCH PWS	NC	GW	Very Small	4/1/2006	22	3100
OH8560612	LEHMAN HARDWARE AND APPLIANCES PWS	NTNC	GW	Very Small	7/1/2006	21	3100
OH8560612	LEHMAN HARDWARE AND APPLIANCES PWS	NTNC	GW	Very Small	7/1/2006	22	3100
OH7939212	SHADY REST ARMY/NAVY CLUB	NC	GW	Very Small	10/1/2006	22	3100
OH7939212	SHADY REST ARMY/NAVY CLUB	NC	GW	Very Small	7/1/2006	21	3100
OH7939212	SHADY REST ARMY/NAVY CLUB	NC	GW	Very Small	7/1/2006	22	3100
OH7848812	MAPLEWOOD MIDDLE SCHOOL	NTNC	GW	Very Small	10/1/2006	02	1005
OH7849112	MAPLEWOOD ELEMENTARY SCHOOL	NTNC	GW	Very Small	10/1/2006	02	1005
OH7849112	MAPLEWOOD ELEMENTARY SCHOOL	NTNC	GW	Very Small	7/1/2006	02	1005

APPENDIX B
CY2006 MCL AND TT VIOLATIONS FOR OHIO

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant Type
OH8542712	MORELAND UNITED METHODIST CHURCH	NTNC	GW	Very Small	4/1/2006	22	3100
OH8546012	PUTNAM POST HOUSE	NC	GW	Very Small	7/1/2006	21	3100
OH8546012	PUTNAM POST HOUSE	NC	GW	Very Small	7/1/2006	22	3100
OH8547812	STERLING ELEMENTARY SCHOOL	NTNC	GW	Very Small	10/1/2006	02	1005
OH8548212	STERLING FARM EQUIPMENT	NC	GW	Very Small	11/1/2006	22	3100
OH8548212	STERLING FARM EQUIPMENT	NC	GW	Very Small	10/1/2006	22	3100
OH8548212	STERLING FARM EQUIPMENT	NC	GW	Very Small	4/1/2006	22	3100
OH7661312	CLAYS PARK - WATER PARK PWS	NC	GW	Very Small	4/1/2006	22	3100
OH7661712	SONS OF HERMAN	NC	GW	Very Small	10/1/2006	22	3100
OH7661712	SONS OF HERMAN	NC	GW	Very Small	1/1/2006	22	3100
OH5541912	WEST CHARLESTON CHURCH OF THE BRETHREN	NTNC	GW	Very Small	7/1/2006	22	3100
OH5438012	KORNER KAFE - MARIA STEIN	NC	GW	Very Small	7/1/2006	22	3100
OH5440112	ODOT-MERCER CO GARAGE PWS	NTNC	GW	Very Small	10/1/2006	22	3100
OH5441612	MAPLEWOOD OF SHANES VILLAGE PWS	NTNC	GW	Very Small	7/1/2006	22	3100
OH5441612	MAPLEWOOD OF SHANES VILLAGE PWS	NTNC	GW	Very Small	4/1/2006	22	3100
OH7727012	CAMP Y NOAH-LDC PWS	NC	GW	Very Small	7/1/2006	22	3100
OH7727112	CAMP Y NOAH-MAIN KYBO PWS	NC	GW	Very Small	7/1/2006	22	3100
OH7728512	DOUBLE PLAY-BALLFIELDS PWS	NC	GW	Very Small	4/1/2006	22	3100
OH7728612	VINEYARD CITY CHURCH PWS	NC	GW	Very Small	4/1/2006	21	3100
OH6539412	SLATE RUN-BUZZARDS ROOST	NC	GW	Very Small	7/1/2006	22	3100
OH6434312	MARANATHA BIBLE CHURCH	NC	GW	Very Small	7/1/2006	21	3100
OH6703912	SPRING LAKES MOBILE HOME PARK	C	GW	Very Small	10/1/2006	02	1005
OH6833722	CAMP AMERICA, INC.	NC	GW	Very Small	7/1/2006	21	3100
OH7670712	KOCH KNIGHT LLC	NTNC	GW	Very Small	1/1/2006	22	3100
OH5600711	WOODSFIELD VILLAGE PWS	C	SW	Small	10/1/2006	02	2950
OH6401403	OLD STRAITSVILLE WATER ASSOCIATION	C	SWP	Small	10/1/2006	02	2950
OH6401403	OLD STRAITSVILLE WATER ASSOCIATION	C	SWP	Small	7/1/2006	02	2950
OH6401403	OLD STRAITSVILLE WATER ASSOCIATION	C	SWP	Small	4/1/2006	02	2950
OH6402303	PORTERSVILLE EAST BRANCH WATER CO.	C	SWP	Small	10/1/2006	02	2950
OH6402303	PORTERSVILLE EAST BRANCH WATER CO.	C	SWP	Small	7/1/2006	02	2950
OH6402303	PORTERSVILLE EAST BRANCH WATER CO.	C	SWP	Small	4/1/2006	02	2950

APPENDIX B
CY2006 MCL AND TT VIOLATIONS FOR OHIO

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant Type
OH7500512	JACKSON CENTER VILLAGE PWS	C	GW	Small	8/1/2006	22	3100
OH7500812	MCCARTYVILLE WELL ASSOCIATION PWS	C	GW	Very Small	10/1/2006	02	1005
OH7500912	NORTHVIEW UTILITIES ASSOCIATION PWS	C	GW	Very Small	10/1/2006	02	1005
OH7501012	NORTHBROOK MHP	C	GW	Very Small	10/1/2006	02	1005
OH6745512	KOOL LAKES FAMILY CAMPGROUND-CLUBHOUSE	NC	GW	Very Small	7/1/2006	22	3100
OH7135512	SCHOOL HOUSE RESTAURANT PWS	NC	GW	Very Small	4/1/2006	22	3100
OH7136112	HIRNS CORNER PWS	NC	GW	Very Small	7/1/2006	21	3100
OH7136112	HIRNS CORNER PWS	NC	GW	Very Small	7/1/2006	22	3100
OH7136212	THE BRIDGE PWS	NC	GW	Very Small	1/1/2006	02	1040
OH7200311	FREMONT CITY PWS	C	SW	Large	5/1/2006	02	1040
OH7200311	FREMONT CITY PWS	C	SW	Large	6/1/2006	02	1040
OH6776312	SUFFIELD UNITED CHURCH OF CHRIST	NC	GW	Very Small	7/1/2006	22	3100
OH6776312	SUFFIELD UNITED CHURCH OF CHRIST	NC	GW	Very Small	4/1/2006	22	3100
OH6776412	SUFFIELD SPRINGS GOLF	NC	GW	Very Small	7/1/2006	22	3100
OH6778312	CIRCLE K 5363-RANDOLPH	NC	GW	Very Small	10/1/2006	22	3100
OH6778612	CAMP ASBURY- SHAW	NC	GW	Very Small	10/1/2006	22	3100
OH6778612	CAMP ASBURY- SHAW	NC	GW	Very Small	7/1/2006	22	3100
OH8437512	MARIETTA BIBLE CENTER CHURCH	NTNC	GW	Very Small	7/1/2006	22	3100
OH8446412	SMURFIT-STONE CORPORATION	NTNC	GW	Very Small	10/1/2006	22	3100
OH7770112	GRACE BIBLE CHURCH - AKRON	NC	GW	Very Small	10/1/2006	22	3100
OH8556312	VALLEY VIEW MENNONITE SCHOOL	NTNC	GW	Very Small	7/1/2006	21	3100
OH6502812	WAGON WHEEL MOBILE HOME	C	GW	Very Small	10/1/2006	02	1005
OH6531212	FROSTIES BAIT AND TACKLE PWS	NC	GW	Very Small	10/1/2006	22	3100
OH6531212	FROSTIES BAIT AND TACKLE PWS	NC	GW	Very Small	7/1/2006	22	3100
OH7036012	WALTON LAKE COMPANY 3 PWS	NC	GW	Very Small	10/1/2006	22	3100
OH7655712	KAUFMAN CENTER	NC	GW	Very Small	7/1/2006	22	3100
OH8636712	ORCHARD HILLS COUNTRY CLUB	NC	GW	Very Small	10/1/2006	22	3100
OH8637312	PULASKI UNITED METHODIST CHURCH PWS	NC	GW	Very Small	12/1/2006	22	3100
OH8637312	PULASKI UNITED METHODIST CHURCH PWS	NC	GW	Very Small	10/1/2006	22	3100
OH8561312	ADVANCED DRAINAGE SYSTEMS PWS	NTNC	GW	Very Small	10/1/2006	22	3100
OH8561312	ADVANCED DRAINAGE SYSTEMS PWS	NTNC	GW	Very Small	7/1/2006	22	3100

APPENDIX B
CY2006 MCL AND TT VIOLATIONS FOR OHIO

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant Type
OH8561412	CROWN HILL MANOR PWS	C	GW	Very Small	10/1/2006	02	1005
OH8561412	CROWN HILL MANOR PWS	C	GW	Very Small	7/1/2006	02	1005
OH8704312	FIVE POINT MHP WATER	C	GW	Very Small	7/1/2006	22	3100
OH8200003	HAMDEN VILLAGE PWS	C	GWP	Small	4/1/2006	02	2456
OH8100611	VAN WERT WATER TREATMENT PLANT	C	SW	Large	1/1/2006	44	0300
OH6254212	ISLAND CLUB PWS	NC	GU	Very Small	12/1/2006	41	0200
OH6254212	ISLAND CLUB PWS	NC	GU	Very Small	10/1/2006	41	0200
OH6254212	ISLAND CLUB PWS	NC	GU	Very Small	11/1/2006	41	0200
OH6900612	LEIPSIC VILLAGE WATER	C	GW	Small	11/1/2006	22	3100
OH6900612	LEIPSIC VILLAGE WATER	C	GW	Small	4/1/2006	02	2950
OH5432512	FORT RECOVERY INDUSTRIES	NTNC	GW	Very Small	7/1/2006	22	3100
OH7646512	MEADOWLAKE GOLF & SWIM	NC	GU	Very Small	12/1/2006	41	0200
OH7646512	MEADOWLAKE GOLF & SWIM	NC	GU	Very Small	11/1/2006	41	0200
OH7646512	MEADOWLAKE GOLF & SWIM	NC	GU	Very Small	10/1/2006	41	0200
OH7646512	MEADOWLAKE GOLF & SWIM	NC	GU	Very Small	9/1/2006	41	0200
OH7646512	MEADOWLAKE GOLF & SWIM	NC	GU	Very Small	8/1/2006	41	0200
OH7646512	MEADOWLAKE GOLF & SWIM	NC	GU	Very Small	8/1/2006	22	3100
OH7646512	MEADOWLAKE GOLF & SWIM	NC	GU	Very Small	7/1/2006	41	0200
OH7646512	MEADOWLAKE GOLF & SWIM	NC	GU	Very Small	5/1/2006	41	0200
OH7646512	MEADOWLAKE GOLF & SWIM	NC	GU	Very Small	6/1/2006	41	0200
OH7646512	MEADOWLAKE GOLF & SWIM	NC	GU	Very Small	4/1/2006	41	0200
OH7646512	MEADOWLAKE GOLF & SWIM	NC	GU	Very Small	6/1/2006	22	3100
OH7646512	MEADOWLAKE GOLF & SWIM	NC	GU	Very Small	1/1/2006	41	0200
OH7646512	MEADOWLAKE GOLF & SWIM	NC	GU	Very Small	2/1/2006	41	0200
OH7650112	CLEARWATER PARK, LTD. CAMP PWS	NC	GW	Very Small	7/1/2006	22	3100
OH7786112	PIONEER PLASTICS CORP.	NTNC	GW	Very Small	7/1/2006	21	3100
OH7786112	PIONEER PLASTICS CORP.	NTNC	GW	Very Small	7/1/2006	22	3100
OH7786612	MCAFFEE TOOL AND DIE, INC	NTNC	GW	Very Small	7/1/2006	22	3100
OH7709012	HIGHPOINT VILLA APTS.	C	GW	Very Small	9/1/2006	22	3100
OH8552312	ODOT / REST AREA 3-35	NC	GW	Very Small	7/1/2006	22	3100
OH7745712	BETHEL LUTHERAN CHURCH	NTNC	GW	Very Small	4/1/2006	22	3100

APPENDIX B
CY2006 MCL AND TT VIOLATIONS FOR OHIO

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant Type
OH6700212	BEECHWOOD ISLAND ESTATES	C	GW	Very Small	10/1/2006	02	1005
OH6700212	BEECHWOOD ISLAND ESTATES	C	GW	Very Small	7/1/2006	02	1005
OH6201003	GENOA VILLAGE PWS	C	SWP	Small	10/1/2006	02	2950
OH6201003	GENOA VILLAGE PWS	C	SWP	Small	7/1/2006	02	2950
OH6201003	GENOA VILLAGE PWS	C	SWP	Small	4/1/2006	02	2950
OH6201003	GENOA VILLAGE PWS	C	SWP	Small	6/1/2006	21	3100
OH7040812	CLEARFORK VALLEY WES CHURCH	NC	GW	Very Small	7/1/2006	22	3100
OH7941112	UNITED METHODIST CHURCH	NC	GW	Very Small	7/1/2006	22	3100
OH8747612	HIGH STAKES,INC. AMLC	NC	GW	Very Small	7/1/2006	21	3100
OH8747612	HIGH STAKES,INC. AMLC	NC	GW	Very Small	7/1/2006	22	3100
OH8748912	ST. PAULS EVANGENLIST LUTHERAN CHURCH PV	NTNC	GW	Very Small	4/1/2006	21	3100
OH8748912	ST. PAULS EVANGENLIST LUTHERAN CHURCH PV	NTNC	GW	Very Small	7/1/2006	22	3100
OH6759912	VAUGHNS MARKET 43 PWS	NC	GW	Very Small	1/1/2006	22	3100
OH6762012	RANDOLPH TOWN HALL	NC	GW	Very Small	7/1/2006	22	3100
OH6762912	SAVE 4 STORE	NC	GW	Very Small	7/1/2006	22	3100
OH6763112	SCOTT MOLDERS INCORPORATED	NTNC	GW	Very Small	7/1/2006	21	3100
OH7606922	CASTLEBAR APARTMENTS PWS	C	GW	Very Small	2/1/2006	21	3100
OH5740812	TIMBER LANES PWS	NC	GW	Very Small	10/1/2006	22	3100
OH5740912	HIGH SPIRITS	NC	GW	Very Small	10/1/2006	22	3100
OH7659512	NORTH WHIPPLE PLAZA	NTNC	GW	Very Small	7/1/2006	22	3100
OH6001711	NEW CONCORD VILLAGE PWS	C	SW	Small	12/1/2006	44	0100
OH5836612	MAHLE ENGINE COMPONENTS	NTNC	GW	Very Small	10/1/2006	22	3100
OH6249112	FOXS DEN CAMPGROUND PWS	NC	GU	Very Small	10/1/2006	41	0200
OH6249112	FOXS DEN CAMPGROUND PWS	NC	GU	Very Small	9/1/2006	41	0200
OH5260412	RED ONION PWS	NC	GW	Very Small	7/1/2006	22	3100
OH5400011	CELINA CITY PWS	C	SW	Large	10/1/2006	02	2950
OH5400011	CELINA CITY PWS	C	SW	Large	7/1/2006	02	2456
OH5400011	CELINA CITY PWS	C	SW	Large	7/1/2006	02	2950
OH5400011	CELINA CITY PWS	C	SW	Large	4/1/2006	02	2950
OH5400011	CELINA CITY PWS	C	SW	Large	4/1/2006	02	2456
OH5400011	CELINA CITY PWS	C	SW	Large	1/1/2006	02	2950

APPENDIX B
CY2006 MCL AND TT VIOLATIONS FOR OHIO

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant Type
OH5400011	CELINA CITY PWS	C	SW	Large	1/1/2006	02	2456
OH5400212	FORT RECOVERY VILLAGE PWS	C	GW	Small	4/1/2006	22	3100
OH5401112	ROCKFORD VILLAGE PWS	C	GW	Small	2/1/2006	21	3100
OH5401612	WOODHAVEN MHP PWS	NC	GW	Very Small	11/1/2006	22	3100
OH5401612	WOODHAVEN MHP PWS	NC	GW	Very Small	10/1/2006	22	3100
OH5402112	BAYVIEW WATER ASSOCIATION	NC	GW	Very Small	7/1/2006	22	3100
OH6705812	KELLIMAR COURT APARTMENT	C	GW	Very Small	10/1/2006	02	2456
OH6705812	KELLIMAR COURT APARTMENT	C	GW	Very Small	10/1/2006	02	2950
OH6705812	KELLIMAR COURT APARTMENT	C	GW	Very Small	7/1/2006	02	2456
OH6705812	KELLIMAR COURT APARTMENT	C	GW	Very Small	7/1/2006	02	2950
OH6705812	KELLIMAR COURT APARTMENT	C	GW	Very Small	4/1/2006	02	2950
OH6705812	KELLIMAR COURT APARTMENT	C	GW	Very Small	4/1/2006	02	2456
OH6705812	KELLIMAR COURT APARTMENT	C	GW	Very Small	1/1/2006	02	2456
OH6705812	KELLIMAR COURT APARTMENT	C	GW	Very Small	1/1/2006	02	2950
OH7532212	HARDIN ELEMENTARY SCHOOL	NTNC	GW	Very Small	10/1/2006	02	1005
OH7532212	HARDIN ELEMENTARY SCHOOL	NTNC	GW	Very Small	7/1/2006	22	3100
OH7532312	KEYHOLE TAVERN	NC	GW	Very Small	7/1/2006	21	3100
OH5551412	MIAMI VALLEY CHRISTIAN CENTER	NTNC	GW	Very Small	7/1/2006	21	3100
OH5552512	CHRISTIAN FAMILY FELLOWSHIP PWS	NC	GW	Very Small	10/1/2006	21	3100
OH5552512	CHRISTIAN FAMILY FELLOWSHIP PWS	NC	GW	Very Small	10/1/2006	22	3100
OH5552512	CHRISTIAN FAMILY FELLOWSHIP PWS	NC	GW	Very Small	7/1/2006	22	3100
OH7235112	HIDDEN HILLS GOLF CLUB, INC.	NC	GW	Very Small	1/1/2006	21	3100
OH8631912	PULASKI HEAD START PWS	NTNC	GW	Very Small	10/1/2006	22	3100
OH7707512	COUNTRY VIEW SOUTH APTS.	C	GW	Very Small	7/1/2006	22	3100
OH7707512	COUNTRY VIEW SOUTH APTS.	C	GW	Very Small	6/1/2006	22	3100
OH7707512	COUNTRY VIEW SOUTH APTS.	C	GW	Very Small	6/1/2006	21	3100
OH7745012	AKRON READING & SPEECH	NC	GW	Very Small	7/1/2006	22	3100
OH8502312	MOUNT EATON VILLAGE PWS	C	GW	Very Small	8/1/2006	22	3100
OH6944612	AMERICAN LEGION POST 715	NC	GW	Very Small	7/1/2006	21	3100
OH5256212	CLEVELAND METROPARKS/WHIPPS LEDGES PWS	NC	GW	Very Small	10/1/2006	22	3100
OH7400011	ATTICA, VILLAGE OF	C	SW	Small	4/1/2006	02	2950

APPENDIX B
CY2006 MCL AND TT VIOLATIONS FOR OHIO

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant Type
OH7430212	AMERICAN LEGION POST 354	NC	GW	Very Small	7/1/2006	22	3100
OH7791512	RING AROUND THE ROSIE DAY CARE	NTNC	GW	Very Small	7/1/2006	22	3100
OH5749512	UPPER DECK TAVERN PWS	NC	GW	Very Small	4/1/2006	22	3100
OH5749512	UPPER DECK TAVERN PWS	NC	GW	Very Small	4/1/2006	21	3100
OH5749512	UPPER DECK TAVERN PWS	NC	GW	Very Small	7/1/2006	22	3100
OH5749512	UPPER DECK TAVERN PWS	NC	GW	Very Small	7/1/2006	21	3100
OH5831212	OHIO POWER/HOOK LAKE-A1	NC	GW	Very Small	10/1/2006	22	3100
OH6540412	THE LANDINGS AT RICKENBACKER	NC	GW	Very Small	10/1/2006	22	3100
OH6540412	THE LANDINGS AT RICKENBACKER	NC	GW	Very Small	10/1/2006	21	3100
OH6540812	BUBBAS CORNER PWS	NC	GW	Very Small	7/1/2006	22	3100
OH6434712	MOOSE LODGE 2434 PWS	NC	GW	Very Small	10/1/2006	22	3100
OH4549412	CAMP OBANNON	NC	GW	Very Small	7/1/2006	21	3100
OH4549622	4-H CAMP OHIO-POOL	NC	GW	Very Small	11/1/2006	22	3100
OH4554112	ODOT DISTRICT 5 OFFICE & GARAGE PWS	NTNC	GW	Very Small	7/1/2006	22	3100
OH4555112	MPW INDUSTRIAL SERVICES	NTNC	GW	Very Small	10/1/2006	22	3100
OH4555112	MPW INDUSTRIAL SERVICES	NTNC	GW	Very Small	7/1/2006	22	3100
OH4557212	BUCKEYE LAKE HEAD START	NTNC	GW	Very Small	10/1/2006	02	2456
OH4557212	BUCKEYE LAKE HEAD START	NTNC	GW	Very Small	10/1/2006	02	2950
OH4557312	CITGO BUCKEYE LAKE PWS	NC	GW	Small	7/1/2006	21	3100
OH4557712	ODNR-BUCKEYE LAKE NORTH	NC	GW	Very Small	4/1/2006	21	3100
OH4559412	TRICOUNTY CHURCH NAZARENE	NC	GW	Very Small	10/1/2006	22	3100
OH4559612	THE LINKS AT ECHO SPRING PWS	NC	GW	Very Small	7/1/2006	21	3100
OH4559612	THE LINKS AT ECHO SPRING PWS	NC	GW	Very Small	4/1/2006	22	3100
OH4559612	THE LINKS AT ECHO SPRING PWS	NC	GW	Very Small	4/1/2006	21	3100
OH4559912	BUCKEYE LAKE DUKE STATION PWS	NC	GW	Very Small	4/1/2006	21	3100
OH4559912	BUCKEYE LAKE DUKE STATION PWS	NC	GW	Very Small	7/1/2006	22	3100
OH7748212	REGINA HEALTH CENTER	C	GW	Very Small	8/1/2006	21	3100
OH7749312	BP OIL STATION 22490 PWS	NC	GW	Very Small	7/1/2006	22	3100
OH8033712	RAYMOND UNITED METHODIST	NC	GW	Very Small	11/1/2006	22	3100
OH8033712	RAYMOND UNITED METHODIST	NC	GW	Very Small	7/1/2006	22	3100
OH7787612	SAWMILL BUILDINGS	NTNC	GW	Very Small	10/1/2006	02	1005

APPENDIX B
CY2006 MCL AND TT VIOLATIONS FOR OHIO

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant Type
OH7787612	SAWMILL BUILDINGS	NTNC	GW	Very Small	7/1/2006	22	3100
OH7787612	SAWMILL BUILDINGS	NTNC	GW	Very Small	4/1/2006	22	3100
OH8532612	HOPE COMMUNITY CHURCH PWS	NC	GW	Very Small	7/1/2006	22	3100
OH8532912	CAMP LUZ, KITCHEN WELL	NC	GW	Very Small	1/1/2006	22	3100
OH8555212	WOOSTER CONGREGATION OF JEHOVAH WITNE	NC	GW	Very Small	4/1/2006	21	3100
OH7700411	BARBERTON CITY	C	SW	Large	4/1/2006	02	2456
OH7700411	BARBERTON CITY	C	SW	Large	1/1/2006	02	2456
OH7602012	FORTY CORNERS MOBILE VILLAGE	C	GW	Very Small	7/1/2006	22	3100
OH7602412	HILLVIEW MOBILE COURT	C	GW	Very Small	10/1/2006	02	1005
OH7602412	HILLVIEW MOBILE COURT	C	GW	Very Small	4/1/2006	02	1005
OH7602412	HILLVIEW MOBILE COURT	C	GW	Very Small	7/1/2006	02	1005
OH7602412	HILLVIEW MOBILE COURT	C	GW	Very Small	1/1/2006	02	1005
OH5734812	OLD TROY PIKE COMMUNITY CHURCH	NC	GW	Very Small	12/1/2006	22	3100
OH5734812	OLD TROY PIKE COMMUNITY CHURCH	NC	GW	Very Small	10/1/2006	22	3100
OH6400812	ROBERTS TRAILER PARK	C	GW	Very Small	10/1/2006	02	1005
OH6400812	ROBERTS TRAILER PARK	C	GW	Very Small	7/1/2006	02	1005
OH8131312	COUNTRYSIDE CHAPEL U.M.	NC	GW	Very Small	7/1/2006	21	3100
OH8133012	HUGGY BEAR CAMPGROUND	NC	GW	Very Small	4/1/2006	21	3100
OH8133012	HUGGY BEAR CAMPGROUND	NC	GW	Very Small	7/1/2006	22	3100
OH8133012	HUGGY BEAR CAMPGROUND	NC	GW	Very Small	6/1/2006	22	3100
OH8750812	FAITH UNITED METHODIST CHURCH - LUCKEY	NC	GW	Very Small	7/1/2006	22	3100
OH8751012	THOMAS LOEW	NC	GW	Very Small	10/1/2006	22	3100
OH8751212	ZION UNITED METHODIST CHURCH	NC	GW	Very Small	1/1/2006	22	3100
OH7804612	LIBERTY SQUARE APARTMENTS	C	GW	Very Small	7/1/2006	22	3100
OH7806112	TRUMBULL CO.-WARREN TWP PWS	C	GWP	Very Small	4/1/2006	02	2456
OH4946012	MADISON COUNTY ENGINEERS OFFICE PWS	NTNC	GW	Very Small	11/1/2006	22	3100
OH4946012	MADISON COUNTY ENGINEERS OFFICE PWS	NTNC	GW	Very Small	10/1/2006	22	3100
OH5001911	SEBRING VILLAGE PWS	C	SW	Medium	10/1/2006	02	2950
OH5033712	DEPOT LOUNGE	NC	GU	Very Small	12/1/2006	41	0200
OH5033712	DEPOT LOUNGE	NC	GU	Very Small	11/1/2006	41	0200
OH5033712	DEPOT LOUNGE	NC	GU	Very Small	10/1/2006	41	0200

APPENDIX B
CY2006 MCL AND TT VIOLATIONS FOR OHIO

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant Type
OH5033712	DEPOT LOUNGE	NC	GU	Very Small	8/1/2006	41	0200
OH5033712	DEPOT LOUNGE	NC	GU	Very Small	9/1/2006	41	0200
OH5033712	DEPOT LOUNGE	NC	GU	Very Small	7/1/2006	41	0200
OH5033712	DEPOT LOUNGE	NC	GU	Very Small	5/1/2006	41	0200
OH5033712	DEPOT LOUNGE	NC	GU	Very Small	6/1/2006	41	0200
OH5033712	DEPOT LOUNGE	NC	GU	Very Small	4/1/2006	41	0200
OH5033712	DEPOT LOUNGE	NC	GU	Very Small	2/1/2006	41	0200
OH5033712	DEPOT LOUNGE	NC	GU	Very Small	3/1/2006	41	0200
OH5033712	DEPOT LOUNGE	NC	GU	Very Small	1/1/2006	41	0200
OH5034212	ELLSWORTH ELEMENTARY SCHOOL	NTNC	GW	Very Small	10/1/2006	22	3100
OH5034212	ELLSWORTH ELEMENTARY SCHOOL	NTNC	GW	Very Small	7/1/2006	22	3100
OH5034212	ELLSWORTH ELEMENTARY SCHOOL	NTNC	GW	Very Small	4/1/2006	22	3100
OH5036612	N.E. OH CHURCH OF GOD CAMP	NC	GW	Very Small	10/1/2006	22	3100
OH4646612	CLASSIC SWING DRIVING RANGE PWS	NC	GW	Very Small	4/1/2006	21	3100
OH4647012	ODNR INDIAN LAKE ST PK MOUNDWOOD RESTRO	NC	GW	Very Small	4/1/2006	22	3100
OH4647212	CONDO CAMPING PUBLIC WATER SYSTEM	NC	GW	Very Small	4/1/2006	22	3100
OH4647412	TREE LINKS GC-CLUBHOUSE PWS	NC	GW	Very Small	7/1/2006	22	3100
OH7044712	SKYWAY EAST	NC	GW	Very Small	7/1/2006	21	3100
OH6767112	ODNR-NELSON LEDGES STATE PARK	NC	GW	Very Small	7/1/2006	22	3100
OH6767112	ODNR-NELSON LEDGES STATE PARK	NC	GW	Very Small	4/1/2006	22	3100
OH7670312	LAKE OPINES PWS	NC	GW	Very Small	10/1/2006	22	3100
OH6747112	DUSTY ARMADILLO	NC	GW	Very Small	10/1/2006	22	3100
OH8361212	LITTLE MIAMI CANOE RENTAL PWS	NC	GW	Very Small	7/1/2006	22	3100
OH7841412	RIDGE RANCH CAMP-A LINE	NC	GW	Very Small	7/1/2006	21	3100
OH7841412	RIDGE RANCH CAMP-A LINE	NC	GW	Very Small	7/1/2006	22	3100
OH4560712	THE HERB-N-EWE	NC	GW	Very Small	7/1/2006	21	3100
OH4560812	THE CHURCH OF GOD AT NEWARK, OHIO PWS	NC	GW	Very Small	7/1/2006	22	3100
OH4560812	THE CHURCH OF GOD AT NEWARK, OHIO PWS	NC	GW	Very Small	7/1/2006	21	3100
OH4561112	NEWARK VINEYARD PWS	NC	GW	Very Small	7/1/2006	22	3100
OH4561112	NEWARK VINEYARD PWS	NC	GW	Very Small	4/1/2006	21	3100
OH4562012	LICKING VALLEY HIGH SCHOOL PWS	NTNC	GW	Small	10/1/2006	02	1005

APPENDIX B
CY2006 MCL AND TT VIOLATIONS FOR OHIO

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant Type
OH4562012	LICKING VALLEY HIGH SCHOOL PWS	NTNC	GW	Small	7/1/2006	02	1005
OH4564912	NEW HOPE BIBLE CHURCH PWS	NC	GW	Very Small	10/1/2006	22	3100
OH4600412	CRANBERRY CONDOMINIUMS	NC	GW	Very Small	10/1/2006	22	3100
OH4600412	CRANBERRY CONDOMINIUMS	NC	GW	Very Small	7/1/2006	22	3100
OH4943512	M.H. EBY, INC. PWS	NTNC	GW	Very Small	10/1/2006	02	1005
OH4943512	M.H. EBY, INC. PWS	NTNC	GW	Very Small	7/1/2006	02	1005
OH4943612	NATIONAL ROAD GOLF, INC.	NC	GW	Very Small	10/1/2006	22	3100
OH4943812	J.D. EQUIPMENT, INC.	NTNC	GW	Very Small	10/1/2006	02	1005
OH4943812	J.D. EQUIPMENT, INC.	NTNC	GW	Very Small	7/1/2006	02	1005
OH4943812	J.D. EQUIPMENT, INC.	NTNC	GW	Very Small	7/1/2006	22	3100
OH4943912	TRI-GREEN INTERSTATE EQ.	NC	GW	Very Small	7/1/2006	22	3100
OH5257912	MEDINA COUNTY PARKS/RIVER STYX	NC	GW	Very Small	7/1/2006	21	3100
OH5257912	MEDINA COUNTY PARKS/RIVER STYX	NC	GW	Very Small	7/1/2006	22	3100
OH5258512	MAPLE HILL MENNONITE CHURCH	NC	GW	Very Small	7/1/2006	21	3100
OH5258512	MAPLE HILL MENNONITE CHURCH	NC	GW	Very Small	7/1/2006	22	3100
OH5258512	MAPLE HILL MENNONITE CHURCH	NC	GW	Very Small	4/1/2006	22	3100
OH5259812	APOSTOLIC CHRISTIAN CHURCH-WADSWORTH P	NC	GW	Very Small	7/1/2006	22	3100
OH5260112	SKYVIEW LODGE PWS	NC	GW	Very Small	7/1/2006	21	3100
OH5260112	SKYVIEW LODGE PWS	NC	GW	Very Small	7/1/2006	22	3100
OH5260112	SKYVIEW LODGE PWS	NC	GW	Very Small	4/1/2006	22	3100
OH7255212	FIRELANDS COUNSELING & RECOVERY	NC	GW	Very Small	7/1/2006	21	3100
OH7255612	CRYSTAL ARBOR BANQUET HALL PWS	NC	GW	Very Small	1/1/2006	22	3100
OH7673212	REGAL METAL PRODUCTS CO PWS	NTNC	GW	Very Small	7/1/2006	21	3100
OH7673212	REGAL METAL PRODUCTS CO PWS	NTNC	GW	Very Small	7/1/2006	22	3100
OH7673212	REGAL METAL PRODUCTS CO PWS	NTNC	GW	Very Small	1/1/2006	21	3100
OH7673212	REGAL METAL PRODUCTS CO PWS	NTNC	GW	Very Small	1/1/2006	22	3100
OH7674012	ARMY NAVY GARRISON 2003 PWS	NC	GW	Very Small	10/1/2006	22	3100
OH7431312	NW OHIO CHRISTIAN YOUTH	NC	GW	Very Small	7/1/2006	21	3100
OH8134812	ST THOMAS LUTHERAN CHURCH	NC	GW	Very Small	11/1/2006	22	3100
OH8134812	ST THOMAS LUTHERAN CHURCH	NC	GW	Very Small	10/1/2006	22	3100
OH8134812	ST THOMAS LUTHERAN CHURCH	NC	GW	Very Small	7/1/2006	22	3100

APPENDIX B
CY2006 MCL AND TT VIOLATIONS FOR OHIO

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant Type
OH8134812	ST THOMAS LUTHERAN CHURCH	NC	GW	Very Small	7/1/2006	21	3100
OH8134912	SALEM PRESBYTERIAN CHURCH	NC	GW	Very Small	7/1/2006	22	3100
OH8550412	WAYNE PRESBYTERIAN CHURCH	NC	GW	Very Small	7/1/2006	22	3100
OH7836312	PAGES "NEW AGES" DINER	NC	GW	Very Small	7/1/2006	22	3100
OH7837112	DEER CREEK GOLF COURSE	NC	GW	Very Small	7/1/2006	22	3100
OH7839512	MAPLEWOOD HIGH SCHOOL	NTNC	GW	Very Small	4/1/2006	22	3100
OH7792612	DOUBLE PLAY INC	NC	GW	Very Small	7/1/2006	22	3100
OH7792612	DOUBLE PLAY INC	NC	GW	Very Small	4/1/2006	22	3100
OH8536312	GRACE BAPTIST CHURCH - ORRVILLE	NC	GW	Very Small	7/1/2006	22	3100
OH8536512	EMANUEL OLD STONE CHURCH - WOOSTER	NC	GW	Very Small	7/1/2006	22	3100
OH6775012	TOWNERS WOODS PWS	NC	GW	Very Small	4/1/2006	22	3100
OH6775012	TOWNERS WOODS PWS	NC	GW	Very Small	4/1/2006	21	3100
OH5747612	DOMINION MINISTRIES INTERNATIONAL	NC	GW	Very Small	7/1/2006	22	3100
OH5747612	DOMINION MINISTRIES INTERNATIONAL	NC	GW	Very Small	7/1/2006	21	3100
OH5747612	DOMINION MINISTRIES INTERNATIONAL	NC	GW	Very Small	4/1/2006	21	3100
OH5747612	DOMINION MINISTRIES INTERNATIONAL	NC	GW	Very Small	1/1/2006	21	3100
OH5747712	GERMANTOWN METRO PARK	NC	GW	Very Small	7/1/2006	22	3100
OH5747712	GERMANTOWN METRO PARK	NC	GW	Very Small	7/1/2006	21	3100
OH5748212	OLIVET UNITED BRETHREN	NC	GW	Very Small	10/1/2006	22	3100
OH5748312	ABUNDANT LIFE TABERNACLE PWS	NTNC	GWP	Very Small	10/1/2006	22	3100
OH5748312	ABUNDANT LIFE TABERNACLE PWS	NTNC	GWP	Very Small	4/1/2006	21	3100
OH5500712	LE-O-NA FALLS MHP	C	GW	Very Small	8/1/2006	21	3100
OH5500712	LE-O-NA FALLS MHP	C	GW	Very Small	7/1/2006	21	3100
OH5500712	LE-O-NA FALLS MHP	C	GW	Very Small	6/1/2006	22	3100
OH5500712	LE-O-NA FALLS MHP	C	GW	Very Small	7/1/2006	22	3100
OH5500712	LE-O-NA FALLS MHP	C	GW	Very Small	6/1/2006	21	3100
OH7004511	SHELBY WATER TREATMENT PLANT	C	SW	Medium	10/1/2006	02	2950
OH7004511	SHELBY WATER TREATMENT PLANT	C	SW	Medium	7/1/2006	02	2950
OH7004511	SHELBY WATER TREATMENT PLANT	C	SW	Medium	4/1/2006	02	2950
OH7004511	SHELBY WATER TREATMENT PLANT	C	SW	Medium	1/1/2006	02	2950
OH4648412	BROTHERS BAR AND GRILL PWS	NC	GW	Very Small	10/1/2006	22	3100

APPENDIX B
CY2006 MCL AND TT VIOLATIONS FOR OHIO

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant Type
OH4900212	CHOCTAW UTILITIES, INC.	C	GW	Small	9/1/2006	22	3100
OH4900212	CHOCTAW UTILITIES, INC.	C	GW	Small	7/1/2006	22	3100
OH4900512	GREENTREE MOBILE HOME PARK	C	GW	Very Small	10/1/2006	02	1005
OH4900512	GREENTREE MOBILE HOME PARK	C	GW	Very Small	6/1/2006	21	3100
OH8030012	B&E PIZZA PWS	NC	GW	Small	11/1/2006	22	3100
OH8030012	B&E PIZZA PWS	NC	GW	Small	7/1/2006	21	3100
OH8030012	B&E PIZZA PWS	NC	GW	Small	7/1/2006	22	3100
OH8031312	OLD STONE HAUS TAVERN PWS	NC	GW	Very Small	7/1/2006	21	3100
OH7835212	BLOOMFIELD HIGH SCHOOL	NTNC	GW	Very Small	10/1/2006	02	1005
OH7835212	BLOOMFIELD HIGH SCHOOL	NTNC	GW	Very Small	7/1/2006	02	1005
OH7854612	SLN TEMPLE PWS	NC	GW	Very Small	10/1/2006	22	3100
OH8535012	SHORTYS MARKET	NC	GW	Very Small	4/1/2006	22	3100
OH8633812	BETHLEHEM CHRISTIAN UNION CHURCH	NC	GW	Very Small	7/1/2006	21	3100
OH7447312	FIRST CHRISTIAN CHURCH	NC	GW	Very Small	7/1/2006	21	3100
OH7532512	HOUSTON HIGH SCHOOL	NTNC	GW	Very Small	10/1/2006	02	1005
OH7532512	HOUSTON HIGH SCHOOL	NTNC	GW	Very Small	7/1/2006	02	1005
OH7534512	SAV-A-TON 081	NC	GW	Small	10/1/2006	22	3100
OH7534512	SAV-A-TON 081	NC	GW	Small	7/1/2006	22	3100
OH7534512	SAV-A-TON 081	NC	GW	Small	7/1/2006	21	3100
OH7534512	SAV-A-TON 081	NC	GW	Small	4/1/2006	21	3100
OH7538712	G & G MACHINETECHNOLOGY	NTNC	GW	Very Small	7/1/2006	22	3100
OH6257412	GRACE BAPTIST CHURCH	NC	GW	Very Small	7/1/2006	21	3100
OH4902112	ROSEDALE BIBLE INSTITUTE	C	GW	Very Small	5/1/2006	22	3100
OH4930212	BATTELLE-WEST JEFFERSON	NTNC	GW	Very Small	11/1/2006	22	3100
OH4930212	BATTELLE-WEST JEFFERSON	NTNC	GW	Very Small	7/1/2006	22	3100
OH4930912	CANAAN MIDDLE SCHOOL	NTNC	GW	Very Small	10/1/2006	02	1005
OH4931912	FUELCO INC.	NC	GW	Very Small	1/1/2006	21	3100
OH4932812	JONATHAN ALDER JUNIOR HIGH SCHOOL	NTNC	GW	Very Small	10/1/2006	02	1005
OH4942612	HOLIDAY INN EXPRESS	NC	GW	Very Small	11/1/2006	22	3100
OH5202112	GRANGER LAKE CONDO 1 PWS	C	GW	Very Small	10/1/2006	02	1005
OH5202112	GRANGER LAKE CONDO 1 PWS	C	GW	Very Small	7/1/2006	02	1005

APPENDIX B
CY2006 MCL AND TT VIOLATIONS FOR OHIO

PWS ID	System Name	System Type	Source Type	Population	Violation Begin Date	Violation Type	Contaminant Type
OH6300411	PAULDING WATER TREATMENT PLANT	C	SW	Medium	1/1/2006	02	2950
OH6330612	THE DEPOT	NC	GW	Very Small	10/1/2006	22	3100
OH6330612	THE DEPOT	NC	GW	Very Small	7/1/2006	21	3100
OH6332812	R AND B FABRICATIONS INC PWS	NTNC	GW	Very Small	7/1/2006	22	3100
OH6332812	R AND B FABRICATIONS INC PWS	NTNC	GW	Very Small	4/1/2006	22	3100
OH6400111	CROOKSVILLE, VILLAGE OF	C	SW	Small	10/1/2006	02	2950
OH6400411	NEW LEXINGTON CITY PWS	C	SW	Medium	10/1/2006	02	2950
OH6400411	NEW LEXINGTON CITY PWS	C	SW	Medium	7/1/2006	02	2950
OH6901603	PUTNAM COUNTY-NORTH OTTAWA	C	SWP	Very Small	10/1/2006	02	2950
OH6901603	PUTNAM COUNTY-NORTH OTTAWA	C	SWP	Very Small	7/1/2006	02	2950
OH6936612	PIKE RUN GOLF CLUB INC	NC	GW	Very Small	7/1/2006	21	3100
OH6936612	PIKE RUN GOLF CLUB INC	NC	GW	Very Small	7/1/2006	22	3100
OH8500012	APOSTOLIC CHRISTIAN HOME	C	GW	Very Small	10/1/2006	02	1005
OH7799112	CLARKE FORD-SHOW ROOM	NTNC	GW	Very Small	7/1/2006	22	3100
OH7799112	CLARKE FORD-SHOW ROOM	NTNC	GW	Very Small	7/1/2006	21	3100
OH7850012	JAKS FINE FOODS	NC	GW	Very Small	7/1/2006	22	3100
OH8738612	INLAND PROPERTY MGMT	NC	GW	Very Small	7/1/2006	22	3100
OH6541112	CIRCLEVILLE CARRIER ANNEX-USPS	NTNC	GW	Very Small	7/1/2006	22	3100
OH6541112	CIRCLEVILLE CARRIER ANNEX-USPS	NTNC	GW	Very Small	7/1/2006	21	3100
OH8502812	PEACH GROVE MOBILE HOME PARK	C	GW	Very Small	8/1/2006	21	3100
OH7782112	METROPARKS CASCADE VALLEY PWS	NC	GW	Very Small	4/1/2006	22	3100
OH8345812	LITTLE RIVER CAFE	NC	GWP	Very Small	7/1/2006	21	3100