

2008 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH5900112 PWS NAME: CARDINGTON VILLAGE PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001

STU ID: 5956758 STU NAME: CARDINGTON VILLAGE

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE (AS N) - 1040	1 Sample(s) between 6/1/2008 and 10/31/2008
NITRITE	NITRITE (AS N) - 1041	Not Required
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	1 Sample(s) between 6/1/2008 and 10/31/2008

REMINDER: Consumer Confidence Report (CCR) is due July 1, 2008

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
<i>NITRATE Sample Date(s):</i>
<i>SOC Group 1 Sample Date(s):</i>
<i>Date CCR sent to Ohio EPA:</i>

2008 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH5900112 PWS NAME: CARDINGTON VILLAGE PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: CARDINGTON, VILLAGE OF DISTRIBUTION

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
ASBESTOS - 1094	Not Required
LEAD - 1030 & COPPER - 1022	Not Required
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** 1 Sample(s) between 7/1/2008 and 9/30/2008
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Monthly between 1/1/2008 and 12/31/2008
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

Asbestos Sampling Information

Collect one sample at a tap served by asbestos-cement pipe. The sample monitoring point (smp) code is DS000. Due to limited Laboratory capacity and a 48 hour filtering requirement, contact your lab early in the monitoring period to schedule a sampling date.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Central District Office - DDAGW representative immediately at 614-728-3778.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
<i>HAA5 & TTHM Sample Date(s):</i>												
<i>TCR Monthly Sample Date(s):</i>	<i>Jan</i>	<i>Feb</i>	<i>Mar</i>	<i>Apr</i>	<i>May</i>	<i>Jun</i>	<i>Jul</i>	<i>Aug</i>	<i>Sept</i>	<i>Oct</i>	<i>Nov</i>	<i>Dec</i>
<i>Total Chlorine Sample Date(s):</i>												

2008 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH5900412 PWS NAME: HICKORY GROVE MOBILE HOME COMMUNITY
PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001
STU ID: 5956761 STU NAME: HICKORY GROVE MOBILE HOME COMMUNITY
Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE (AS N) - 1040	1 Sample(s) between 6/1/2008 and 10/31/2008
NITRITE	NITRITE (AS N) - 1041	Not Required
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	1 Sample(s) between 6/1/2008 and 10/31/2008

REMINDER: Consumer Confidence Report (CCR) is due July 1, 2008

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
<i>NITRATE Sample Date(s):</i>
<i>SOC Group 1 Sample Date(s):</i>
<i>Date CCR sent to Ohio EPA:</i>

2008 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH5900512 PWS NAME: LAKEVIEW ESTATES MOBILE HOME PARK
PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001
STU ID: 5956762 STU NAME: LAKEVIEW ESTATES MHP
Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE (AS N) - 1040	1 Sample(s) between 6/1/2008 and 10/31/2008
NITRITE	NITRITE (AS N) - 1041	Not Required
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	1 Sample(s) between 6/1/2008 and 10/31/2008
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 2 List Below	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 4 List Below	1 Sample(s) between 4/1/2008 and 6/30/2008

REMINDER: Consumer Confidence Report (CCR) is due July 1, 2008

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

SOC Group 2 Chemicals: CARBOFURAN - 2046, OXAMYL (VYDATE) - 2036, PICLORAM - 2040, 2,4-D - 2105, PENTACHLOROPHENOL - 2326

SOC Group 4 Chemicals: BENZO (A) PYRENE - 2306, ENDOTHALL - 2033, DI(2-ETHYLHEXYL) - ADIPATE - 2035, DI(2-ETHYLHEXYL) - PHTHALATE - 2034

Use for Sample Tracking Purposes
<i>NITRATE Sample Date(s):</i>
<i>SOC Group 1 Sample Date(s):</i>
<i>SOC Group 4 Sample Date(s):</i>
<i>Date CCR sent to Ohio EPA:</i>

2008 CHEMICAL MONITORING ENTRY POINT SCHEDULE
PWS ID: OH5900712 PWS NAME: MT GILEAD VILLAGE PWS
PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001
STU ID: 5956763 STU NAME: MT GILEAD WTP
Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
ARSENIC	ARSENIC - 1005	1 Sample(s) Quarterly
NITRATE	NITRATE (AS N) - 1040	1 Sample(s) between 6/1/2008 and 10/31/2008
NITRITE	NITRITE (AS N) - 1041	Not Required
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	1 Sample(s) between 6/1/2008 and 10/31/2008

REMINDER: Consumer Confidence Report (CCR) is due July 1, 2008

INORGANIC Chemicals: ANTIMONY - 1074, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes				
	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)
<i>ARSENIC Quarterly Sample Date(s):</i>				
<i>NITRATE Sample Date(s):</i>				
<i>SOC Group 1 Sample Date(s):</i>				
<i>Date CCR sent to Ohio EPA:</i>				

2008 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH5900712 PWS NAME: MT GILEAD VILLAGE PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: MOUNT GILEAD, VILLAGE OF DISTRIBUTION

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
ASBESTOS - 1094	Not Required
LEAD - 1030 & COPPER - 1022	Not Required
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** 1 Sample(s) Quarterly
TOTAL COLIFORM (TCR) - 3100	3 Sample(s) Monthly between 1/1/2008 and 12/31/2008
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

**** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)**

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

Asbestos Sampling Information

Collect one sample at a tap served by asbestos-cement pipe. The sample monitoring point (smp) code is DS000. Due to limited Laboratory capacity and a 48 hour filtering requirement, contact your lab early in the monitoring period to schedule a sampling date.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Central District Office - DDAGW representative immediately at 614-728-3778.

***** TOTAL CHLORINE Sampling Information**

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
	Jan - Mar Sample Date(s)			Apr - Jun Sample Date(s)			Jul - Sept Sample Date(s)			Oct - Dec Sample Date(s)		
HAA5 & TTHM Quarterly Sample Date(s):												
TCR Monthly Sample Date(s):	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sept	Oct	Nov	Dec
Total Chlorine Sample Date(s):												

2008 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH5901012 PWS NAME: CANDLEWOOD LAKE ASSOCIATION INC

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001

STU ID: 5956765 STU NAME: CANDLEWOOD LAKE ASSN INC

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE (AS N) - 1040	1 Sample(s) between 6/1/2008 and 10/31/2008
NITRITE	NITRITE (AS N) - 1041	Not Required
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	1 Sample(s) between 6/1/2008 and 10/31/2008

REMINDER: Consumer Confidence Report (CCR) is due July 1, 2008

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
<i>NITRATE Sample Date(s):</i>
<i>SOC Group 1 Sample Date(s):</i>
<i>Date CCR sent to Ohio EPA:</i>

2008 CONTAMINANT MONITORING SCHEDULE


PWS ID: OH5931712 PWS NAME: CLEARFORK MARINA
PWS TYPE: Transient Noncommunity SOURCE: Ground Water
STU ID: 5956768 STU NAME: CLEARFORK MARINA
Effective Date: 1/1/08

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 6/1/2008 and 10/31/2008	<i>Sample should be taken at EP001</i>
NITRITE - 1041	Not Required	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 4/1/2008 and 11/30/2008	<i>Sample should be taken at DS000</i>

Where to Collect Samples For a Small Public Water System

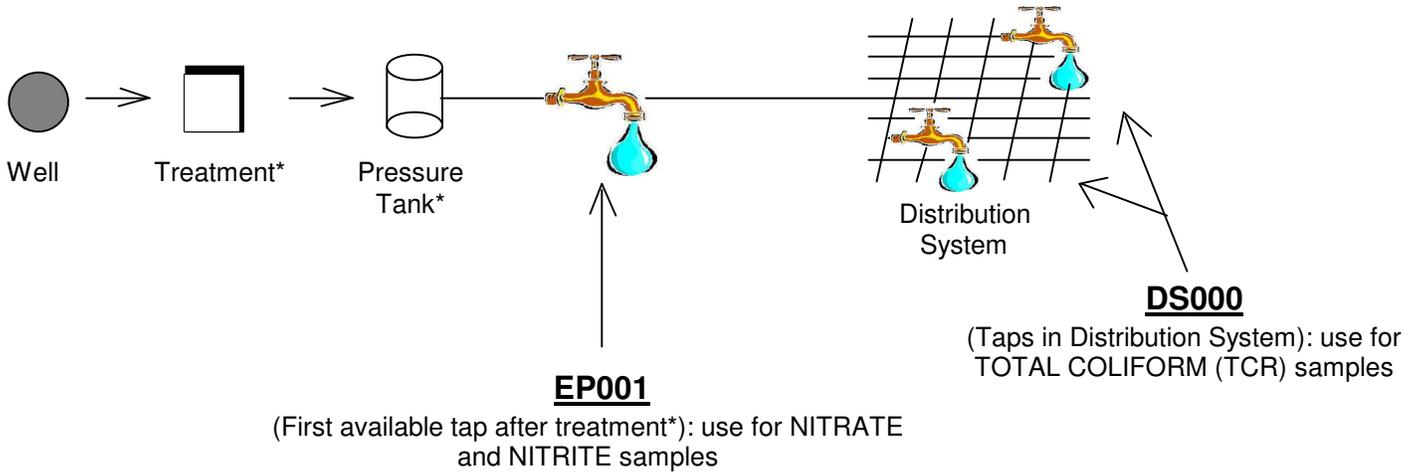

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2008 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH5931812 PWS NAME: CLEARFORK CAMPGROUND

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

STU ID: 5956769 STU NAME: CLEARFORK CAMPGROUND


Effective Date: 1/1/08

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 6/1/2008 and 10/31/2008	<i>Sample should be taken at EP001</i>
NITRITE - 1041	Not Required	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 4/1/2008 and 11/30/2008	<i>Sample should be taken at DS000</i>

Where to Collect Samples For a Small Public Water System

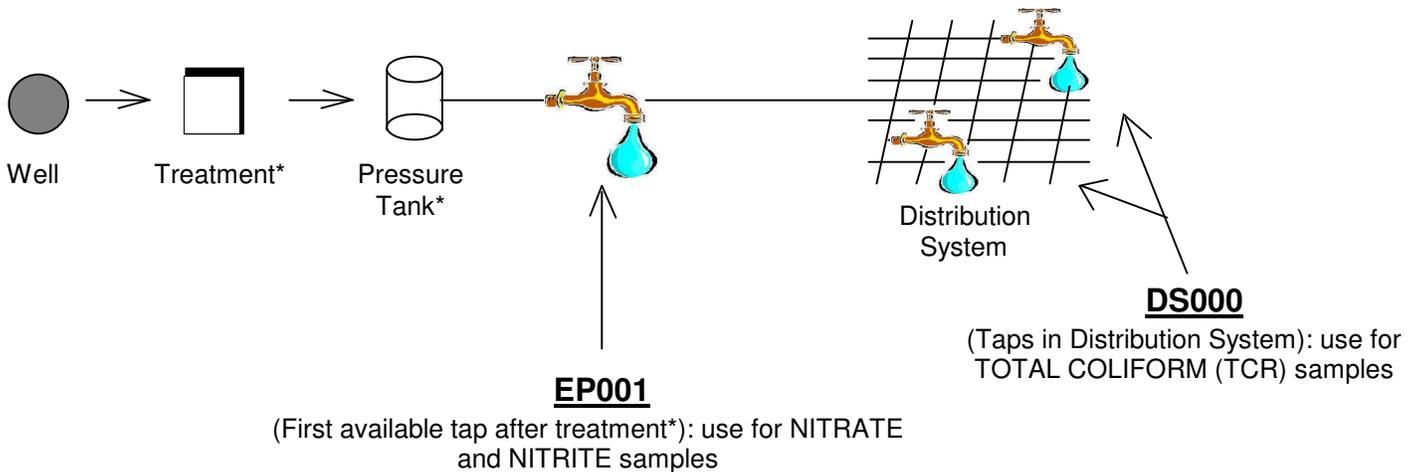

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2008 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH5932212 PWS NAME: DOGWOOD VALLEY CAMPGROUND

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

STU ID: 5956771 STU NAME: DOGWOOD VALLEY CAMPGROUND NO 1


Effective Date: 1/1/08

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 6/1/2008 and 10/31/2008	<i>Sample should be taken at EP001</i>
NITRITE - 1041	Not Required	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 5/1/2008 and 10/31/2008	<i>Sample should be taken at DS000</i>

Where to Collect Samples For a Small Public Water System

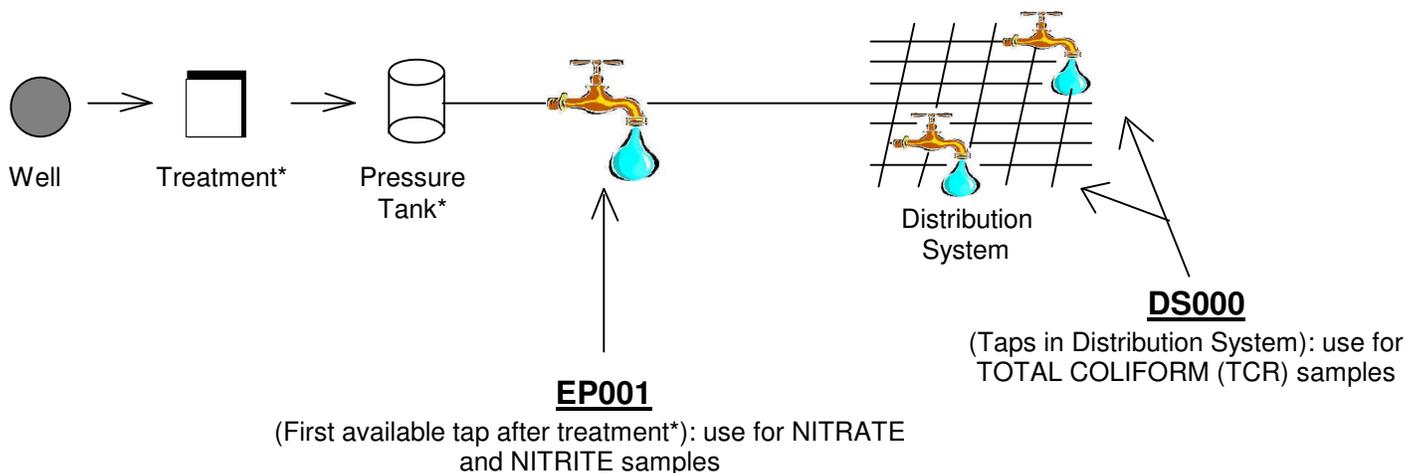

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2008 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH5934512 PWS NAME: JOHNSVILLE SCHOOL

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: EP001

STU ID: 5956775 STU NAME: JOHNSVILLE ELEM SCH

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE (AS N) - 1040	1 Sample(s) between 6/1/2008 and 10/31/2008
NITRITE	NITRITE (AS N) - 1041	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	1 Sample(s) between 6/1/2008 and 10/31/2008

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
<i>NITRATE Sample Date(s):</i>
<i>SOC Group 1 Sample Date(s):</i>

2008 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH5934512 PWS NAME: JOHNSVILLE SCHOOL

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: JOHNSVILLE SCHOOL DISTRIBUTION

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	5 Sample(s) between 6/1/2008 and 9/30/2008
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2008 and 12/31/2008

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month. If you receive a Total Coliform Positive result, contact your Central District Office - DDAGW representative immediately at 614-728-3778.

Use for Sample Tracking Purposes				
<i>Lead & Copper Sample Date(s):</i>				
<i>TCR Quarterly Sample Date(s):</i>				
	<i>Jan - Mar Sample Date(s)</i>	<i>Apr - Jun Sample Date(s)</i>	<i>Jul - Sept Sample Date(s)</i>	<i>Oct - Dec Sample Date(s)</i>

2008 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH5934712 PWS NAME: MT. GILEAD CAMPGROUND PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

STU ID: 5956776 STU NAME: KOA CAMPGROUND


Effective Date: 1/1/08

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 6/1/2008 and 10/31/2008	<i>Sample should be taken at EP001</i>
NITRITE - 1041	Not Required	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 4/1/2008 and 10/31/2008	<i>Sample should be taken at DS000</i>

Where to Collect Samples For a Small Public Water System

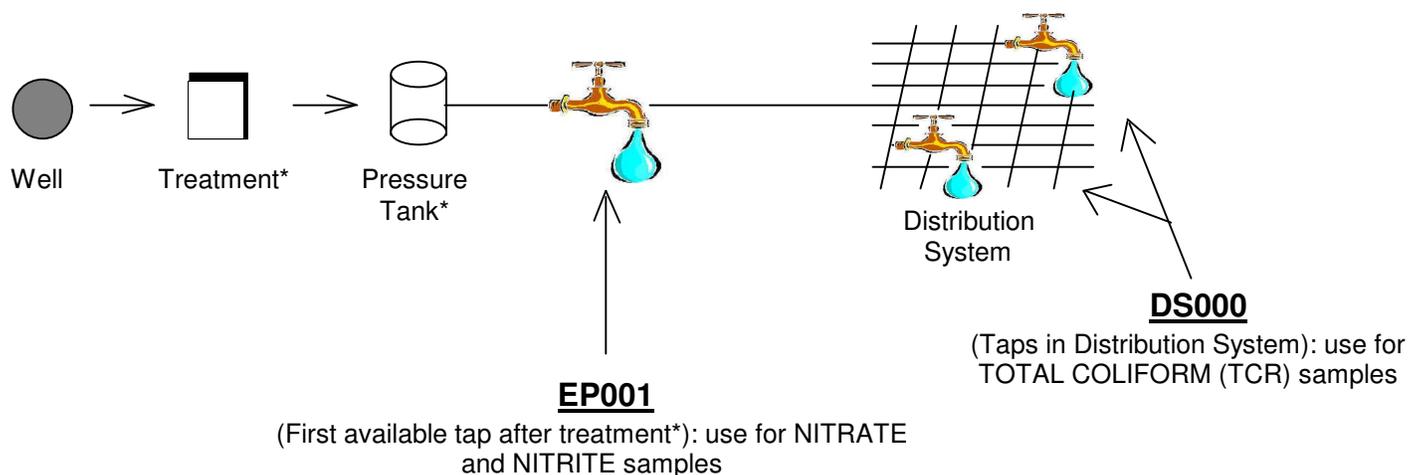

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2008 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH5935512 PWS NAME: HERSHS COUNTRYSIDE RESTAURANT PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

STU ID: 5956778 STU NAME: HERSHS COUNTRYSIDE RESTAURANT


Effective Date: 1/1/08

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 6/1/2008 and 10/31/2008	<i>Sample should be taken at EP001</i>
NITRITE - 1041	Not Required	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2008 and 12/31/2008	<i>Sample should be taken at DS000</i>

Where to Collect Samples For a Small Public Water System

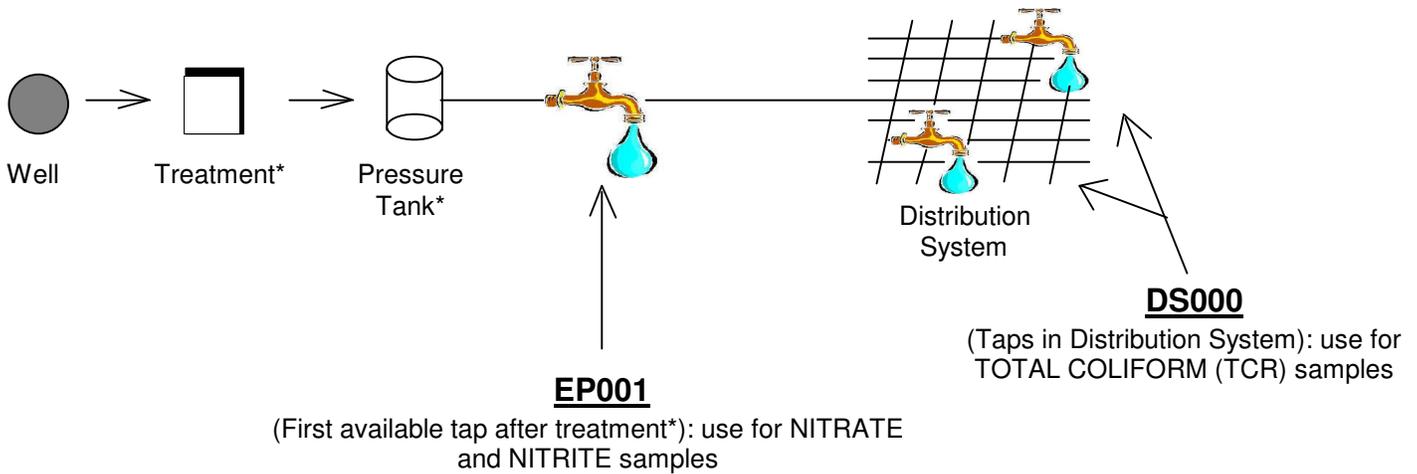

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2008 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH5935712 PWS NAME: MID-OHIO SPORTS MAINTENANCE

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

STU ID: 5956779 STU NAME: MID-OHIO SPORTS CAR COURSE


Effective Date: 1/1/08

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 6/1/2008 and 10/31/2008	<i>Sample should be taken at EP001</i>
NITRITE - 1041	Not Required	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2008 and 12/31/2008	<i>Sample should be taken at DS000</i>

Where to Collect Samples For a Small Public Water System

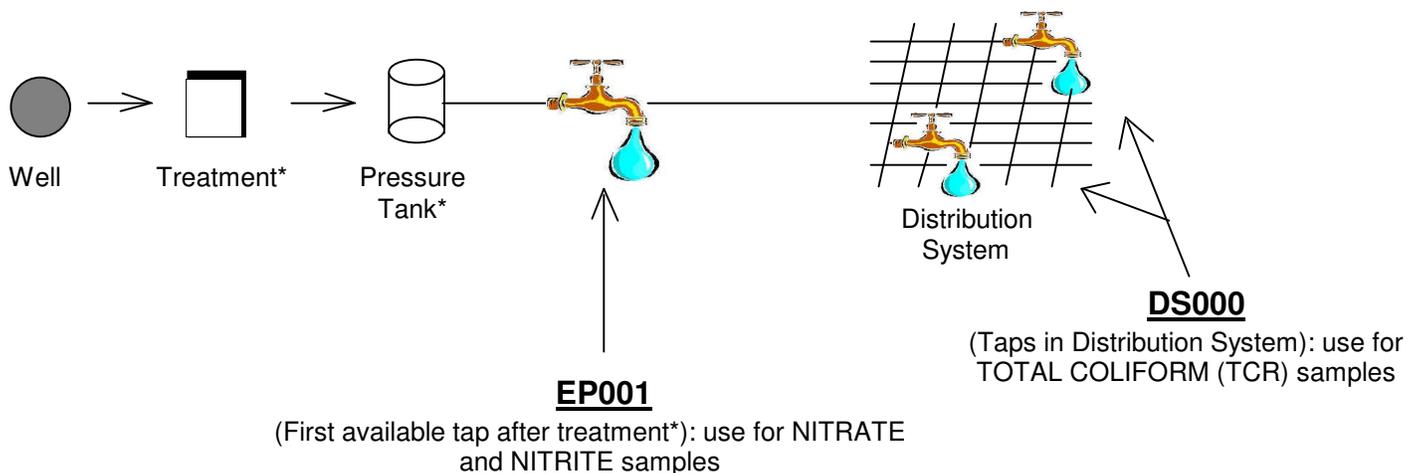

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2008 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH5935812 PWS NAME: MID-OHIO SPORTS/TOWER G

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

STU ID: 5956780 STU NAME: MID-OHIO SPORTS CAR COURSE TOWER G STU 1


Effective Date: 1/1/08

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 6/1/2008 and 10/31/2008	Sample should be taken at EP001
NITRITE - 1041	Not Required	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 4/1/2008 and 11/30/2008	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

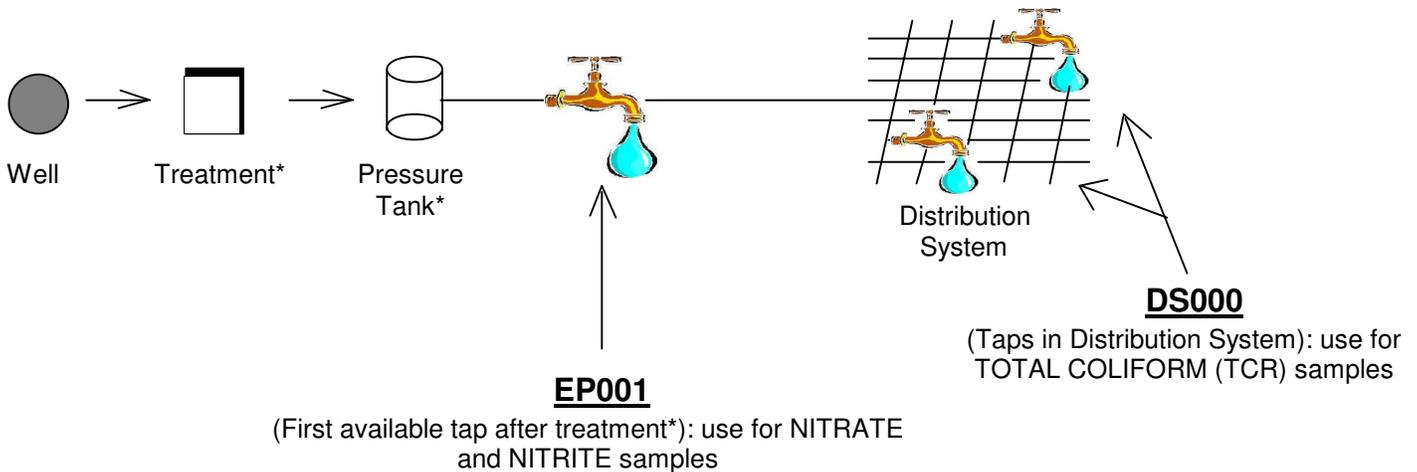

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2008 CONTAMINANT MONITORING SCHEDULE


PWS ID: OH5935812 PWS NAME: MID-OHIO SPORTS/TOWER G
PWS TYPE: Transient Noncommunity SOURCE: Ground Water
STU ID: 5960571 STU NAME: MID-OHIO SPORTS - TOWER G STU 2
Effective Date: 1/1/08

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 6/1/2008 and 10/31/2008	Sample should be taken at EP002
NITRITE - 1041	Not Required	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 4/1/2008 and 11/30/2008	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

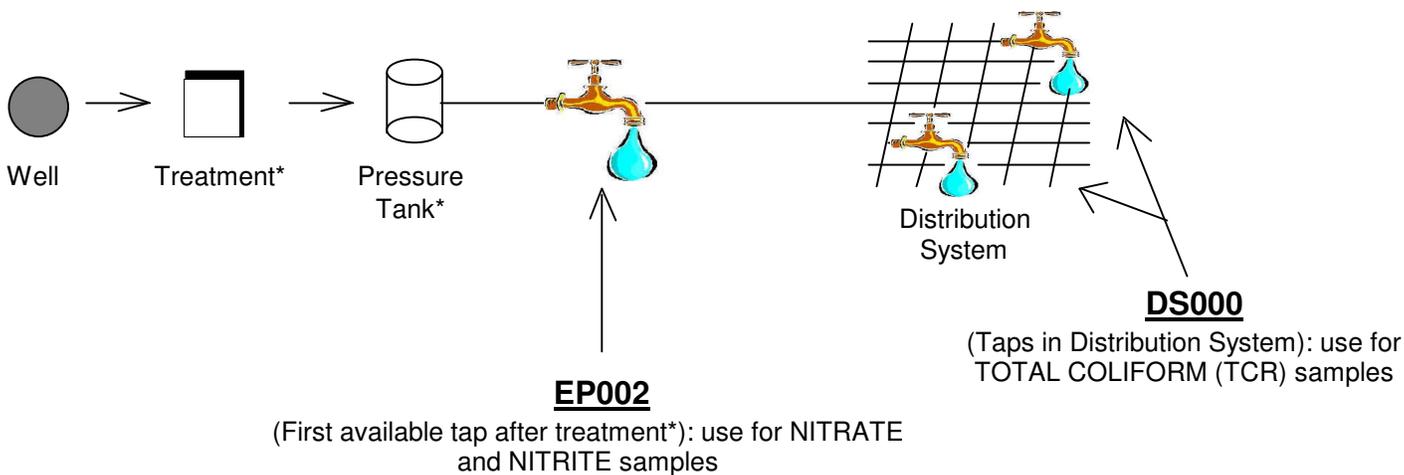

* If system does not have treatment, EP002 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2008 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH5936212 PWS NAME: NORTHMOR HIGH SCHOOL

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: EP001

STU ID: 5956783 STU NAME: NORTHMOR JR & SR HS

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE (AS N) - 1040	1 Sample(s) between 6/1/2008 and 10/31/2008
NITRITE	NITRITE (AS N) - 1041	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	1 Sample(s) between 6/1/2008 and 10/31/2008

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
<i>NITRATE Sample Date(s):</i>
<i>SOC Group 1 Sample Date(s):</i>

2008 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH5936212 PWS NAME: NORTHMOR HIGH SCHOOL

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: NORTHMOR HIGH SCHOOL DISTRIBUTION

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	Not Required
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2008 and 12/31/2008

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Central District Office - DDAGW representative immediately at 614-728-3778.

Use for Sample Tracking Purposes				
	<i>Jan - Mar Sample Date(s)</i>	<i>Apr - Jun Sample Date(s)</i>	<i>Jul - Sept Sample Date(s)</i>	<i>Oct - Dec Sample Date(s)</i>
<i>TCR Quarterly Sample Date(s):</i>				

2008 CONTAMINANT MONITORING SCHEDULE


PWS ID: OH5936412 PWS NAME: OHIO RETREAT CENTER
PWS TYPE: Transient Noncommunity SOURCE: Ground Water
STU ID: 5956785 STU NAME: OHIO RETREAT CENTER
Effective Date: 1/1/08

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 6/1/2008 and 10/31/2008	<i>Sample should be taken at EP001</i>
NITRITE - 1041	Not Required	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 6/1/2008 and 9/30/2008	<i>Sample should be taken at DS000</i>

Where to Collect Samples For a Small Public Water System

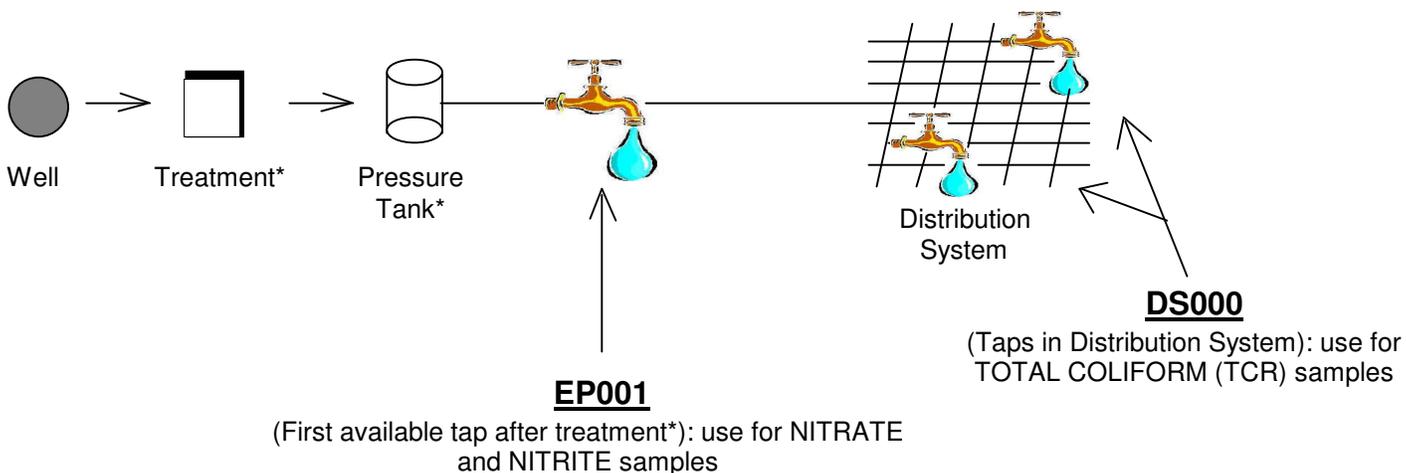

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2008 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH5936712 PWS NAME: PLEASANT GROVE CHURCH OF CHRIST

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

STU ID: 5956788 STU NAME: PLEASANT GROVE CHURCH OF CHRST


Effective Date: 1/1/08

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 6/1/2008 and 10/31/2008	<i>Sample should be taken at EP001</i>
NITRITE - 1041	Not Required	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2008 and 12/31/2008	<i>Sample should be taken at DS000</i>

Where to Collect Samples For a Small Public Water System

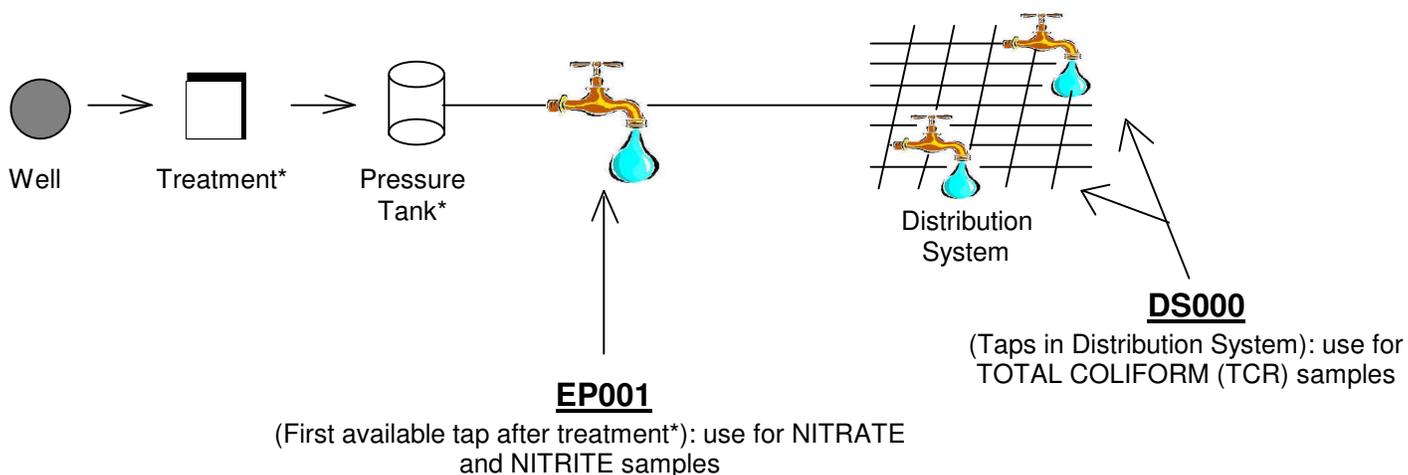

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2008 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH5938412 PWS NAME: HIDDEN LAKES CAMPGROUND

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

STU ID: 5956790 STU NAME: HIDDEN LAKE CAMPGROUND STU 1


Effective Date: 1/1/08

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 6/1/2008 and 10/31/2008	<i>Sample should be taken at EP001</i>
NITRITE - 1041	Not Required	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 4/1/2008 and 10/31/2008	<i>Sample should be taken at DS000</i>

Where to Collect Samples For a Small Public Water System

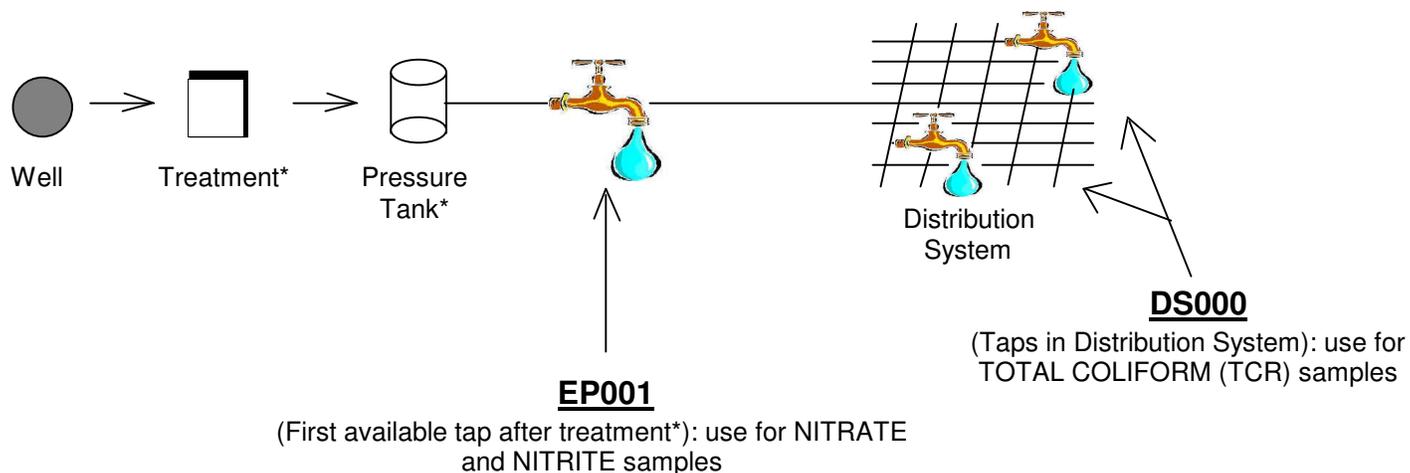

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2008 CONTAMINANT MONITORING SCHEDULE


PWS ID: OH5938412 PWS NAME: HIDDEN LAKES CAMPGROUND
PWS TYPE: Transient Noncommunity SOURCE: Ground Water
STU ID: 5960572 STU NAME: HIDDEN LAKES CAMPGROUND STU 2
Effective Date: 1/1/08

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 6/1/2008 and 10/31/2008	Sample should be taken at EP002
NITRITE - 1041	Not Required	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 4/1/2008 and 10/31/2008	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

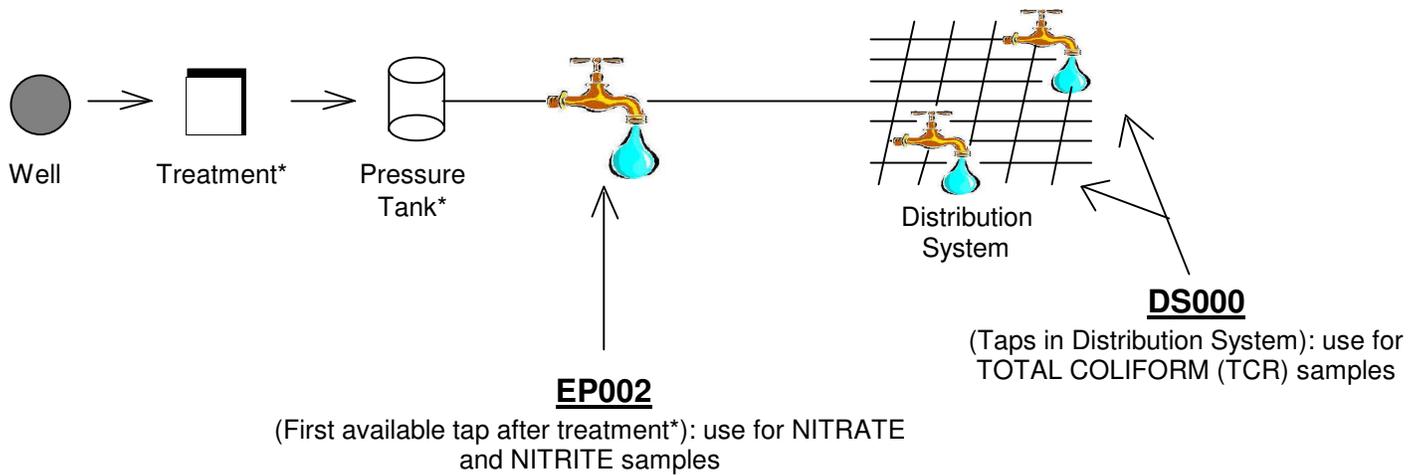

* If system does not have treatment, EP002 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2008 CONTAMINANT MONITORING SCHEDULE


PWS ID: OH5938412 PWS NAME: HIDDEN LAKES CAMPGROUND
PWS TYPE: Transient Noncommunity SOURCE: Ground Water
STU ID: 5960573 STU NAME: HIDDEN LAKES CAMPGROUND STU 3
Effective Date: 1/1/08

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 6/1/2008 and 10/31/2008	Sample should be taken at EP003
NITRITE - 1041	Not Required	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 4/1/2008 and 10/31/2008	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

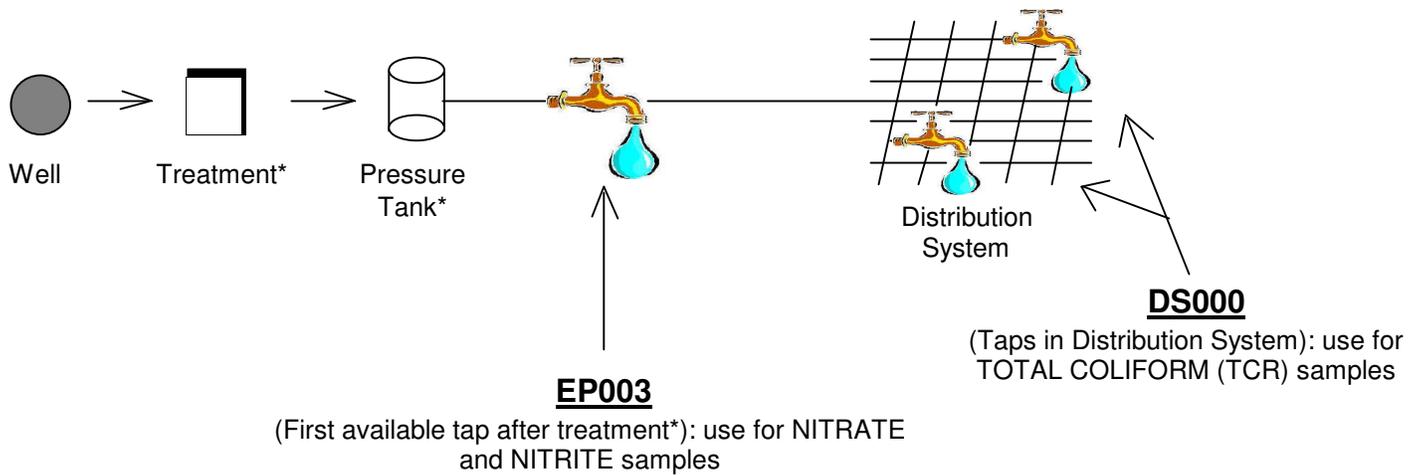

* If system does not have treatment, EP003 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2008 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH5940112 PWS NAME: MT. GILEAD TRUCK PLAZA

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: EP001

STU ID: 5956797 STU NAME: MT GILEAD TRUCK PLAZA

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE (AS N) - 1040	1 Sample(s) between 6/1/2008 and 10/31/2008
NITRITE	NITRITE (AS N) - 1041	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	1 Sample(s) between 6/1/2008 and 10/31/2008

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
<i>NITRATE Sample Date(s):</i>
<i>SOC Group 1 Sample Date(s):</i>

2008 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH5940112 PWS NAME: MT. GILEAD TRUCK PLAZA

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: MT. GILEAD TRUCK PLAZA DISTRIBUTION

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	Not Required
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** Not Required
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2008 and 12/31/2008
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Central District Office - DDAGW representative immediately at 614-728-3778.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes				
	<i>Jan - Mar Sample Date(s)</i>	<i>Apr - Jun Sample Date(s)</i>	<i>Jul - Sept Sample Date(s)</i>	<i>Oct - Dec Sample Date(s)</i>
<i>TCR Quarterly Sample Date(s):</i>				

2008 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH5941112 PWS NAME: GALION COUNTRY CLUB POOL PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

STU ID: 5956804 STU NAME: GALION COUNTRY CLUB POOL


Effective Date: 1/1/08

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 6/1/2008 and 10/31/2008	<i>Sample should be taken at EP001</i>
NITRITE - 1041	Not Required	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 5/1/2008 and 9/30/2008	<i>Sample should be taken at DS000</i>

Where to Collect Samples For a Small Public Water System

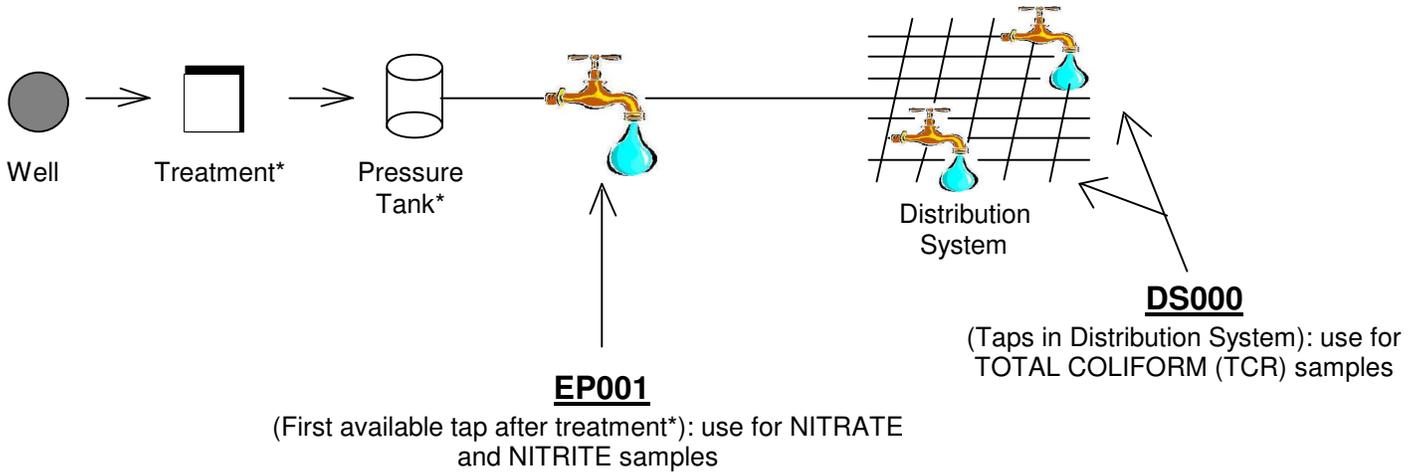

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2008 CONTAMINANT MONITORING SCHEDULE


PWS ID: OH5941222 PWS NAME: GALION COUNTRY CLUB LODGE PWS
PWS TYPE: Transient Noncommunity SOURCE: Ground Water
STU ID: 5956805 STU NAME: GALION COUNTRY CLUB LODGE
Effective Date: 1/1/08

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 6/1/2008 and 10/31/2008	Sample should be taken at EP001
NITRITE - 1041	Not Required	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2008 and 12/31/2008	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

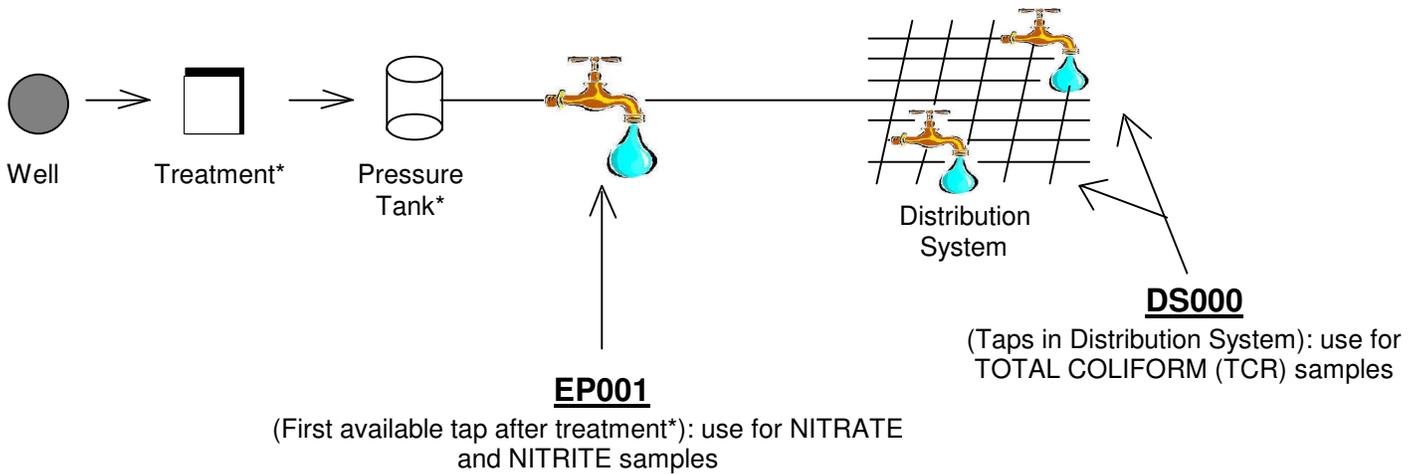

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2008 CONTAMINANT MONITORING SCHEDULE


PWS ID: OH5941412 PWS NAME: APPLE PIE INN
PWS TYPE: Transient Noncommunity SOURCE: Ground Water
STU ID: 5956806 STU NAME: APPLE PIE INN
Effective Date: 1/1/08

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 6/1/2008 and 10/31/2008	Sample should be taken at EP001
NITRITE - 1041	Not Required	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2008 and 12/31/2008	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

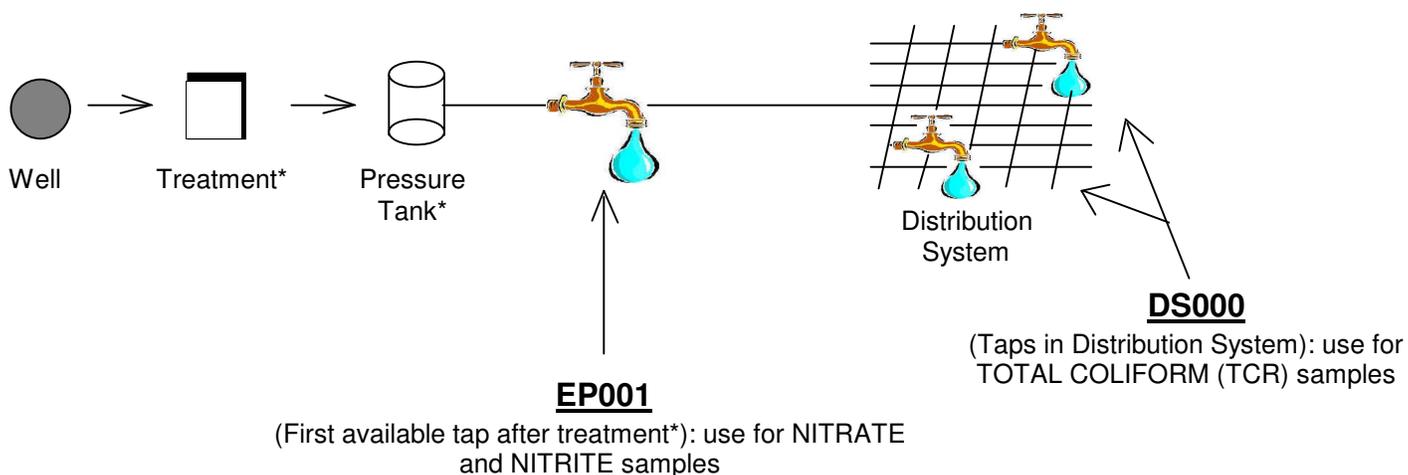

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2008 CONTAMINANT MONITORING SCHEDULE


PWS ID: OH5942112 PWS NAME: MT. GILEAD VFW PWS
PWS TYPE: Transient Noncommunity SOURCE: Ground Water
STU ID: 5961705 STU NAME: MT GILEAD VFW
Effective Date: 1/1/08

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 6/1/2008 and 10/31/2008	Sample should be taken at EP001
NITRITE - 1041	Not Required	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2008 and 12/31/2008	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

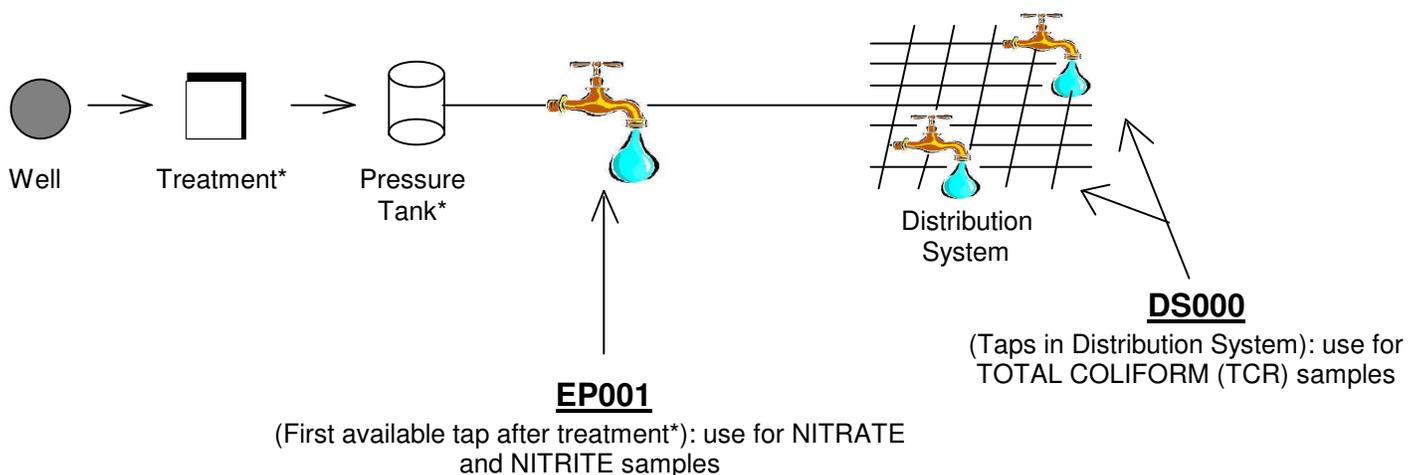

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)