2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH2900212 PWS NAME: BOWERSVILLE VILLAGE PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001

STATE FACILITY ID: 2954582 FACILITY NAME: BOWERSVILLE VILLAGE

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRATE	NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011
NITRITE	NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011
VOLATILE ORGANIC CHEMICALS (VOC)		1 Sample(s) between 6/1/2011 and 10/31/2011
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 2954582. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

REMINDER: **Consumer Confidence Report (CCR) is due July 1, 2011**

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
INORGANIC Sample Date(s):
NITRATE Sample Date(s):
NITRITE Sample Date(s):
VOC Sample Date(s):
Date CCR sent to Ohio EPA:

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH2900212 PWS NAME: BOWERSVILLE VILLAGE PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: BOWERSVILLE, VILLAGE OF DISTRIBUTION

Groundwater Rule Substantial Treatment System

Effective Date: 1/19/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
ASBESTOS - 1094	1 Sample(s) between 6/1/2011 and 10/31/2011
LEAD - 1030 & COPPER - 1022	Not Required
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** 1 Sample(s) between 7/1/2011 and 9/30/2011
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Monthly between 1/1/2011 and 12/31/2011
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

Asbestos Sampling Information

Collect one sample at a tap served by asbestos-cement pipe. The sample monitoring point (smp) code is DS000. Due to limited Laboratory capacity and a 48 hour filtering requirement, contact your lab early in the monitoring period to schedule a sampling date.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
Asbestos Sample Date(s):												
HAA5 & TTHM Sample Date(s):												
TCR Monthly Sample Date(s):	*Jan*	*Feb*	*Mar*	*Apr*	*May*	*Jun*	*Jul*	*Aug*	*Sept*	*Oct*	*Nov*	*Dec*
Total Chlorine Sample Date(s):												

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH2900612 PWS NAME: FAIRBORN PUBLIC WATER SYSTEM

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001

STATE FACILITY ID: 2954585 FACILITY NAME: FAIRBORN - SANDHILL

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRATE	NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011
NITRITE	NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		1 Sample(s) between 6/1/2011 and 10/31/2011
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 2954585. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

REMINDER: **Consumer Confidence Report (CCR) is due July 1, 2011**

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
INORGANIC Sample Date(s):
NITRATE Sample Date(s):
NITRITE Sample Date(s):
VOC Sample Date(s):
Date CCR sent to Ohio EPA:

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH2900612 PWS NAME: FAIRBORN PUBLIC WATER SYSTEM

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP002

STATE FACILITY ID: 2960642 FACILITY NAME: FAIRBORN - NORTH PARK

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRATE	NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011
NITRITE	NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		1 Sample(s) between 6/1/2011 and 10/31/2011
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP002 and the State Facility ID is 2960642. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

REMINDER: **Consumer Confidence Report (CCR) is due July 1, 2011**

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
INORGANIC Sample Date(s):
NITRATE Sample Date(s):
NITRITE Sample Date(s):
VOC Sample Date(s):
Date CCR sent to Ohio EPA:

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH2900612 PWS NAME: FAIRBORN PUBLIC WATER SYSTEM

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP003

STATE FACILITY ID: 2960643 FACILITY NAME: FAIRBORN-CENTRAL PARK

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRATE	NITRATE - 1040	1 Sample(s) between 10/1/2011 and 12/31/2011
NITRITE	NITRITE - 1041	1 Sample(s) between 6/1/2011 and 10/31/2011
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		1 Sample(s) between 6/1/2011 and 10/31/2011
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP003 and the State Facility ID is 2960643. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

REMINDER: **Consumer Confidence Report (CCR) is due July 1, 2011**

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
INORGANIC Sample Date(s):
NITRATE Sample Date(s):
NITRITE Sample Date(s):
VOC Sample Date(s):
Date CCR sent to Ohio EPA:

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH2900612 PWS NAME: FAIRBORN PUBLIC WATER SYSTEM

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: FAIRBORN, CITY OF DISTRIBUTION

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
ASBESTOS - 1094	1 Sample(s) between 6/1/2011 and 10/31/2011
LEAD - 1030 & COPPER - 1022	30 Sample(s) between 6/1/2011 and 9/30/2011
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** 1 Sample(s) between 7/1/2011 and 9/30/2011
TOTAL COLIFORM (TCR) - 3100	30 Sample(s) Monthly between 1/1/2011 and 12/31/2011
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period.

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

Asbestos Sampling Information

Collect one sample at a tap served by asbestos-cement pipe. The sample monitoring point (smp) code is DS000. Due to limited Laboratory capacity and a 48 hour filtering requirement, contact your lab early in the monitoring period to schedule a sampling date.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately. You should also continue to take Routine Samples according to this schedule.* If you have any questions, please contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
Asbestos Sample Date(s):												
Lead & Copper Sample Date(s):												
HAA5 & TTHM Sample Date(s):												
TCR Monthly Sample Date(s):	*Jan*	*Feb*	*Mar*	*Apr*	*May*	*Jun*	*Jul*	*Aug*	*Sept*	*Oct*	*Nov*	*Dec*
Total Chlorine Sample Date(s):												

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH2900803 PWS NAME: GREENE COUNTY - DAY

PWS TYPE: Community SOURCE: Purchased Surface Water Sample Monitoring Point: DS000

FACILITY NAME: GREENE COUNTY - DAY DISTRIBUTION

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	10 Sample(s) between 6/1/2011 and 9/30/2011
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** 1 Sample(s) Quarterly
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Monthly between 1/1/2011 and 12/31/2011
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period.

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
Lead & Copper Sample Date(s):												
HAA5 & TTHM Quarterly Sample Date(s):	*Jan - Mar Sample Date(s)*			*Apr - Jun Sample Date(s)*			*Jul - Sept Sample Date(s)*			*Oct - Dec Sample Date(s)*		
TCR Monthly Sample Date(s):	*Jan*	*Feb*	*Mar*	*Apr*	*May*	*Jun*	*Jul*	*Aug*	*Sept*	*Oct*	*Nov*	*Dec*
Total Chlorine Sample Date(s):												

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH2901112 PWS NAME: BELLBROOK WATER WORKS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001

STATE FACILITY ID: 2954587 FACILITY NAME: BELLBROOK WTP 1

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRATE	NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011
NITRITE	NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		1 Sample(s) between 6/1/2011 and 10/31/2011
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 2954587. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

REMINDER: **Consumer Confidence Report (CCR) is due July 1, 2011**

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
INORGANIC Sample Date(s):
NITRATE Sample Date(s):
NITRITE Sample Date(s):
VOC Sample Date(s):
Date CCR sent to Ohio EPA:

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH2901112 PWS NAME: BELLBROOK WATER WORKS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: BELLBROOK WATER WORKS DISTRIBUTION

Groundwater Rule Substantial Treatment System

Effective Date: 1/19/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
ASBESTOS - 1094	1 Sample(s) between 6/1/2011 and 10/31/2011
LEAD - 1030 & COPPER - 1022	20 Sample(s) between 6/1/2011 and 9/30/2011
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** 1 Sample(s) between 7/1/2011 and 9/30/2011
TOTAL COLIFORM (TCR) - 3100	10 Sample(s) Monthly between 1/1/2011 and 12/31/2011
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period.

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

Asbestos Sampling Information

Collect one sample at a tap served by asbestos-cement pipe. The sample monitoring point (smp) code is DS000. Due to limited Laboratory capacity and a 48 hour filtering requirement, contact your lab early in the monitoring period to schedule a sampling date.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately. You should also continue to take Routine Samples according to this schedule.* If you have any questions, please contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
Asbestos Sample Date(s):												
Lead & Copper Sample Date(s):												
HAA5 & TTHM Sample Date(s):												
TCR Monthly Sample Date(s):	*Jan*	*Feb*	*Mar*	*Apr*	*May*	*Jun*	*Jul*	*Aug*	*Sept*	*Oct*	*Nov*	*Dec*
Total Chlorine Sample Date(s):												

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH2901712 PWS NAME: JAMESTOWN VILLAGE PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001

STATE FACILITY ID: 2954589 FACILITY NAME: JAMESTOWN NEW PWS

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRATE	NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011
NITRITE	NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	1 Sample(s) between 6/1/2011 and 10/31/2011
VOLATILE ORGANIC CHEMICALS (VOC)		1 Sample(s) between 6/1/2011 and 10/31/2011
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 2954589. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

REMINDER: **Consumer Confidence Report (CCR) is due July 1, 2011**

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
INORGANIC Sample Date(s):
NITRATE Sample Date(s):
NITRITE Sample Date(s):
RADIOLOGICAL Sample Date(s):
VOC Sample Date(s):
Date CCR sent to Ohio EPA:

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH2901712 PWS NAME: JAMESTOWN VILLAGE PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: JAMESTOWN, VILLAGE OF DISTRIBUTION

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
ASBESTOS - 1094	1 Sample(s) between 6/1/2011 and 10/31/2011
LEAD - 1030 & COPPER - 1022	Not Required
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** 1 Sample(s) between 7/1/2011 and 9/30/2011
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Monthly between 1/1/2011 and 12/31/2011
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

Asbestos Sampling Information

Collect one sample at a tap served by asbestos-cement pipe. The sample monitoring point (smp) code is DS000. Due to limited Laboratory capacity and a 48 hour filtering requirement, contact your lab early in the monitoring period to schedule a sampling date.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
Asbestos Sample Date(s):												
HAA5 & TTHM Sample Date(s):												
TCR Monthly Sample Date(s):	*Jan*	*Feb*	*Mar*	*Apr*	*May*	*Jun*	*Jul*	*Aug*	*Sept*	*Oct*	*Nov*	*Dec*
Total Chlorine Sample Date(s):												

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH2901812 PWS NAME: MAPLE GROVE MOBILE HOME

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001

STATE FACILITY ID: 2954590 FACILITY NAME: MAPLE GROVE MHP

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRATE	NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011
NITRITE	NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		1 Sample(s) between 6/1/2011 and 10/31/2011
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 2954590. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

REMINDER: **Consumer Confidence Report (CCR) is due July 1, 2011**

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
INORGANIC Sample Date(s):
NITRATE Sample Date(s):
NITRITE Sample Date(s):
VOC Sample Date(s):
Date CCR sent to Ohio EPA:

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH2901812 PWS NAME: MAPLE GROVE MOBILE HOME

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: MAPLE GROVE MOBILE HOME DISTRIBUTION

Groundwater Rule Substantial Treatment System

Effective Date: 1/19/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	5 Sample(s) between 6/1/2011 and 9/30/2011
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** 1 Sample(s) between 7/1/2011 and 9/30/2011
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Monthly between 1/1/2011 and 12/31/2011
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period.

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
Lead & Copper Sample Date(s):												
HAA5 & TTHM Sample Date(s):												
TCR Monthly Sample Date(s):	*Jan*	*Feb*	*Mar*	*Apr*	*May*	*Jun*	*Jul*	*Aug*	*Sept*	*Oct*	*Nov*	*Dec*
Total Chlorine Sample Date(s):												

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH2901912 PWS NAME: CENTRAL STATE UNIVERSITY

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001

STATE FACILITY ID: 2954591 FACILITY NAME: CENTRAL STATE UNIVERSITY WTP

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRATE	NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011
NITRITE	NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		1 Sample(s) between 6/1/2011 and 10/31/2011
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 2954591. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

REMINDER: **Consumer Confidence Report (CCR) is due July 1, 2011**

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
INORGANIC Sample Date(s):
NITRATE Sample Date(s):
NITRITE Sample Date(s):
VOC Sample Date(s):
Date CCR sent to Ohio EPA:

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH2901912 PWS NAME: CENTRAL STATE UNIVERSITY

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: CENTRAL STATE UNIVERSITY DISTRIBUTION

Groundwater Rule Substantial Treatment System

Effective Date: 1/19/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	Not Required
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** 1 Sample(s) between 7/1/2011 and 9/30/2011
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Monthly between 1/1/2011 and 12/31/2011
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
HAA5 & TTHM Sample Date(s):												
TCR Monthly Sample Date(s):	*Jan*	*Feb*	*Mar*	*Apr*	*May*	*Jun*	*Jul*	*Aug*	*Sept*	*Oct*	*Nov*	*Dec*
Total Chlorine Sample Date(s):												

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH2902012 PWS NAME: WRIGHT STATE UNIVERSITY

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001

STATE FACILITY ID: 2954592 FACILITY NAME: WRIGHT STATE UNIVERSITY WTP

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRATE	NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011
NITRITE	NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		1 Sample(s) between 6/1/2011 and 10/31/2011
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 2954592. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

REMINDER: **Consumer Confidence Report (CCR) is due July 1, 2011**

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
INORGANIC Sample Date(s):
NITRATE Sample Date(s):
NITRITE Sample Date(s):
VOC Sample Date(s):
Date CCR sent to Ohio EPA:

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH2902012 PWS NAME: WRIGHT STATE UNIVERSITY

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: WRIGHT STATE UNIVERSITY DISTRIBUTION

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	Not Required
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** 1 Sample(s) between 7/1/2011 and 9/30/2011
TOTAL COLIFORM (TCR) - 3100	20 Sample(s) Monthly between 1/1/2011 and 12/31/2011
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately. You should also continue to take Routine Samples according to this schedule.* If you have any questions, please contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
HAA5 & TTHM Sample Date(s):												
TCR Monthly Sample Date(s):	*Jan*	*Feb*	*Mar*	*Apr*	*May*	*Jun*	*Jul*	*Aug*	*Sept*	*Oct*	*Nov*	*Dec*
Total Chlorine Sample Date(s):												

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH2902422 PWS NAME: SPRING VALLEY VILLAGE

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP002

STATE FACILITY ID: 2954594 FACILITY NAME: SPRING VALLEY STU 2

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRATE	NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011
NITRITE	NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	1 Sample(s) between 6/1/2011 and 10/31/2011
VOLATILE ORGANIC CHEMICALS (VOC)		1 Sample(s) between 4/1/2011 and 6/30/2011
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 2 List Below	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 3 List Below	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 4 List Below	1 Sample(s) between 4/1/2011 and 6/30/2011

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP002 and the State Facility ID is 2954594. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

REMINDER: **Consumer Confidence Report (CCR) is due July 1, 2011**

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

SOC Group 2 Chemicals: CARBOFURAN - 2046, OXAMYL (VYDATE) - 2036, PICLORAM - 2040, 2,4-D - 2105, PENTACHLOROPHENOL - 2326

SOC Group 3 Chemicals: BHC-GAMMA (LINDANE) - 2010, METHOXYCHLOR - 2015, DIQUAT - 2032, GLYPHOSATE - 2034, POLYCHLORINATED BIPHENYLS (PCB) - 2383

SOC Group 4 Chemicals: BENZO (A) PYRENE - 2306, ENDOTHALL - 2033, DI(2-ETHYLHEXYL) - ADIPATE - 2035, DI(2-ETHYLHEXYL) - PHTHALATE - 2039

Use for Sample Tracking Purposes
INORGANIC Sample Date(s):
NITRATE Sample Date(s):
NITRITE Sample Date(s):
RADIOLOGICAL Sample Date(s):
VOC Sample Date(s):
SOC Group 4 Sample Date(s):
Date CCR sent to Ohio EPA:

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH2902422 PWS NAME: SPRING VALLEY VILLAGE

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: SPRING VALLEY,VILLAGE OF DISTRIBUTION

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
ASBESTOS - 1094	1 Sample(s) between 6/1/2011 and 10/31/2011
LEAD - 1030 & COPPER - 1022	Not Required
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** 1 Sample(s) between 7/1/2011 and 9/30/2011
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Monthly between 1/1/2011 and 12/31/2011
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

Asbestos Sampling Information

Collect one sample at a tap served by asbestos-cement pipe. The sample monitoring point (smp) code is DS000. Due to limited Laboratory capacity and a 48 hour filtering requirement, contact your lab early in the monitoring period to schedule a sampling date.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
Asbestos Sample Date(s):												
HAA5 & TTHM Sample Date(s):												
TCR Monthly Sample Date(s):	*Jan*	*Feb*	*Mar*	*Apr*	*May*	*Jun*	*Jul*	*Aug*	*Sept*	*Oct*	*Nov*	*Dec*
Total Chlorine Sample Date(s):												

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH2902512 PWS NAME: SPRING VALLEY ESTATES MHP

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001

STATE FACILITY ID: 2954595 FACILITY NAME: SPRING VALLEY ESTATES MHP

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRATE	NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011
NITRITE	NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	1 Sample(s) between 6/1/2011 and 10/31/2011
VOLATILE ORGANIC CHEMICALS (VOC)		1 Sample(s) between 6/1/2011 and 10/31/2011
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 2954595. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

REMINDER: **Consumer Confidence Report (CCR) is due July 1, 2011**

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
INORGANIC Sample Date(s):
NITRATE Sample Date(s):
NITRITE Sample Date(s):
RADIOLOGICAL Sample Date(s):
VOC Sample Date(s):
Date CCR sent to Ohio EPA:

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH2902512 PWS NAME: SPRING VALLEY ESTATES MHP

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: SPRING VALLEY ESTATES MH DISTRIBUTION

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	Not Required
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** 1 Sample(s) between 7/1/2011 and 9/30/2011
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Monthly between 1/1/2011 and 12/31/2011
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
HAA5 & TTHM Sample Date(s):												
TCR Monthly Sample Date(s):	*Jan*	*Feb*	*Mar*	*Apr*	*May*	*Jun*	*Jul*	*Aug*	*Sept*	*Oct*	*Nov*	*Dec*
Total Chlorine Sample Date(s):												

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH2902812 PWS NAME: XENIA CITY PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001

STATE FACILITY ID: 2954597 FACILITY NAME: XENIA CITY

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRATE	NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011
NITRITE	NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		1 Sample(s) between 6/1/2011 and 10/31/2011
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 2954597. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

REMINDER: **Consumer Confidence Report (CCR) is due July 1, 2011**

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
INORGANIC Sample Date(s):
NITRATE Sample Date(s):
NITRITE Sample Date(s):
VOC Sample Date(s):
Date CCR sent to Ohio EPA:

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH2902812 PWS NAME: XENIA CITY PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: XENIA, CITY OF DISTRIBUTION

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
ASBESTOS - 1094	1 Sample(s) between 6/1/2011 and 10/31/2011
LEAD - 1030 & COPPER - 1022	Not Required
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** 1 Sample(s) between 7/1/2011 and 9/30/2011
TOTAL COLIFORM (TCR) - 3100	30 Sample(s) Monthly between 1/1/2011 and 12/31/2011
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

Asbestos Sampling Information

Collect one sample at a tap served by asbestos-cement pipe. The sample monitoring point (smp) code is DS000. Due to limited Laboratory capacity and a 48 hour filtering requirement, contact your lab early in the monitoring period to schedule a sampling date.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately. You should also continue to take Routine Samples according to this schedule.* If you have any questions, please contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
Asbestos Sample Date(s):												
HAA5 & TTHM Sample Date(s):												
TCR Monthly Sample Date(s):	*Jan*	*Feb*	*Mar*	*Apr*	*May*	*Jun*	*Jul*	*Aug*	*Sept*	*Oct*	*Nov*	*Dec*
Total Chlorine Sample Date(s):												

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH2903012 PWS NAME: YELLOW SPRINGS VILLAGE PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001

STATE FACILITY ID: 2954598 FACILITY NAME: YELLOW SPRINGS VLG

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRATE	NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011
NITRITE	NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		1 Sample(s) between 6/1/2011 and 10/31/2011
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 2954598. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

REMINDER: **Consumer Confidence Report (CCR) is due July 1, 2011**

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
INORGANIC Sample Date(s):
NITRATE Sample Date(s):
NITRITE Sample Date(s):
VOC Sample Date(s):
Date CCR sent to Ohio EPA:

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH2903012 PWS NAME: YELLOW SPRINGS VILLAGE PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: YELLOW SPRINGS, VILLAGE DISTRIBUTION

Groundwater Rule Substantial Treatment System

Effective Date: 1/19/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	Not Required
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** 1 Sample(s) between 7/1/2011 and 9/30/2011
TOTAL COLIFORM (TCR) - 3100	4 Sample(s) Monthly between 1/1/2011 and 12/31/2011
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
HAA5 & TTHM Sample Date(s):												
TCR Monthly Sample Date(s):	*Jan*	*Feb*	*Mar*	*Apr*	*May*	*Jun*	*Jul*	*Aug*	*Sept*	*Oct*	*Nov*	*Dec*
Total Chlorine Sample Date(s):												

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH2903312 PWS NAME: WRIGHT-PATTERSON AFB AREA B PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001

STATE FACILITY ID: 2954600 FACILITY NAME: WRIGHT-PATTERSON AFB AREA B STU 1

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRATE	NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011
NITRITE	NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	1 Sample(s) between 6/1/2011 and 10/31/2011
VOLATILE ORGANIC CHEMICALS (VOC)		1 Sample(s) between 7/1/2011 and 9/30/2011
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 2954600. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

REMINDER: **Consumer Confidence Report (CCR) is due July 1, 2011**

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
INORGANIC Sample Date(s):
NITRATE Sample Date(s):
NITRITE Sample Date(s):
RADIOLOGICAL Sample Date(s):
VOC Sample Date(s):
Date CCR sent to Ohio EPA:

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH2903312 PWS NAME: WRIGHT-PATTERSON AFB AREA B PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP002

STATE FACILITY ID: 2960515 FACILITY NAME: WRIGHT-PATTERSON AFB AREA B STU 2

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRATE	NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011
NITRITE	NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		1 Sample(s) between 6/1/2011 and 10/31/2011
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP002 and the State Facility ID is 2960515. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

REMINDER: **Consumer Confidence Report (CCR) is due July 1, 2011**

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
INORGANIC Sample Date(s):
NITRATE Sample Date(s):
NITRITE Sample Date(s):
VOC Sample Date(s):
Date CCR sent to Ohio EPA:

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH2903312 PWS NAME: WRIGHT-PATTERSON AFB AREA B PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: WRIGHT-PATTERSON AFB, B DISTRIBUTION

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
ASBESTOS - 1094	1 Sample(s) between 6/1/2011 and 10/31/2011
LEAD - 1030 & COPPER - 1022	Not Required
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** 1 Sample(s) between 7/1/2011 and 9/30/2011
TOTAL COLIFORM (TCR) - 3100	10 Sample(s) Monthly between 1/1/2011 and 12/31/2011
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

Asbestos Sampling Information

Collect one sample at a tap served by asbestos-cement pipe. The sample monitoring point (smp) code is DS000. Due to limited Laboratory capacity and a 48 hour filtering requirement, contact your lab early in the monitoring period to schedule a sampling date.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately. You should also continue to take Routine Samples according to this schedule.* If you have any questions, please contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
Asbestos Sample Date(s):												
HAA5 & TTHM Sample Date(s):												
TCR Monthly Sample Date(s):	*Jan*	*Feb*	*Mar*	*Apr*	*May*	*Jun*	*Jul*	*Aug*	*Sept*	*Oct*	*Nov*	*Dec*
Total Chlorine Sample Date(s):												

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH2903412 PWS NAME: WRIGHT-PATTERSON AFB AREA A/C PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001

STATE FACILITY ID: 2954601 FACILITY NAME: WRIGHT PATTERSON AFB AREA A/C STU 1

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRATE	NITRATE - 1040	1 Sample(s) between 7/1/2011 and 9/30/2011
NITRITE	NITRITE - 1041	1 Sample(s) between 6/1/2011 and 10/31/2011
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	1 Sample(s) between 6/1/2011 and 10/31/2011
VOLATILE ORGANIC CHEMICALS (VOC)		1 Sample(s) between 4/1/2011 and 6/30/2011
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 2954601. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

REMINDER: **Consumer Confidence Report (CCR) is due July 1, 2011**

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
INORGANIC Sample Date(s):
NITRATE Sample Date(s):
NITRITE Sample Date(s):
RADIOLOGICAL Sample Date(s):
VOC Sample Date(s):
Date CCR sent to Ohio EPA:

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH2903412 PWS NAME: WRIGHT-PATTERSON AFB AREA A/C PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP002

STATE FACILITY ID: 2960516 FACILITY NAME: WRIGHT-PATTERSON AFB AREA A/C STU 2

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRATE	NITRATE - 1040	1 Sample(s) between 7/1/2011 and 9/30/2011
NITRITE	NITRITE - 1041	1 Sample(s) between 6/1/2011 and 10/31/2011
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		1 Sample(s) between 4/1/2011 and 6/30/2011
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP002 and the State Facility ID is 2960516. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

REMINDER: **Consumer Confidence Report (CCR) is due July 1, 2011**

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
INORGANIC Sample Date(s):
NITRATE Sample Date(s):
NITRITE Sample Date(s):
VOC Sample Date(s):
Date CCR sent to Ohio EPA:

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH2903412 PWS NAME: WRIGHT-PATTERSON AFB AREA A/C PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP003

STATE FACILITY ID: 2960517 FACILITY NAME: WRIGHT-PATTERSON AFB AREA A/C STU 3

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRATE	NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011
NITRITE	NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		1 Sample(s) between 4/1/2011 and 6/30/2011
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP003 and the State Facility ID is 2960517. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

REMINDER: **Consumer Confidence Report (CCR) is due July 1, 2011**

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
INORGANIC Sample Date(s):
NITRATE Sample Date(s):
NITRITE Sample Date(s):
VOC Sample Date(s):
Date CCR sent to Ohio EPA:

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH2903412 PWS NAME: WRIGHT-PATTERSON AFB AREA A/C PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP004

STATE FACILITY ID: 2960518 FACILITY NAME: WRIGHT-PATTERSON AFB AREA A/C STU 4

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRATE	NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011
NITRITE	NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	1 Sample(s) between 6/1/2011 and 10/31/2011
VOLATILE ORGANIC CHEMICALS (VOC)		1 Sample(s) between 4/1/2011 and 6/30/2011
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP004 and the State Facility ID is 2960518. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

REMINDER: **Consumer Confidence Report (CCR) is due July 1, 2011**

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
INORGANIC Sample Date(s):
NITRATE Sample Date(s):
NITRITE Sample Date(s):
RADIOLOGICAL Sample Date(s):
VOC Sample Date(s):
Date CCR sent to Ohio EPA:

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH2903412 PWS NAME: WRIGHT-PATTERSON AFB AREA A/C PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: WRIGHT-PATTERSON AFB, A/C DISTRIBUTION

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
ASBESTOS - 1094	1 Sample(s) between 6/1/2011 and 10/31/2011
LEAD - 1030 & COPPER - 1022	Not Required
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** 2 Sample(s) between 7/1/2011 and 9/30/2011
TOTAL COLIFORM (TCR) - 3100	10 Sample(s) Monthly between 1/1/2011 and 12/31/2011
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

Asbestos Sampling Information

Collect one sample at a tap served by asbestos-cement pipe. The sample monitoring point (smp) code is DS000. Due to limited Laboratory capacity and a 48 hour filtering requirement, contact your lab early in the monitoring period to schedule a sampling date.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately. You should also continue to take Routine Samples according to this schedule.* If you have any questions, please contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
Asbestos Sample Date(s):												
HAA5 & TTHM Sample Date(s):												
TCR Monthly Sample Date(s):	*Jan*	*Feb*	*Mar*	*Apr*	*May*	*Jun*	*Jul*	*Aug*	*Sept*	*Oct*	*Nov*	*Dec*
Total Chlorine Sample Date(s):												

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH2903512 PWS NAME: GREENE CO.-NORTHWEST REG WATER

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001

STATE FACILITY ID: 2954602 FACILITY NAME: GREENE CO NORTHWEST REGIONAL WTP 1

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRATE	NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011
NITRITE	NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		1 Sample(s) between 6/1/2011 and 10/31/2011
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 2954602. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

REMINDER: **Consumer Confidence Report (CCR) is due July 1, 2011**

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
INORGANIC Sample Date(s):
NITRATE Sample Date(s):
NITRITE Sample Date(s):
VOC Sample Date(s):
Date CCR sent to Ohio EPA:

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH2903512 PWS NAME: GREENE CO.-NORTHWEST REG WATER

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP002

STATE FACILITY ID: 2960519 FACILITY NAME: GREENE CO. NORTHWEST REGIONAL WTP 2

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	1 Sample(s) between 6/1/2011 and 10/31/2011
ARSENIC	ARSENIC - 1005	1 Sample(s) Quarterly
NITRATE	NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011
NITRITE	NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		1 Sample(s) between 6/1/2011 and 10/31/2011
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP002 and the State Facility ID is 2960519. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

REMINDER: **Consumer Confidence Report (CCR) is due July 1, 2011**

INORGANIC Chemicals: ANTIMONY - 1074, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes				
INORGANIC Sample Date(s):				
ARSENIC Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)
NITRATE Sample Date(s):				
NITRITE Sample Date(s):				
VOC Sample Date(s):				
Date CCR sent to Ohio EPA:				

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH2903512 PWS NAME: GREENE CO.-NORTHWEST REG WATER

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: GREENE CO.-NORTHWEST REG WTP 01 DISTRIBU

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	30 Sample(s) between 6/1/2011 and 9/30/2011
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** 2 Sample(s) between 7/1/2011 and 9/30/2011
TOTAL COLIFORM (TCR) - 3100	40 Sample(s) Monthly between 1/1/2011 and 12/31/2011
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period.

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately. You should also continue to take Routine Samples according to this schedule.* If you have any questions, please contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
Lead & Copper Sample Date(s):												
HAA5 & TTHM Sample Date(s):												
TCR Monthly Sample Date(s):	*Jan*	*Feb*	*Mar*	*Apr*	*May*	*Jun*	*Jul*	*Aug*	*Sept*	*Oct*	*Nov*	*Dec*
Total Chlorine Sample Date(s):												

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH2903612 PWS NAME: CEDARVILLE UNIVERSITY

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001

STATE FACILITY ID: 2954603 FACILITY NAME: CEDARVILLE UNIVERSITY

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	1 Sample(s) between 6/1/2011 and 10/31/2011
ARSENIC	ARSENIC - 1005	1 Sample(s) Quarterly
NITRATE	NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011
NITRITE	NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		1 Sample(s) between 6/1/2011 and 10/31/2011
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 2954603. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

REMINDER: **Consumer Confidence Report (CCR) is due July 1, 2011**

INORGANIC Chemicals: ANTIMONY - 1074, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes				
INORGANIC Sample Date(s):				
ARSENIC Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)
NITRATE Sample Date(s):				
NITRITE Sample Date(s):				
VOC Sample Date(s):				
Date CCR sent to Ohio EPA:				

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH2903612 PWS NAME: CEDARVILLE UNIVERSITY

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: CEDARVILLE UNIVERSITY DISTRIBUTION

Groundwater Rule Substantial Treatment System

Effective Date: 1/19/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
ASBESTOS - 1094	1 Sample(s) between 6/1/2011 and 10/31/2011
LEAD - 1030 & COPPER - 1022	20 Sample(s) between 6/1/2011 and 9/30/2011
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** 1 Sample(s) between 7/1/2011 and 9/30/2011
TOTAL COLIFORM (TCR) - 3100	4 Sample(s) Monthly between 1/1/2011 and 12/31/2011
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period.

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

Asbestos Sampling Information

Collect one sample at a tap served by asbestos-cement pipe. The sample monitoring point (smp) code is DS000. Due to limited Laboratory capacity and a 48 hour filtering requirement, contact your lab early in the monitoring period to schedule a sampling date.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
Asbestos Sample Date(s):												
Lead & Copper Sample Date(s):												
HAA5 & TTHM Sample Date(s):												
TCR Monthly Sample Date(s):	*Jan*	*Feb*	*Mar*	*Apr*	*May*	*Jun*	*Jul*	*Aug*	*Sept*	*Oct*	*Nov*	*Dec*
Total Chlorine Sample Date(s):												

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH2903912 PWS NAME: GREENE CO.-SOUTHWEST REG WATER

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001

STATE FACILITY ID: 2954605 FACILITY NAME: GREENE CO SOUTHWEST REGIONAL

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRATE	NITRATE - 1040	1 Sample(s) between 7/1/2011 and 9/30/2011
NITRITE	NITRITE - 1041	1 Sample(s) between 6/1/2011 and 10/31/2011
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		1 Sample(s) between 6/1/2011 and 10/31/2011
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 2 List Below	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 3 List Below	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 4 List Below	1 Sample(s) between 4/1/2011 and 6/30/2011

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 2954605. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

REMINDER: **Consumer Confidence Report (CCR) is due July 1, 2011**

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

SOC Group 2 Chemicals: CARBOFURAN - 2046, OXAMYL (VYDATE) - 2036, PICLORAM - 2040, 2,4-D - 2105, PENTACHLOROPHENOL - 2326

SOC Group 3 Chemicals: BHC-GAMMA (LINDANE) - 2010, METHOXYCHLOR - 2015, DIQUAT - 2032, GLYPHOSATE - 2034, POLYCHLORINATED BIPHENYLS (PCB) - 2383

SOC Group 4 Chemicals: BENZO (A) PYRENE - 2306, ENDOTHALL - 2033, DI(2-ETHYLHEXYL) - ADIPATE - 2035, DI(2-ETHYLHEXYL) - PHTHALATE - 2039

Use for Sample Tracking Purposes
INORGANIC Sample Date(s):
NITRATE Sample Date(s):
NITRITE Sample Date(s):
VOC Sample Date(s):
SOC Group 4 Sample Date(s):
Date CCR sent to Ohio EPA:

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH2903912 PWS NAME: GREENE CO.-SOUTHWEST REG WATER

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: GREENE CO.-SOUTHWEST REG DISTRIBUTION

Groundwater Rule Substantial Treatment System

Effective Date: 1/19/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	Not Required
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** 1 Sample(s) between 7/1/2011 and 9/30/2011
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Monthly between 1/1/2011 and 12/31/2011
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
HAA5 & TTHM Sample Date(s):												
TCR Monthly Sample Date(s):	*Jan*	*Feb*	*Mar*	*Apr*	*May*	*Jun*	*Jul*	*Aug*	*Sept*	*Oct*	*Nov*	*Dec*
Total Chlorine Sample Date(s):												

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH2904103 PWS NAME: GREENE COUNTY - SWIGART PWS

PWS TYPE: Community SOURCE: Purchased Surface Water Sample Monitoring Point: DS000

FACILITY NAME: GREENE COUNTY - SWIGART DISTRIBUTION

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	5 Sample(s) between 6/1/2011 and 9/30/2011
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** 1 Sample(s) Quarterly
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Monthly between 1/1/2011 and 12/31/2011
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period.

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
Lead & Copper Sample Date(s):												
HAA5 & TTHM Quarterly Sample Date(s):	*Jan - Mar Sample Date(s)*			*Apr - Jun Sample Date(s)*			*Jul - Sept Sample Date(s)*			*Oct - Dec Sample Date(s)*		
TCR Monthly Sample Date(s):	*Jan*	*Feb*	*Mar*	*Apr*	*May*	*Jun*	*Jul*	*Aug*	*Sept*	*Oct*	*Nov*	*Dec*
Total Chlorine Sample Date(s):												

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH2904203 PWS NAME: GREENE COUNTY - CLYO PWS

PWS TYPE: Community SOURCE: Purchased Surface Water Sample Monitoring Point: DS000

FACILITY NAME: GREENE COUNTY - CLYO DISTRIBUTION

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	10 Sample(s) between 6/1/2011 and 9/30/2011
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** 1 Sample(s) Quarterly
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Monthly between 1/1/2011 and 12/31/2011
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period.

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
Lead & Copper Sample Date(s):												
HAA5 & TTHM Quarterly Sample Date(s):	*Jan - Mar Sample Date(s)*			*Apr - Jun Sample Date(s)*			*Jul - Sept Sample Date(s)*			*Oct - Dec Sample Date(s)*		
TCR Monthly Sample Date(s):	*Jan*	*Feb*	*Mar*	*Apr*	*May*	*Jun*	*Jul*	*Aug*	*Sept*	*Oct*	*Nov*	*Dec*
Total Chlorine Sample Date(s):												

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH2905003 PWS NAME: GREENE COUNTY - KITRIDGE

PWS TYPE: Community SOURCE: Purchased Surface Water Sample Monitoring Point: DS000

FACILITY NAME: GREENE COUNTY - KITRIDGE DISTRIBUTION

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	5 Sample(s) between 6/1/2011 and 9/30/2011
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** 1 Sample(s) Quarterly
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Monthly between 1/1/2011 and 12/31/2011
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period.

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
Lead & Copper Sample Date(s):												
HAA5 & TTHM Quarterly Sample Date(s):	*Jan - Mar Sample Date(s)*			*Apr - Jun Sample Date(s)*			*Jul - Sept Sample Date(s)*			*Oct - Dec Sample Date(s)*		
TCR Monthly Sample Date(s):	*Jan*	*Feb*	*Mar*	*Apr*	*May*	*Jun*	*Jul*	*Aug*	*Sept*	*Oct*	*Nov*	*Dec*
Total Chlorine Sample Date(s):												

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH2906103 PWS NAME: GREENE COUNTY EASTERN REGIONAL PWS

PWS TYPE: Community SOURCE: Purchased Ground Water Sample Monitoring Point: DS000

FACILITY NAME: GREENE COUNTY - EASTERN REG. DISTRIBUTIO

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
ASBESTOS - 1094	1 Sample(s) between 6/1/2011 and 10/31/2011
LEAD - 1030 & COPPER - 1022	Not Required
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** 1 Sample(s) between 7/1/2011 and 9/30/2011
TOTAL COLIFORM (TCR) - 3100	5 Sample(s) Monthly between 1/1/2011 and 12/31/2011
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

Asbestos Sampling Information

Collect one sample at a tap served by asbestos-cement pipe. The sample monitoring point (smp) code is DS000. Due to limited Laboratory capacity and a 48 hour filtering requirement, contact your lab early in the monitoring period to schedule a sampling date.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately. You should also continue to take Routine Samples according to this schedule.* If you have any questions, please contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
Asbestos Sample Date(s):												
HAA5 & TTHM Sample Date(s):												
TCR Monthly Sample Date(s):	*Jan*	*Feb*	*Mar*	*Apr*	*May*	*Jun*	*Jul*	*Aug*	*Sept*	*Oct*	*Nov*	*Dec*
Total Chlorine Sample Date(s):												

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2930612 PWS NAME: BEAVER SQUARE

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954609 FACILITY NAME: BEAVER SQUARE

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

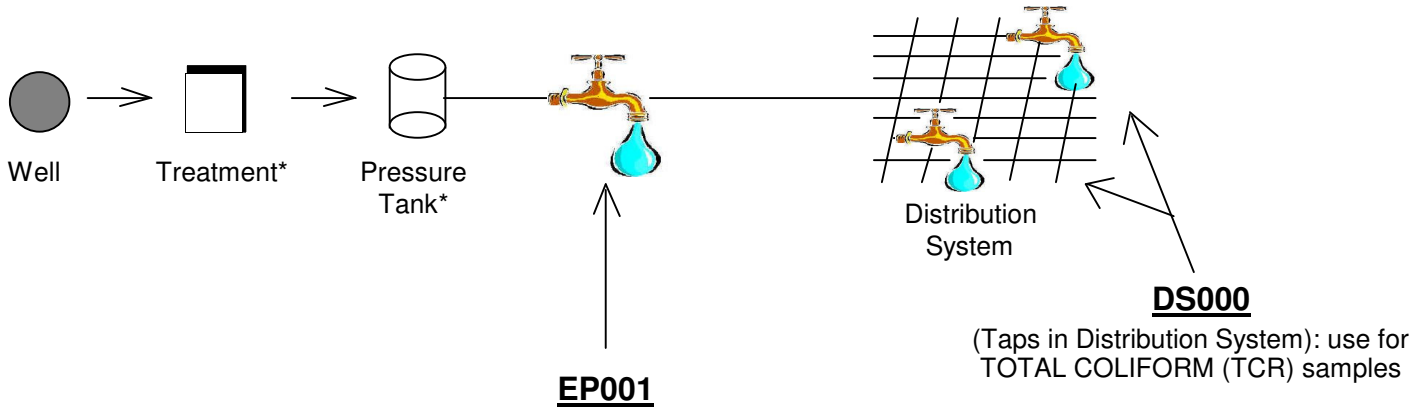

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2930912 PWS NAME: BEAVERCREEK PROFESSIONAL BLDG PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954610 FACILITY NAME: BEAVERCREEK PROFESSIONAL BLDG

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

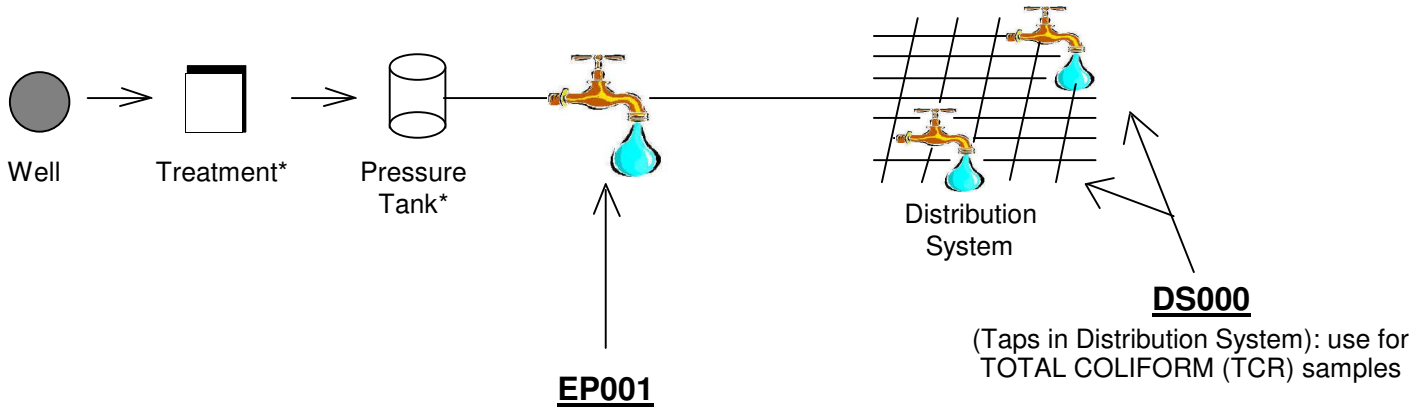

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2932212 PWS NAME: ECONOLODGE BEAVERCREEK

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954613 FACILITY NAME: ECONO LODGE BEAVERCREEK

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

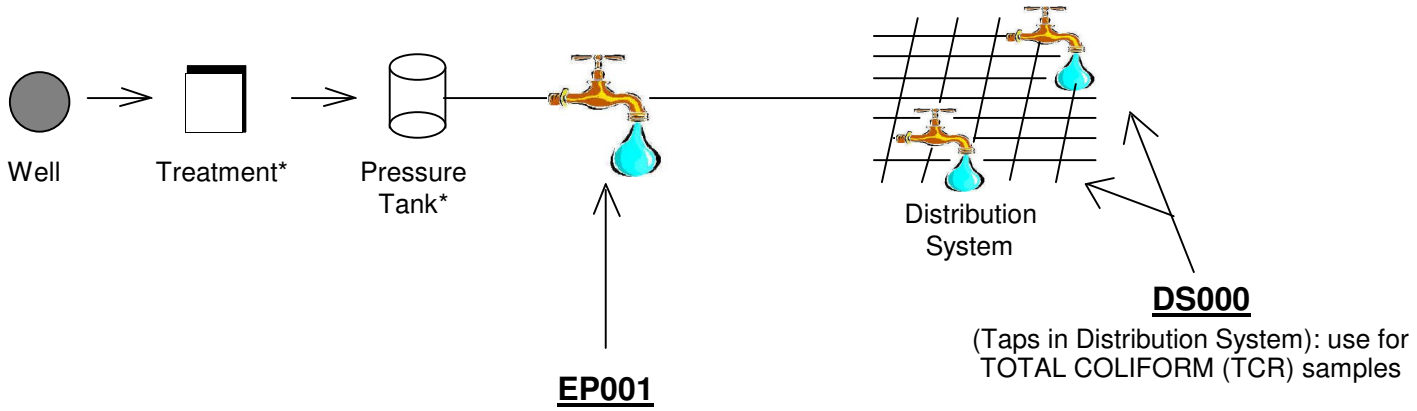

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH2932612 PWS NAME: RESEARCH PARK CORPORATION

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: EP001

STATE FACILITY ID: 2954614 FACILITY NAME: RESEARCH PARK CORPORATION

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRATE	NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011
NITRITE	NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011
VOLATILE ORGANIC CHEMICALS (VOC)		1 Sample(s) between 6/1/2011 and 10/31/2011
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 2 List Below	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 3 List Below	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 4 List Below	1 Sample(s) between 4/1/2011 and 6/30/2011

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 2954614. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

SOC Group 2 Chemicals: CARBOFURAN - 2046, OXAMYL (VYDATE) - 2036, PICLORAM - 2040, 2,4-D - 2105, PENTACHLOROPHENOL - 2326

SOC Group 3 Chemicals: BHC-GAMMA (LINDANE) - 2010, METHOXYCHLOR - 2015, DIQUAT - 2032, GLYPHOSATE - 2034, POLYCHLORINATED BIPHENYLS (PCB) - 2383

SOC Group 4 Chemicals: BENZO (A) PYRENE - 2306, ENDOTHALL - 2033, DI(2-ETHYLHEXYL) - ADIPATE - 2035, DI(2-ETHYLHEXYL) - PHTHALATE - 2039

Use for Sample Tracking Purposes
INORGANIC Sample Date(s):
NITRATE Sample Date(s):
NITRITE Sample Date(s):
VOC Sample Date(s):
SOC Group 4 Sample Date(s):

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH2932612 PWS NAME: RESEARCH PARK CORPORATION

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: RESEARCH PARK CORP DISTRIBUTION

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	Not Required
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

Use for Sample Tracking Purposes				
TCR Quarterly Sample Date(s):	*Jan - Mar Sample Date(s)*	*Apr - Jun Sample Date(s)*	*Jul - Sept Sample Date(s)*	*Oct - Dec Sample Date(s)*

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2934012 PWS NAME: GLEN HELEN OUTDOOR EDUCATION CENTER

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954617 FACILITY NAME: GLEN HELEN OUTDOOR ED CTR

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 3/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

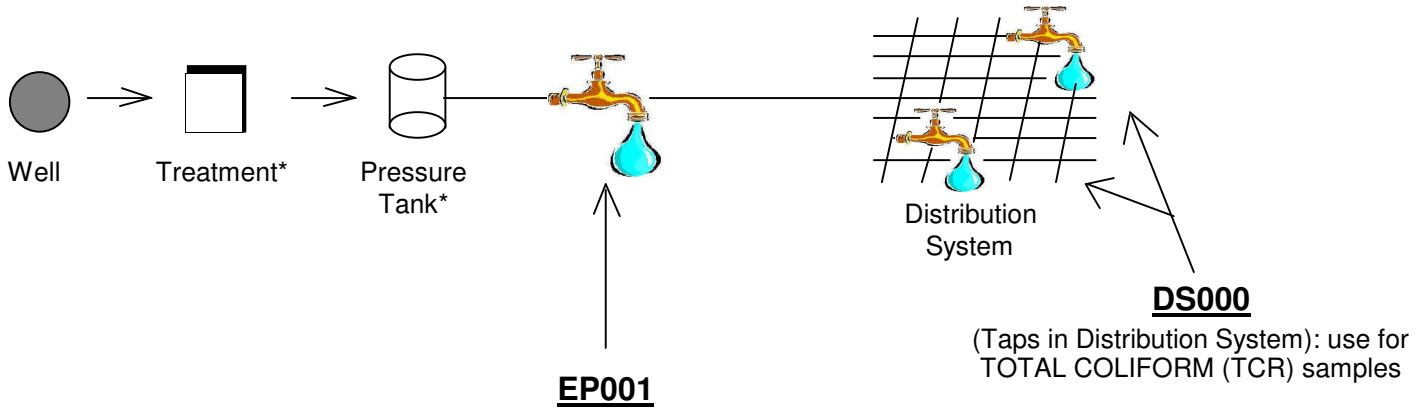

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2934112 PWS NAME: GREENE CO FISH AND GAME CLUBHOUSE PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2962123 FACILITY NAME: GREENE COUNTY FISH & GAME CLUBHOUSE

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

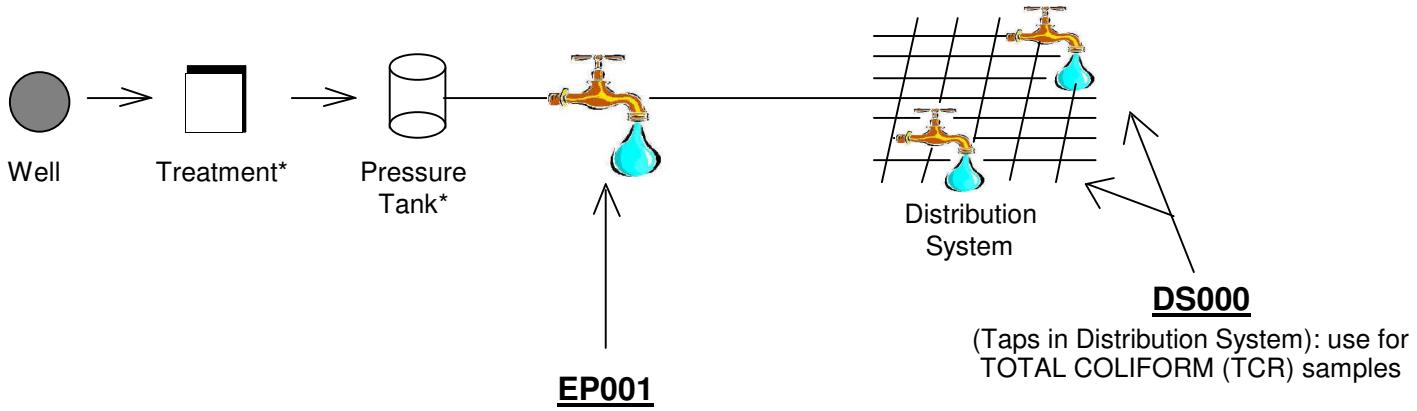

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2934412 PWS NAME: WOODYS BAR B Q PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954619 FACILITY NAME: WOODYS BAR B Q

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

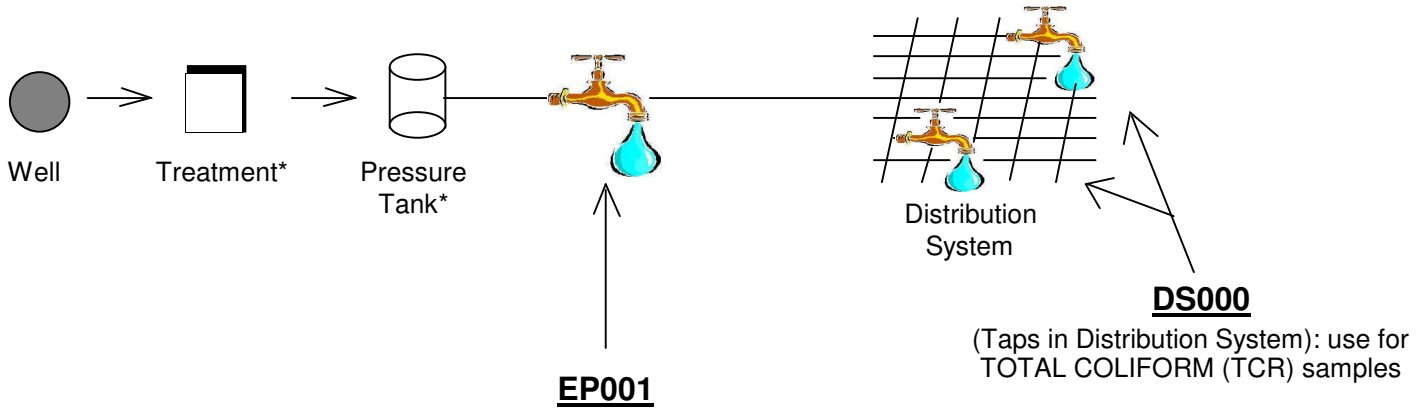

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2935012 PWS NAME: ODNR-JOHN BRYAN STATE PARK CAMPGROUND

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954621 FACILITY NAME: ODNR JOHN BRYAN STATE PARK CAMP

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 4/1/2011 and 10/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

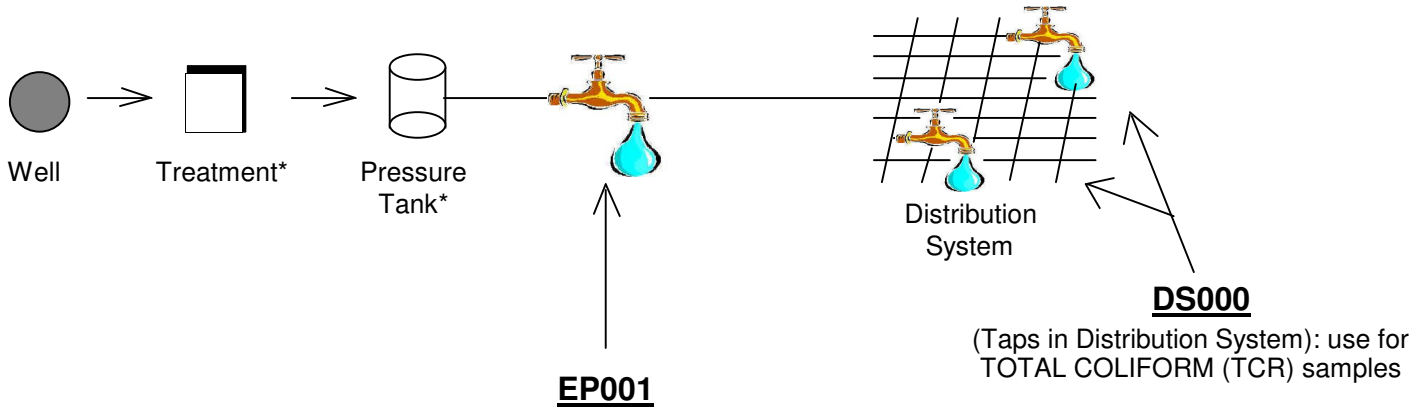

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2935812 PWS NAME: KNOLLWOOD TAVERN

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954623 FACILITY NAME: KNOLLWOOD TAVERN

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

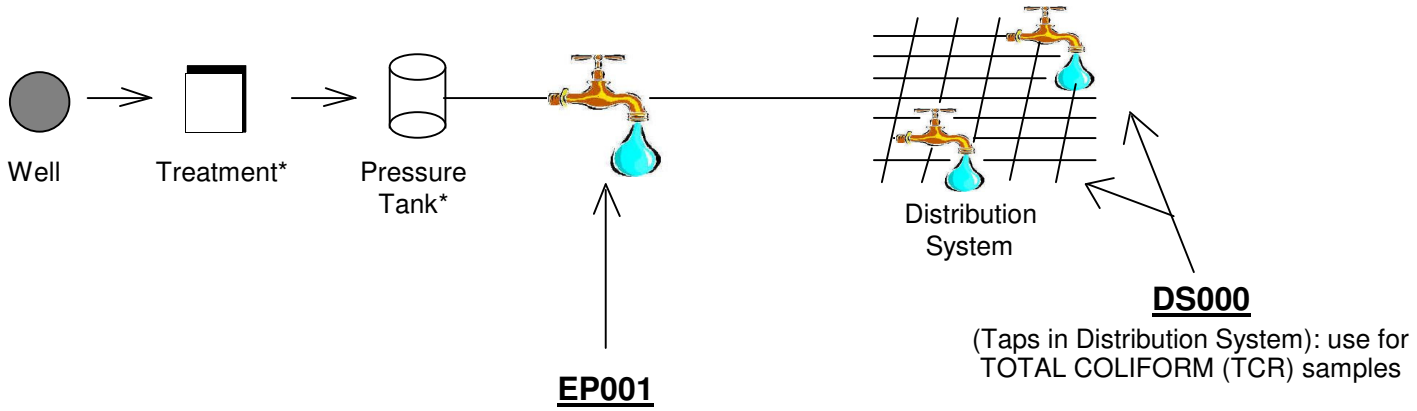

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2936312 PWS NAME: SANTA FE LOUNGE

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954625 FACILITY NAME: SANTA FE LOUNGE

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

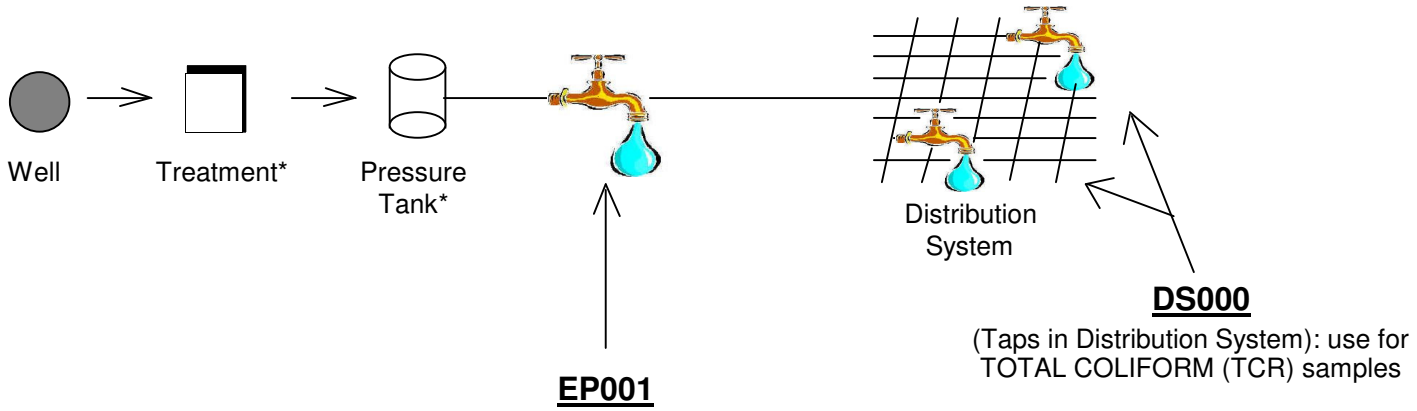

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2936912 PWS NAME: REMAX PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954626 FACILITY NAME: M & S AUTOMOTIVE

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

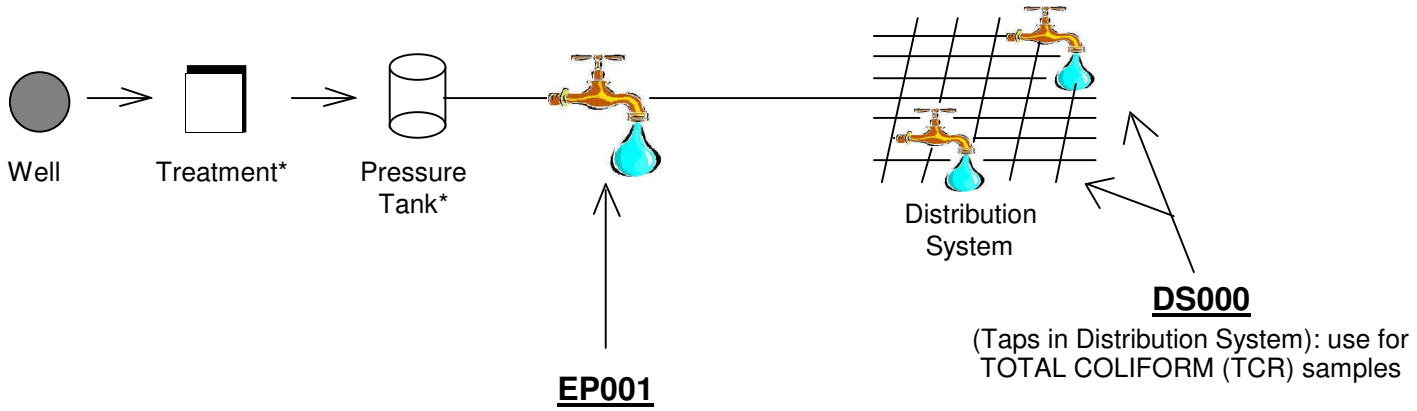

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2937612 PWS NAME: RAINBOW LAKE

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954629 FACILITY NAME: RAINBOW LAKE

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 3/1/2011 and 9/30/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

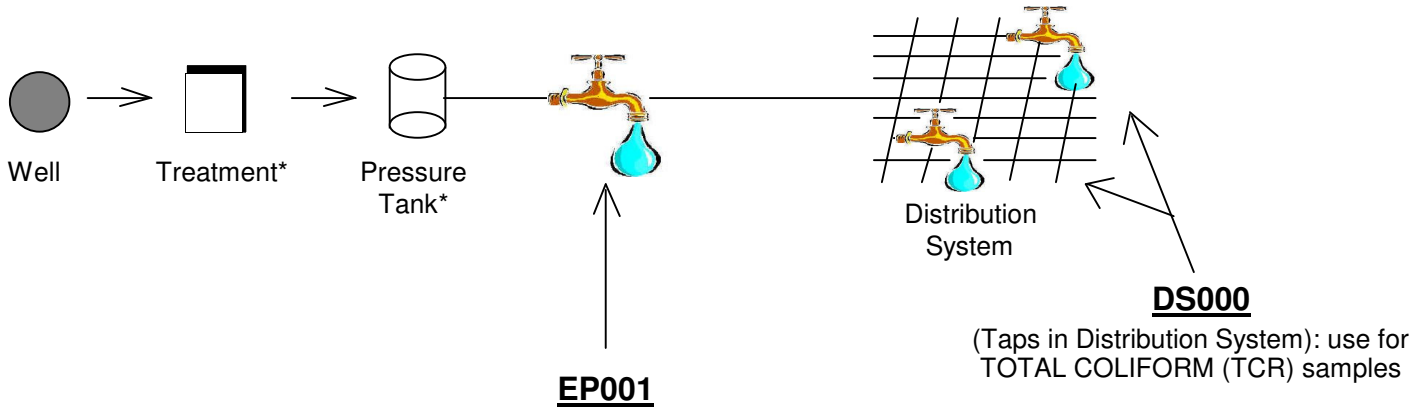

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2938412 PWS NAME: SKYBORN DRIVE-IN THEATER

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954630 FACILITY NAME: SKYBORN DRIVE-IN THEATER

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 5/1/2011 and 9/30/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

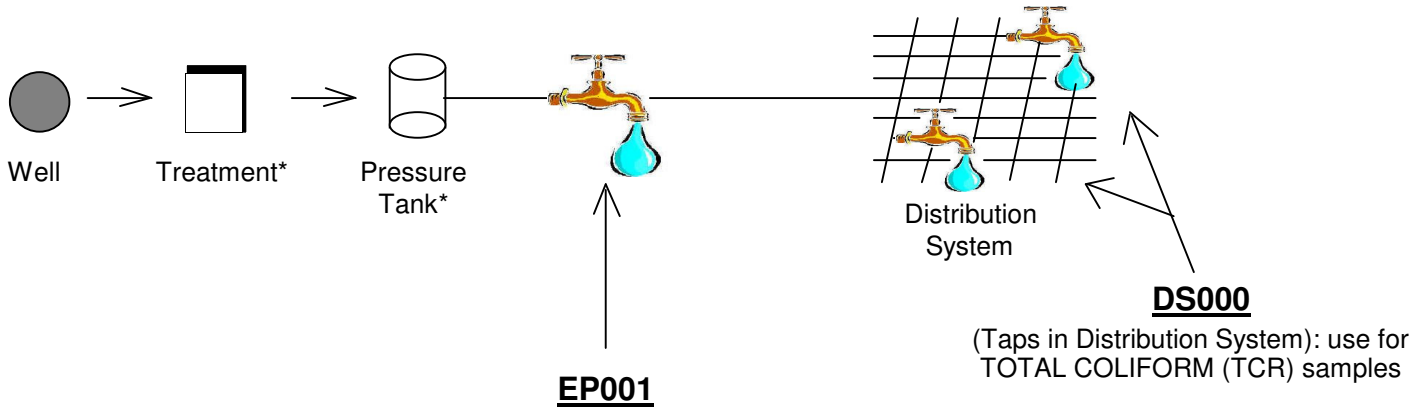

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2938512 PWS NAME: SKYBORN SKATELAND

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954631 FACILITY NAME: SKYBORN SKATELAND

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

Where to Collect Samples For a Small Public Water System

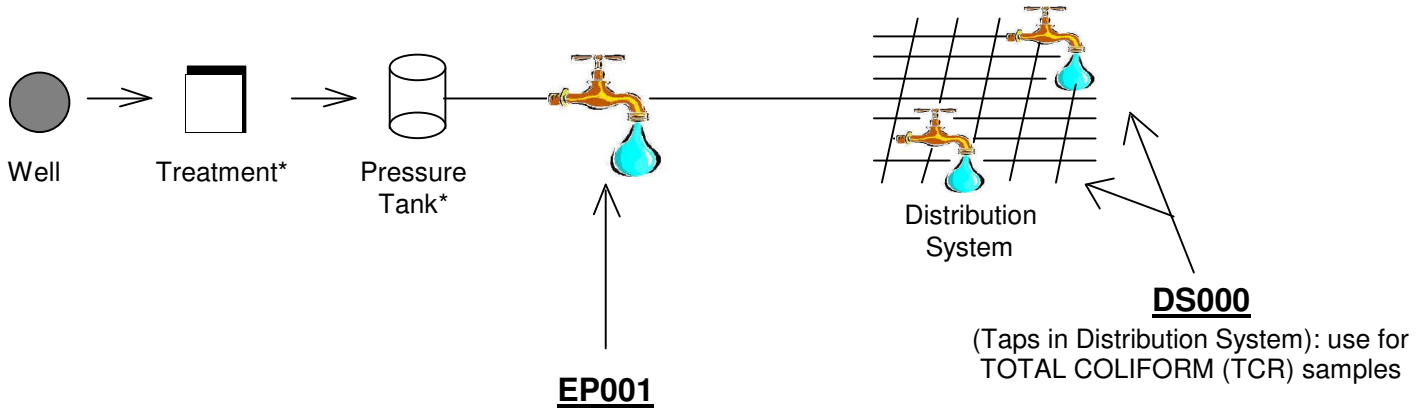

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes
Nitrate Sample Date(s):
Nitrite Sample Date(s):

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2939312 PWS NAME: XENIA CHRIST TEMPLE CHURCH

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954633 FACILITY NAME: XENIA CHRIST TEMPLE CHURCH

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

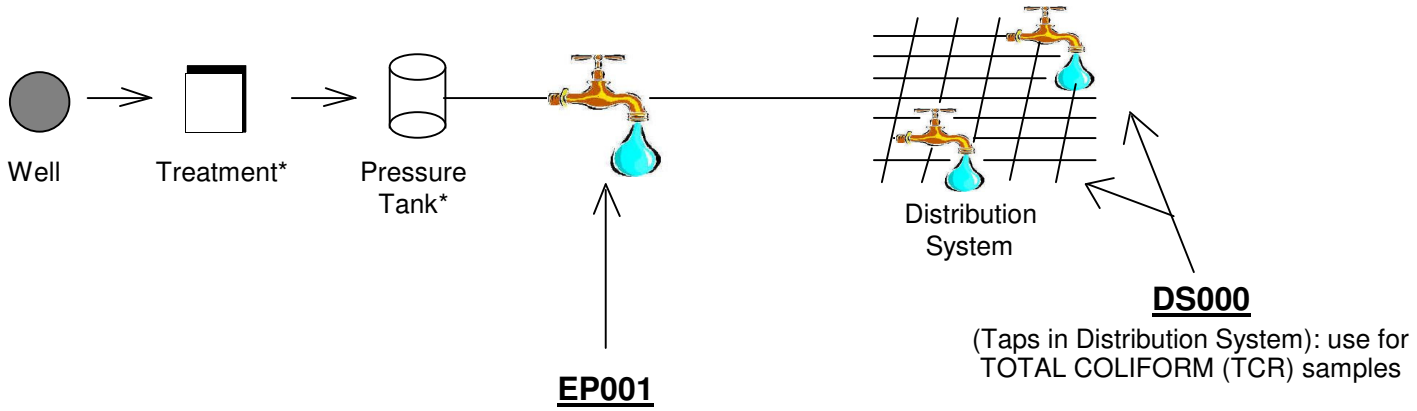

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2939612 PWS NAME: 4-H CAMP CLIFTON, INC.

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954634 FACILITY NAME: 4-H CAMP CLIFTON INC

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) Quarterly	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 6/1/2011 and 8/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

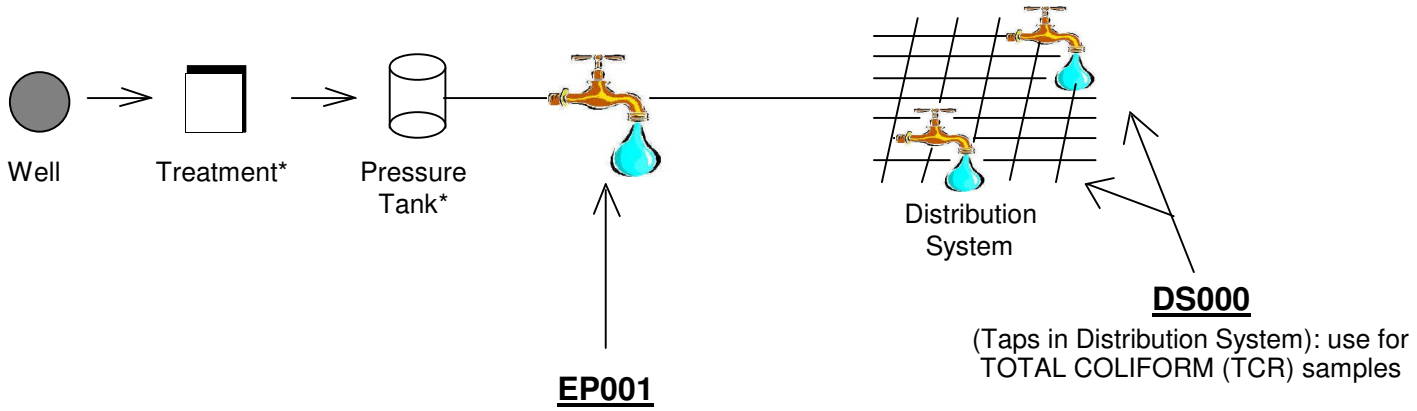

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2940312 PWS NAME: BOY SCOUTS-CAMP BIRCH 1 PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954635 FACILITY NAME: BOY SCOUTS CAMP BIRCH NO 1

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

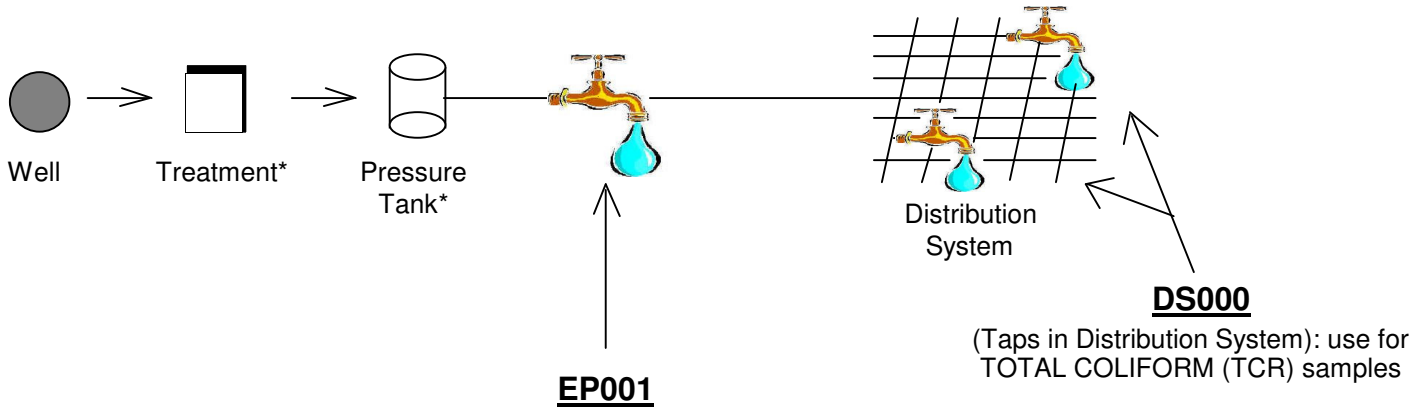

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2940322 PWS NAME: BOY SCOUTS-CAMP BIRCH 2 PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954636 FACILITY NAME: BOY SCOUTS CAMP BIRCH NO 2

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

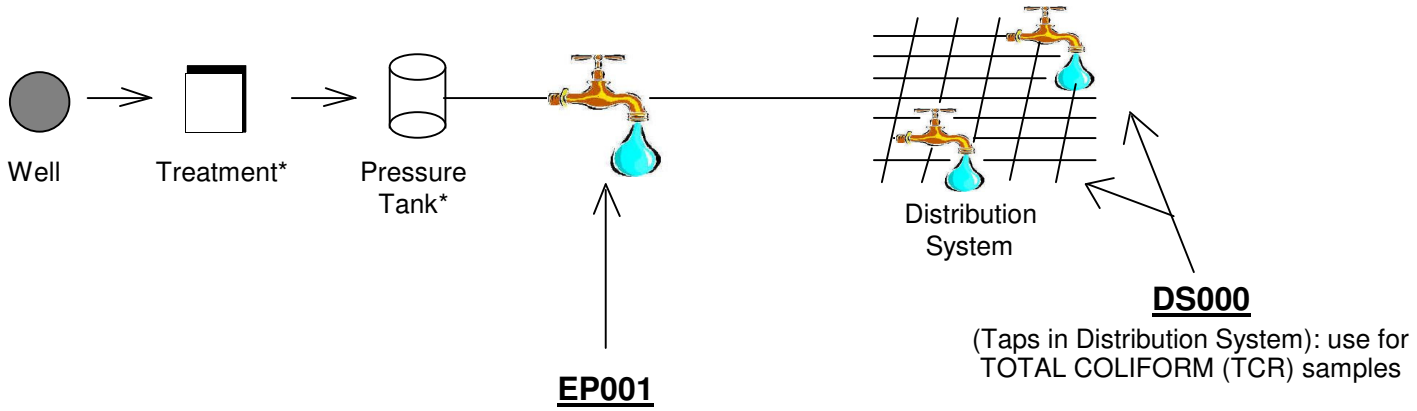

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2940712 PWS NAME: CLIFTON MILLS, INC.

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954638 FACILITY NAME: CLIFTON MILLS INC

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

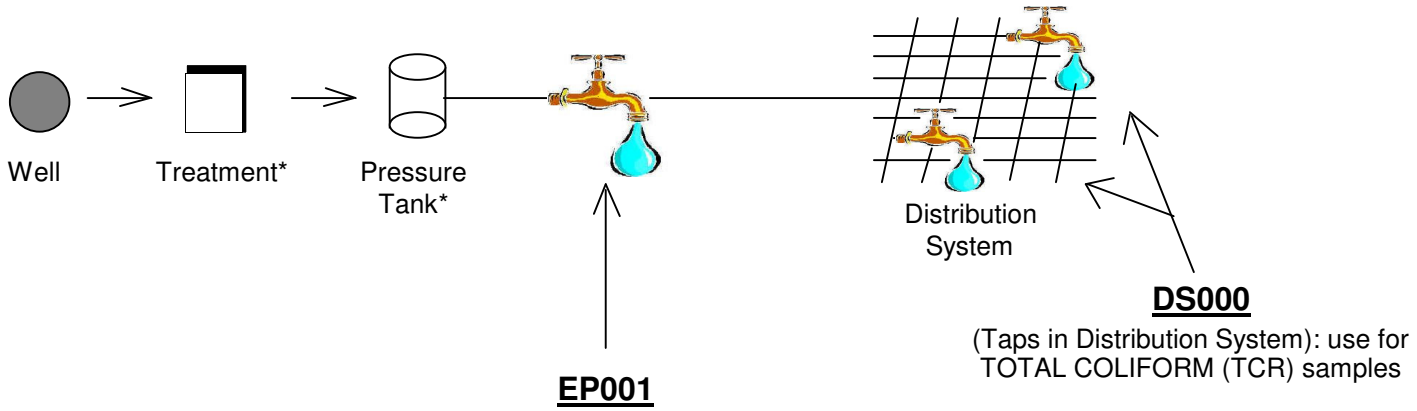

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2940912 PWS NAME: COUNTY LINE BAPTIST CHURCH

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954639 FACILITY NAME: COUNTY LINE BAPTIST CHURCH

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

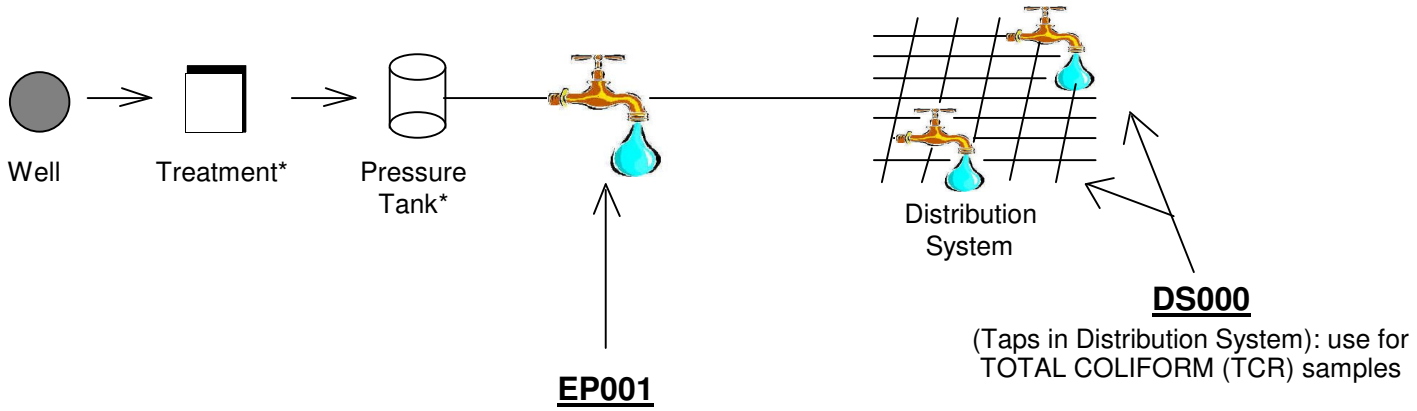

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2941212 PWS NAME: FELLOWSHIP TABERNACLE CHURCH

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954640 FACILITY NAME: FELLOWSHIP TABERNACLE CHURCH

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

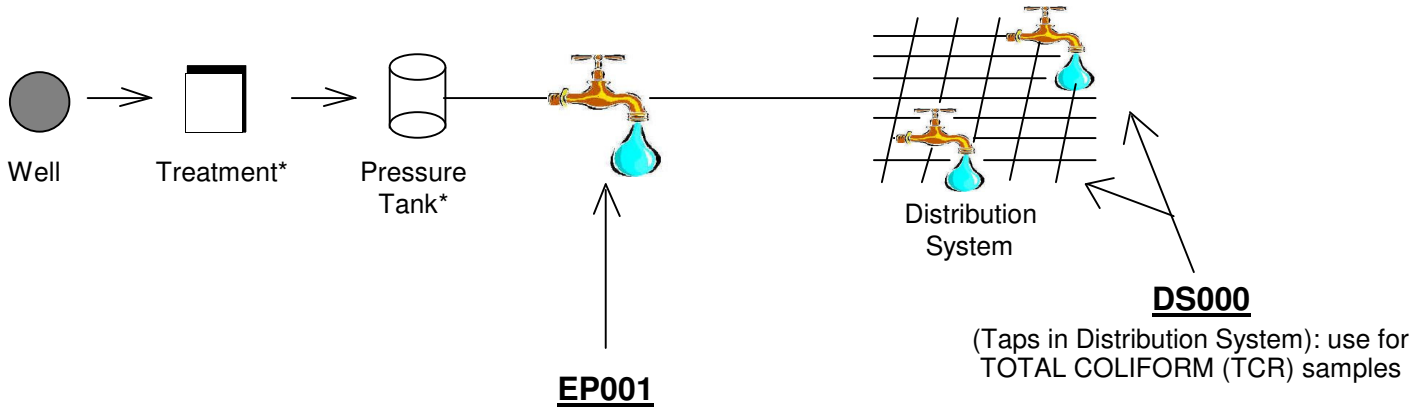

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2941412 PWS NAME: GRAPE GROVE CHURCH OF CHRIST PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954641 FACILITY NAME: GRAPE GROVE CHURCH OF CHRIST

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

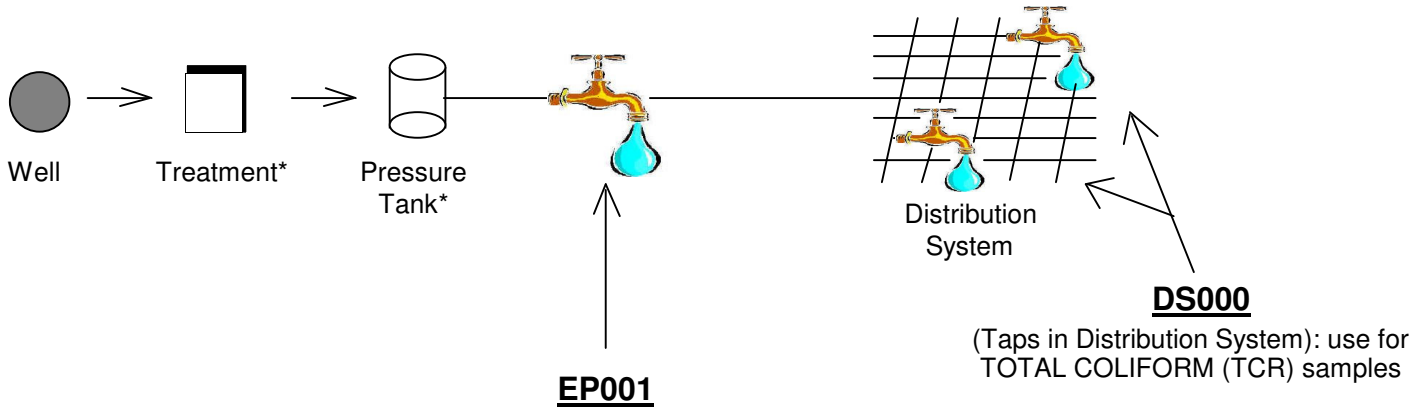

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH2941912 PWS NAME: KIDDIE KINGDOM

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: EP001

STATE FACILITY ID: 2954644 FACILITY NAME: KIDDIE KINGDOM

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRATE	NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011
NITRITE	NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011
VOLATILE ORGANIC CHEMICALS (VOC)		1 Sample(s) between 6/1/2011 and 10/31/2011
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 2954644. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
INORGANIC Sample Date(s):
NITRATE Sample Date(s):
NITRITE Sample Date(s):
VOC Sample Date(s):

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH2941912 PWS NAME: KIDDIE KINGDOM

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: KIDDIE KINGDOM DISTRIBUTION

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	Not Required
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

Use for Sample Tracking Purposes				
TCR Quarterly Sample Date(s):	*Jan - Mar Sample Date(s)*	*Apr - Jun Sample Date(s)*	*Jul - Sept Sample Date(s)*	*Oct - Dec Sample Date(s)*

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2942312 PWS NAME: SHAWNEE HILLS BAPTIST CHURCH

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954646 FACILITY NAME: SHAWNEE HILLS BAPTIST CHURCH

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

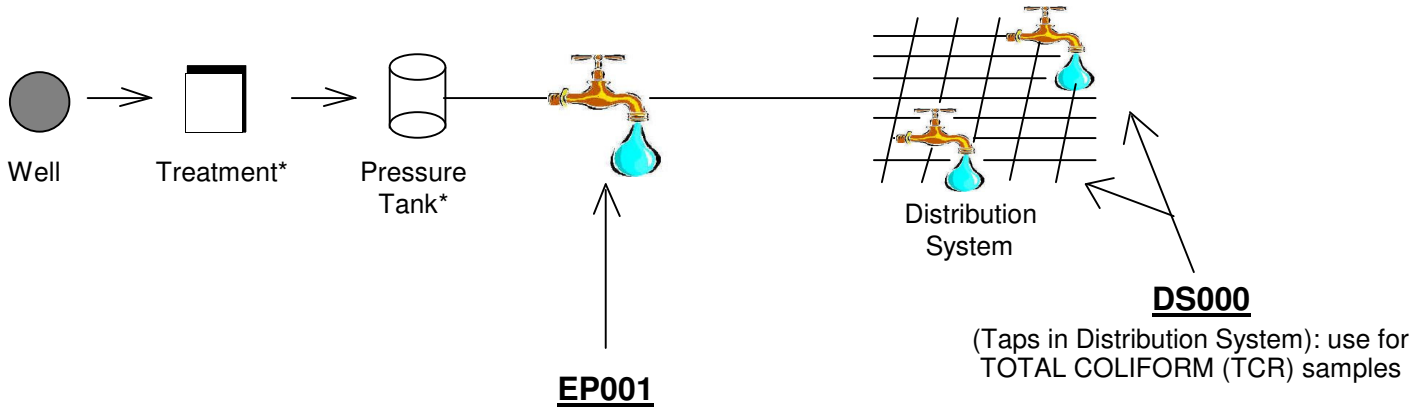

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2943112 PWS NAME: GRACE BAPTIST CHURCH

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954649 FACILITY NAME: GRACE BAPTIST CHURCH

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

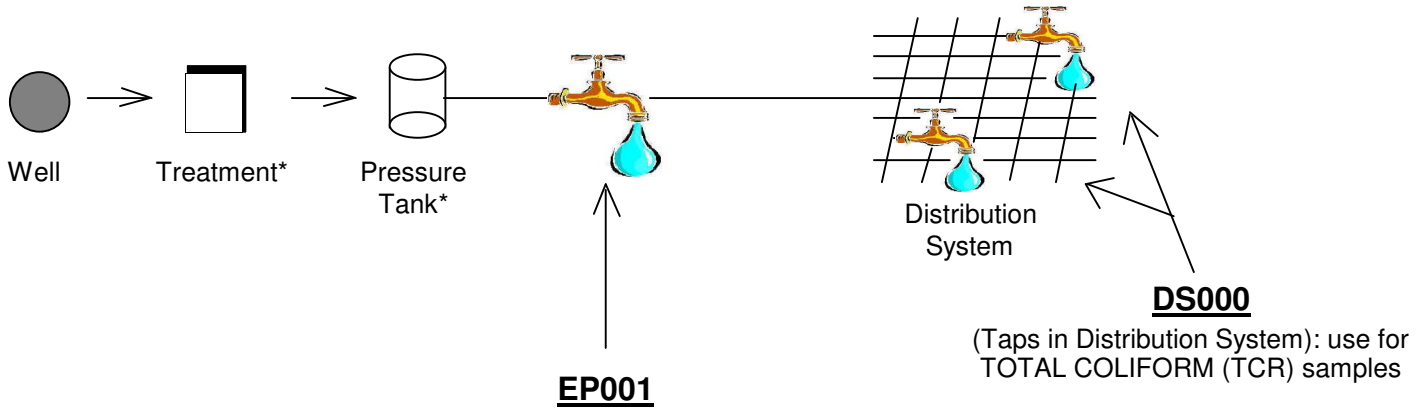

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2943712 PWS NAME: WOODHAVEN SWIM AND TENNIS CLUB, INC

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954653 FACILITY NAME: WOODHAVEN SWIM CLUB INC

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 6/1/2011 and 9/30/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

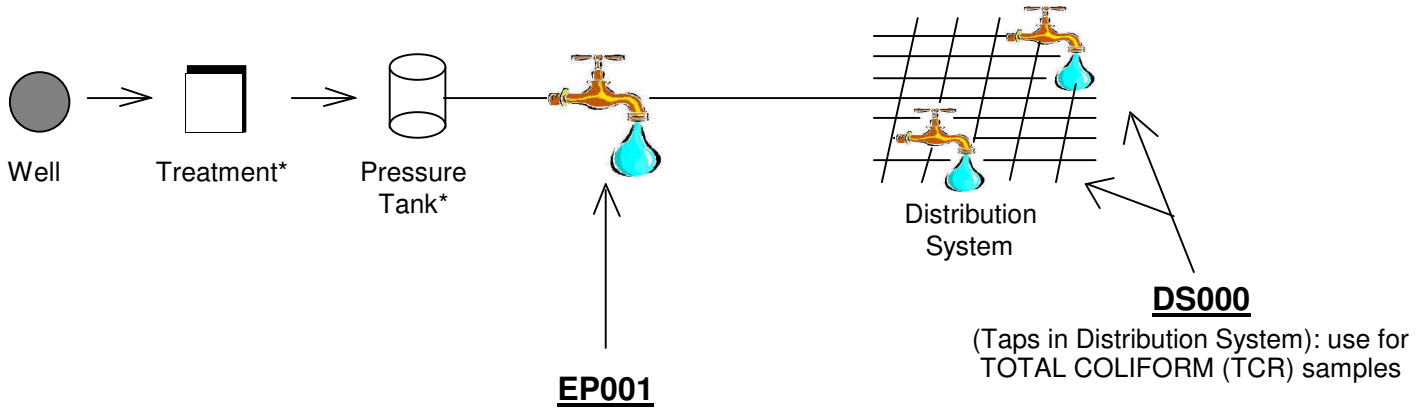

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2944912 PWS NAME: W.O. WRIGHTS PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954656 FACILITY NAME: WO WRIGHTS

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

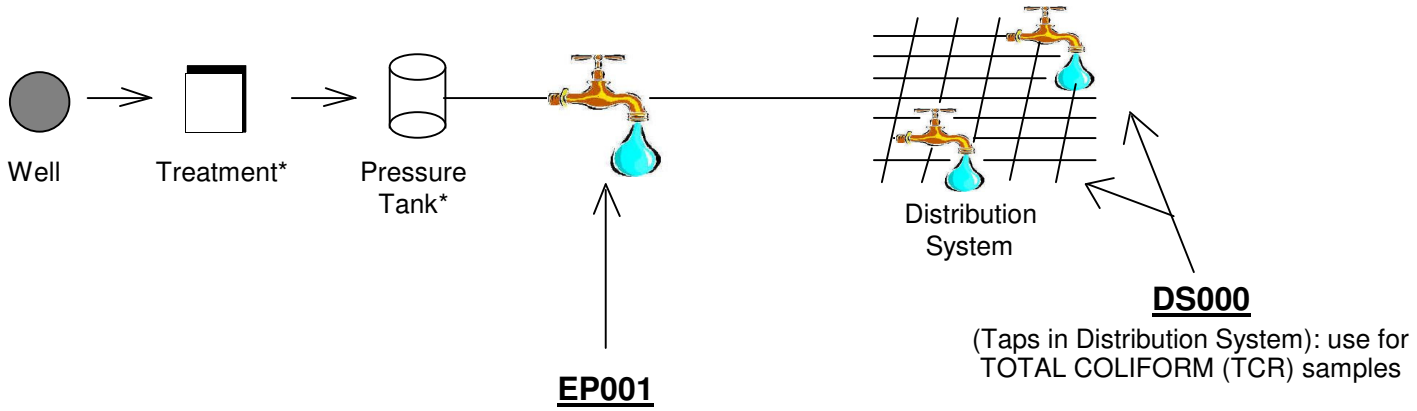

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2945712 PWS NAME: CAMP CLIFTON DAY CAMP

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954657 FACILITY NAME: CAMP CLIFTON DAY CAMP

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) Quarterly	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 4/1/2011 and 9/30/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

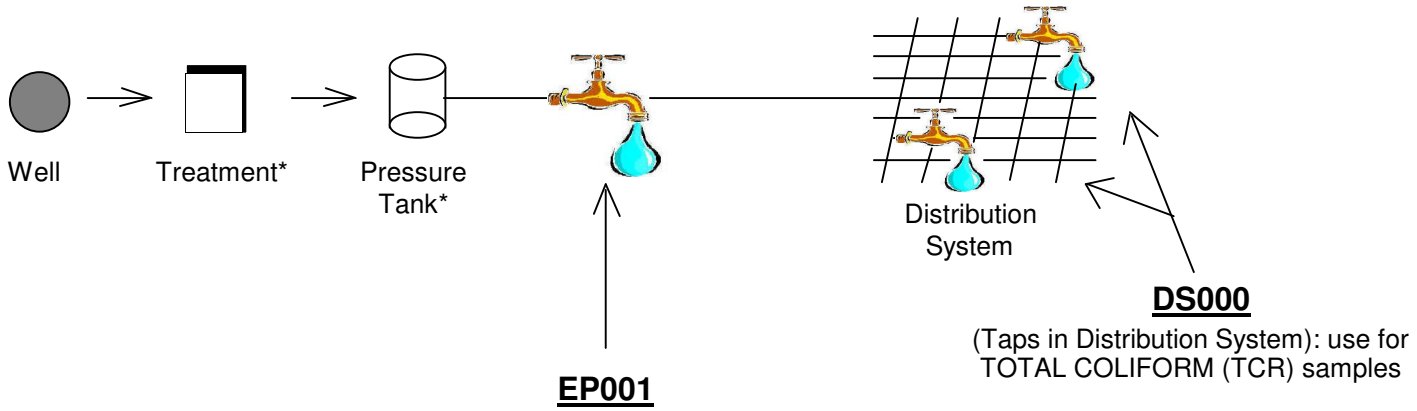

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2946912 PWS NAME: LIBERTY WORSHIP CENTER CHURCH OF GOD

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954660 FACILITY NAME: LIBERTY WORSHIP CENTER CHURCH OF GOD

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 3/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

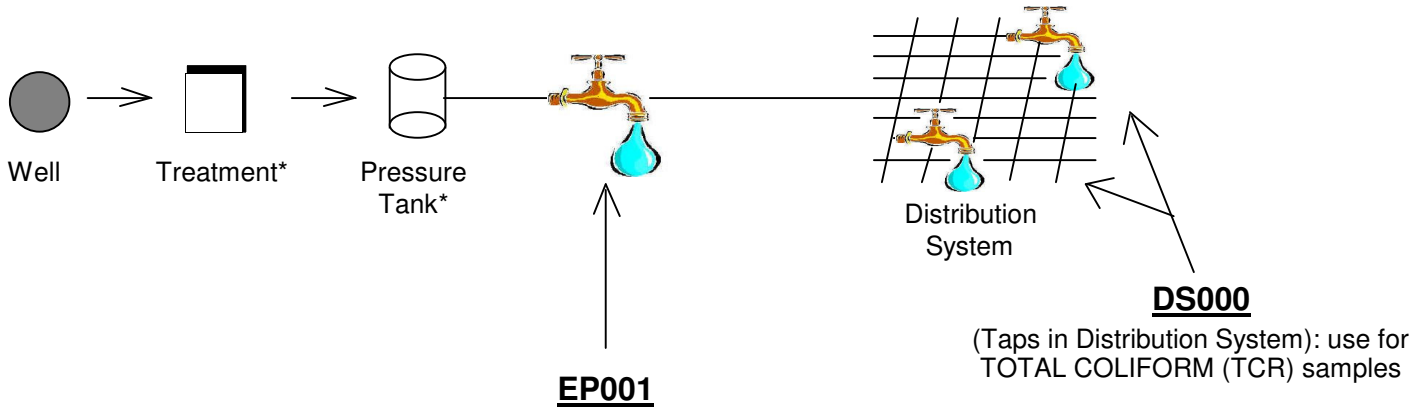

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2947212 PWS NAME: GRACE COVENANT CHURCH

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954661 FACILITY NAME: GRACE COVENANT CHURCH

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

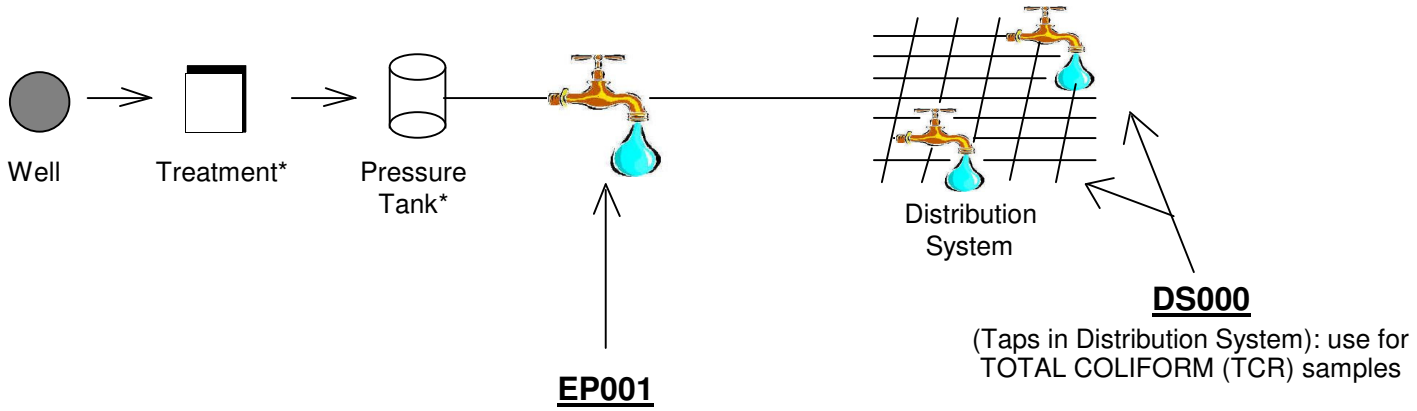

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2947612 PWS NAME: GRACE CHRISTIAN CENTER

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954662 FACILITY NAME: GRACE CHRISTIAN CENTER

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

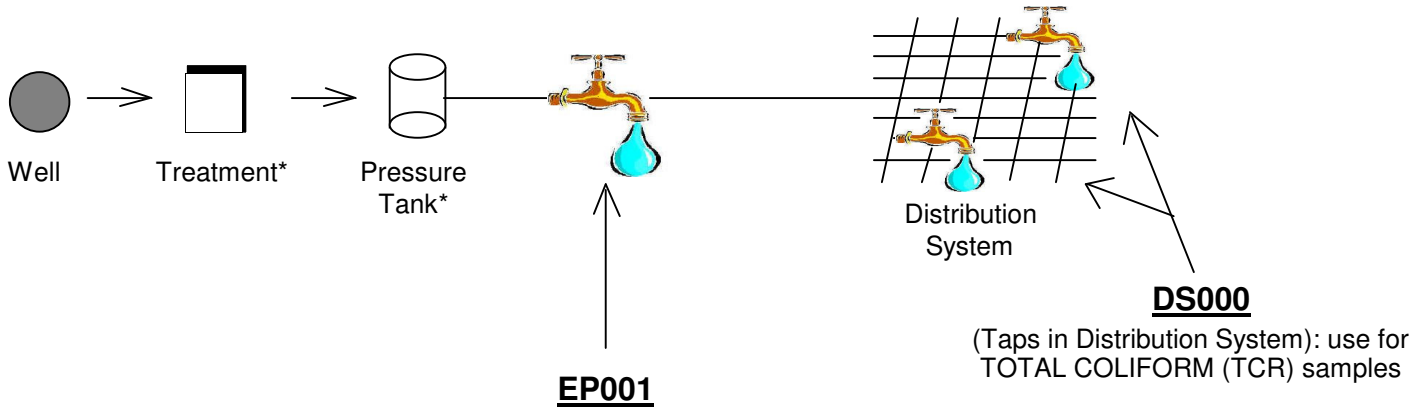

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2948312 PWS NAME: GREENE VALLEY RECREATION

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954664 FACILITY NAME: GREENE VALLEY RECREATION CLUB

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 5/1/2011 and 9/30/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

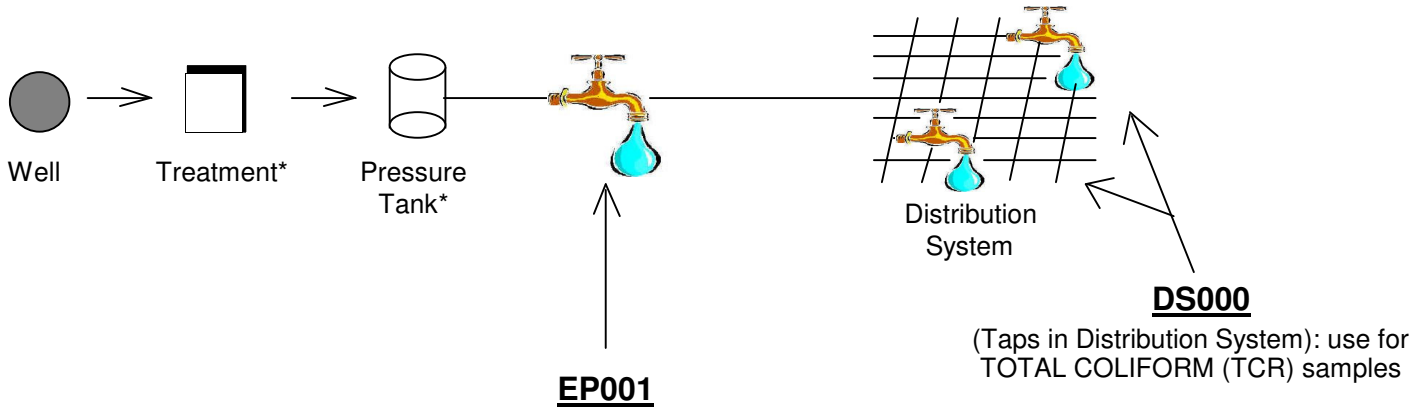

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2948512 PWS NAME: GREENE COUNTRY CLUB LLC

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954666 FACILITY NAME: GREENE COUNTRY CLUB

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

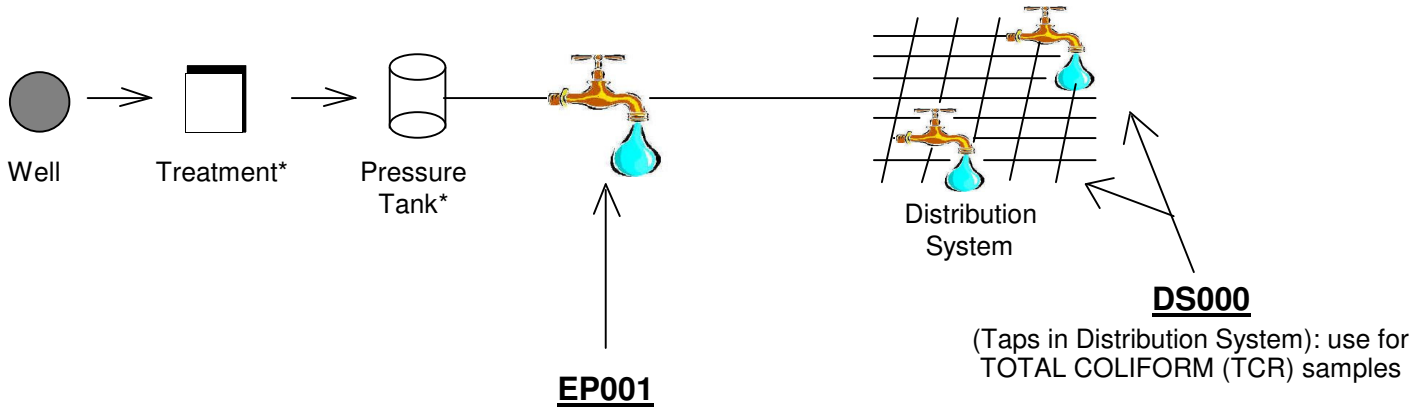

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2949112 PWS NAME: KIL-KARE INCORPORATED 1

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954667 FACILITY NAME: KIL-KARE INC NO 1

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 4/1/2011 and 11/30/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

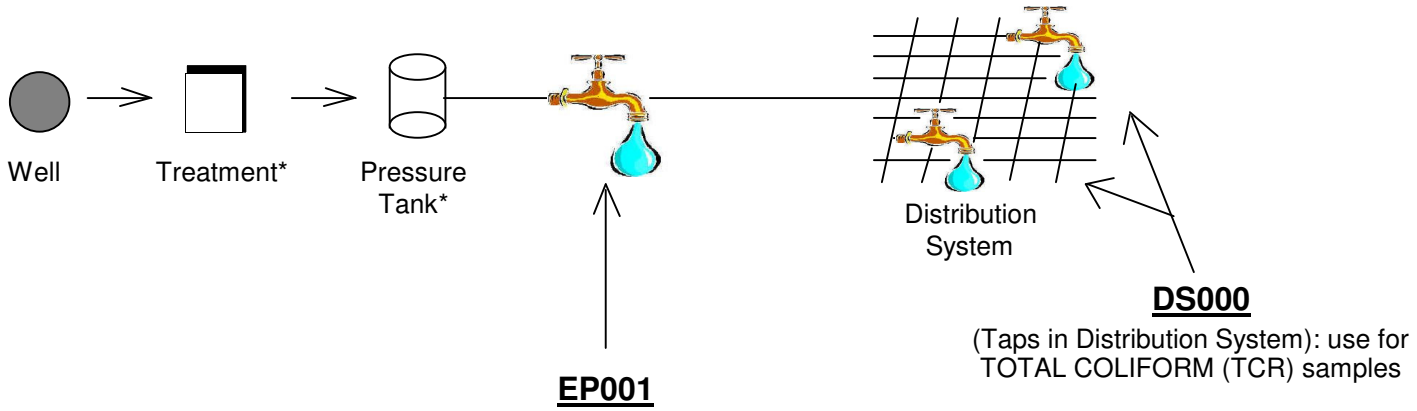

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2949712 PWS NAME: KNOLLWOOD FLOWERS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954669 FACILITY NAME: KNOLLWOOD FLORISTS INC

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

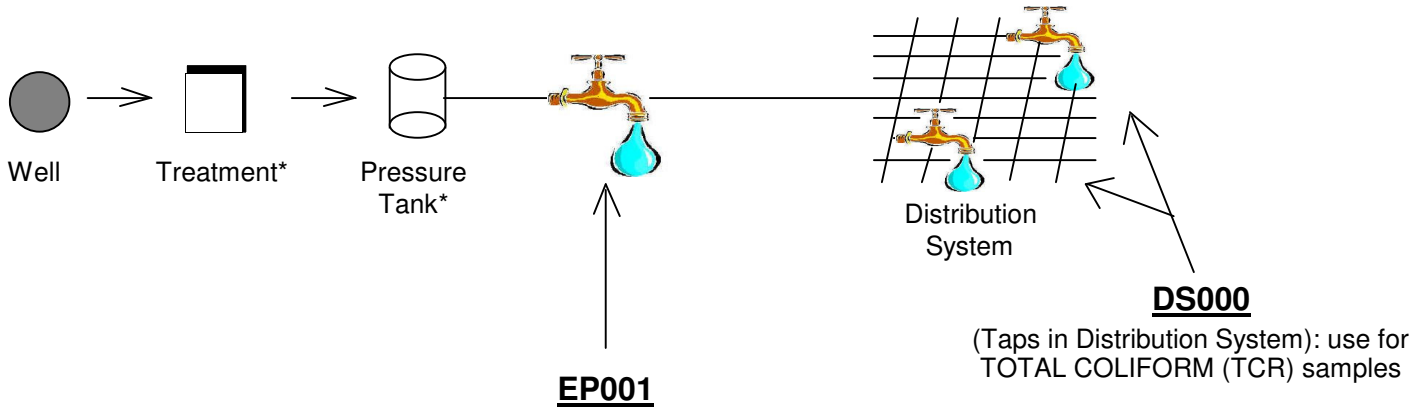

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2950212 PWS NAME: MOMS KOUNTRY KITCHEN

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954670 FACILITY NAME: MOMS KOUNTRY KITCHEN

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 4/1/2011 and 6/30/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

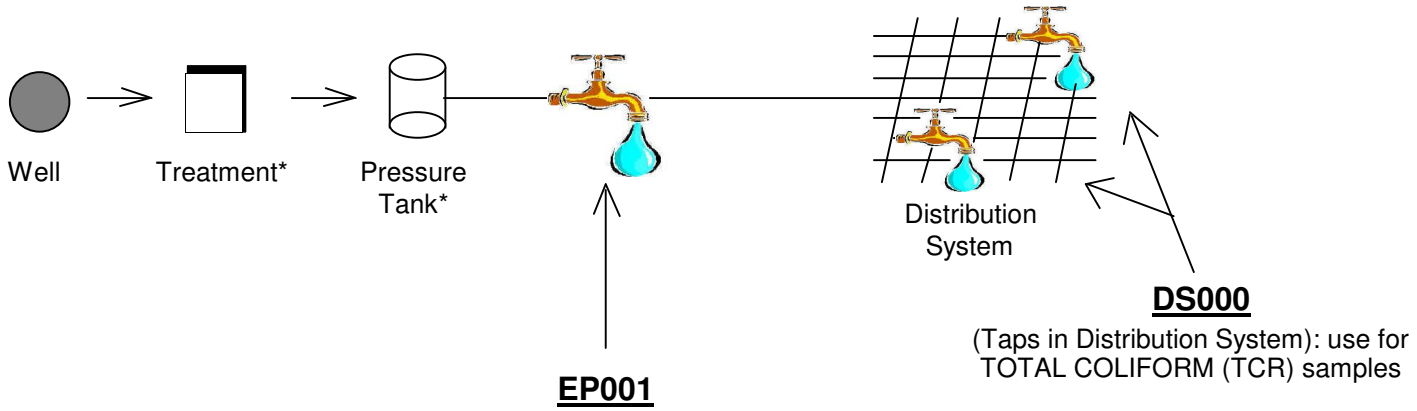

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2950312 PWS NAME: MOOSE LODGE 73

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954671 FACILITY NAME: MOOSE LODGE 73

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

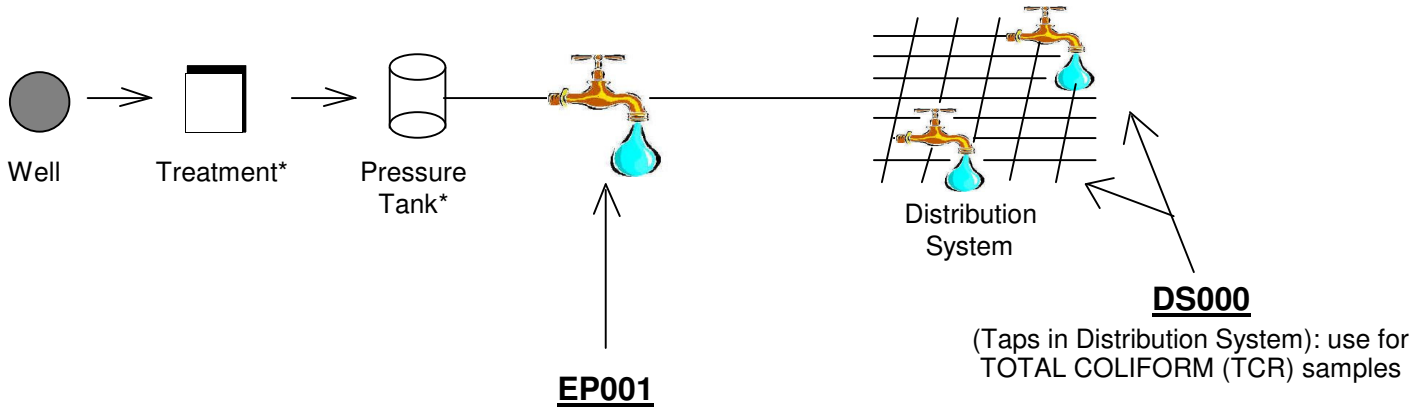

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2950712 PWS NAME: ODNR-JOHN BRYAN STATE PARK 2 PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954672 FACILITY NAME: ODNR JOHN BRYAN STATE PARK NO 2

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 4/1/2011 and 9/30/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

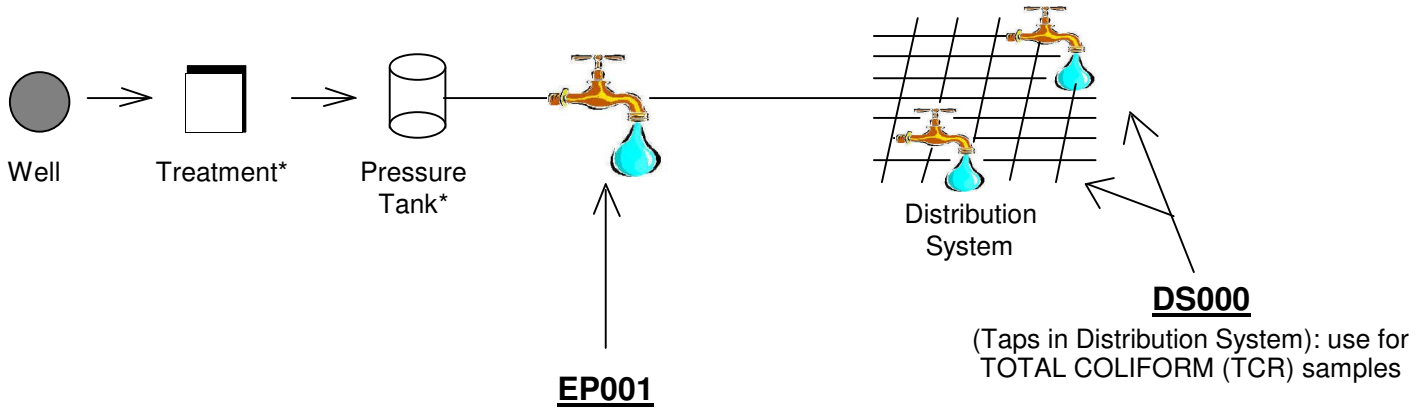

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2951312 PWS NAME: BELLBROOK-SUGARCREEK COMMUNITY CENTER

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954675 FACILITY NAME: BELLBROOK-SUGARCREEK COMM CTR

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

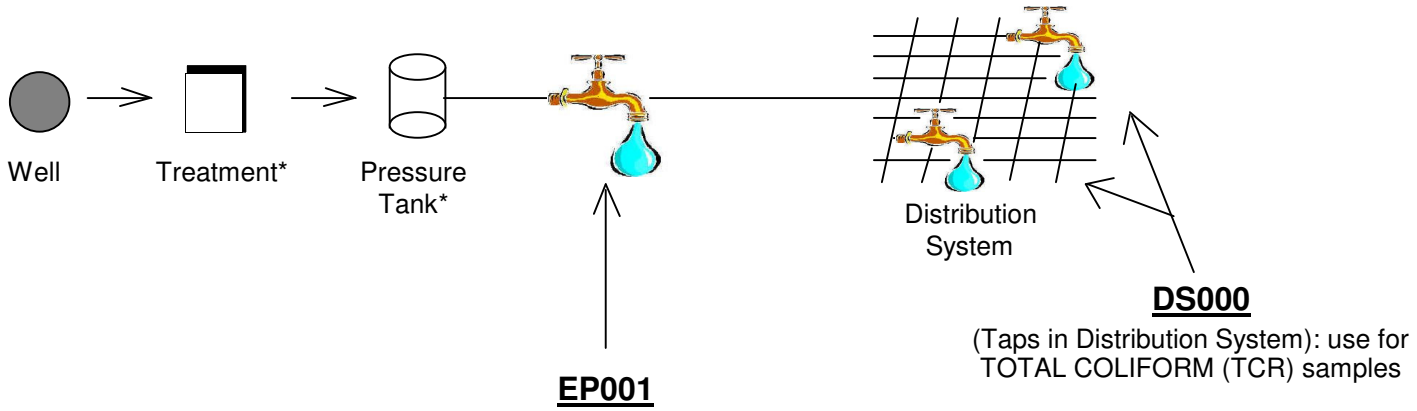

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2952512 PWS NAME: SUGAR VALLEY COUNTRY CLUB

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954677 FACILITY NAME: SUGAR VALLEY C.C. - CLUBHOUSE

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

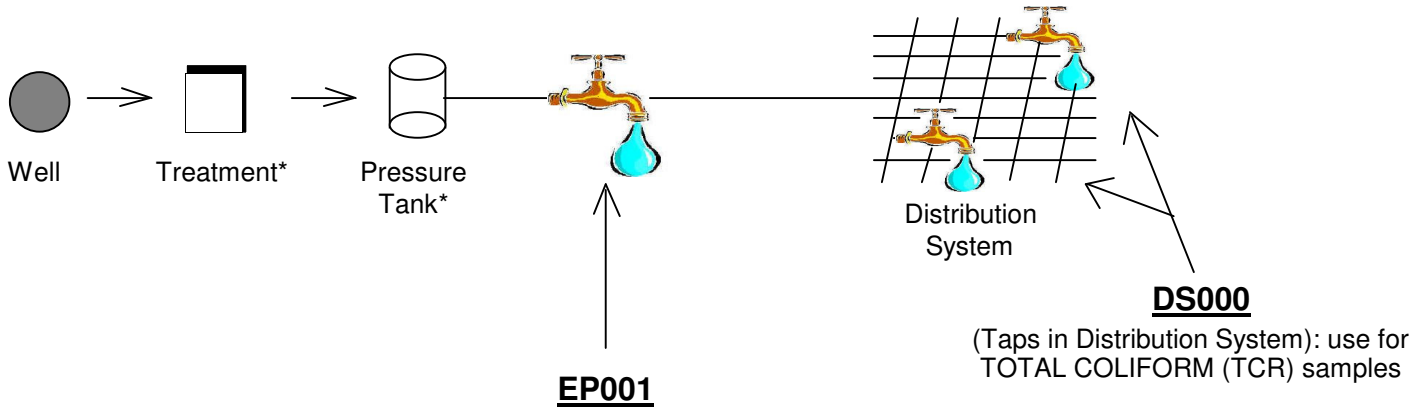

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH2954912 PWS NAME: HOMECROFT, INC. PWS

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: EP001

STATE FACILITY ID: 2954691 FACILITY NAME: HOMECROFT INC

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRATE	NITRATE - 1040	1 Sample(s) between 4/1/2011 and 6/30/2011
NITRITE	NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011
VOLATILE ORGANIC CHEMICALS (VOC)		1 Sample(s) between 6/1/2011 and 10/31/2011
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 2 List Below	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 4 List Below	1 Sample(s) between 4/1/2011 and 6/30/2011
SYNTHETIC ORGANIC CHEMICALS (SOC)	TOTAL POLYCHLORINATED BIPHENYLS (PCB) - 2383	1 Sample(s) between 4/1/2011 and 6/30/2011

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 2954691. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

SOC Group 2 Chemicals: CARBOFURAN - 2046, OXAMYL (VYDATE) - 2036, PICLORAM - 2040, 2,4-D - 2105, PENTACHLOROPHENOL - 2326

SOC Group 4 Chemicals: BENZO (A) PYRENE - 2306, ENDOTHALL - 2033, DI(2-ETHYLHEXYL) - ADIPATE - 2035, DI(2-ETHYLHEXYL) - PHTHALATE - 2039

Use for Sample Tracking Purposes
INORGANIC Sample Date(s):
NITRATE Sample Date(s):
NITRITE Sample Date(s):
VOC Sample Date(s):
SOC Group 4 Sample Date(s):

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH2954912 PWS NAME: HOMECROFT, INC. PWS

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: HOMECROFT, INC. DISTRIBUTION

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	5 Sample(s) between 6/1/2011 and 9/30/2011
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

Use for Sample Tracking Purposes				
Lead & Copper Sample Date(s):				
TCR Quarterly Sample Date(s):	*Jan - Mar Sample Date(s)*	*Apr - Jun Sample Date(s)*	*Jul - Sept Sample Date(s)*	*Oct - Dec Sample Date(s)*

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH2955112 PWS NAME: DAYTON POWER AND LIGHT CO

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: EP001

STATE FACILITY ID: 2954693 FACILITY NAME: DAYTON POWER & LIGHT CO XENIA SERV BLDG

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	1 Sample(s) between 6/1/2011 and 10/31/2011
ARSENIC	ARSENIC - 1005	1 Sample(s) Quarterly
NITRATE	NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011
NITRITE	NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011
VOLATILE ORGANIC CHEMICALS (VOC)		1 Sample(s) between 6/1/2011 and 10/31/2011
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 2954693. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

INORGANIC Chemicals: ANTIMONY - 1074, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes				
INORGANIC Sample Date(s):				
ARSENIC Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)
NITRATE Sample Date(s):				
NITRITE Sample Date(s):				
VOC Sample Date(s):				

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH2955112 PWS NAME: DAYTON POWER AND LIGHT CO

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: DAYTON POWER & LIGHT CO DISTRIBUTION

Groundwater Rule Substantial Treatment System

Effective Date: 1/19/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	5 Sample(s) between 6/1/2011 and 9/30/2011
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** 1 Sample(s) between 7/1/2011 and 9/30/2011
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period.

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes				
Lead & Copper Sample Date(s):				
HAA5 & TTHM Sample Date(s):				
TCR Quarterly Sample Date(s):	*Jan - Mar Sample Date(s)*	*Apr - Jun Sample Date(s)*	*Jul - Sept Sample Date(s)*	*Oct - Dec Sample Date(s)*
Total Chlorine Sample Date(s):				

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2955812 PWS NAME: D & K MARKET

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954695 FACILITY NAME: D & K MARKET

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

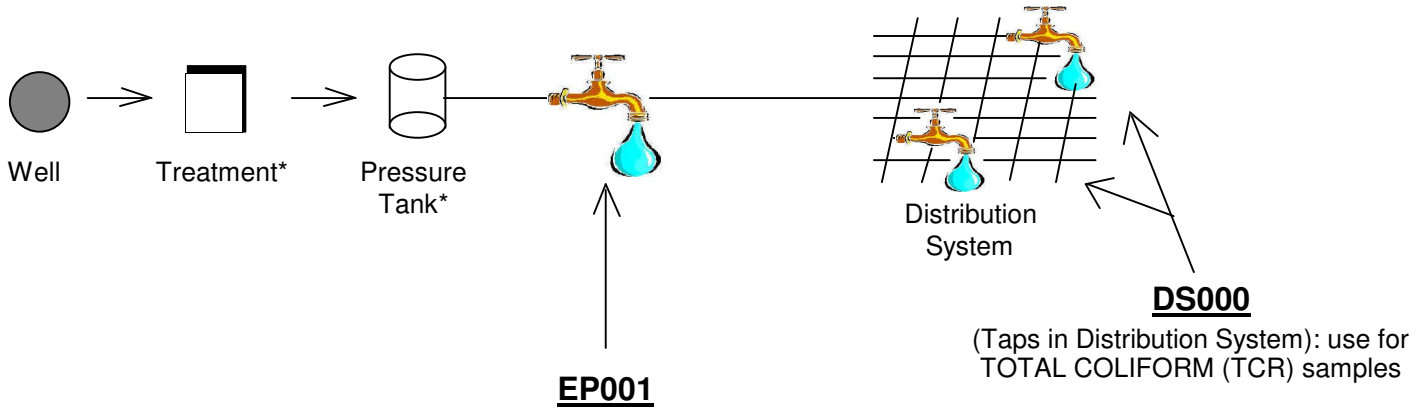

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2956012 PWS NAME: FREEDOM BAPTIST TEMPLE

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954697 FACILITY NAME: FREEDOM BAPTIST TEMPLE

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

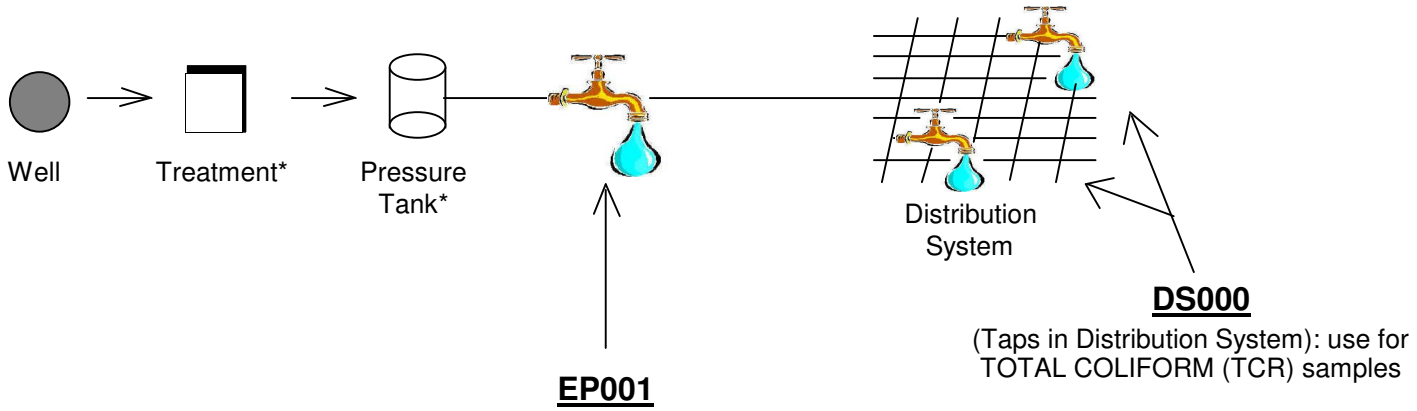

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2956112 PWS NAME: KINGDOM HALL JEHOVAHS PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954698 FACILITY NAME: KINGDOM HALL JEHOVAH WITNESSES

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

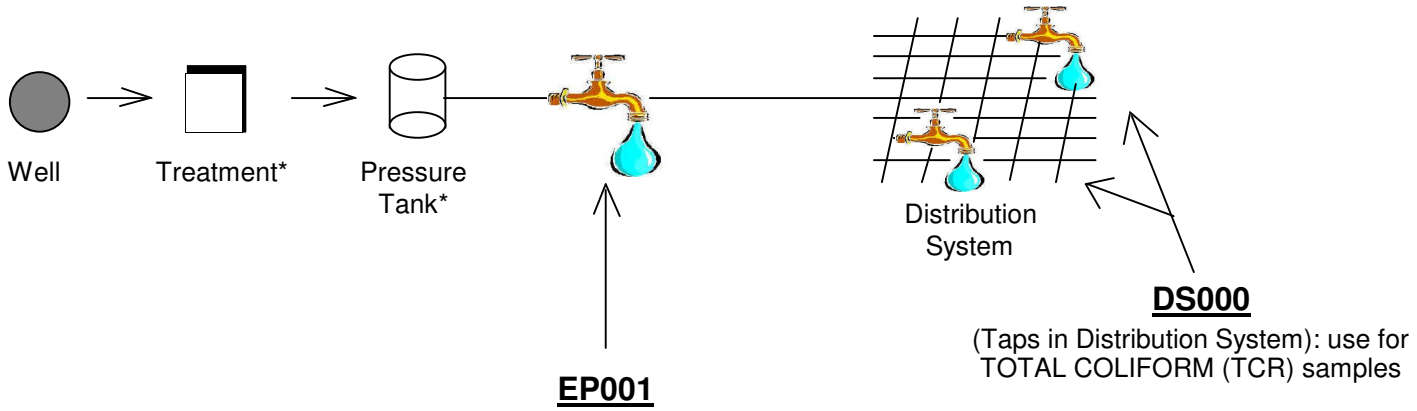

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH2956203 PWS NAME: GREENE COUNTY - FAIRBORN

PWS TYPE: Community SOURCE: Purchased Ground Water Sample Monitoring Point: DS000

FACILITY NAME: GREENE COUNTY - FAIRBORN DISTRIBUTION

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	5 Sample(s) between 6/1/2011 and 9/30/2011
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Monthly between 1/1/2011 and 12/31/2011
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
Lead & Copper Sample Date(s):												
TCR Monthly Sample Date(s):	*Jan*	*Feb*	*Mar*	*Apr*	*May*	*Jun*	*Jul*	*Aug*	*Sept*	*Oct*	*Nov*	*Dec*
Total Chlorine Sample Date(s):												

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2956312 PWS NAME: KIL-KARE INCORPORATED 2

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954700 FACILITY NAME: KIL-KARE INC NO 2

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 4/1/2011 and 11/30/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

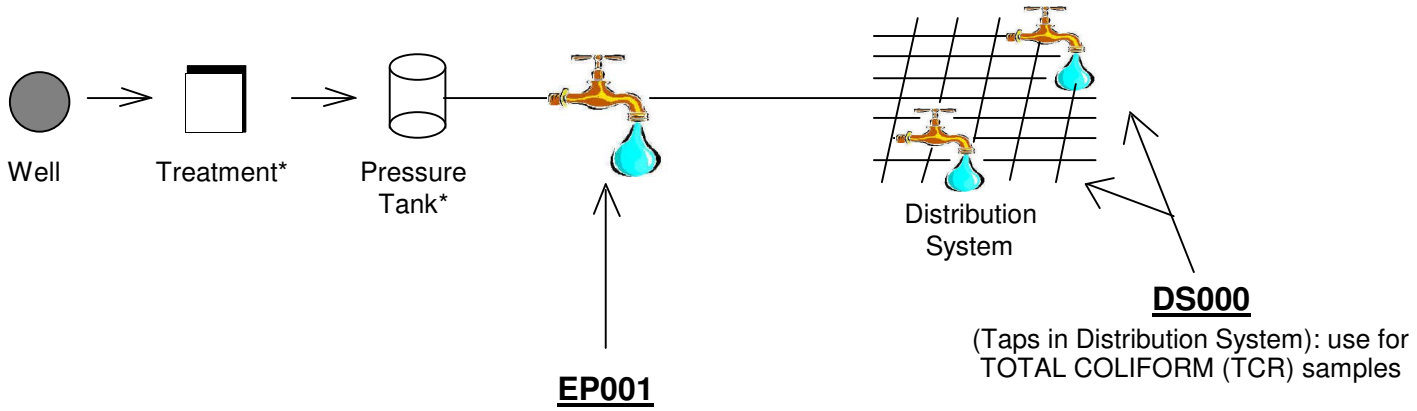

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2956512 PWS NAME: CHURCH OF JESUS CHRIST-FAIRBORN PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954702 FACILITY NAME: CHURCH OF JESUS CHRIST FAIRBORN

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

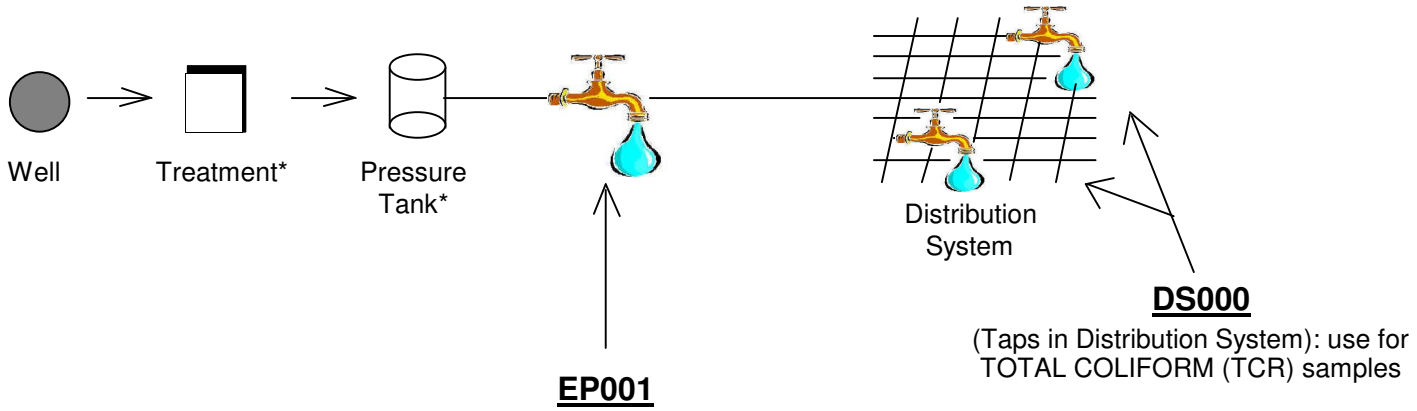

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2956712 PWS NAME: SPORTS PLEX

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954703 FACILITY NAME: SPORTS PLEX

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

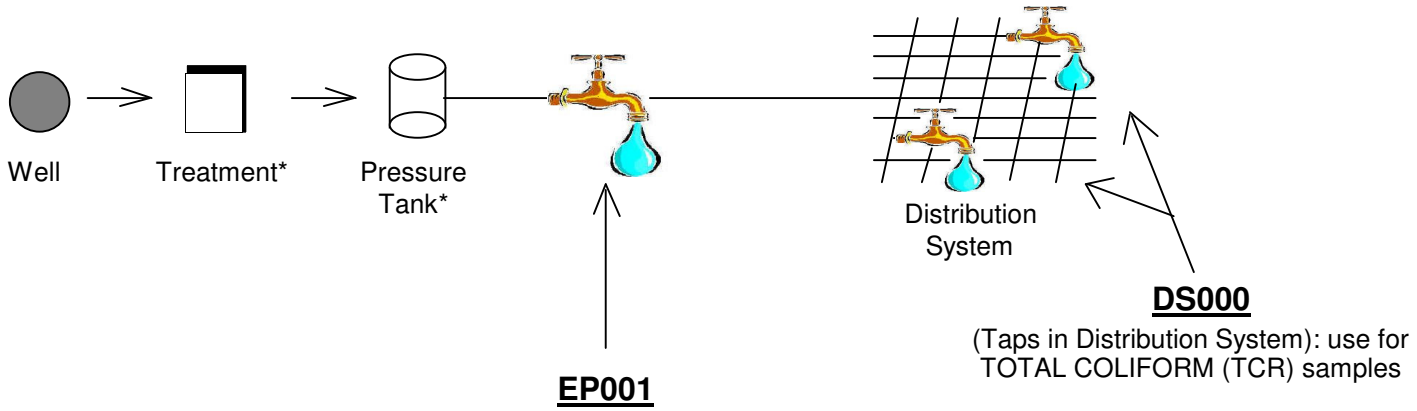

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2956812 PWS NAME: PLAYERS SPORTS PUB

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2954704 FACILITY NAME: PLAYERS SPORTS PUB

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

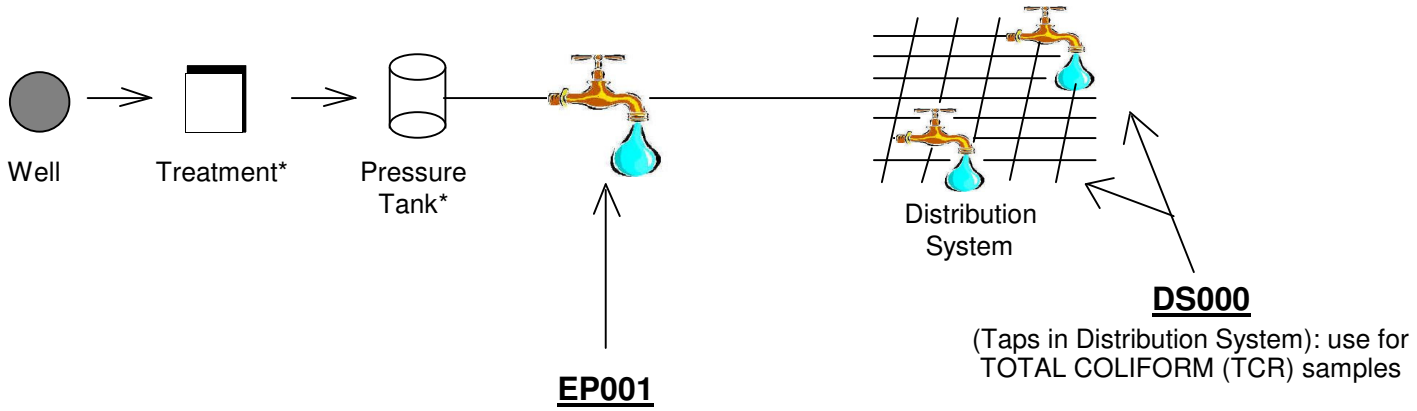

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2956912 PWS NAME: BATH ROAD CHURCH OF CHRIST PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2960779 FACILITY NAME: BATH ROAD CHURCH OF CHRIST

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

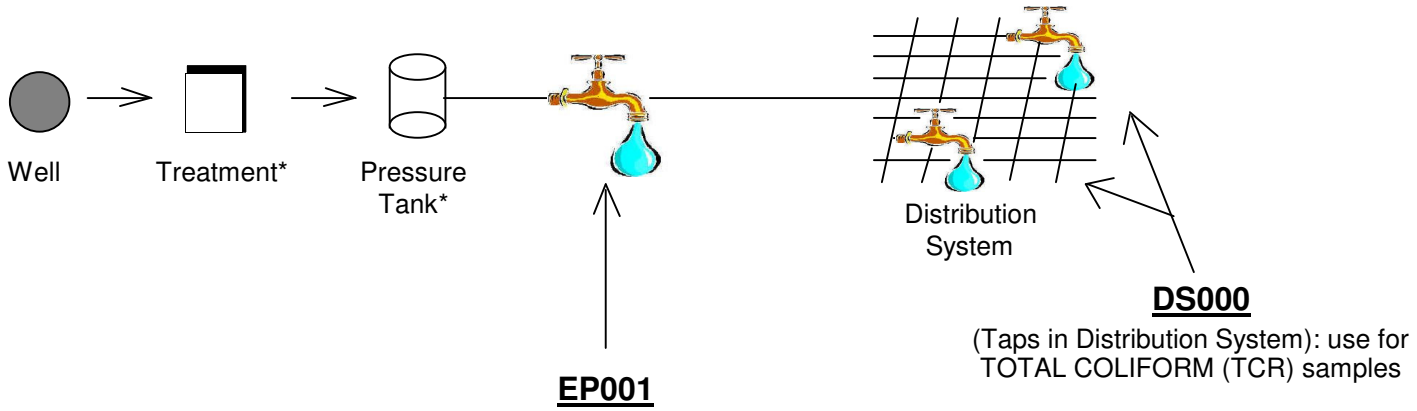

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2957112 PWS NAME: OLD US 35 CAMPGROUND

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2960674 FACILITY NAME: OLD US 35 CAMPGROUND

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 3/1/2011 and 12/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

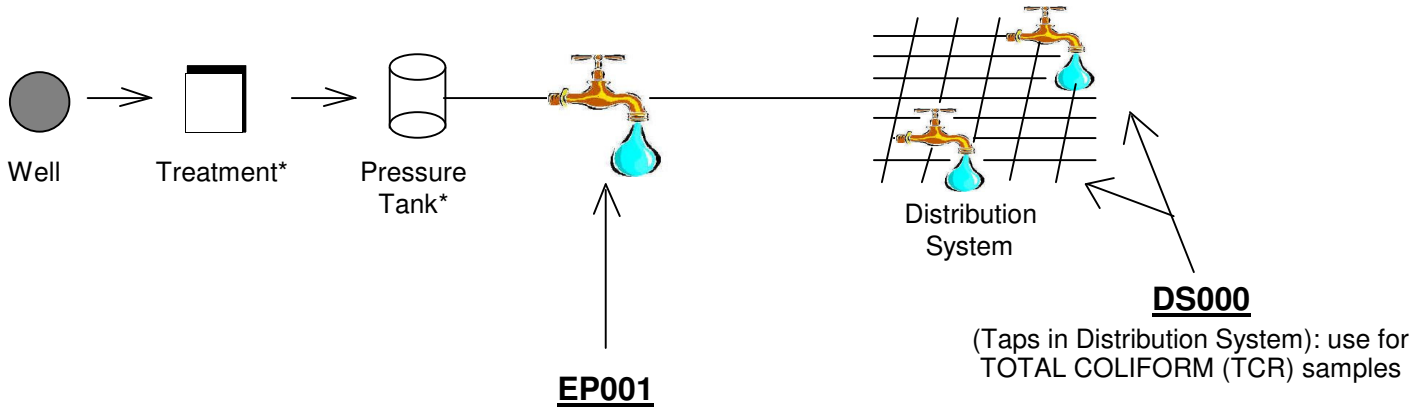

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2957212 PWS NAME: SEBASTIAN HILLS GOLF COURSE PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2960810 FACILITY NAME: SEBASTIAN HILLS GOLF COURSE

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 4/1/2011 and 12/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

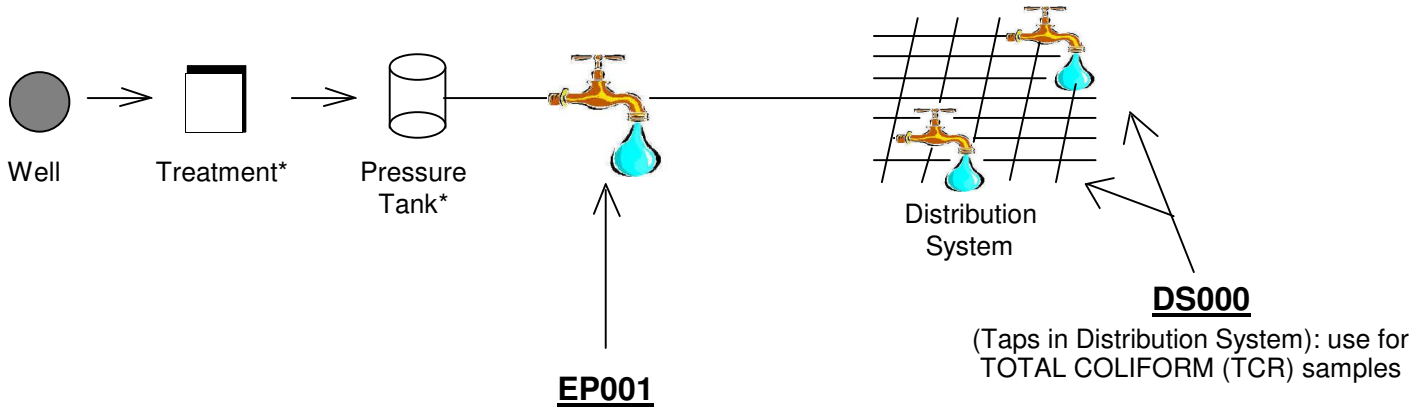

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH2957812 PWS NAME: NBA INC PWS

PWS TYPE: Nontransient Noncommunity SOURCE: Purchased Ground Water Sample Monitoring Point: DS000

FACILITY NAME: NBA INC DISTRIBUTION

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	5 Sample(s) between 6/1/2011 and 9/30/2011
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

Use for Sample Tracking Purposes				
Lead & Copper Sample Date(s):				
TCR Quarterly Sample Date(s):	*Jan - Mar Sample Date(s)*	*Apr - Jun Sample Date(s)*	*Jul - Sept Sample Date(s)*	*Oct - Dec Sample Date(s)*

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH2958312 PWS NAME: GREENE CO FISH AND GAME N CAMPGRND PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

STATE FACILITY ID: 2962124 FACILITY NAME: GREENE COUNTY FISH & GAME

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***
NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011	***Sample should be taken at EP001***

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	*Monitoring Requirements*	*Sample Monitoring Point*
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 5/1/2011 and 10/31/2011	***Sample should be taken at DS000***

Where to Collect Samples For a Small Public Water System

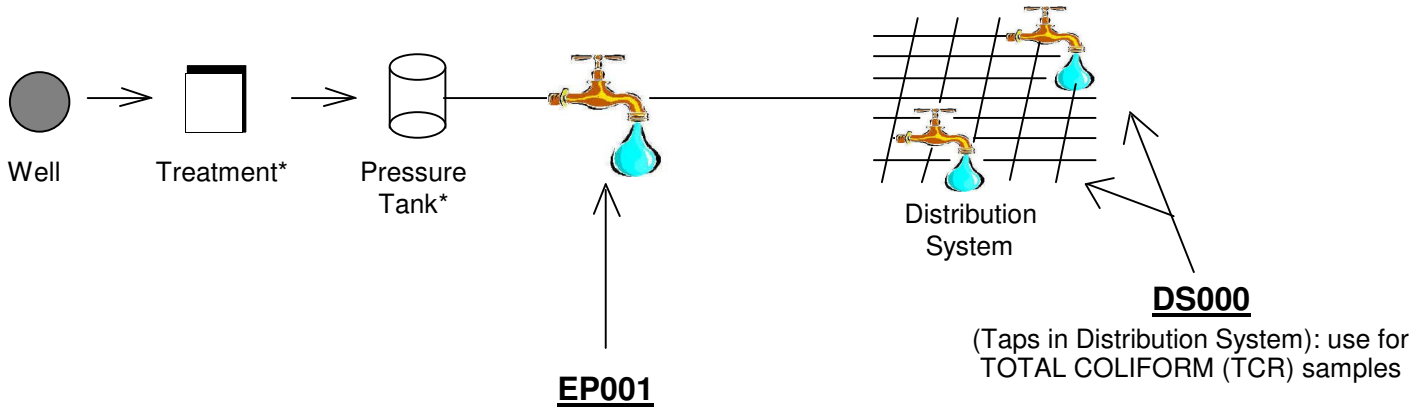

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH2900112 PWS NAME: MOUNT ST. JOHN

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: EP001

STATE FACILITY ID: 2954581 FACILITY NAME: MOUNT ST JOHN STU 1

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRATE	NITRATE - 1040	1 Sample(s) between 1/1/2011 and 5/31/2011
NITRITE	NITRITE - 1041	1 Sample(s) between 1/1/2011 and 5/31/2011
VOLATILE ORGANIC CHEMICALS (VOC)		1 Sample(s) between 6/1/2011 and 10/31/2011
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 2954581. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
INORGANIC Sample Date(s):
NITRATE Sample Date(s):
NITRITE Sample Date(s):
VOC Sample Date(s):

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH2900112 PWS NAME: MOUNT ST. JOHN

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: MOUNT ST. JOHN DISTRIBUTION

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	Not Required
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** 1 Sample(s) between 7/1/2011 and 9/30/2011
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes				
HAA5 & TTHM Sample Date(s):				
TCR Quarterly Sample Date(s):	*Jan - Mar Sample Date(s)*	*Apr - Jun Sample Date(s)*	*Jul - Sept Sample Date(s)*	*Oct - Dec Sample Date(s)*
Total Chlorine Sample Date(s):				