

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH7900212 PWS NAME: BOLIVAR VILLAGE PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001

STATE FACILITY ID: 7959265 FACILITY NAME: BOLIVAR VILLAGE

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRITE	NITRITE - 1041	Not Required
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 3 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 7959265. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

REMINDER: Consumer Confidence Report (CCR) is due July 1, 2011

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

SOC Group 3 Chemicals: BHC-GAMMA (LINDANE) - 2010, METHOXYCHLOR - 2015, DIQUAT - 2032, GLYPHOSATE - 2034, POLYCHLORINATED BIPHENYLS (PCB) - 2383

Use for Sample Tracking Purposes

NITRATE Sample Date(s):

Date CCR sent to Ohio EPA:

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH7900412 PWS NAME: DOVER CITY PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001

STATE FACILITY ID: 7959267 FACILITY NAME: DOVER CITY

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRITE	NITRITE - 1041	Not Required
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 7959267. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

REMINDER: Consumer Confidence Report (CCR) is due July 1, 2011

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
<i>NITRATE Sample Date(s):</i>
<i>Date CCR sent to Ohio EPA:</i>

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH7900412 PWS NAME: DOVER CITY PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: DOVER, CITY OF DISTRIBUTION

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	30 Sample(s) between 6/1/2011 and 9/30/2011
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** 1 Sample(s) between 7/1/2011 and 9/30/2011
TOTAL COLIFORM (TCR) - 3100	15 Sample(s) Monthly between 1/1/2011 and 12/31/2011
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately. You should also continue to take Routine Samples according to this schedule.* If you have any questions, please contact your Southeast District Office - DDAGW representative immediately at 740-385-8501.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
Lead & Copper Sample Date(s):												
HAA5 & TTHM Sample Date(s):												
TCR Monthly Sample Date(s):	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sept	Oct	Nov	Dec
Total Chlorine Sample Date(s):												

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH7900512 PWS NAME: GNADENHUTTEN PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001

STATE FACILITY ID: 7959268 FACILITY NAME: GNADENHUTTEN

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRITE	NITRITE - 1041	Not Required
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 7959268. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

REMINDER: Consumer Confidence Report (CCR) is due July 1, 2011

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
<i>NITRATE Sample Date(s):</i>
<i>Date CCR sent to Ohio EPA:</i>

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH7900612 PWS NAME: MIDVALE VILLAGE PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001

STATE FACILITY ID: 7959269 FACILITY NAME: MIDVALE VILLAGE

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRITE	NITRITE - 1041	Not Required
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 3 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 7959269. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

REMINDER: Consumer Confidence Report (CCR) is due July 1, 2011

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

SOC Group 3 Chemicals: BHC-GAMMA (LINDANE) - 2010, METHOXYCHLOR - 2015, DIQUAT - 2032, GLYPHOSATE - 2034, POLYCHLORINATED BIPHENYLS (PCB) - 2383

Use for Sample Tracking Purposes

NITRATE Sample Date(s):

Date CCR sent to Ohio EPA:

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH7900812 PWS NAME: NEW PHILADELPHIA CITY PWS
PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001
STATE FACILITY ID: 7959270 FACILITY NAME: NEW PHILADELPHIA WTP
Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRITE	NITRITE - 1041	Not Required
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		1 Sample(s) Quarterly
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 7959270. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

REMINDER: Consumer Confidence Report (CCR) is due July 1, 2011

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes				
NITRATE Sample Date(s):				
VOC Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)
Date CCR sent to Ohio EPA:				

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH7900812 PWS NAME: NEW PHILADELPHIA CITY PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: NEW PHILADELPHIA, CITY OF DISTRIBUTION

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	Not Required
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** 1 Sample(s) between 7/1/2011 and 9/30/2011
TOTAL COLIFORM (TCR) - 3100	15 Sample(s) Monthly between 1/1/2011 and 12/31/2011
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately. You should also continue to take Routine Samples according to this schedule.* If you have any questions, please contact your Southeast District Office - DDAGW representative immediately at 740-385-8501.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
HAA5 & TTHM Sample Date(s):												
TCR Monthly Sample Date(s):	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sept	Oct	Nov	Dec
Total Chlorine Sample Date(s):												

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH7900912 PWS NAME: NEWCOMERSTOWN VILLAGE PWS
PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP002
STATE FACILITY ID: 7959271 FACILITY NAME: NEWCOMERSTOWN VLG
Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRITE	NITRITE - 1041	Not Required
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP002 and the State Facility ID is 7959271. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

REMINDER: Consumer Confidence Report (CCR) is due July 1, 2011

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
<i>NITRATE Sample Date(s):</i>
<i>Date CCR sent to Ohio EPA:</i>

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH7901212 PWS NAME: STRASBURG VILLAGE PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001

STATE FACILITY ID: 7959274 FACILITY NAME: STRASBURG VILLAGE

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRITE	NITRITE - 1041	Not Required
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 7959274. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

REMINDER: Consumer Confidence Report (CCR) is due July 1, 2011

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
<i>NITRATE Sample Date(s):</i>
<i>Date CCR sent to Ohio EPA:</i>

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH7901312 PWS NAME: SUGARCREEK VILLAGE PWS
PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001
STATE FACILITY ID: 7959275 FACILITY NAME: SUGARCREEK WTP
Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRITE	NITRITE - 1041	Not Required
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 7959275. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

REMINDER: Consumer Confidence Report (CCR) is due July 1, 2011

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
<i>NITRATE Sample Date(s):</i>
<i>Date CCR sent to Ohio EPA:</i>

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH7901312 PWS NAME: SUGARCREEK VILLAGE PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: SUGARCREEK, VILLAGE OF DISTRIBUTION

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
ASBESTOS - 1094	Not Required
LEAD - 1030 & COPPER - 1022	10 Sample(s) between 6/1/2011 and 9/30/2011
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** Not Required, Unless State Delinquency Notice Received
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Monthly between 1/1/2011 and 12/31/2011
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period.

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

Asbestos Sampling Information

Collect one sample at a tap served by asbestos-cement pipe. The sample monitoring point (smp) code is DS000. Due to limited Laboratory capacity and a 48 hour filtering requirement, contact your lab early in the monitoring period to schedule a sampling date.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southeast District Office - DDAGW representative immediately at 740-385-8501.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
<i>Lead & Copper Sample Date(s):</i>												
<i>TCR Monthly Sample Date(s):</i>	<i>Jan</i>	<i>Feb</i>	<i>Mar</i>	<i>Apr</i>	<i>May</i>	<i>Jun</i>	<i>Jul</i>	<i>Aug</i>	<i>Sept</i>	<i>Oct</i>	<i>Nov</i>	<i>Dec</i>
<i>Total Chlorine Sample Date(s):</i>												

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH7901512 PWS NAME: TUSCARAWAS VILLAGE PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001

STATE FACILITY ID: 7959277 FACILITY NAME: TUSCARAWAS VILLAGE

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
ARSENIC	ARSENIC - 1005	1 Sample(s) Quarterly
NITRATE	NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRITE	NITRITE - 1041	Not Required
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 7959277. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

REMINDER: Consumer Confidence Report (CCR) is due July 1, 2011

INORGANIC Chemicals: ANTIMONY - 1074, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes				
	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)
<i>ARSENIC Quarterly Sample Date(s):</i>				
<i>NITRATE Sample Date(s):</i>				
<i>Date CCR sent to Ohio EPA:</i>				

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH7901612 PWS NAME: TCMSD-WILKSHIRE HILLS PWS
PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001
STATE FACILITY ID: 7959278 FACILITY NAME: TCMSD WILKSHIRE HILLS
Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRITE	NITRITE - 1041	Not Required
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 2 List Below	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 3 List Below	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 4 List Below	1 Sample(s) between 4/1/2011 and 6/30/2011

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 7959278. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

REMINDER: Consumer Confidence Report (CCR) is due July 1, 2011

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

SOC Group 2 Chemicals: CARBOFURAN - 2046, OXAMYL (VYDATE) - 2036, PICLORAM - 2040, 2,4-D - 2105, PENTACHLOROPHENOL - 2326

SOC Group 3 Chemicals: BHC-GAMMA (LINDANE) - 2010, METHOXYCHLOR - 2015, DIQUAT - 2032, GLYPHOSATE - 2034, POLYCHLORINATED BIPHENYLS (PCB) - 2383

SOC Group 4 Chemicals: BENZO (A) PYRENE - 2306, ENDOTHALL - 2033, DI(2-ETHYLHEXYL) - ADIPATE - 2035, DI(2-ETHYLHEXYL) - PHTHALATE - 2039

Use for Sample Tracking Purposes
<i>NITRATE Sample Date(s):</i>
<i>SOC Group 4 Sample Date(s):</i>
<i>Date CCR sent to Ohio EPA:</i>

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH7901612 PWS NAME: TCMSD-WILKSHIRE HILLS PWS
PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: DS000
FACILITY NAME: TCMSD-WILKSHIRE HILLS DISTRIBUTION
Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
ASBESTOS - 1094	Not Required
LEAD - 1030 & COPPER - 1022	20 Sample(s) between 6/1/2011 and 9/30/2011
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** Not Required, Unless State Delinquency Notice Received
TOTAL COLIFORM (TCR) - 3100	7 Sample(s) Monthly between 1/1/2011 and 12/31/2011
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

Asbestos Sampling Information

Collect one sample at a tap served by asbestos-cement pipe. The sample monitoring point (smp) code is DS000. Due to limited Laboratory capacity and a 48 hour filtering requirement, contact your lab early in the monitoring period to schedule a sampling date.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately. You should also continue to take Routine Samples according to this schedule.* If you have any questions, please contact your Southeast District Office - DDAGW representative immediately at 740-385-8501.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
<i>Lead & Copper Sample Date(s):</i>												
<i>TCR Monthly Sample Date(s):</i>	<i>Jan</i>	<i>Feb</i>	<i>Mar</i>	<i>Apr</i>	<i>May</i>	<i>Jun</i>	<i>Jul</i>	<i>Aug</i>	<i>Sept</i>	<i>Oct</i>	<i>Nov</i>	<i>Dec</i>
<i>Total Chlorine Sample Date(s):</i>												

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH7901711 PWS NAME: TWIN CITY WATER AND SEWER DISTRICT PWS
PWS TYPE: Community SOURCE: Surface Water Sample Monitoring Point: EP001
STATE FACILITY ID: 7959279 FACILITY NAME: TWIN CITY WATER DISTRICT WTP

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRATE	NITRATE - 1040	1 Sample(s) Monthly
NITRITE	NITRITE - 1041	Not Required
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
TOTAL ORGANIC CARBON (TOC)		1 Paired Sample Set Monthly *
VOLATILE ORGANIC CHEMICALS (VOC)		1 Sample(s) between 7/1/2011 and 9/30/2011
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	1 Sample(s) between 4/1/2011 and 4/30/2011 1 Sample(s) between 5/1/2011 and 5/31/2011 1 Sample(s) between 6/1/2011 and 6/30/2011
CRYPTOSPORIDIUM		per LT2 Monitoring Plan

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 7959279. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

REMINDER: Consumer Confidence Report (CCR) is due July 1, 2011

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

Paired Sample Set: * A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes												
<i>INORGANIC Sample Date(s):</i>												
<i>NITRATE Monthly Sample Date(s):</i>	<i>Jan</i>	<i>Feb</i>	<i>Mar</i>	<i>Apr</i>	<i>May</i>	<i>Jun</i>	<i>Jul</i>	<i>Aug</i>	<i>Sept</i>	<i>Oct</i>	<i>Nov</i>	<i>Dec</i>
<i>TOC Monthly Sample Date(s):</i>	<i>Jan</i>	<i>Feb</i>	<i>Mar</i>	<i>Apr</i>	<i>May</i>	<i>Jun</i>	<i>Jul</i>	<i>Aug</i>	<i>Sept</i>	<i>Oct</i>	<i>Nov</i>	<i>Dec</i>
<i>VOC Sample Date(s):</i>												
<i>SOC Group 1 Sample Date(s):</i>												
<i>Date CCR sent to Ohio EPA:</i>												

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH7901711 PWS NAME: TWIN CITY WATER AND SEWER DISTRICT PWS
PWS TYPE: Community SOURCE: Surface Water Sample Monitoring Point: DS000
FACILITY NAME: TWIN CITY WTR AND SWR DIST DISTRIBUTION

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
ASBESTOS - 1094	Not Required
LEAD - 1030 & COPPER - 1022	20 Sample(s) between 6/1/2011 and 9/30/2011
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** 1 Sample(s) Quarterly
TOTAL COLIFORM (TCR) - 3100	10 Sample(s) Monthly between 1/1/2011 and 12/31/2011
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

Asbestos Sampling Information

Collect one sample at a tap served by asbestos-cement pipe. The sample monitoring point (smp) code is DS000. Due to limited Laboratory capacity and a 48 hour filtering requirement, contact your lab early in the monitoring period to schedule a sampling date.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately. You should also continue to take Routine Samples according to this schedule.* If you have any questions, please contact your Southeast District Office - DDAGW representative immediately at 740-385-8501.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
<i>Lead & Copper Sample Date(s):</i>												
<i>HAA5 & TTHM Quarterly Sample Date(s):</i>			<i>Jan - Mar Sample Date(s)</i>			<i>Apr - Jun Sample Date(s)</i>			<i>Jul - Sept Sample Date(s)</i>		<i>Oct - Dec Sample Date(s)</i>	
<i>TCR Monthly Sample Date(s):</i>	<i>Jan</i>	<i>Feb</i>	<i>Mar</i>	<i>Apr</i>	<i>May</i>	<i>Jun</i>	<i>Jul</i>	<i>Aug</i>	<i>Sept</i>	<i>Oct</i>	<i>Nov</i>	<i>Dec</i>
<i>Total Chlorine Sample Date(s):</i>												

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH7901812 PWS NAME: ZOARVILLE WATER WORKS CO
PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001
STATE FACILITY ID: 7959280 FACILITY NAME: ZOARVILLE PWS INC
Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRITE	NITRITE - 1041	Not Required
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 7959280. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

REMINDER: Consumer Confidence Report (CCR) is due July 1, 2011

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
<i>NITRATE Sample Date(s):</i>
<i>Date CCR sent to Ohio EPA:</i>

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH7901912 PWS NAME: TCMSD-RIDGEWOOD PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001

STATE FACILITY ID: 7959281 FACILITY NAME: TCMSD RIDGEWOOD

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRITE	NITRITE - 1041	Not Required
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 7959281. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

REMINDER: Consumer Confidence Report (CCR) is due July 1, 2011

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
<i>NITRATE Sample Date(s):</i>
<i>Date CCR sent to Ohio EPA:</i>

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH7902012 PWS NAME: TCMSD-DUNDEE PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001

STATE FACILITY ID: 7959282 FACILITY NAME: TCMSD DUNDEE

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRITE	NITRITE - 1041	Not Required
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 7959282. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

REMINDER: Consumer Confidence Report (CCR) is due July 1, 2011

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
<i>NITRATE Sample Date(s):</i>
<i>Date CCR sent to Ohio EPA:</i>

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH7902012 PWS NAME: TCMSD-DUNDEE PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: TCMSD-DUNDEE DISTRIBUTION

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	5 Sample(s) between 6/1/2011 and 9/30/2011
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** Not Required, Unless State Delinquency Notice Received
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Monthly between 1/1/2011 and 12/31/2011
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southeast District Office - DDAGW representative immediately at 740-385-8501.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
<i>Lead & Copper Sample Date(s):</i>												
<i>TCR Monthly Sample Date(s):</i>	<i>Jan</i>	<i>Feb</i>	<i>Mar</i>	<i>Apr</i>	<i>May</i>	<i>Jun</i>	<i>Jul</i>	<i>Aug</i>	<i>Sept</i>	<i>Oct</i>	<i>Nov</i>	<i>Dec</i>
<i>Total Chlorine Sample Date(s):</i>												

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH7902103 PWS NAME: TCMSD-WAINWRIGHT PWS

PWS TYPE: Community SOURCE: Purchased Ground Water Sample Monitoring Point: DS000

FACILITY NAME: TCMSD-WAINWRIGHT DISTRIBUTION

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	Not Required
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** 1 Sample(s) between 7/1/2011 and 9/30/2011
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Monthly between 1/1/2011 and 12/31/2011
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southeast District Office - DDAGW representative immediately at 740-385-8501.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
HAA5 & TTHM Sample Date(s):												
TCR Monthly Sample Date(s):	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sept	Oct	Nov	Dec
Total Chlorine Sample Date(s):												

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7930212 PWS NAME: STONE CREEK BAR AND GRILLE

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959284 FACILITY NAME: STONE CREEK BAR AND GRILLE INC

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

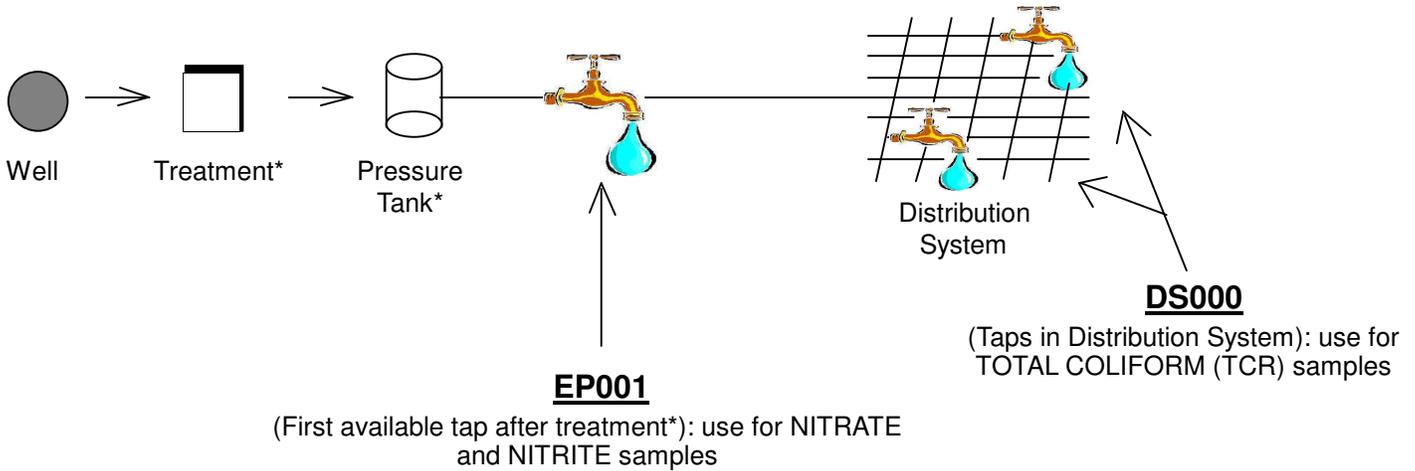

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7930512 PWS NAME: ATWOOD LAKE MARINA-WEST

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959285 FACILITY NAME: ATWOOD LAKE MARINA WEST

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 4/1/2011 and 9/30/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

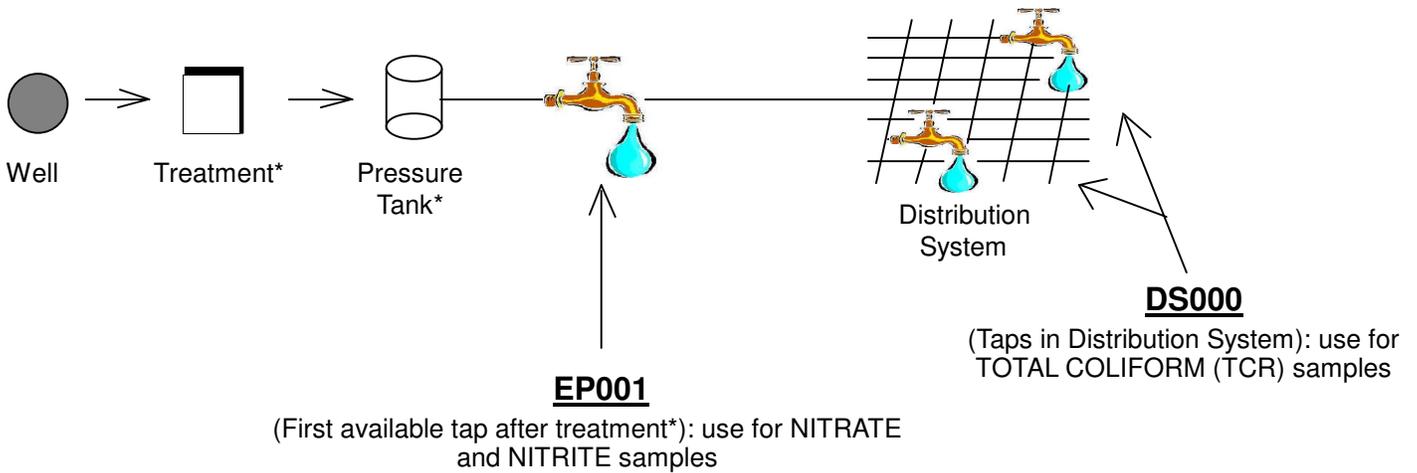

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7930612 PWS NAME: BARRS MILL CHURCH OF GOD

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959286 FACILITY NAME: BARRS MILLS CHURCH OF GOD

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

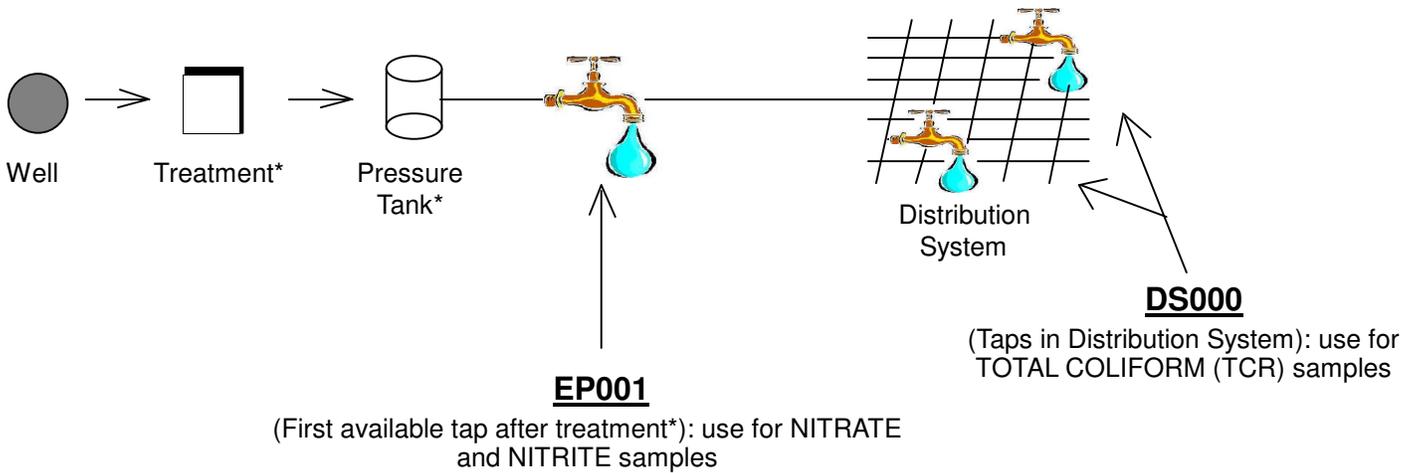

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7931212 PWS NAME: INN ON THE RIVER
PWS TYPE: Transient Noncommunity SOURCE: Ground Water
Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959287 FACILITY NAME: INN ON THE RIVER

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

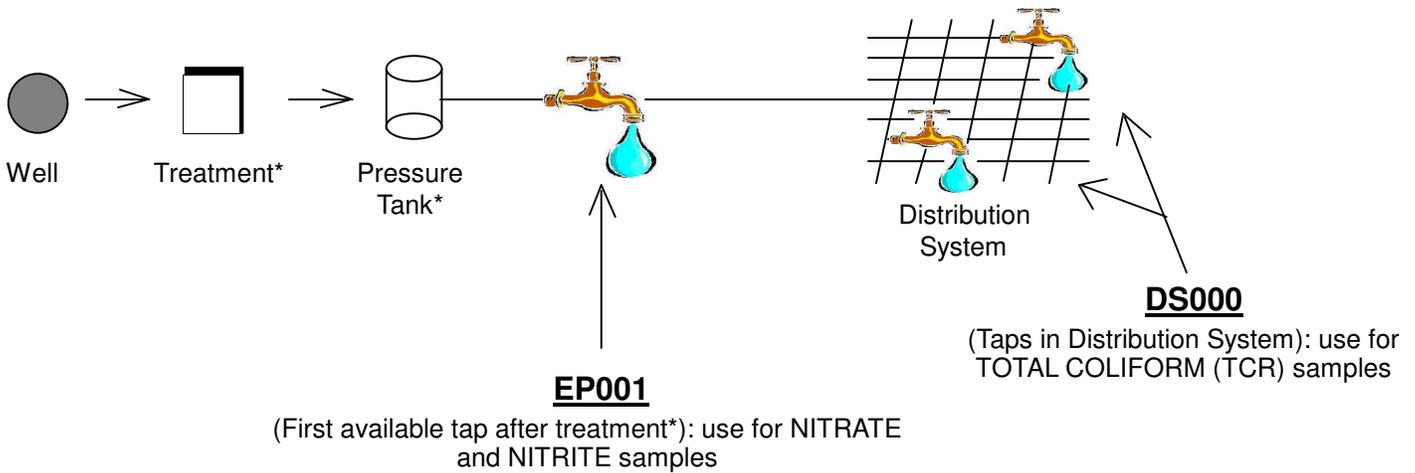

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7931512 PWS NAME: CAMP BUCKEYE RETREAT CENTER

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959288 FACILITY NAME: CAMP BUCKEYE RETREAT CENTER

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

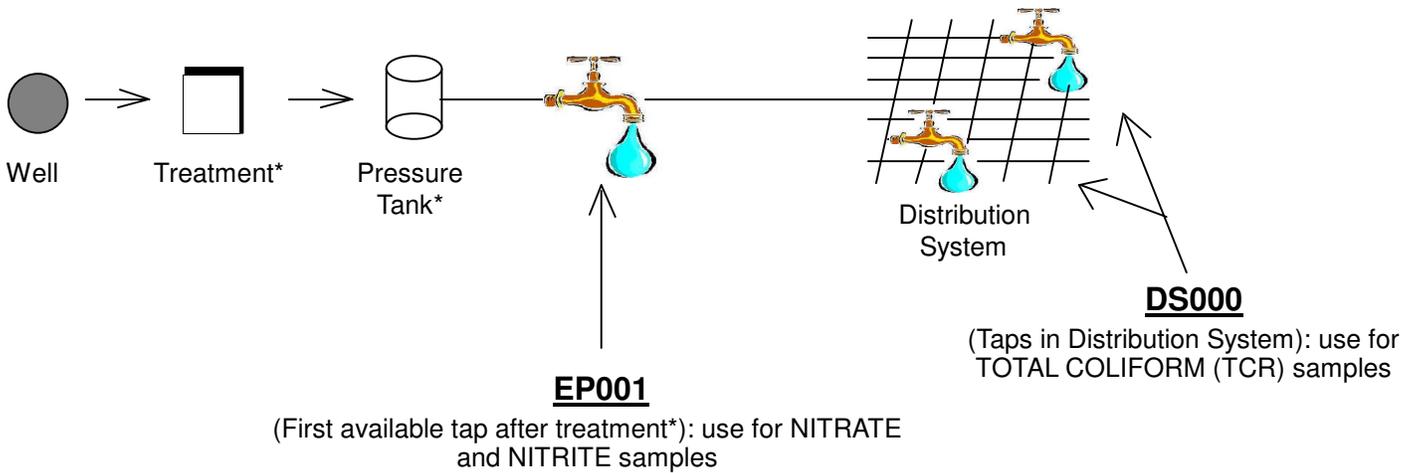

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7931522 PWS NAME: **CAMP BUCKEYE POOL**
PWS TYPE: **Transient Noncommunity** SOURCE: **Ground Water**
Groundwater Rule Minimal Treatment System

Effective Date: 6/17/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959289 FACILITY NAME: CAMP BUCKEYE RETREAT CENTER P

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 6/1/2011 and 9/30/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

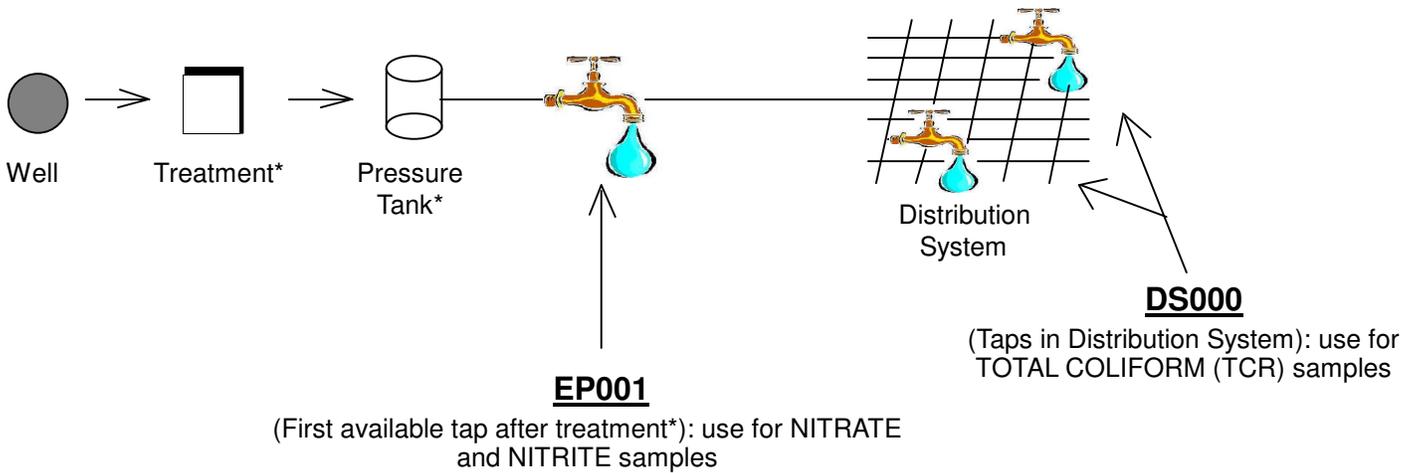

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes
Nitrate Sample Date(s):

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH7932012 PWS NAME: MARANATHA CHRISTIAN SCHOOL

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: EP001

STATE FACILITY ID: 7959290 FACILITY NAME: MARANATHA CHRISTIAN SCHOOL

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRITE	NITRITE - 1041	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 7959290. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
NITRATE Sample Date(s):

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH7932012 PWS NAME: MARANATHA CHRISTIAN SCHOOL

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: MARANATHA CHRISTIAN SCHO DISTRIBUTION

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	Not Required
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule.

Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.

If you receive a Total Coliform Positive result, contact your Southeast District Office - DDAGW representative immediately at 740-385-8501.

Use for Sample Tracking Purposes				
<i>TCR Quarterly Sample Date(s):</i>	<i>Jan - Mar Sample Date(s)</i>	<i>Apr - Jun Sample Date(s)</i>	<i>Jul - Sept Sample Date(s)</i>	<i>Oct - Dec Sample Date(s)</i>

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7932812 PWS NAME: POINTE CAFE

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959295 FACILITY NAME: THE POINTE CAFE

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

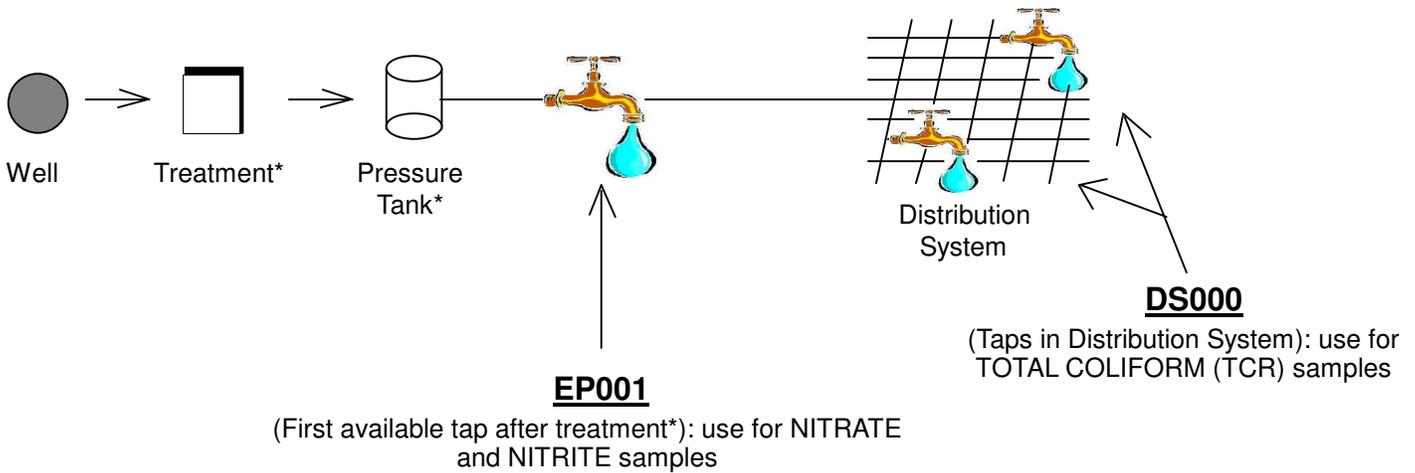

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7933712 PWS NAME: SOMERDALE INN
PWS TYPE: Transient Noncommunity SOURCE: Ground Water
Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959296 FACILITY NAME: SOMERDALE INN

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	Monitoring Requirements	Sample Monitoring Point
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

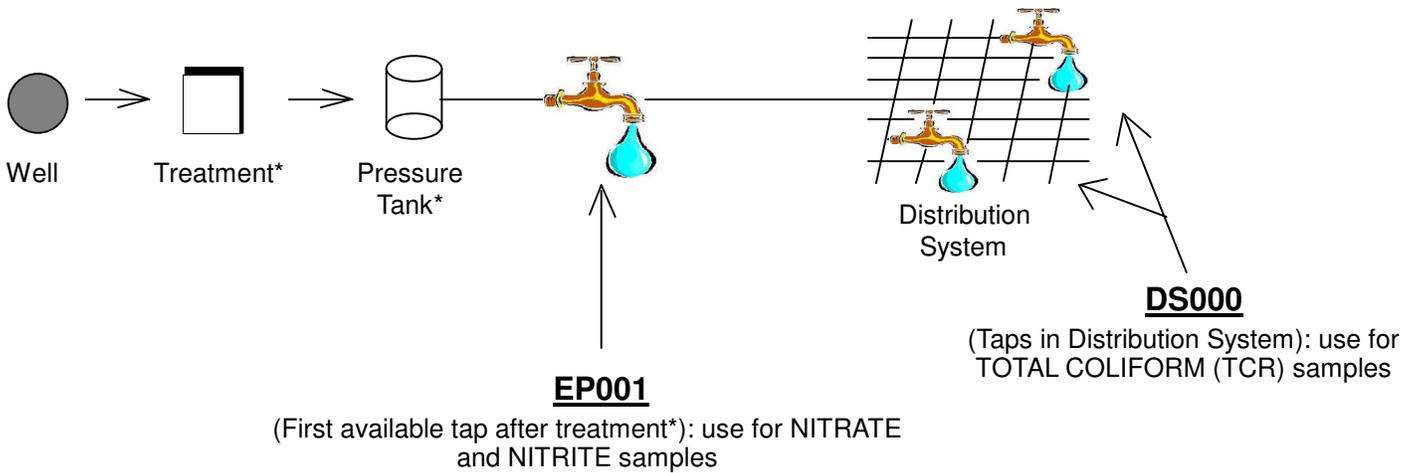

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7934112 PWS NAME: GOOD HOUSE PUB
PWS TYPE: Transient Noncommunity SOURCE: Ground Water
Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959297 FACILITY NAME: THE GOOD HOUSE

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	Monitoring Requirements	Sample Monitoring Point
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

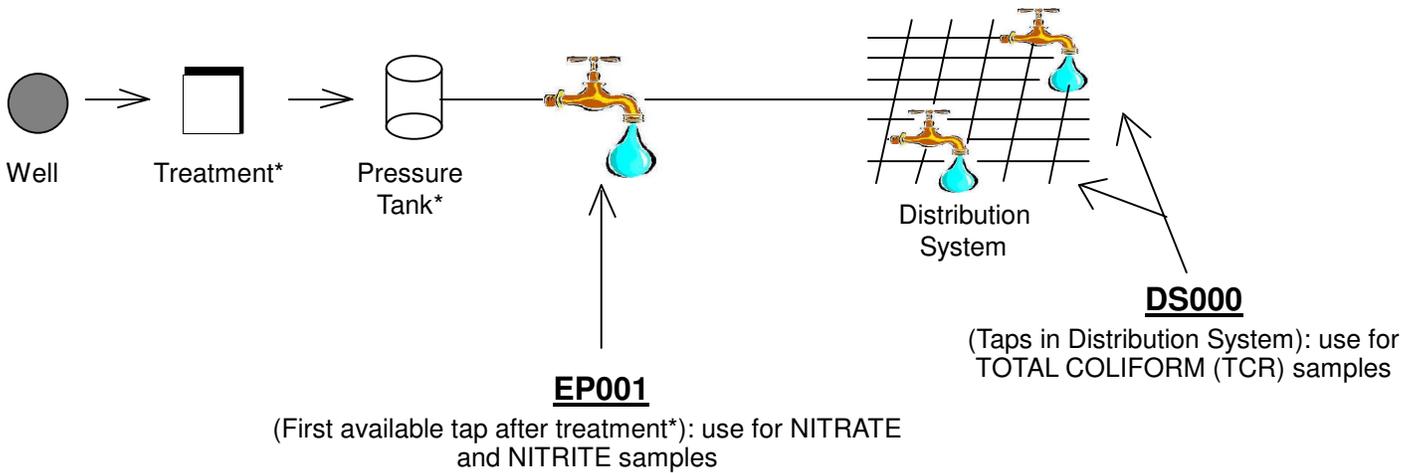

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7934312 PWS NAME: GRACE COMMUNITY CHURCH

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959299 FACILITY NAME: GRACE COMMUNITY CHURCH

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

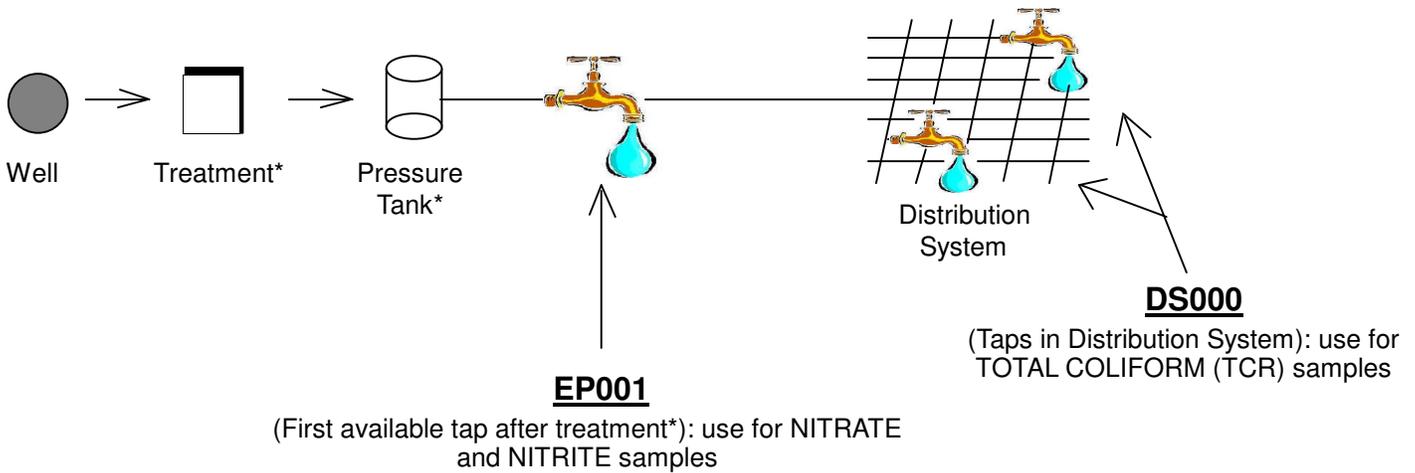

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7934512 PWS NAME: GREEN VALLEY GOLF CLUB

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959300 FACILITY NAME: GREEN VALLEY GOLF CLUB

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 4/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

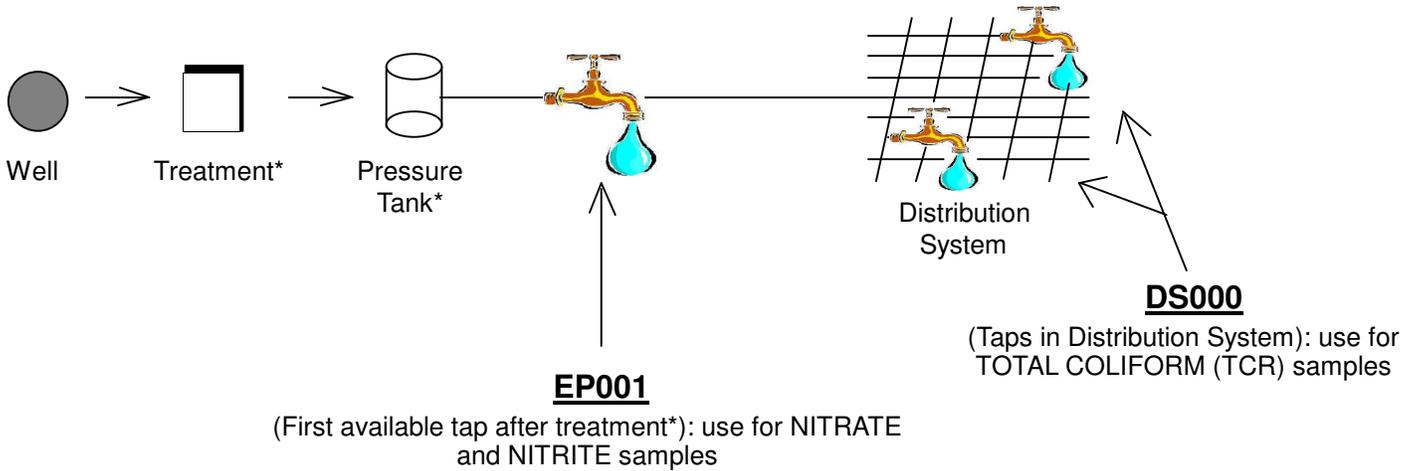

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7935412 PWS NAME: JEHOVAHS WITNESS KINGDOM PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959302 FACILITY NAME: JEHOVAHS WITNESS KINGDOM HALL

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

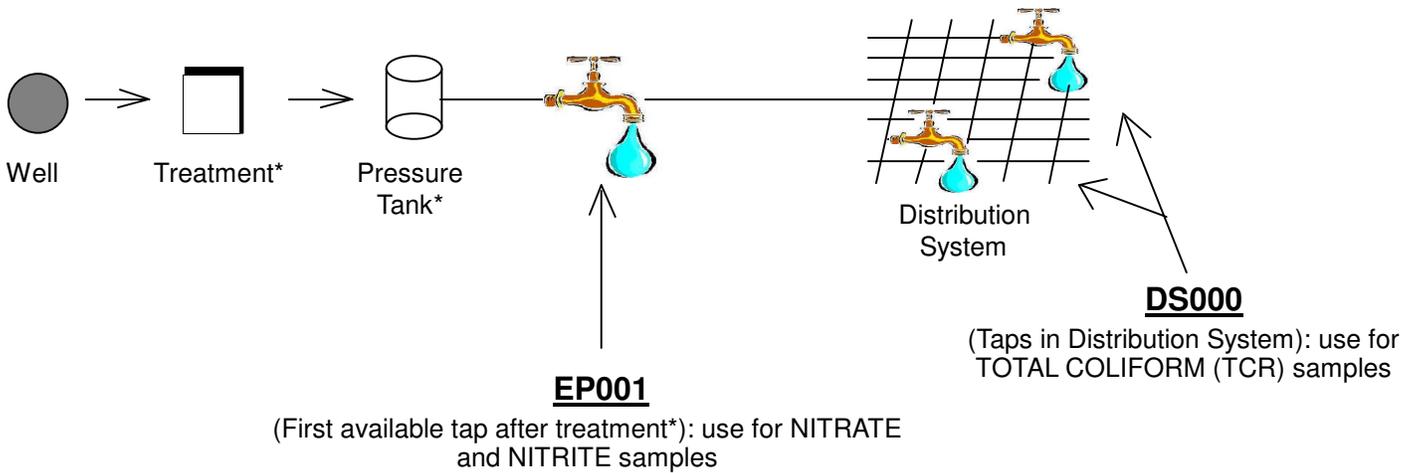

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7935612 PWS NAME: GINGER ROOT PWS
PWS TYPE: Transient Noncommunity SOURCE: Ground Water
Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959303 FACILITY NAME: GINGER ROOT NO TREATMENT

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	Monitoring Requirements	Sample Monitoring Point
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

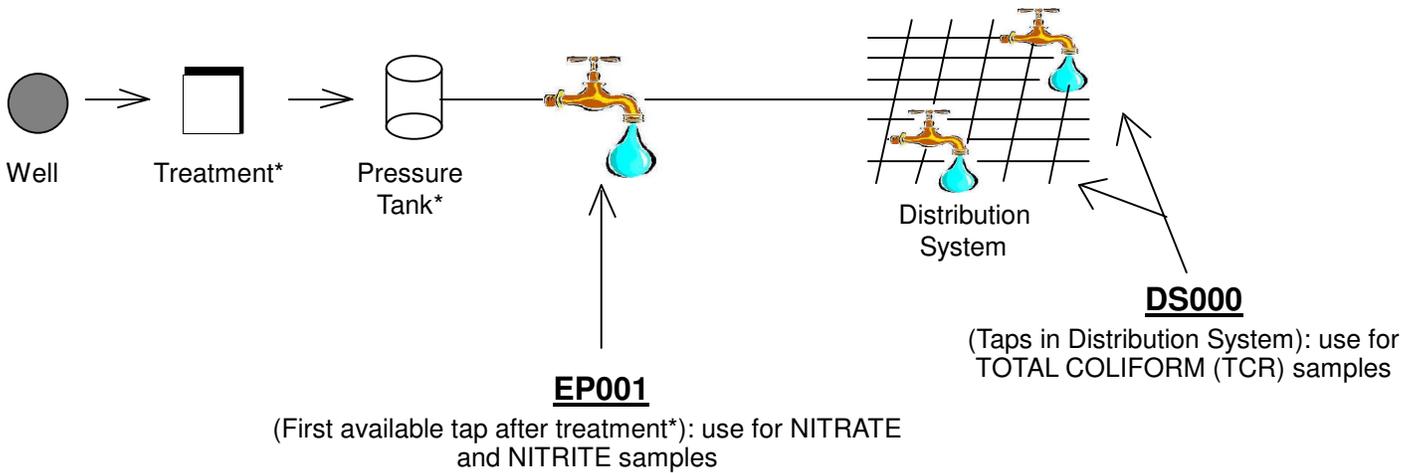

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7935812 PWS NAME: LAMPLIGHTER INN
PWS TYPE: Transient Noncommunity SOURCE: Ground Water
Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959304 FACILITY NAME: LAMPLIGHTER INN

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	Monitoring Requirements	Sample Monitoring Point
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

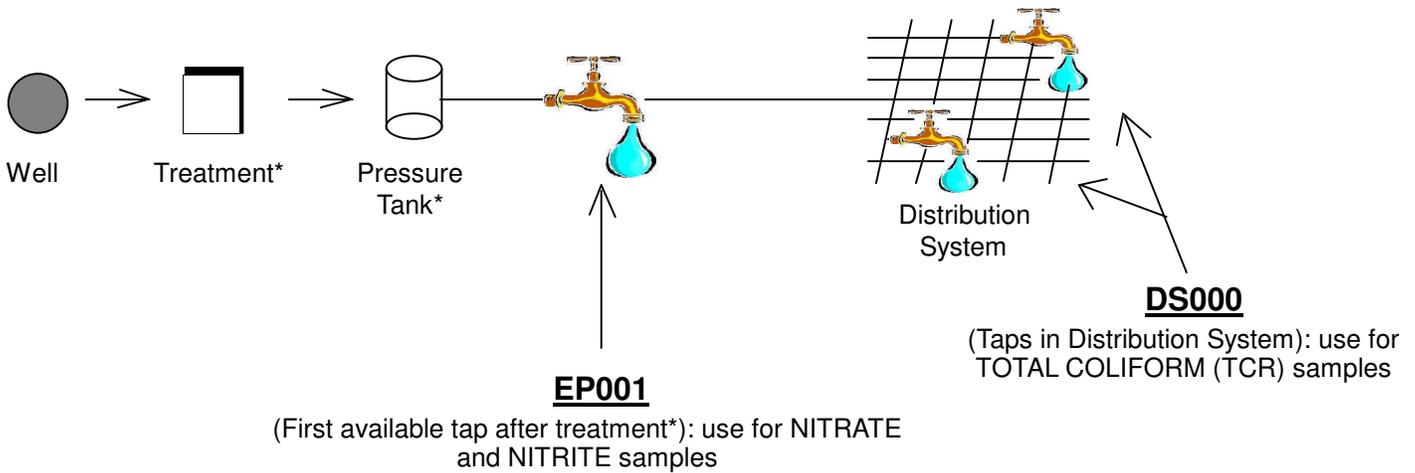

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7936112 PWS NAME: RED ONION
PWS TYPE: Transient Noncommunity SOURCE: Ground Water
Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959305 FACILITY NAME: RED ONION

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	Monitoring Requirements	Sample Monitoring Point
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

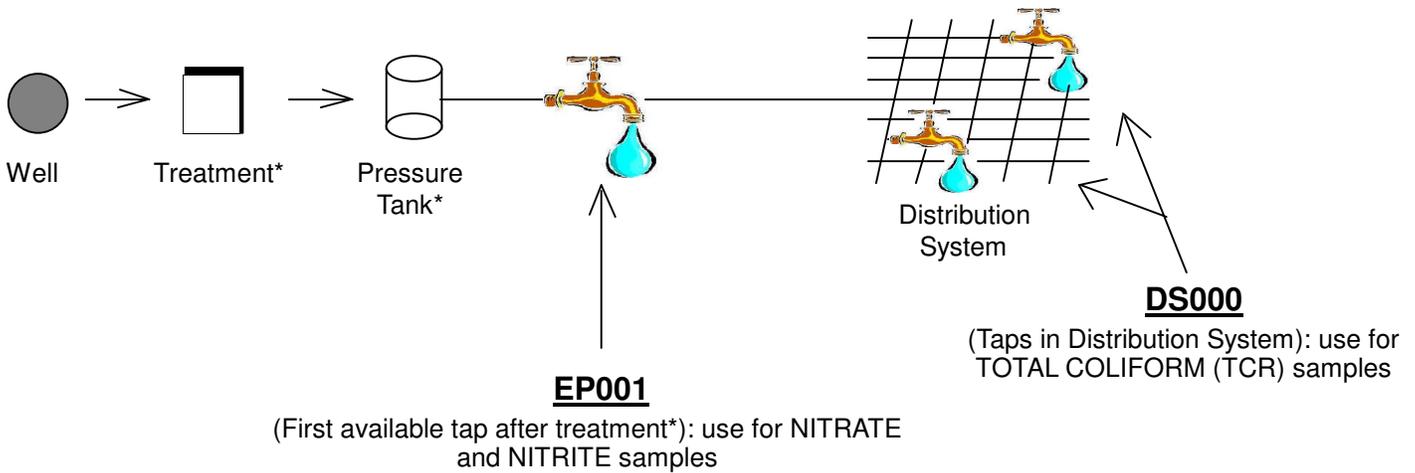

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7936512 PWS NAME: WARREN TOWNSHIP COMMUNITY CTR PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959307 FACILITY NAME: WARREN TOWNSHIP COMMUNITY CTR

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

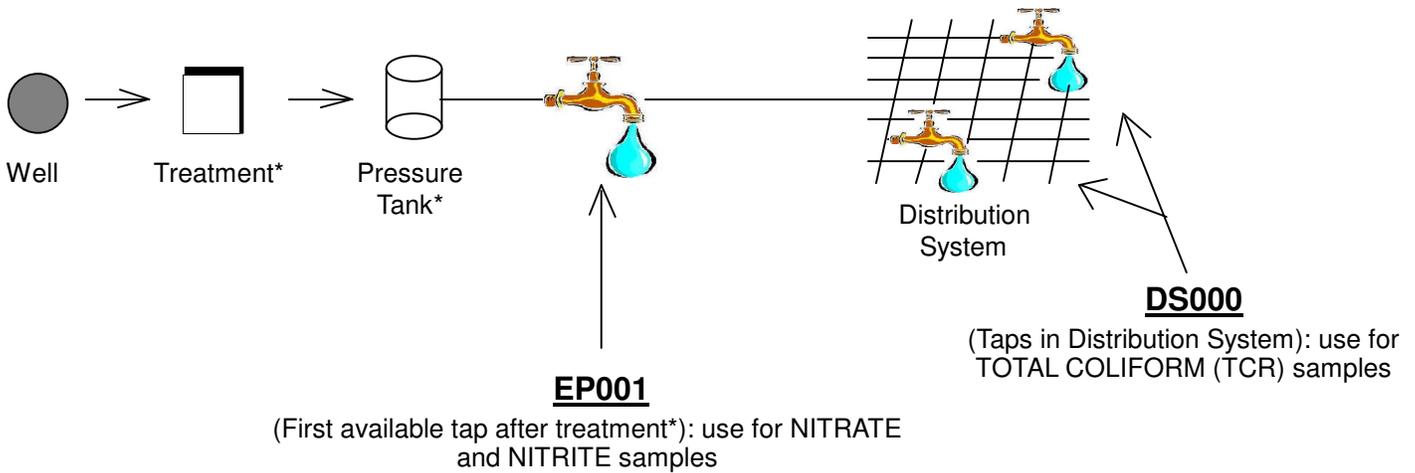

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7937212 PWS NAME: LAKE DRIVE FELLOWSHIP

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959309 FACILITY NAME: LAKE DRIVE FELLOWSHIP

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

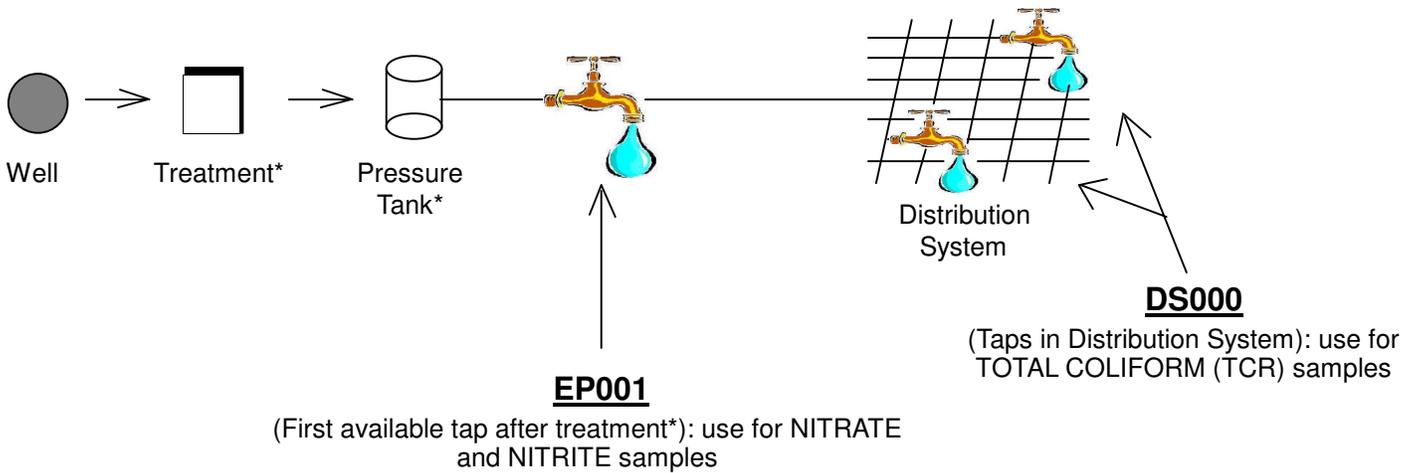

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7937712 PWS NAME: TATMANS RESTAURANT PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959312 FACILITY NAME: TATMANS RESTAURANT

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

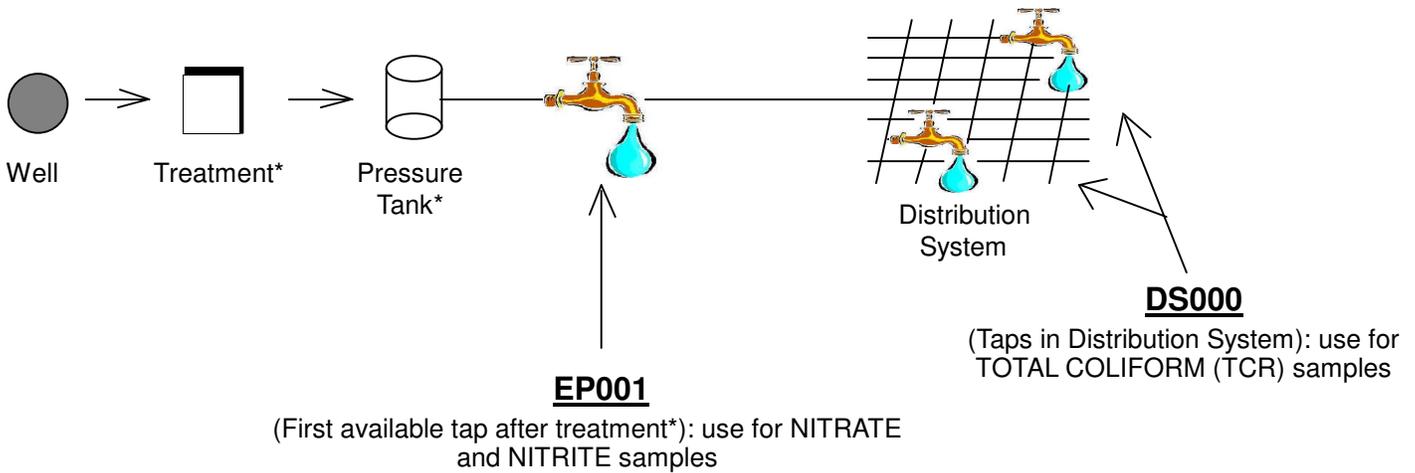

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7937812 PWS NAME: RED ONION PARTY CENTER

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959313 FACILITY NAME: RED ONION PARTY CENTER

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

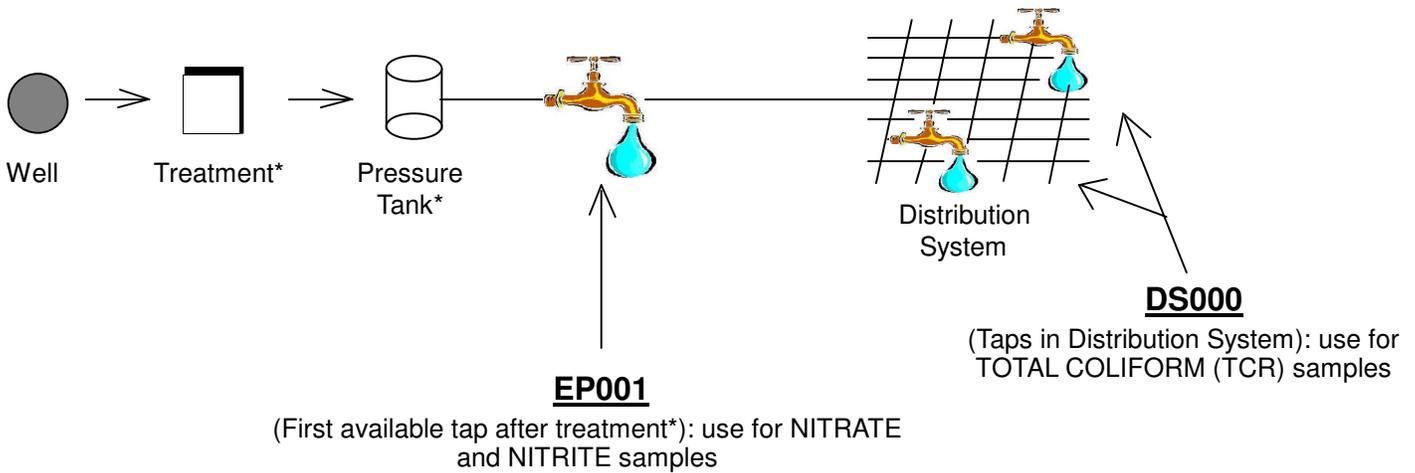

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH7937912 PWS NAME: RAGERSVILLE ELEMENTARY SCHOOL

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: EP001

STATE FACILITY ID: 7959314 FACILITY NAME: RAGERSVILLE ELEMENTARY SCHOOL

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRITE	NITRITE - 1041	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 7959314. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
NITRATE Sample Date(s):

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH7937912 PWS NAME: RAGERSVILLE ELEMENTARY SCHOOL

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: RAGERSVILLE ELEMENTARY S DISTRIBUTION

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	Not Required
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southeast District Office - DDAGW representative immediately at 740-385-8501.

Use for Sample Tracking Purposes				
<i>TCR Quarterly Sample Date(s):</i>	<i>Jan - Mar Sample Date(s)</i>	<i>Apr - Jun Sample Date(s)</i>	<i>Jul - Sept Sample Date(s)</i>	<i>Oct - Dec Sample Date(s)</i>

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7938012 PWS NAME: TAVERN OF RAGERSVILLE

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959315 FACILITY NAME: TAVERN OF RAGERSVILLE

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

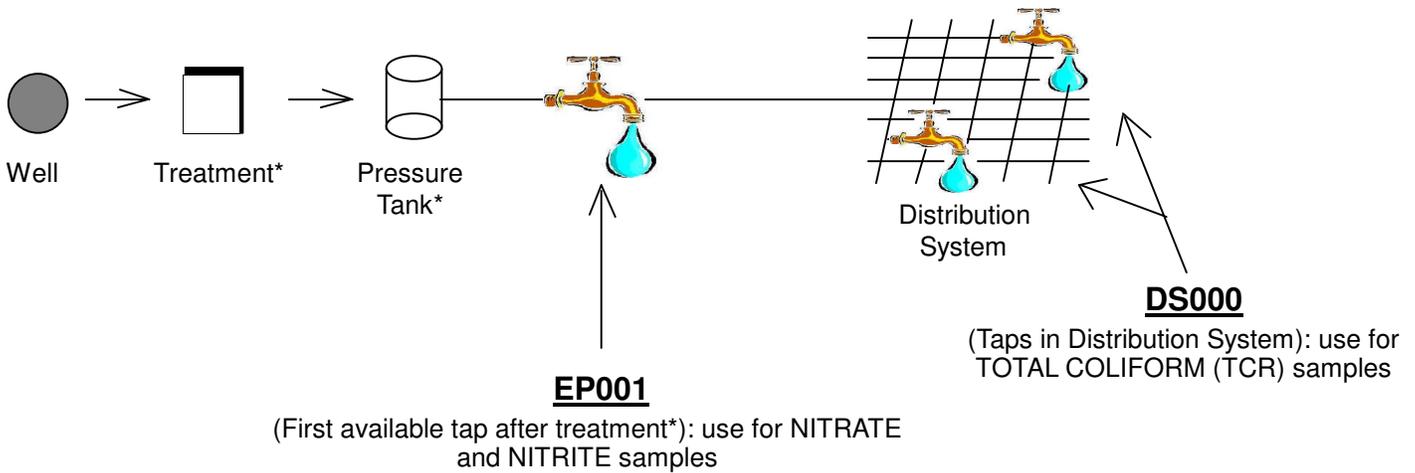

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7938312 PWS NAME: REESE TRUCKING INC.
PWS TYPE: Transient Noncommunity SOURCE: Ground Water
Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959317 FACILITY NAME: REESE TRUCKING INC

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

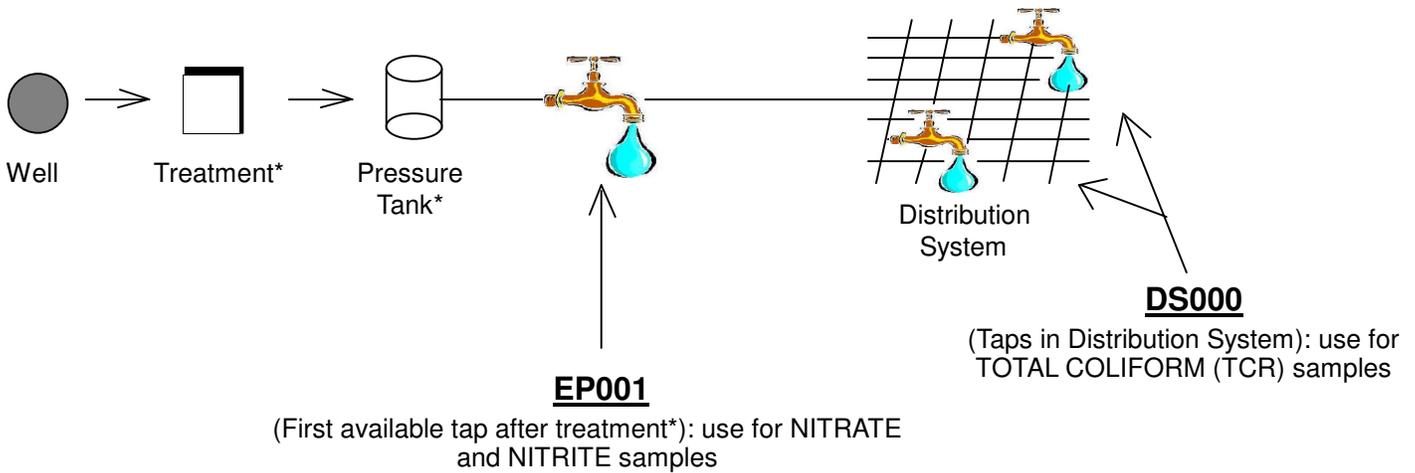

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7938719 PWS NAME: RUSH CHURCH OF THE NAZARENE PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959319 FACILITY NAME: RUSH CHURCH OF THE NAZARENE

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

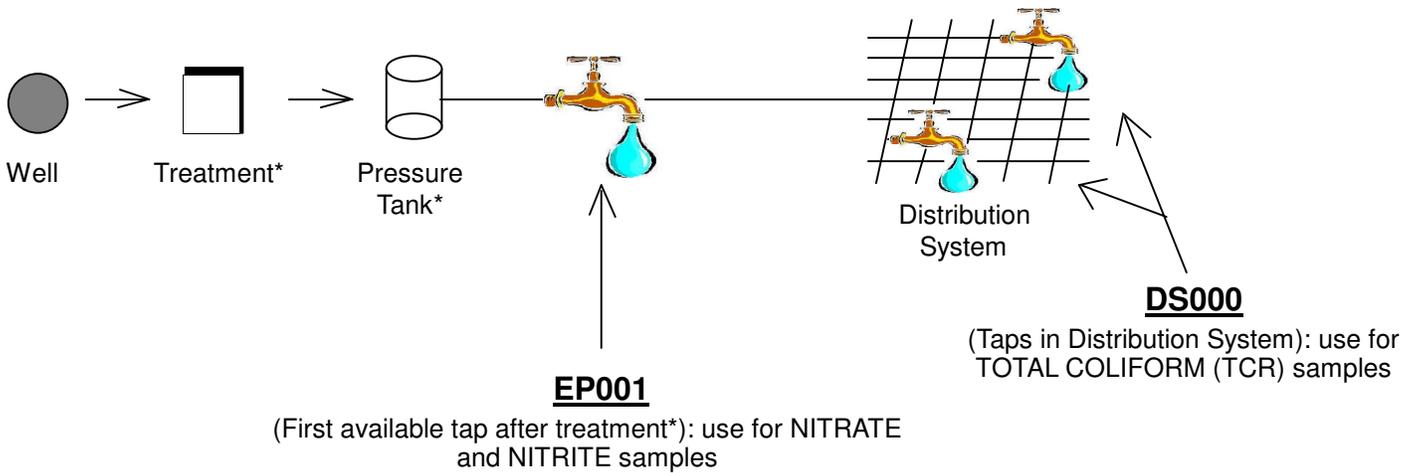

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7939012 PWS NAME: SANDY VALLEY FOE 3228 PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959320 FACILITY NAME: SANDY VALLEY FOE 3228

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

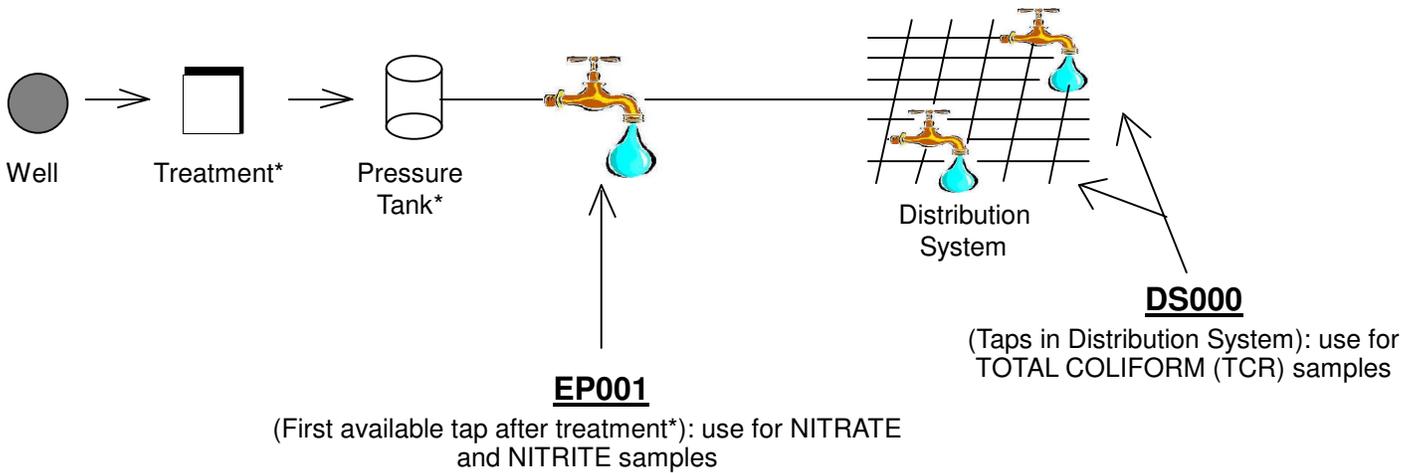

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7939212 PWS NAME: SHADY REST ARMY/NAVY CLUB

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959321 FACILITY NAME: SHADY REST ARMY NAVY CLUB

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

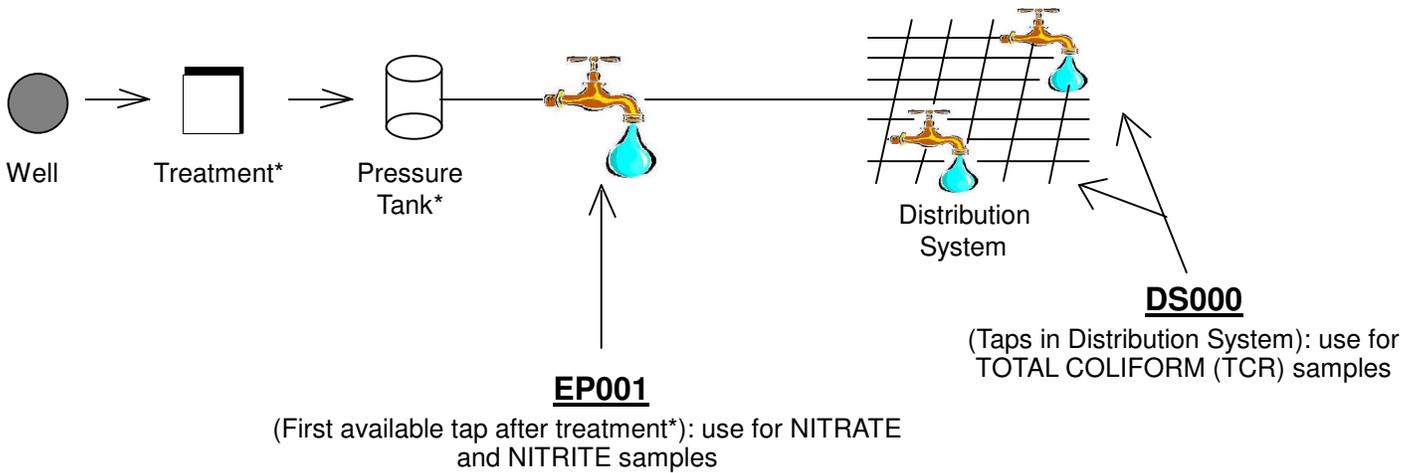

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7940512 PWS NAME: T.J.S RESTAURANT PWS
PWS TYPE: Transient Noncommunity SOURCE: Ground Water
Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959324 FACILITY NAME: TJS RESTAURANT

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	Monitoring Requirements	Sample Monitoring Point
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

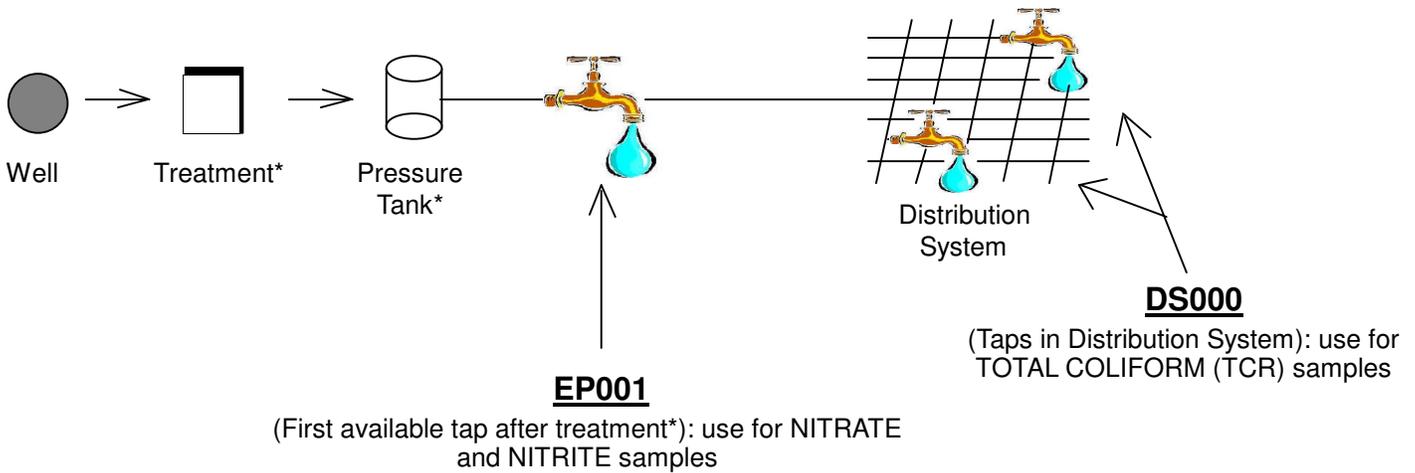

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7941012 PWS NAME: JERUSALEM CHURCH
PWS TYPE: Transient Noncommunity SOURCE: Ground Water
Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959326 FACILITY NAME: JERUSALEM CHURCH

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

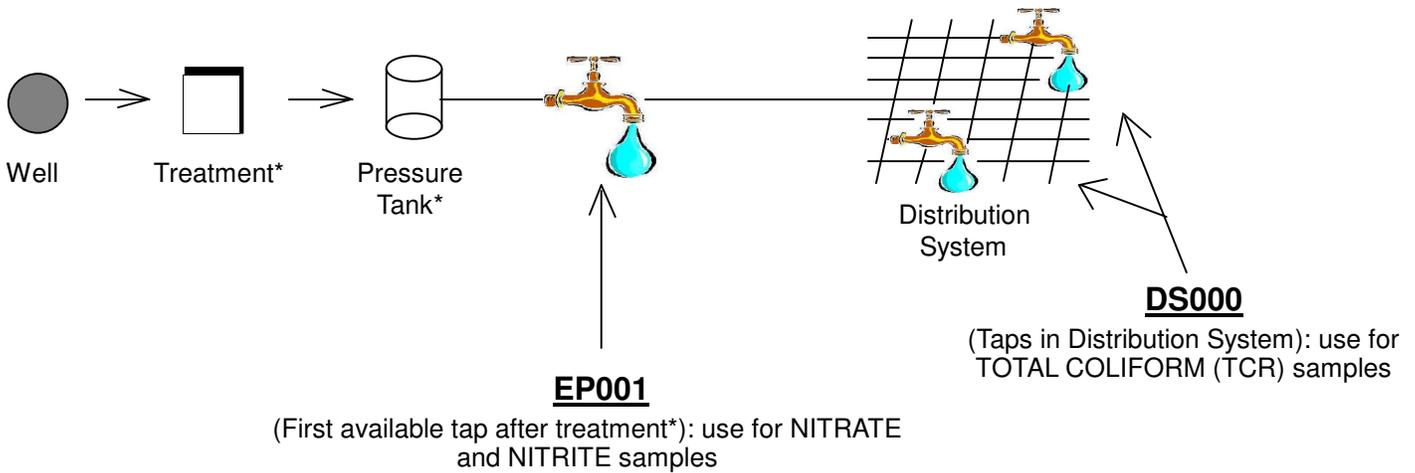

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7941112 PWS NAME: UNITED METHODIST CHURCH

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959327 FACILITY NAME: UNITED METHODIST CHURCH

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

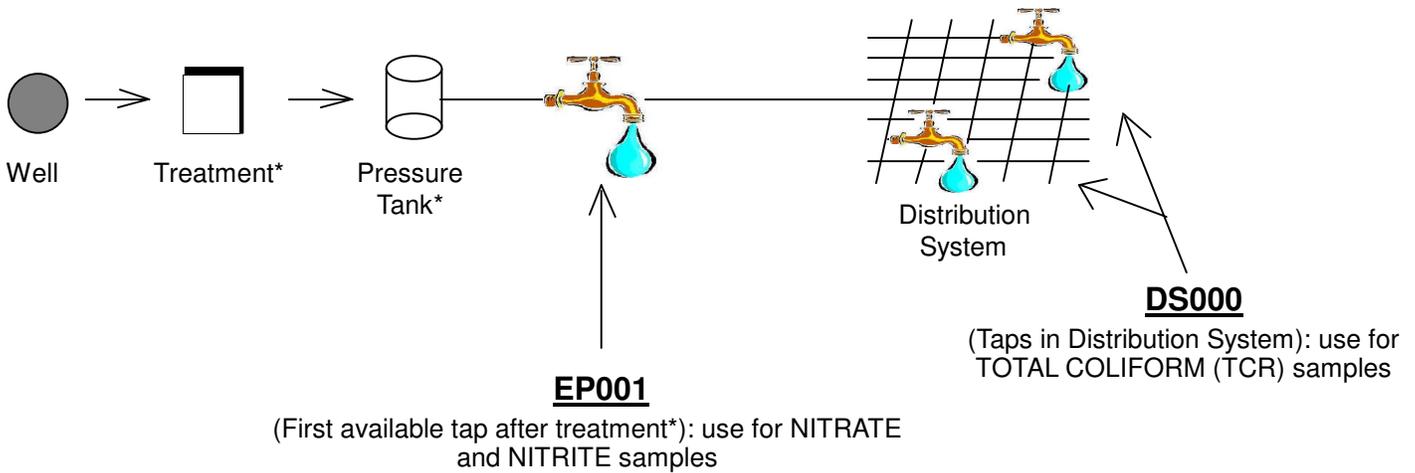

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7941312 PWS NAME: HOG HEAVEN OF DOVER, INC PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959328 FACILITY NAME: HOG HEAVEN

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

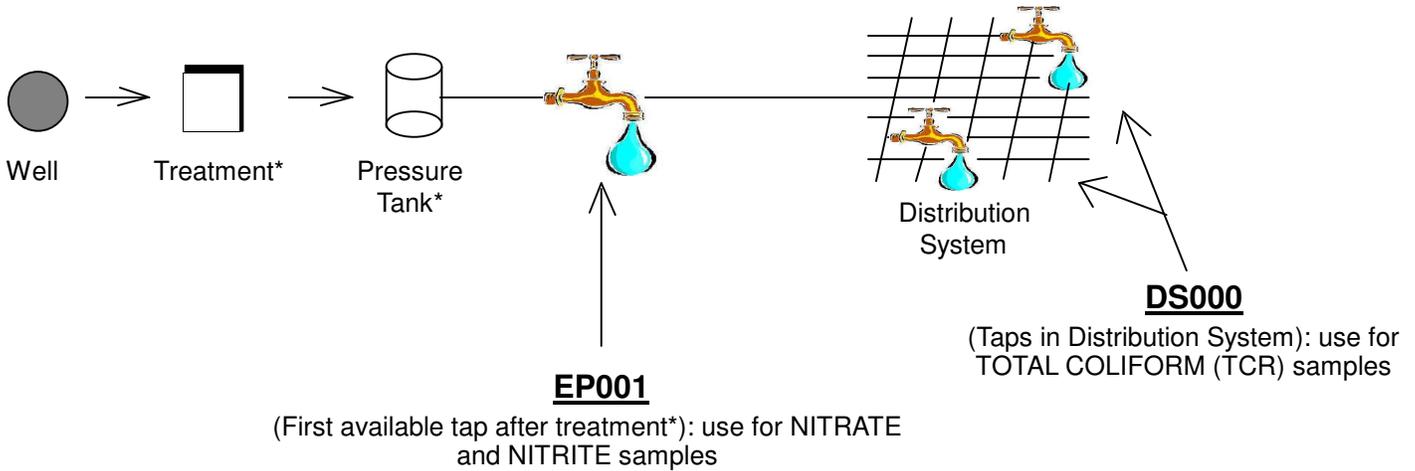

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7941512 PWS NAME: WEST UNION UNITED METHODIST CHURCH

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959329 FACILITY NAME: WEST UNION UNITED METH CHURCH

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

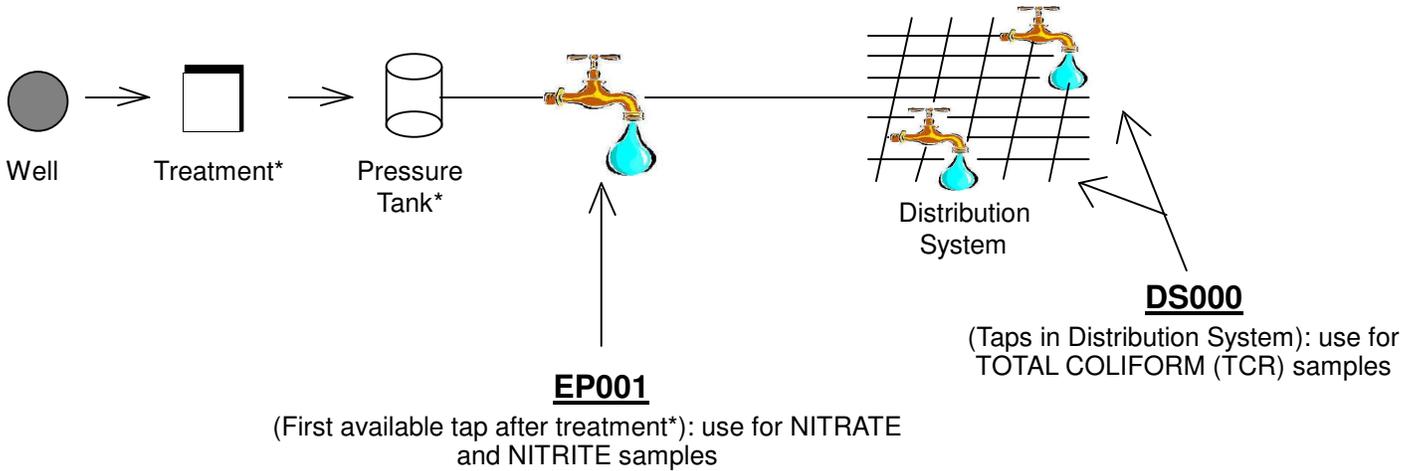

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7941812 PWS NAME: WOOSTER HIGHWAY CHURCH OF GOD PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959330 FACILITY NAME: WOOSTER HWY CHURCH OF GOD

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

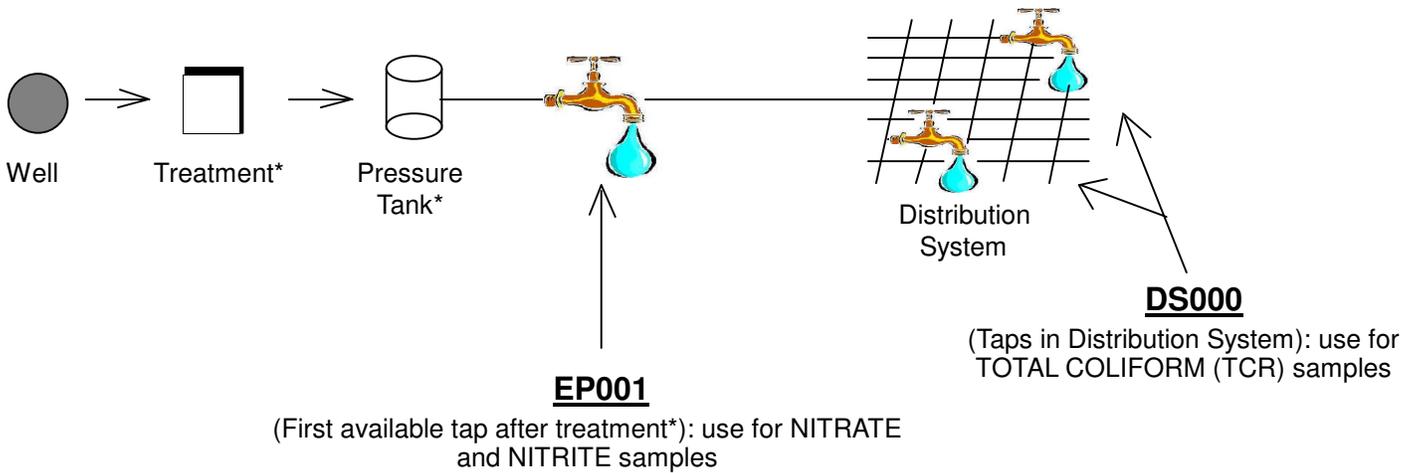

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH7942012 PWS NAME: YORK ELEMENTARY SCHOOL

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: EP001

STATE FACILITY ID: 7959331 FACILITY NAME: YORK ELEMENTARY SCHOOL

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRITE	NITRITE - 1041	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 7959331. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
NITRATE Sample Date(s):

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH7942012 PWS NAME: YORK ELEMENTARY SCHOOL

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: YORK ELEMENTARY SCHOOL DISTRIBUTION

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	5 Sample(s) between 6/1/2011 and 9/30/2011
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southeast District Office - DDAGW representative immediately at 740-385-8501.

Use for Sample Tracking Purposes				
<i>Lead & Copper Sample Date(s):</i>				
<i>TCR Quarterly Sample Date(s):</i>				
	<i>Jan - Mar Sample Date(s)</i>	<i>Apr - Jun Sample Date(s)</i>	<i>Jul - Sept Sample Date(s)</i>	<i>Oct - Dec Sample Date(s)</i>

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7942112 PWS NAME: ZION LUTHERAN CHURCH

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959332 FACILITY NAME: ZION LUTHERAN CHURCH

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

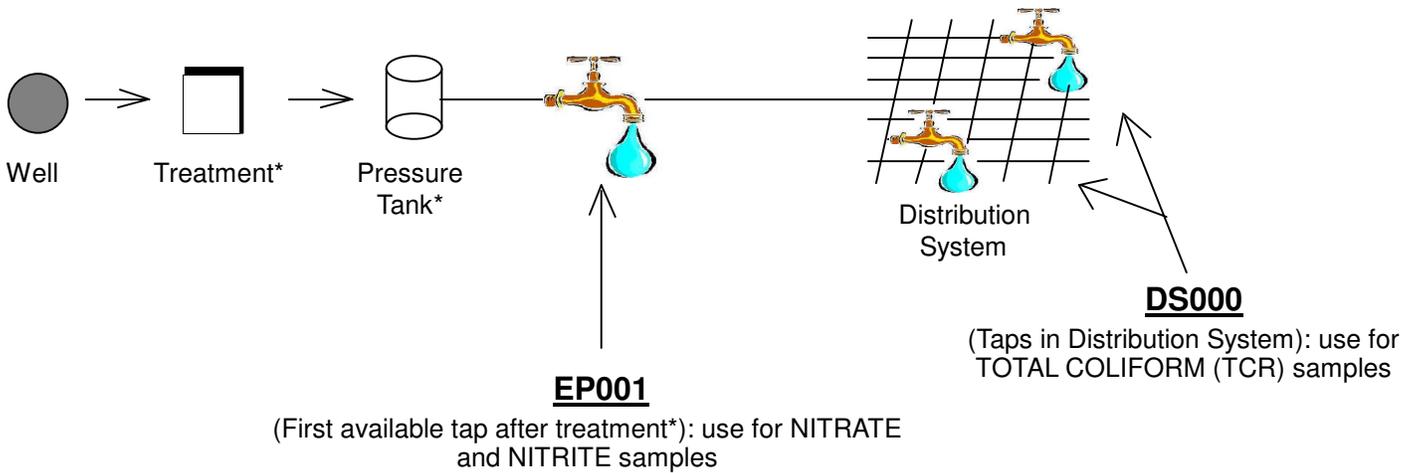

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes
Nitrate Sample Date(s):

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7942212 PWS NAME: ZOAR VILLAGE GOLF COURSE INC.

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959333 FACILITY NAME: ZOAR VLG GOLF COURSE INC

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

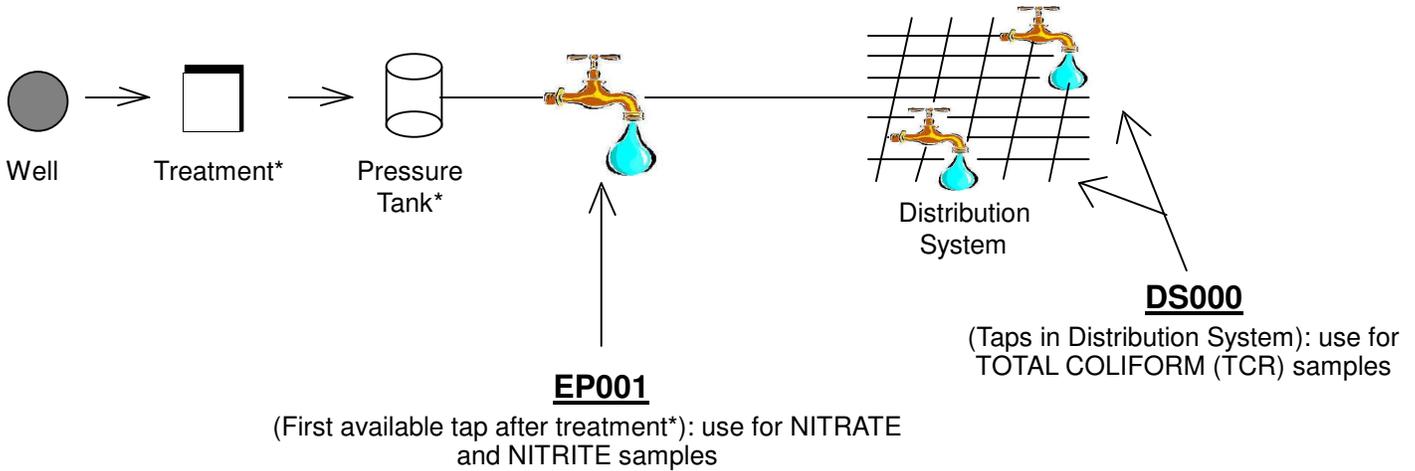

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7942612 PWS NAME: ATWOOD DARI BAR
PWS TYPE: Transient Noncommunity SOURCE: Ground Water
Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959334 FACILITY NAME: ATWOOD DAIRY BAR

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	Monitoring Requirements	Sample Monitoring Point
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 4/1/2011 and 9/30/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

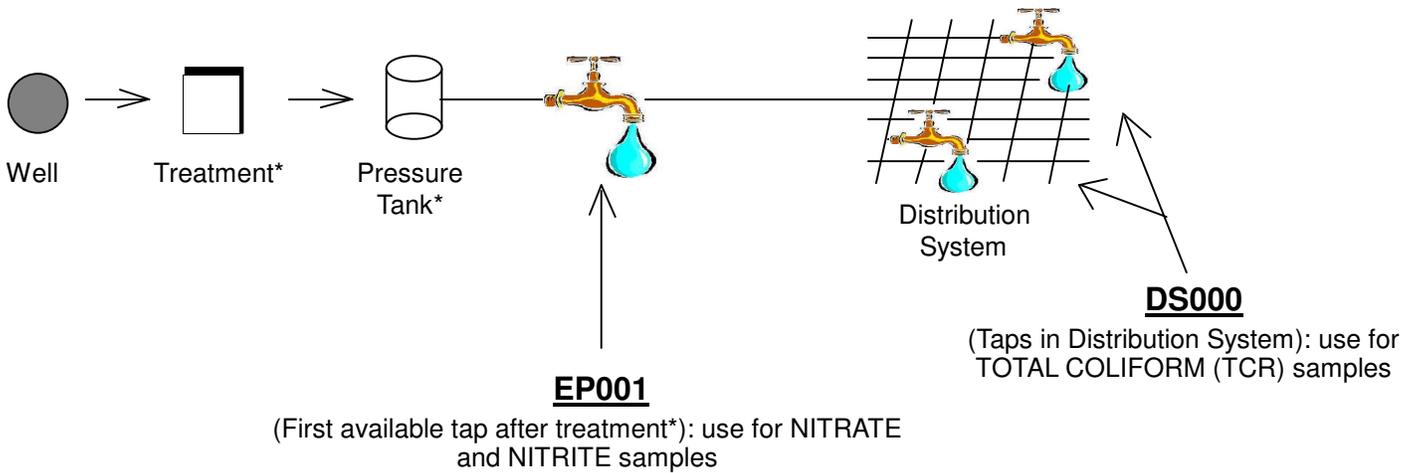

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7942912 PWS NAME: BROAD RUN CHEESE HOUSE

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959335 FACILITY NAME: BROAD RUN CHEESE HOUSE

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

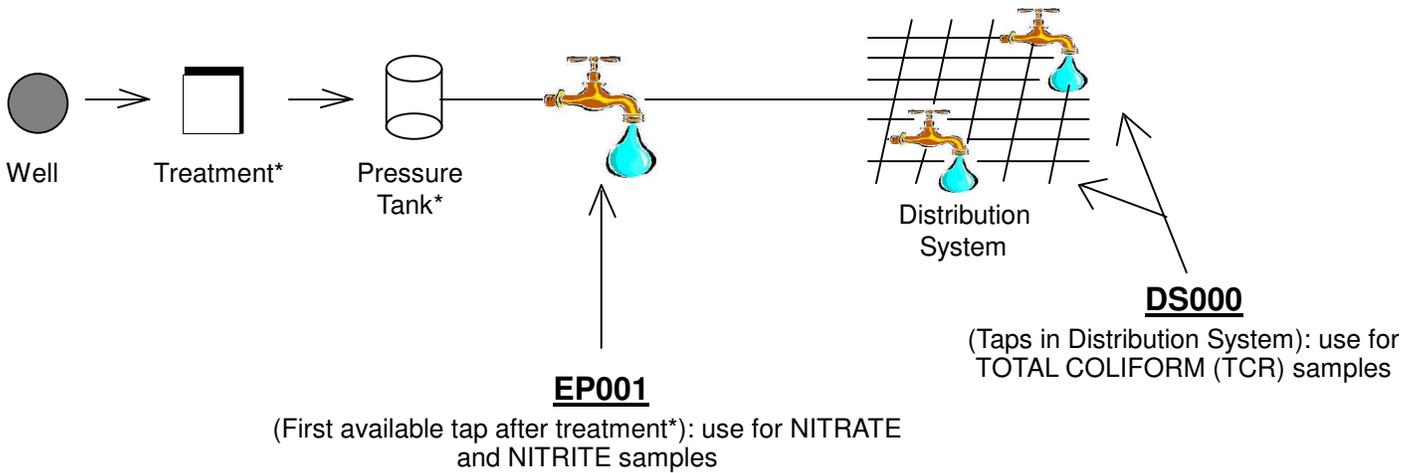

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7943012 PWS NAME: COLUMBIA SKATELAND
PWS TYPE: Transient Noncommunity SOURCE: Ground Water
Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959336 FACILITY NAME: COLUMBIA SKATELAND

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 6/30/2011	Sample should be taken at DS000
	1 Sample(s) Quarterly between 10/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

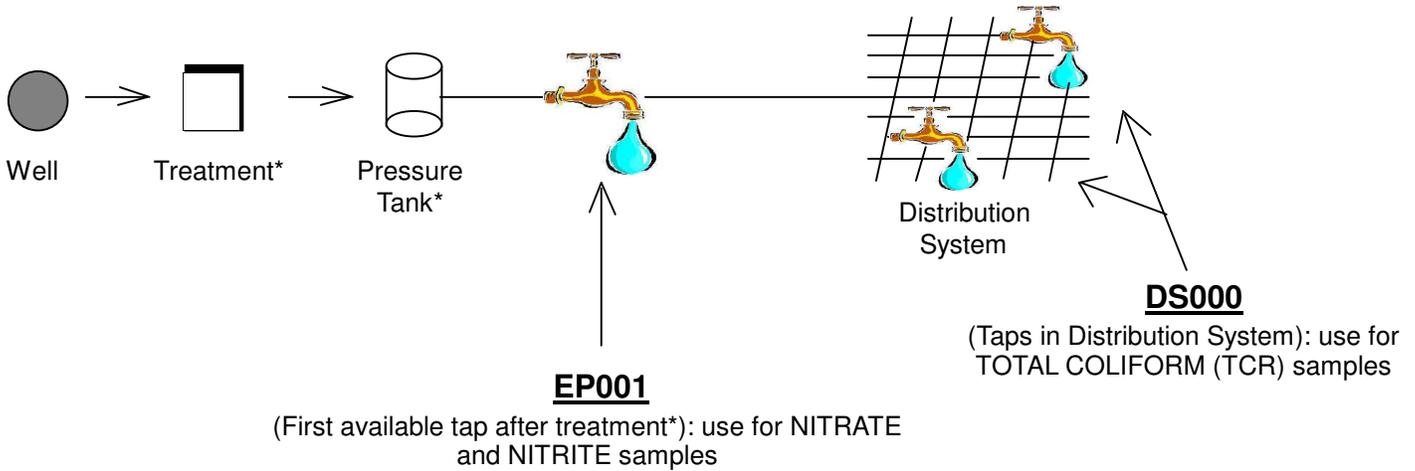

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7943112 PWS NAME: DOVER BIBLE CHURCH
PWS TYPE: Transient Noncommunity SOURCE: Ground Water
Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959337 FACILITY NAME: DOVER BIBLE CHURCH

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	Monitoring Requirements	Sample Monitoring Point
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

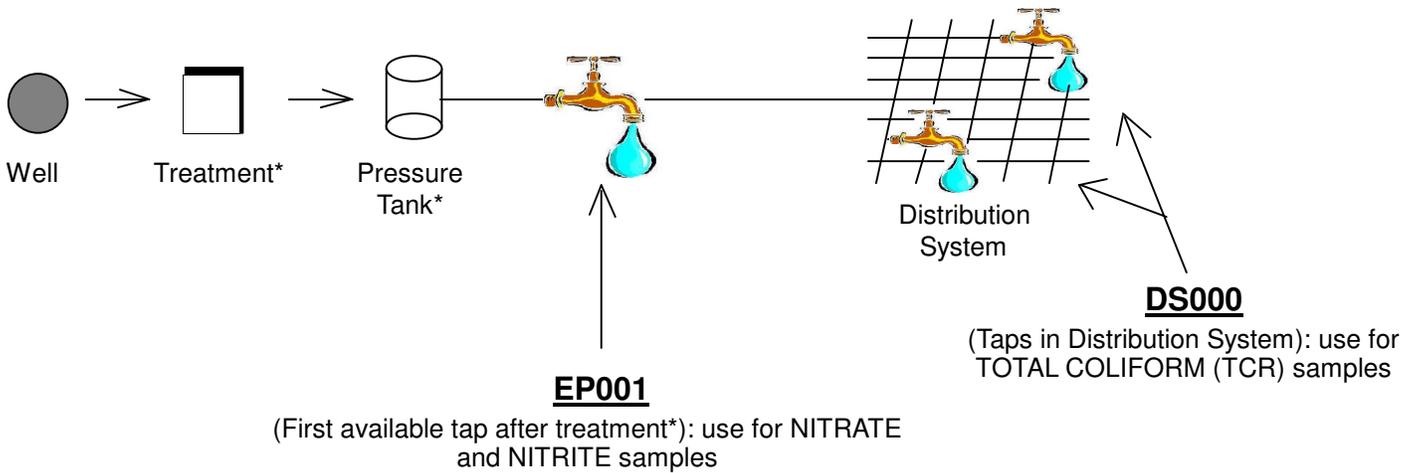

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7943212 PWS NAME: LAKEVIEW BAPTIST CHURCH

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959338 FACILITY NAME: LAKEVIEW BAPTIST CHURCH

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

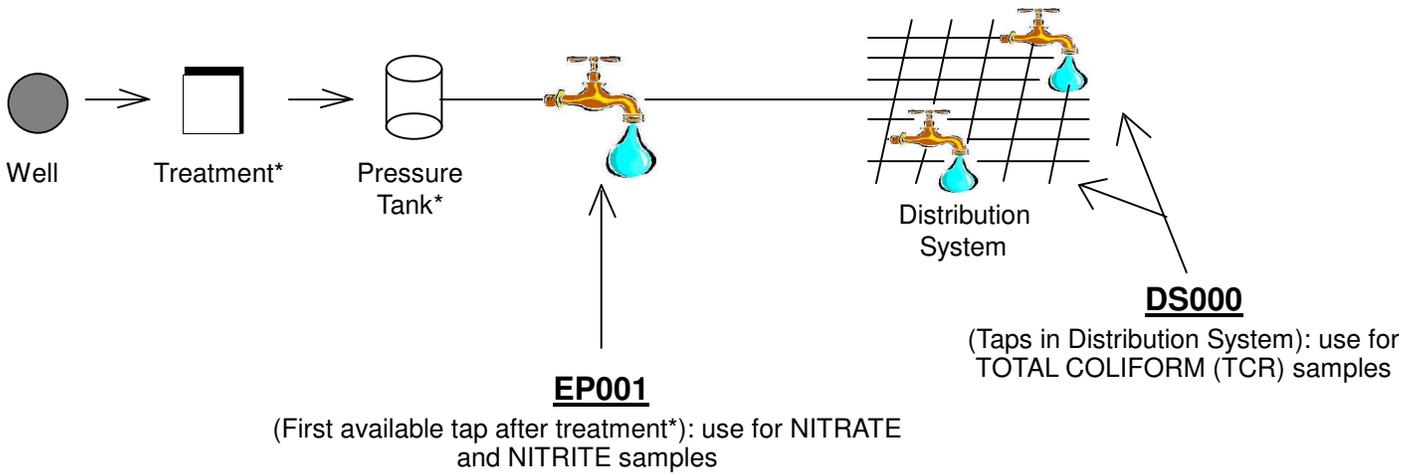

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7944812 PWS NAME: USACE-ATWOOD DAM
PWS TYPE: Transient Noncommunity SOURCE: Ground Water
Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959342 FACILITY NAME: USACE ATWOOD DAM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 4/1/2011 and 10/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

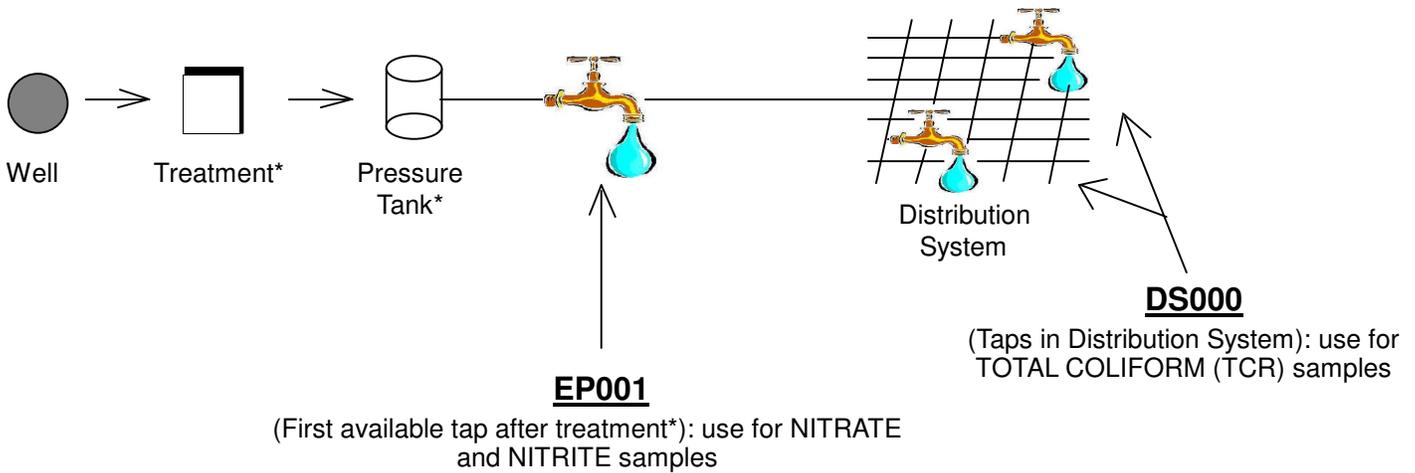

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7944912 PWS NAME: USACE-BEACH CITY DAM
PWS TYPE: Transient Noncommunity SOURCE: Ground Water
Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959343 FACILITY NAME: USACE BEACH CITY DAM

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	Monitoring Requirements	Sample Monitoring Point
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 5/1/2011 and 9/30/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

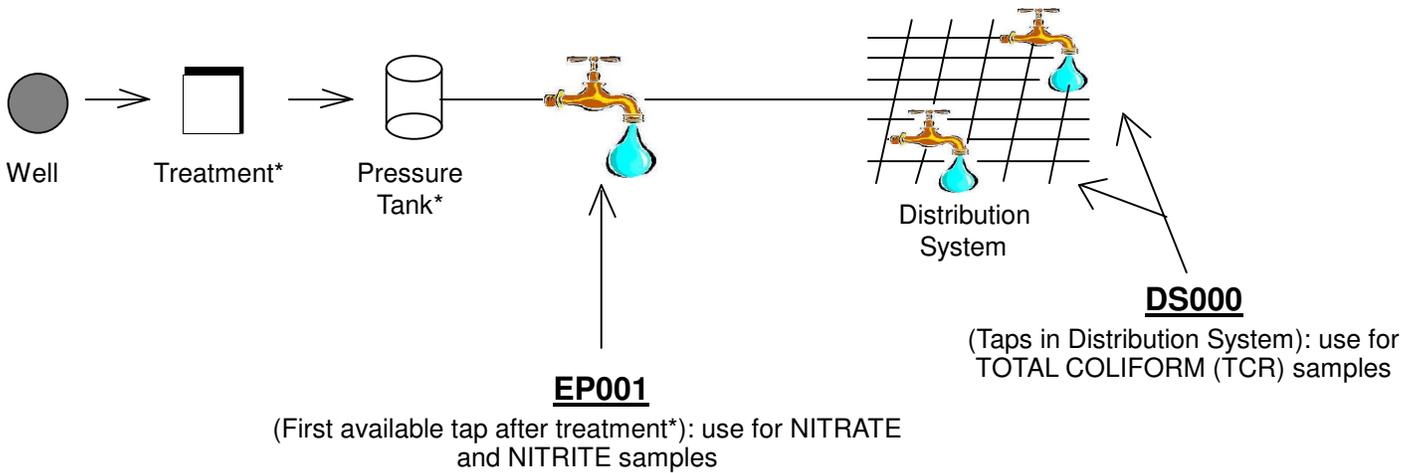

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7945012 PWS NAME: **CAMP ZIMMERMAN**
PWS TYPE: **Transient Noncommunity** SOURCE: **Ground Water**
Groundwater Rule Minimal Treatment System

Effective Date: 4/14/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959344 FACILITY NAME: CAMP ZIMMERMAN

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

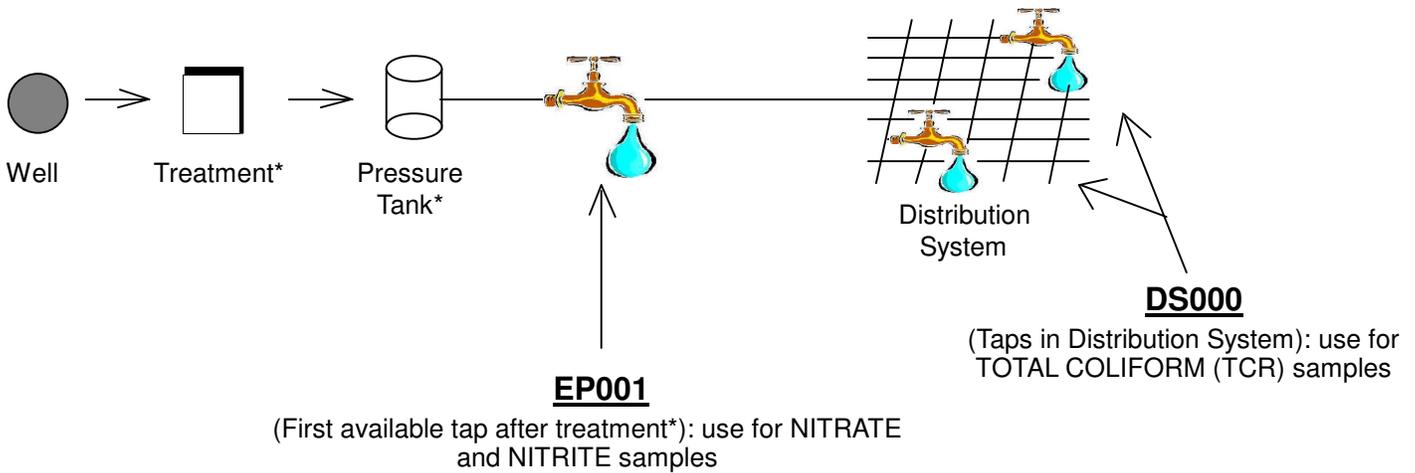

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes
Nitrate Sample Date(s):
Nitrite Sample Date(s):

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7945212 PWS NAME: REDIVISION INC. - DBA LYN AUTO PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959345 FACILITY NAME: REDIVISION INC DBA LYN AUTO

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 4/1/2011 and 9/30/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

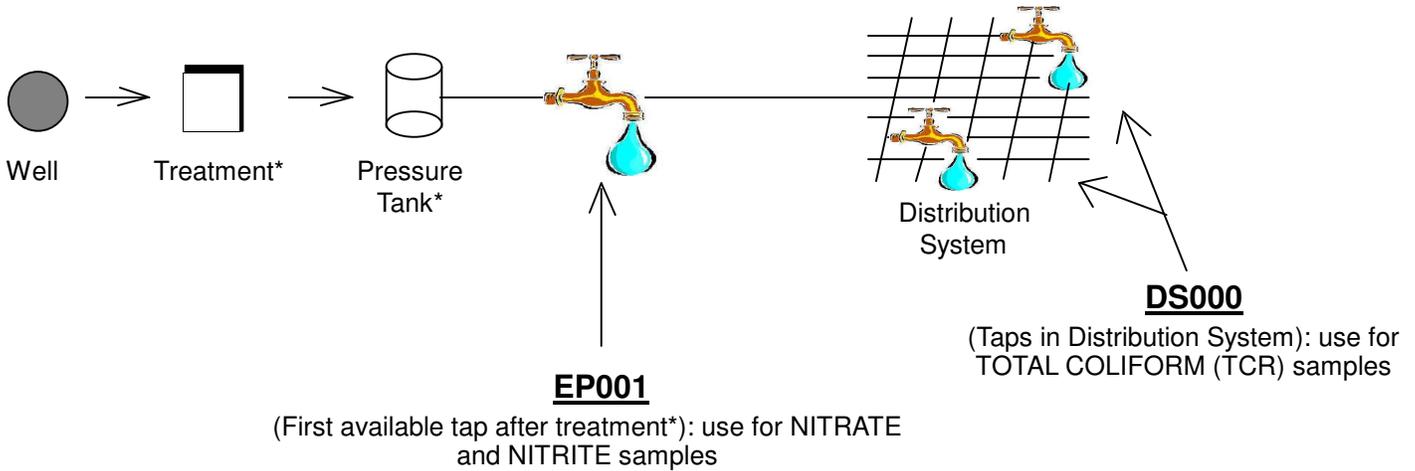

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7945312 PWS NAME: ROXFORD METHODIST CHURCH

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959346 FACILITY NAME: ROXFORD METHODIST CHURCH

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

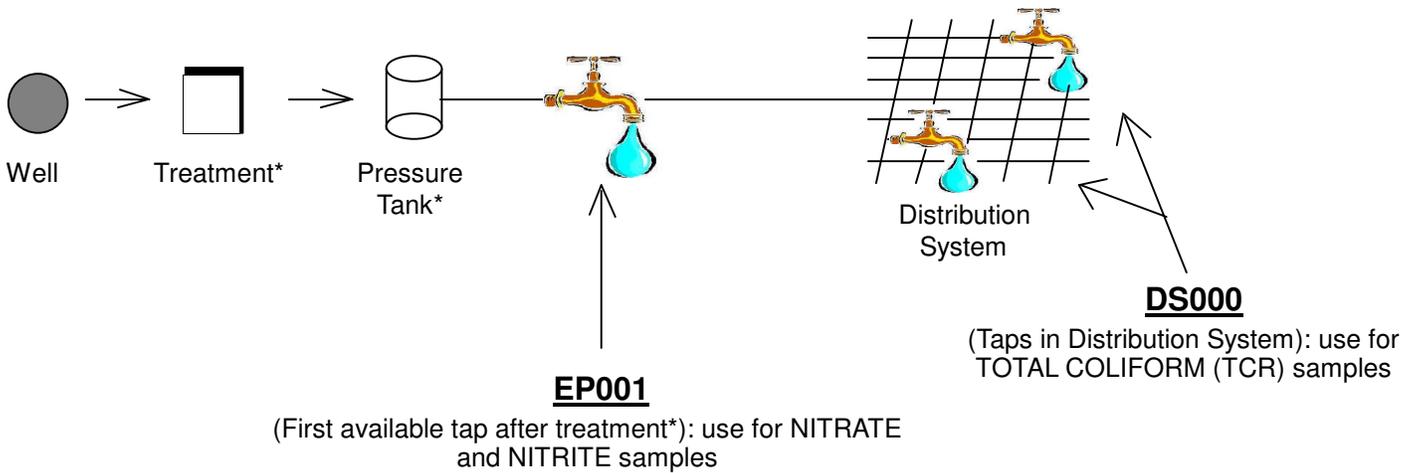

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7945412 PWS NAME: WILLANDALE GOLF CLUB, INC

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959347 FACILITY NAME: WILLANDALE GOLF CLUB, INC

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

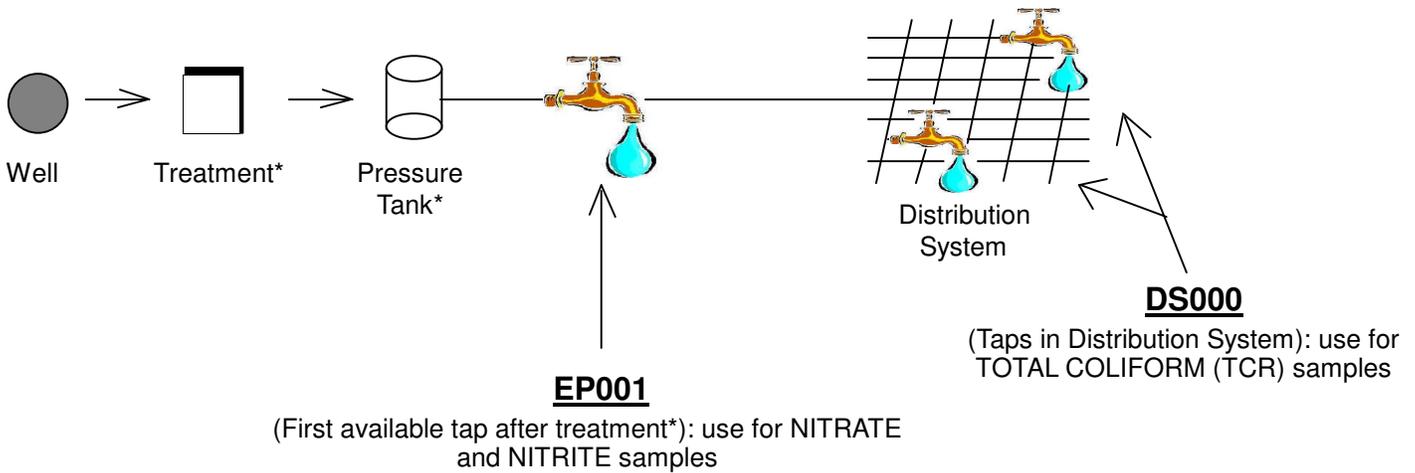

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7945812 PWS NAME: Y TAVERN

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959348 FACILITY NAME: Y TAVERN

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

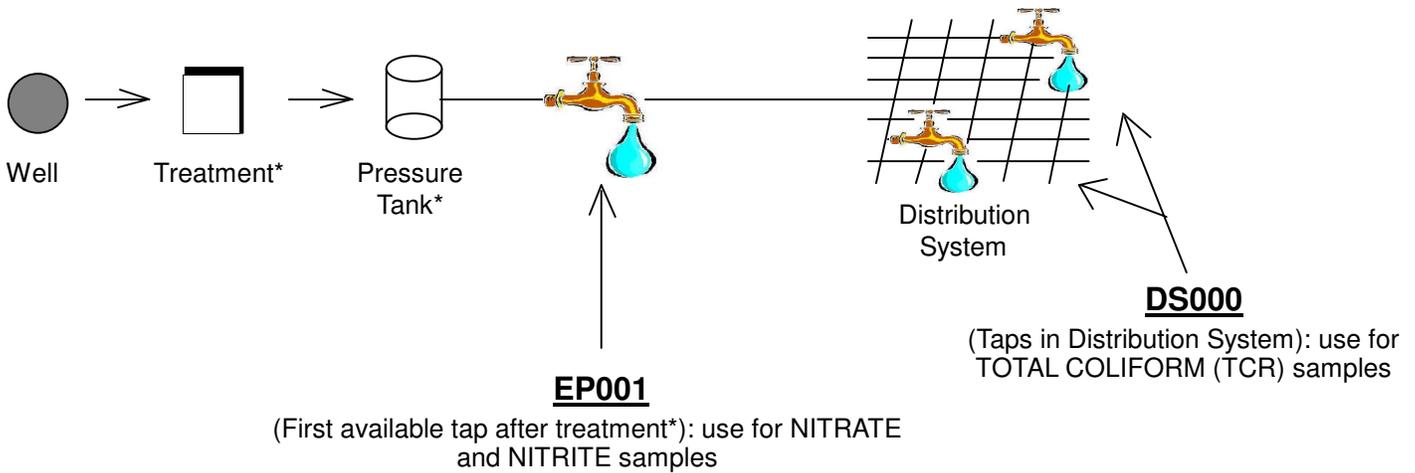

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7946312 PWS NAME: USACE-BOLIVAR DAM
PWS TYPE: Transient Noncommunity SOURCE: Ground Water
Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959349 FACILITY NAME: USACE BOLIVAR DAM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 4/1/2011 and 9/30/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

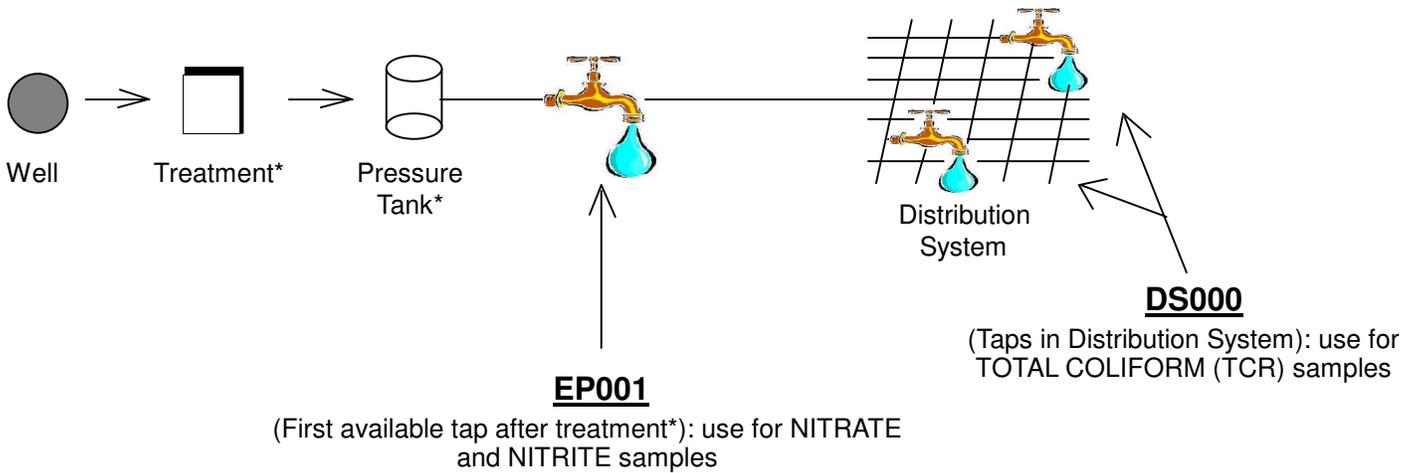

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7947612 PWS NAME: WINFIELD UNITED METHODIST CHURCH PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959356 FACILITY NAME: WINFIELD UM CHURCH

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

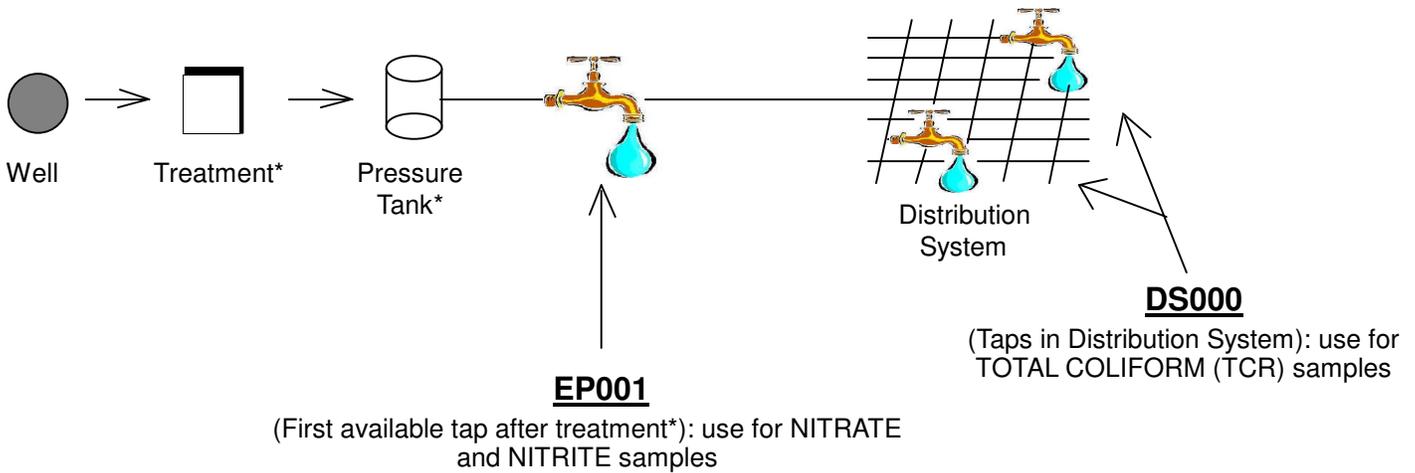

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH7947712 PWS NAME: BATES METAL PRODUCTS,INC

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: EP001

STATE FACILITY ID: 7959357 FACILITY NAME: BATES METAL PRODUCTS INC

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRITE	NITRITE - 1041	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 3 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 7959357. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

SOC Group 3 Chemicals: BHC-GAMMA (LINDANE) - 2010, METHOXYCHLOR - 2015, DIQUAT - 2032, GLYPHOSATE - 2034, POLYCHLORINATED BIPHENYLS (PCB) - 2383

Use for Sample Tracking Purposes

NITRATE Sample Date(s):

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH7947712 PWS NAME: BATES METAL PRODUCTS,INC

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: BATES METAL PRODUCTS,INC DISTRIBUTION

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	5 Sample(s) between 6/1/2011 and 9/30/2011
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** Not Required, Unless State Delinquency Notice Received
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southeast District Office - DDAGW representative immediately at 740-385-8501.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes				
<i>Lead & Copper Sample Date(s):</i>				
<i>TCR Quarterly Sample Date(s):</i>	<i>Jan - Mar Sample Date(s)</i>	<i>Apr - Jun Sample Date(s)</i>	<i>Jul - Sept Sample Date(s)</i>	<i>Oct - Dec Sample Date(s)</i>

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7947912 PWS NAME: ST. PAULS CHURCH PWS
PWS TYPE: Transient Noncommunity SOURCE: Ground Water
Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959359 FACILITY NAME: SAINT PAULS CHURCH OF CHRIST

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) Quarterly	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

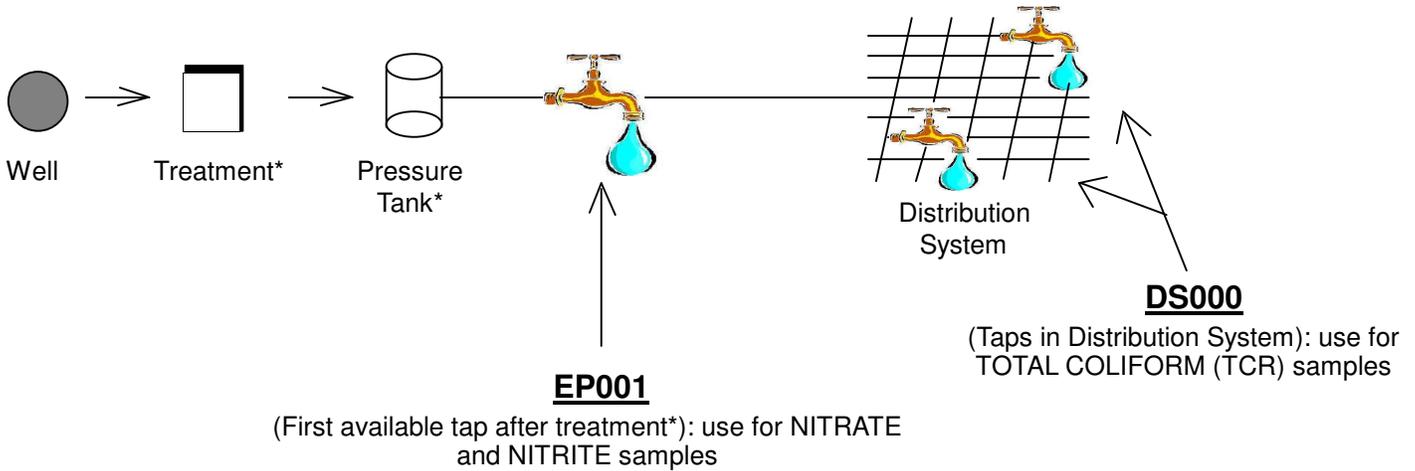

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)
Nitrate Quarterly Sample Date(s):				
TCR Quarterly Sample Date(s):				

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7948012 PWS NAME: CAMP TUSCAZOAR FOUNDATION, INC.

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959360 FACILITY NAME: CAMP TUSCAZOAR FOUNDATION INC

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

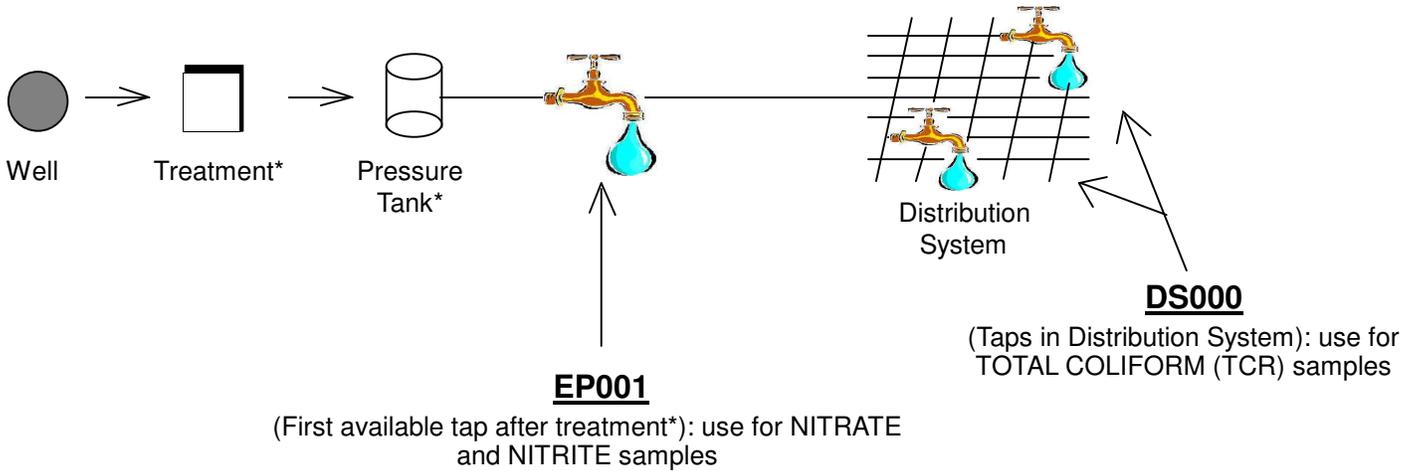

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7948212 PWS NAME: SCHOENBRUNN AMPHITHEATRE

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959362 FACILITY NAME: SCHOENBRUNN AMPHITHEATER

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 5/1/2011 and 9/30/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

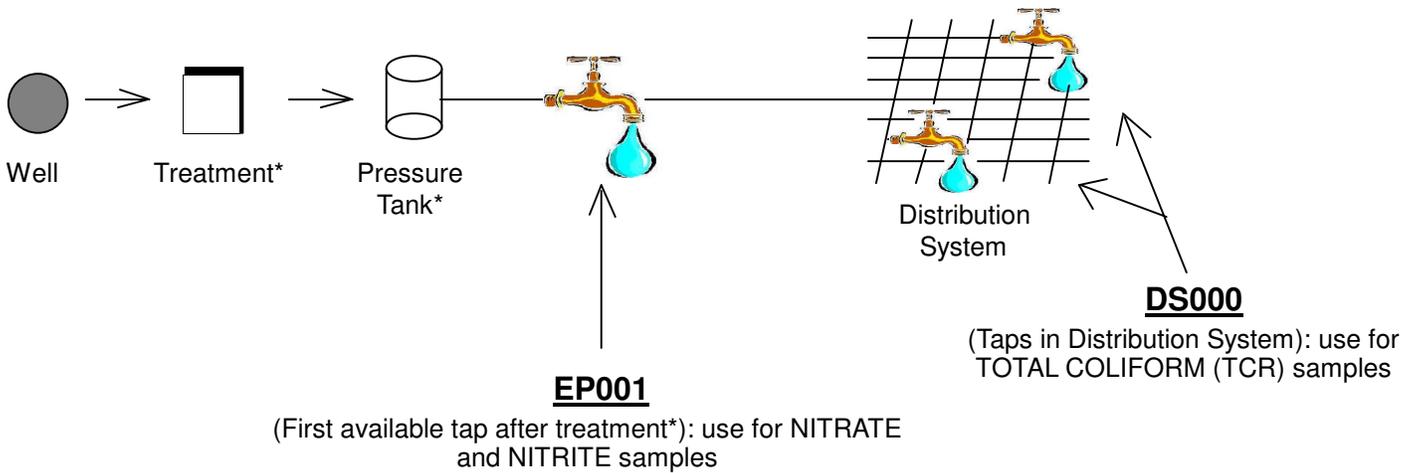

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7948412 PWS NAME: MARANATHA CHURCH
PWS TYPE: Transient Noncommunity SOURCE: Ground Water
Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959364 FACILITY NAME: MARANATHA CHURCH

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	Monitoring Requirements	Sample Monitoring Point
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

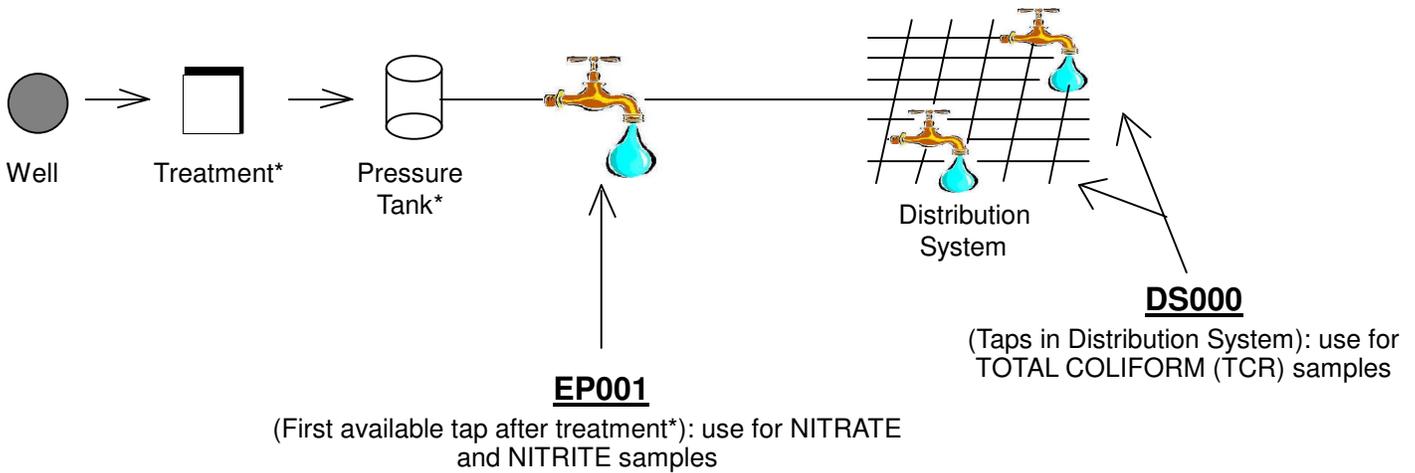

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7948512 PWS NAME: CALVARY BAPTIST CHURCH

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959365 FACILITY NAME: CALVARY BAPTIST CHURCH

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

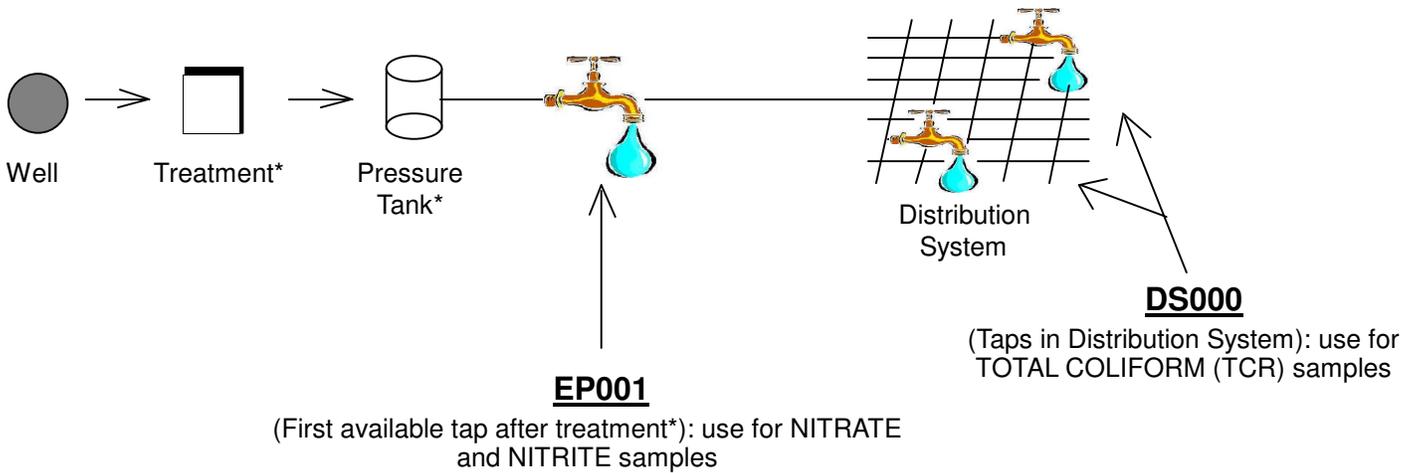

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7948612 PWS NAME: VALLEY VIEW COMMUNITY CHURCH

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7959366 FACILITY NAME: VALLEY VIEW COMMUNITY CHURCH

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

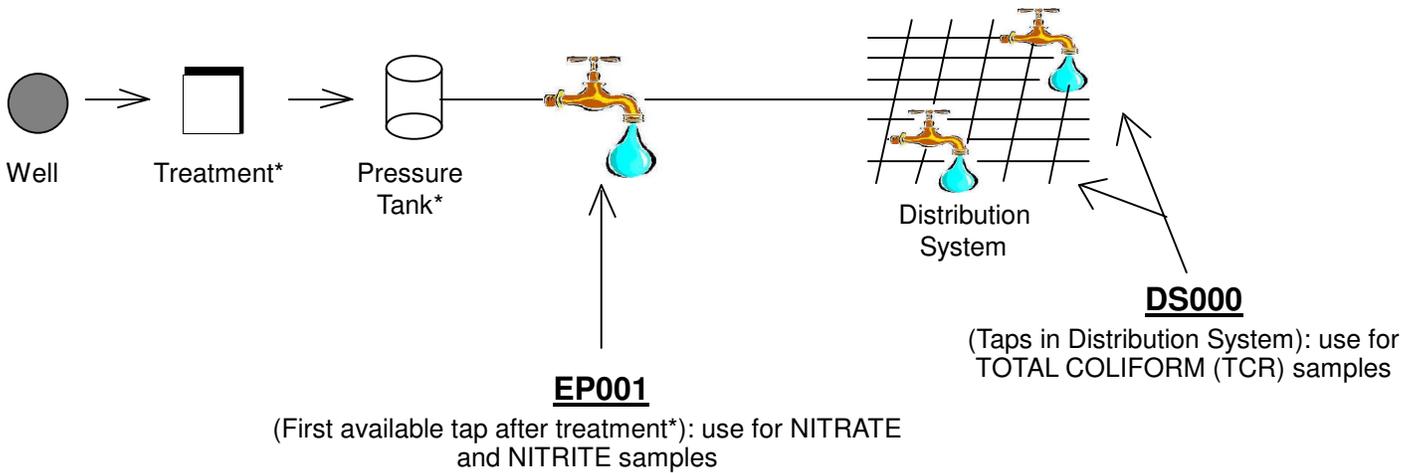

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7948912 PWS NAME: TONY'S 76 PWS
PWS TYPE: Transient Noncommunity SOURCE: Ground Water
Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7960658 FACILITY NAME: TONY'S 76

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 10/1/2011 and 12/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	Monitoring Requirements	Sample Monitoring Point
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

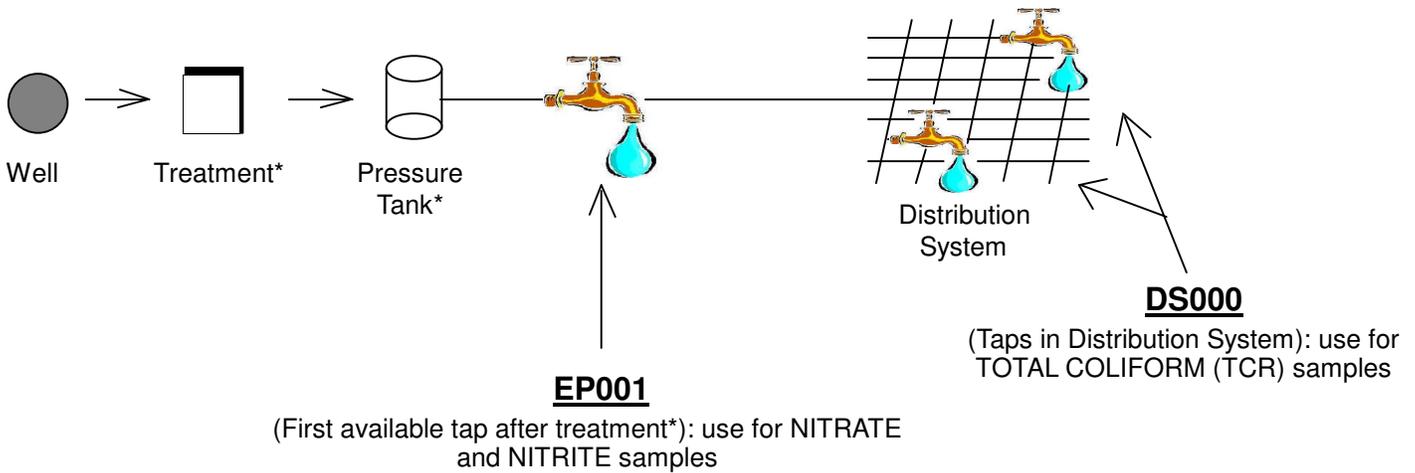

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7949212 PWS NAME: SHROCKS COUNTRY COOKIN PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7961423 FACILITY NAME: SHROCKS COUNTRY COOKING

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 4/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

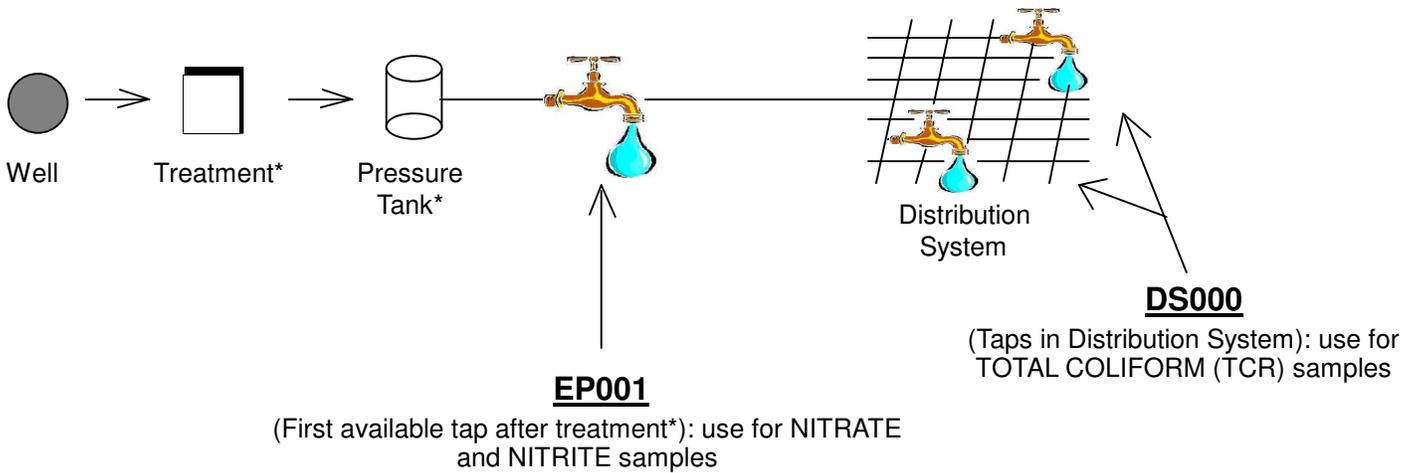

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7949412 PWS NAME: AUMAN TIMBERS GOLF PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7961734 FACILITY NAME: AUMAN TIMBERS GOLF

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 4/1/2011 and 12/31/2011	Sample should be taken at DS000
	1 Sample(s) Quarterly between 4/1/2011 and 9/30/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

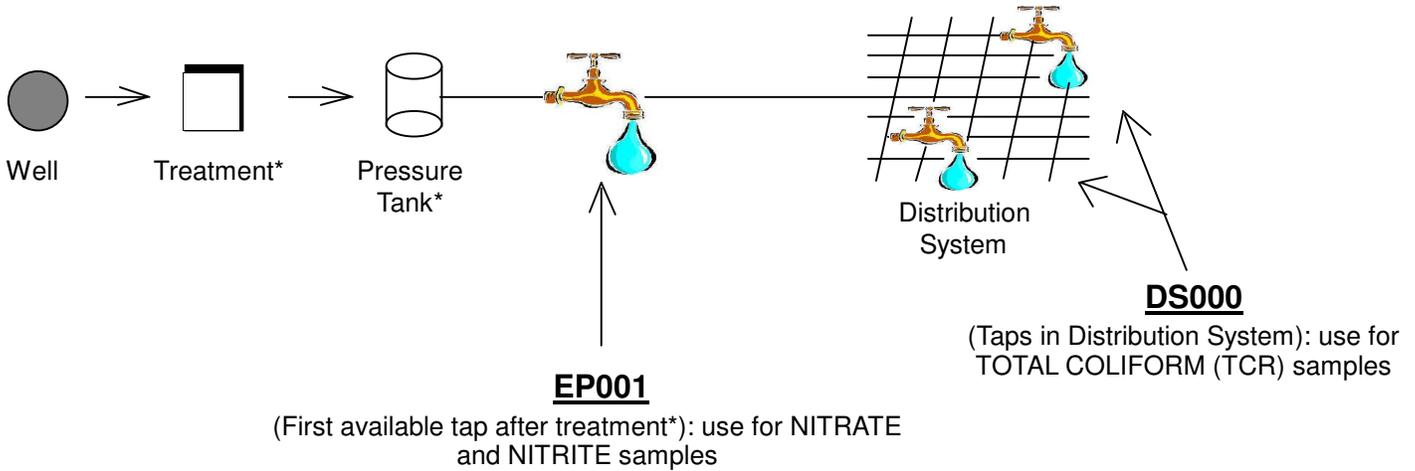

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7949512 PWS NAME: ROXFORD FAMILY LIFE CENTER PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7961815 FACILITY NAME: ROXFORD FAMILY LIFE CENTER

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

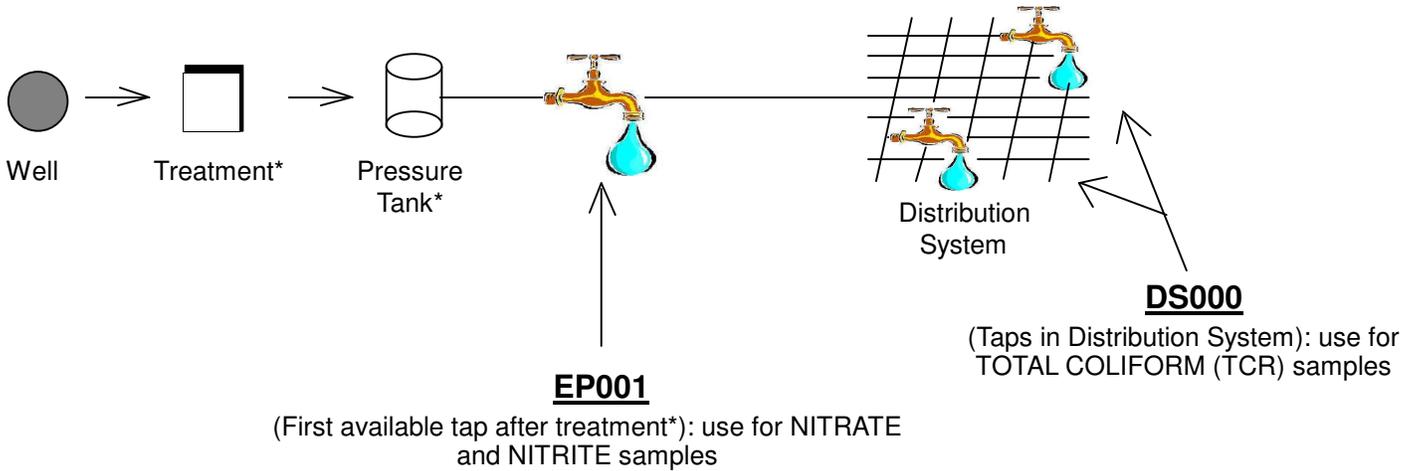

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH7949612 PWS NAME: NEWPOINTE COMMUNITY CHURCH PWS
PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: EP001
STATE FACILITY ID: 7961930 FACILITY NAME: NEWPOINTE COMMUNITY CHURCH
Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRITE	NITRITE - 1041	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		1 Sample(s) between 6/1/2011 and 10/31/2011
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 7961930. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
NITRATE Sample Date(s):
VOC Sample Date(s):

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH7949612 PWS NAME: NEWPOINTE COMMUNITY CHURCH PWS
PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: DS000
FACILITY NAME: NEWPOINTE COMMUNITY CHURCH DISTRIB
Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	5 Sample(s) between 6/1/2011 and 9/30/2011
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** 1 Sample(s) between 7/1/2011 and 9/30/2011
TOTAL COLIFORM (TCR) - 3100	3 Sample(s) Monthly between 1/1/2011 and 12/31/2011
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period.

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southeast District Office - DDAGW representative immediately at 740-385-8501.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
Lead & Copper Sample Date(s):												
HAA5 & TTHM Sample Date(s):												
TCR Monthly Sample Date(s):	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sept	Oct	Nov	Dec
Total Chlorine Sample Date(s):												

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH7949712 PWS NAME: PROGRESSIVE FOAM TECHNOLOGIES PWS
PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: EP001
STATE FACILITY ID: 7961950 FACILITY NAME: PROGRESSIVE FOAM TECHNOLOGIES
Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
ARSENIC	ARSENIC - 1005	1 Sample(s) Quarterly
NITRATE	NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRITE	NITRITE - 1041	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 7961950. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

INORGANIC Chemicals: ANTIMONY - 1074, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes				
	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)
<i>ARSENIC Quarterly Sample Date(s):</i>				
<i>NITRATE Sample Date(s):</i>				
<i>VOC Quarterly Sample Date(s):</i>				

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH7949712 PWS NAME: PROGRESSIVE FOAM TECHNOLOGIES PWS
PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: DS000
FACILITY NAME: PROGRESSIVE FOAM TECHNOLOGIES DISTRIBUTI
Groundwater Rule Minimal Treatment System

Effective Date: 1/19/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	Not Required
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southeast District Office - DDAGW representative immediately at 740-385-8501.

Use for Sample Tracking Purposes				
<i>TCR Quarterly Sample Date(s):</i>	<i>Jan - Mar Sample Date(s)</i>	<i>Apr - Jun Sample Date(s)</i>	<i>Jul - Sept Sample Date(s)</i>	<i>Oct - Dec Sample Date(s)</i>

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7949812 PWS NAME: TALL TIMBER LAKE CAMP-CLUBHOUSE PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7962129 FACILITY NAME: TALL TIMBER LAKE CAMP-CLUBHOUSE

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

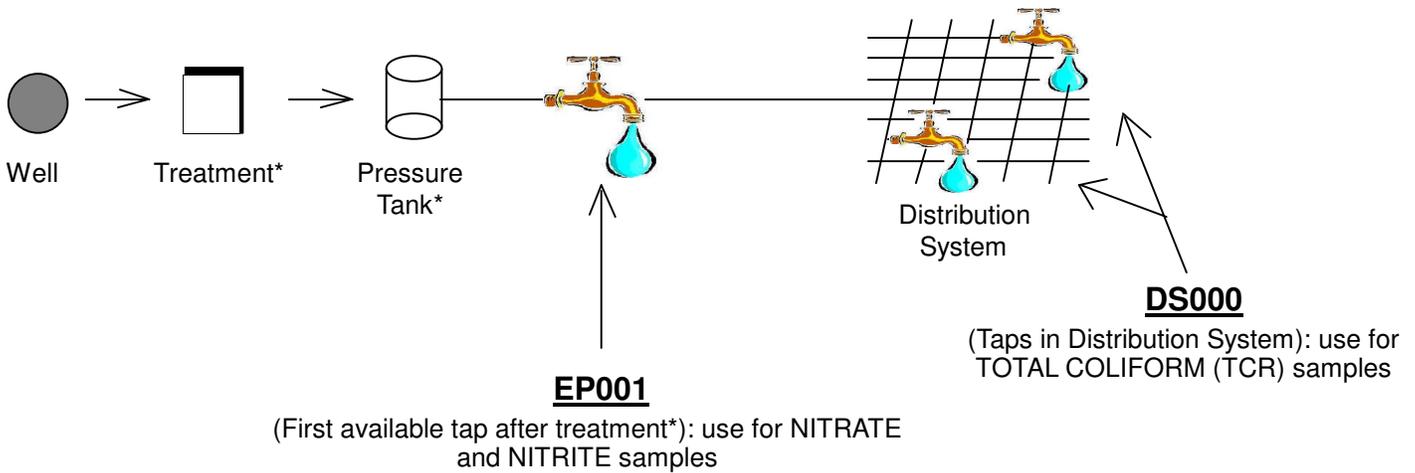

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7949912 PWS NAME: TALL TIMBER LAKE CAMP -CONCESSIONS PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7962130 FACILITY NAME: TALL TIMBER LAKE CAMP-CONCESSIONS

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 4/1/2011 and 10/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

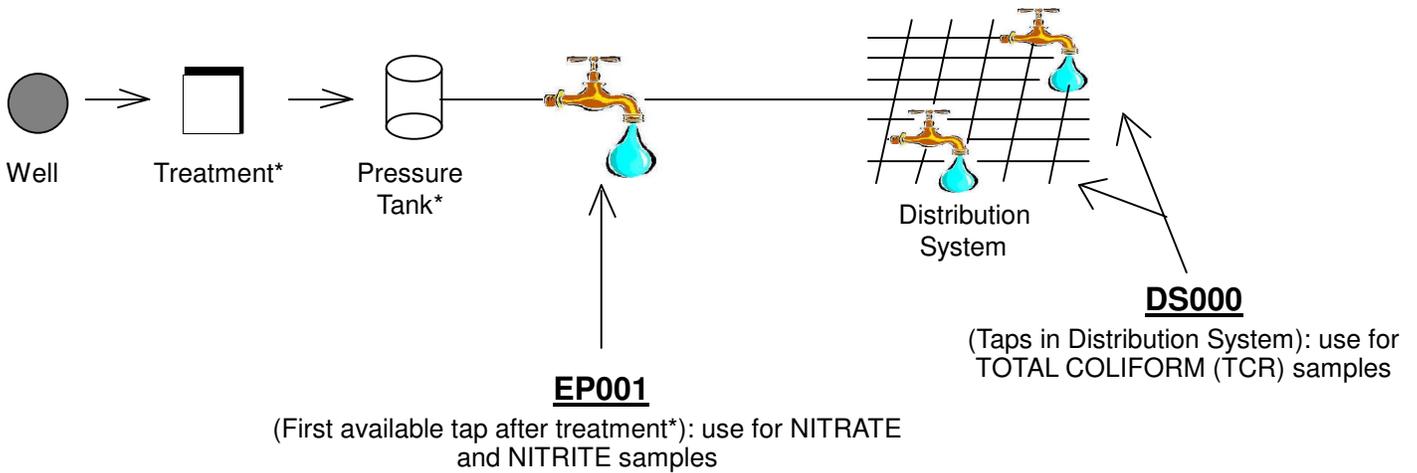

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7950012 PWS NAME: TALL TIMBER LAKE CAMP-CABIN/COTTAGE PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7962131 FACILITY NAME: TALL TIMBER LAKE CAMP-CABIN/COTTAGE

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 4/1/2011 and 10/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

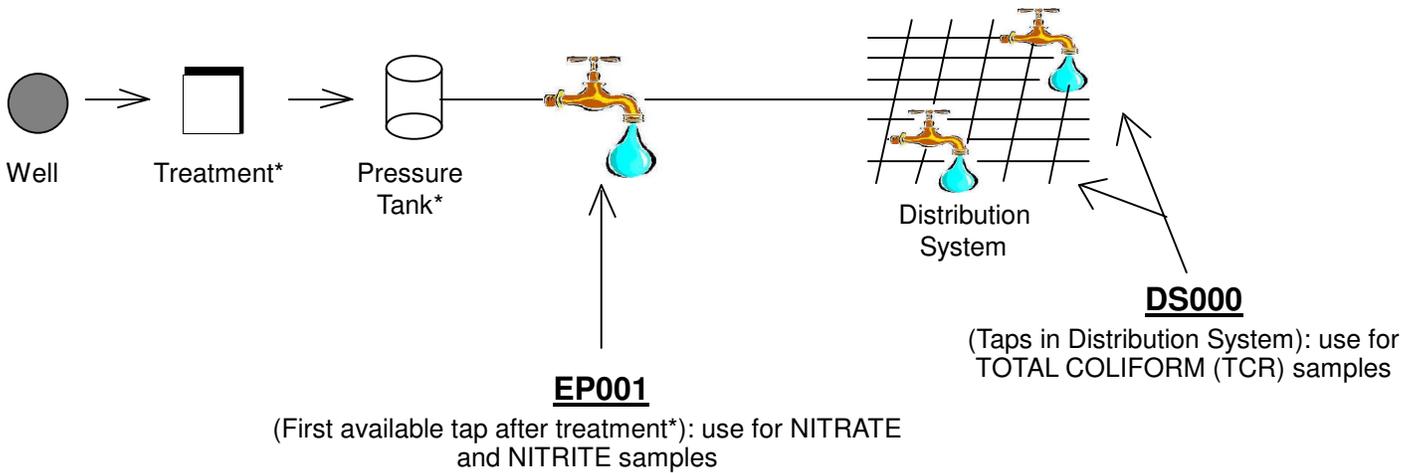

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes
Nitrate Sample Date(s):

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7950112 PWS NAME: TALL TIMBER LAKE CAMP-ShowerHOUSE PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 6/17/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7962132 FACILITY NAME: TALL TIMBER LAKE CAMP-ShowerHOUSE

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 4/1/2011 and 10/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

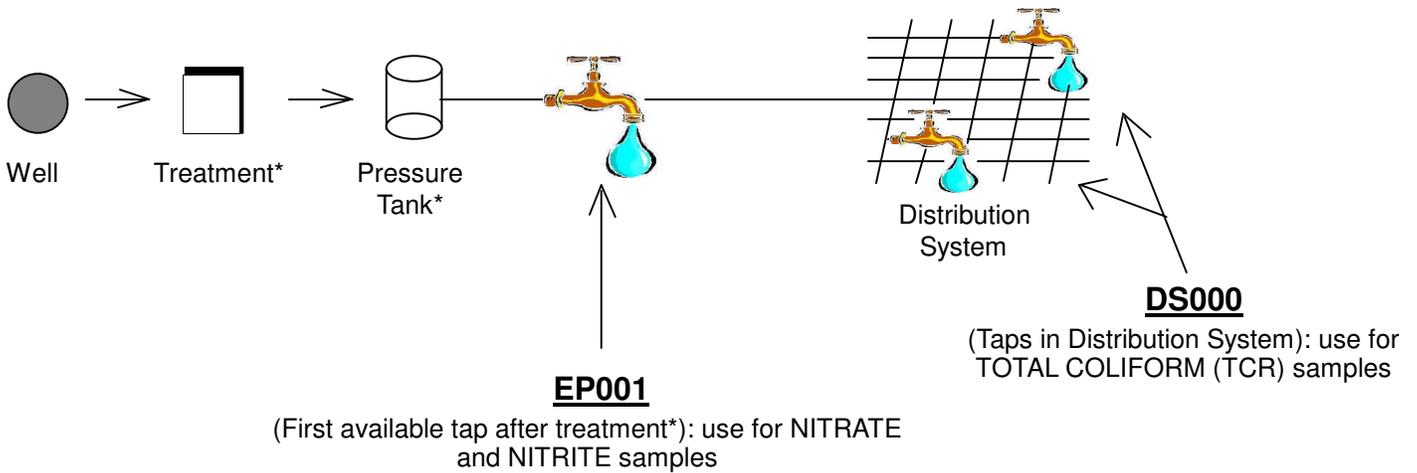

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes
Nitrate Sample Date(s):

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7950212 PWS NAME: TALL TIMBER LAKE CAMP-CAMPER SITES PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 6/17/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7962133 FACILITY NAME: TALL TIMBER LAKE CAMP-CAMPER SITES

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 4/1/2011 and 10/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

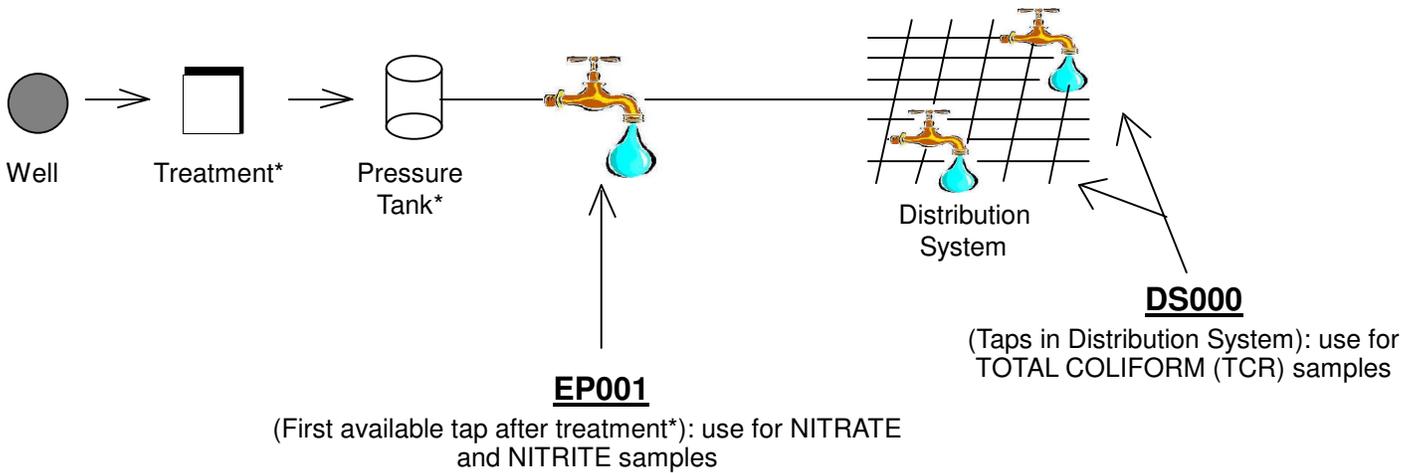

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes
Nitrate Sample Date(s):

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH7950312 PWS NAME: PORT WASHINGTON ELEM SCHOOL NEW PWS

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: EP002

STATE FACILITY ID: 7962150 FACILITY NAME: PORT WASHINGTON ELEM SCHOOL

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE - 1040	1 Sample(s) Monthly
NITRITE	NITRITE - 1041	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		1 Sample(s) Quarterly
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 2 List Below	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 3 List Below	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 4 List Below	1 Sample(s) between 4/1/2011 and 6/30/2011

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP002 and the State Facility ID is 7962150. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

SOC Group 2 Chemicals: CARBOFURAN - 2046, OXAMYL (VYDATE) - 2036, PICLORAM - 2040, 2,4-D - 2105, PENTACHLOROPHENOL - 2326

SOC Group 3 Chemicals: BHC-GAMMA (LINDANE) - 2010, METHOXYCHLOR - 2015, DIQUAT - 2032, GLYPHOSATE - 2034, POLYCHLORINATED BIPHENYLS (PCB) - 2383

SOC Group 4 Chemicals: BENZO (A) PYRENE - 2306, ENDOTHALL - 2033, DI(2-ETHYLHEXYL) - ADIPATE - 2035, DI(2-ETHYLHEXYL) - PHTHALATE - 2039

Use for Sample Tracking Purposes												
	<i>Jan</i>	<i>Feb</i>	<i>Mar</i>	<i>Apr</i>	<i>May</i>	<i>Jun</i>	<i>Jul</i>	<i>Aug</i>	<i>Sept</i>	<i>Oct</i>	<i>Nov</i>	<i>Dec</i>
<i>NITRATE Monthly Sample Date(s):</i>												
<i>VOC Quarterly Sample Date(s):</i>	Jan - Mar Sample Date(s)			Apr - Jun Sample Date(s)			Jul - Sept Sample Date(s)			Oct - Dec Sample Date(s)		
<i>SOC Group 4 Sample Date(s):</i>												

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH7950312 PWS NAME: PORT WASHINGTON ELEM SCHOOL NEW PWS
PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: DS000
FACILITY NAME: PORT WASHINGTON ELEM SCHOOL DISTRIBUTION
Groundwater Rule Minimal Treatment System

Effective Date: 8/15/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	10 Sample(s) between 7/1/2011 and 12/31/2011
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southeast District Office - DDAGW representative immediately at 740-385-8501.

Use for Sample Tracking Purposes				
<i>Lead & Copper Initial Monitoring Sample Date(s):</i>	<i>1st Half Sample Date(s)</i>		<i>2nd Half Sample Date(s)</i>	
<i>TCR Quarterly Sample Date(s):</i>	<i>Jan - Mar Sample Date(s)</i>	<i>Apr - Jun Sample Date(s)</i>	<i>Jul - Sept Sample Date(s)</i>	<i>Oct - Dec Sample Date(s)</i>

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH7950412 PWS NAME: SCENIC WOOD PRODUCTS LTD PWS

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: EP001

STATE FACILITY ID: 7962187 FACILITY NAME: SCENIC WOOD PRODUCTS LTD

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRITE	NITRITE - 1041	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		1 Sample(s) between 6/1/2011 and 10/31/2011
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 7962187. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
NITRATE Sample Date(s):
VOC Sample Date(s):

2011 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH7950412 PWS NAME: SCENIC WOOD PRODUCTS LTD PWS

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: SCENIC WOOD PRODUCTS LTD DISTRIBUTION

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	5 Sample(s) between 6/1/2011 and 9/30/2011
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011

For All Chemicals and Total Coliform Requirements Listed Above, the State Facility ID is DS1. The Sample Monitoring Point Codes for TTHM and HAA5 Samples are MR000/RD000, and DS000 for Asbestos Samples. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southeast District Office - DDAGW representative immediately at 740-385-8501.

Use for Sample Tracking Purposes				
<i>Lead & Copper Sample Date(s):</i>				
<i>TCR Quarterly Sample Date(s):</i>	<i>Jan - Mar Sample Date(s)</i>	<i>Apr - Jun Sample Date(s)</i>	<i>Jul - Sept Sample Date(s)</i>	<i>Oct - Dec Sample Date(s)</i>

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7950512 PWS NAME: FAITH CHRISTIAN CHURCH PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7962304 FACILITY NAME: FAITH CHRISTIAN CHURCH

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

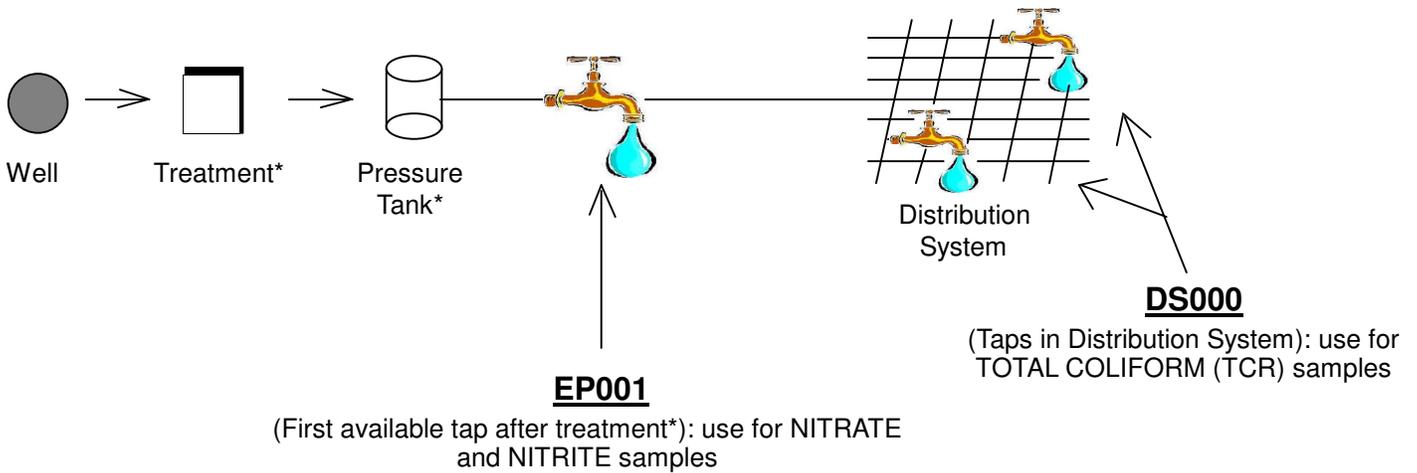

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7950712 PWS NAME: CREEKSIDE GARDENS AND GIFTS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7962387 FACILITY NAME: CREEKSIDE GARDENS AND GIFTS

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

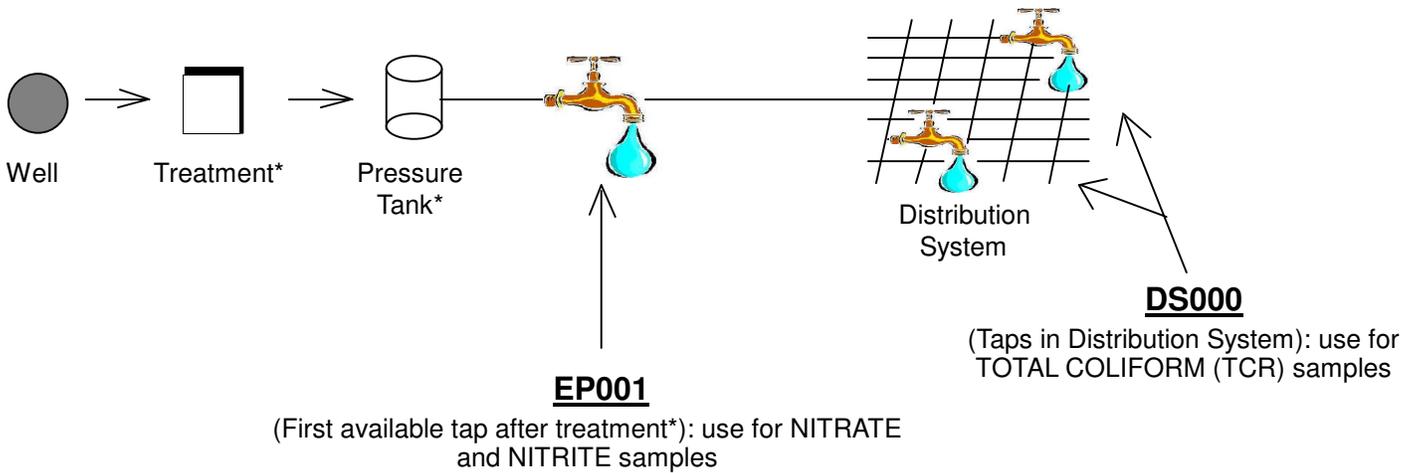

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7950812 PWS NAME: STRAUSBURG PROVISIONS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 4/14/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7962388 FACILITY NAME: VALLEY FARM MEATS

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

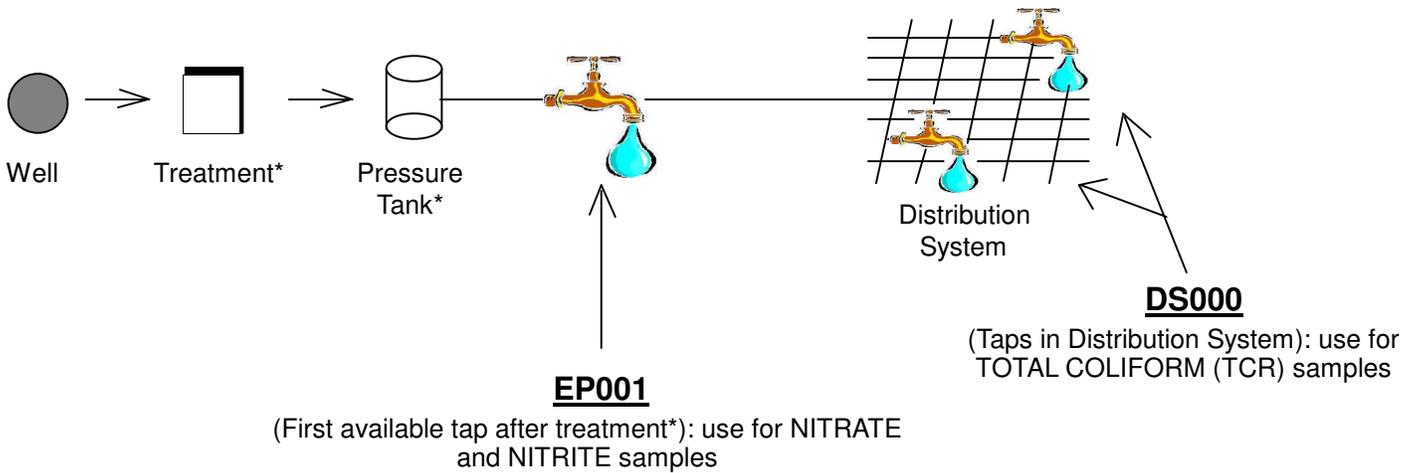

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes
Nitrate Sample Date(s):
Nitrite Sample Date(s):

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7950912 PWS NAME: DER MARKETPLATZ AND BREITENBACH WINE PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7962402 FACILITY NAME: DER MARKETPLATZ AND BREITENBACH WINE

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

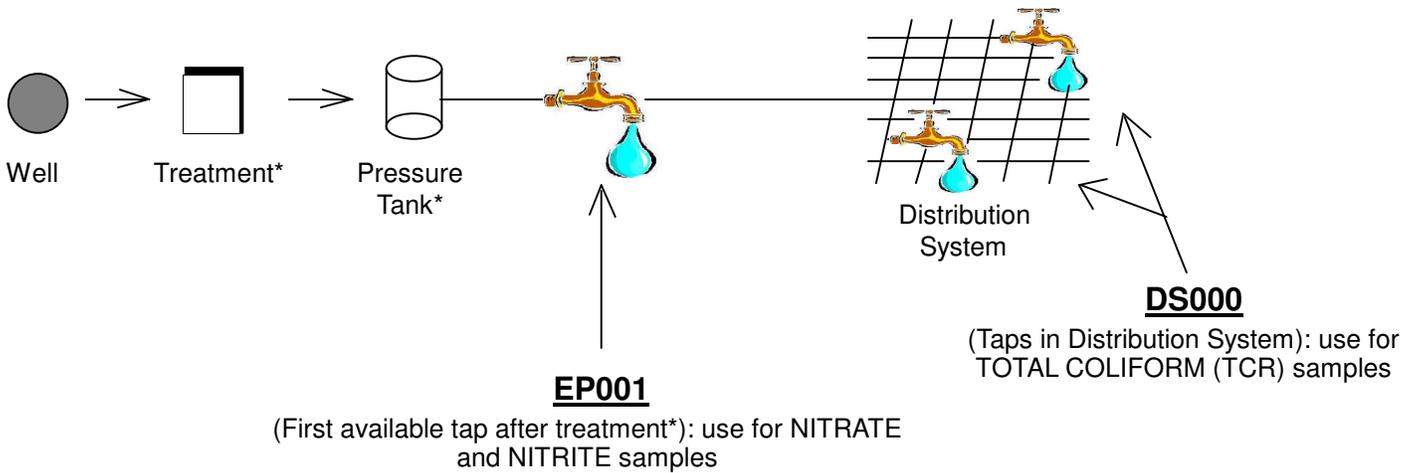

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7951212 PWS NAME: SALLYS HILLTOP LLC PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 4/14/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7962441 FACILITY NAME: SALLYS HILLTOP LLC

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

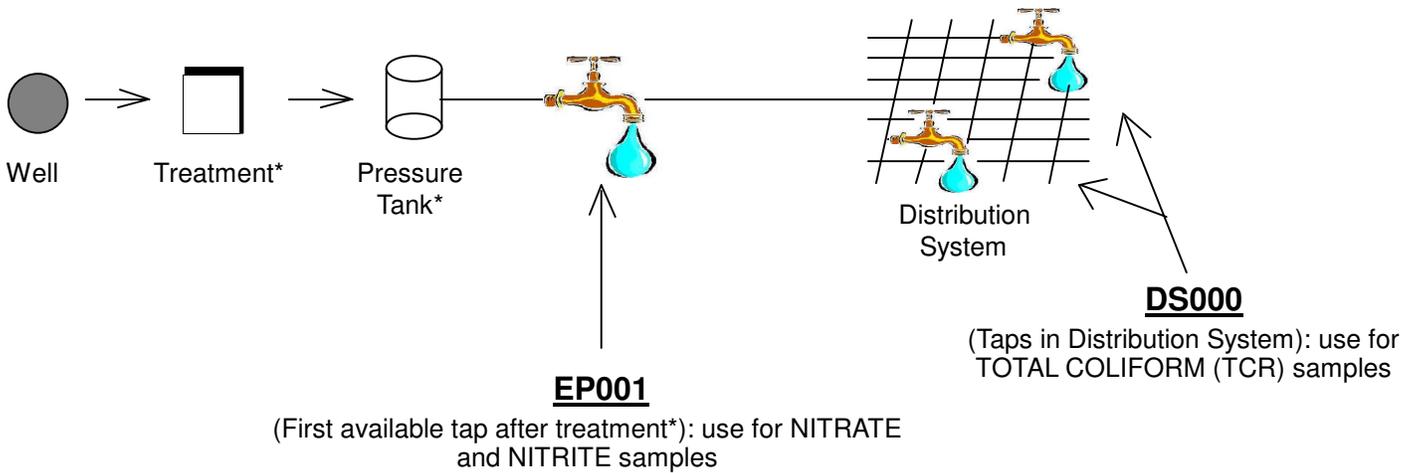

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes
Nitrate Sample Date(s):
Nitrite Sample Date(s):

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7951312 PWS NAME: TINYS INN PWS
PWS TYPE: Transient Noncommunity SOURCE: Ground Water
Groundwater Rule Minimal Treatment System

Effective Date: 7/18/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7962442 FACILITY NAME: TINYS INN

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	Monitoring Requirements	Sample Monitoring Point
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

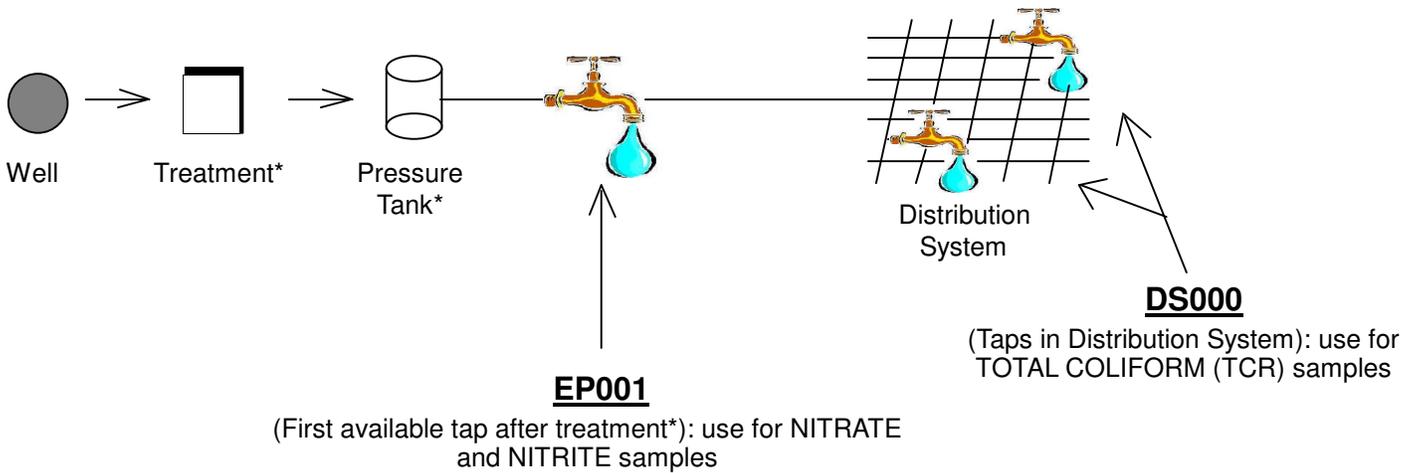

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes
Nitrate Sample Date(s):

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7951412 PWS NAME: TOWNHOUSE DRIVE THRU AND GROCERY PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 4/14/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7962443 FACILITY NAME: TOWNHOUSE DRIVE THRU AND GROCERY

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

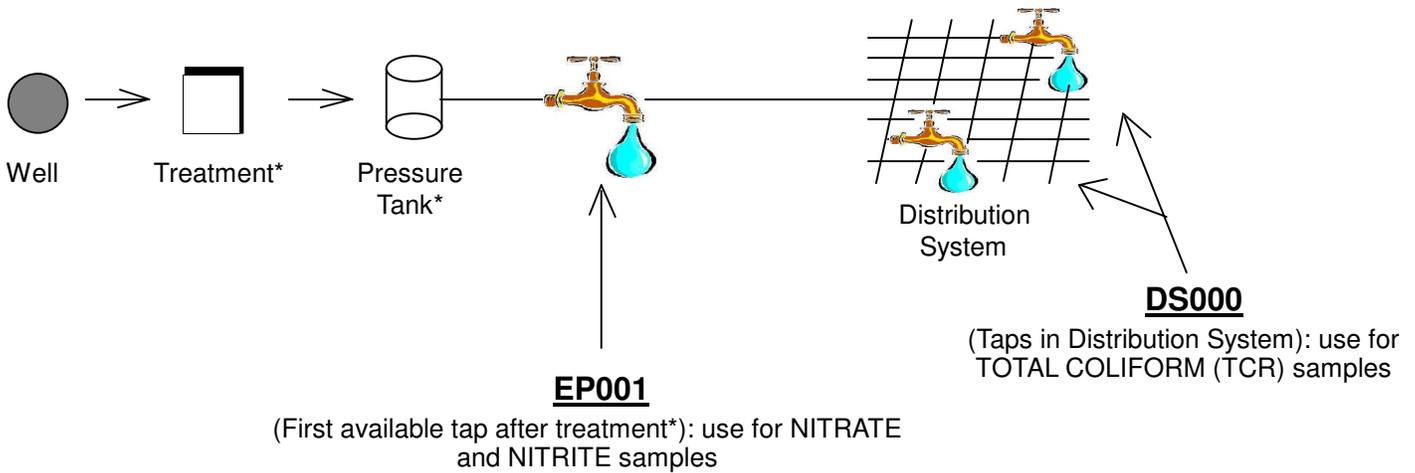

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes
Nitrate Sample Date(s):
Nitrite Sample Date(s):

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7951612 PWS NAME: ZOAR ROAD GUN CLUB PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 4/14/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7962444 FACILITY NAME: ZOAR ROAD GUN CLUB

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

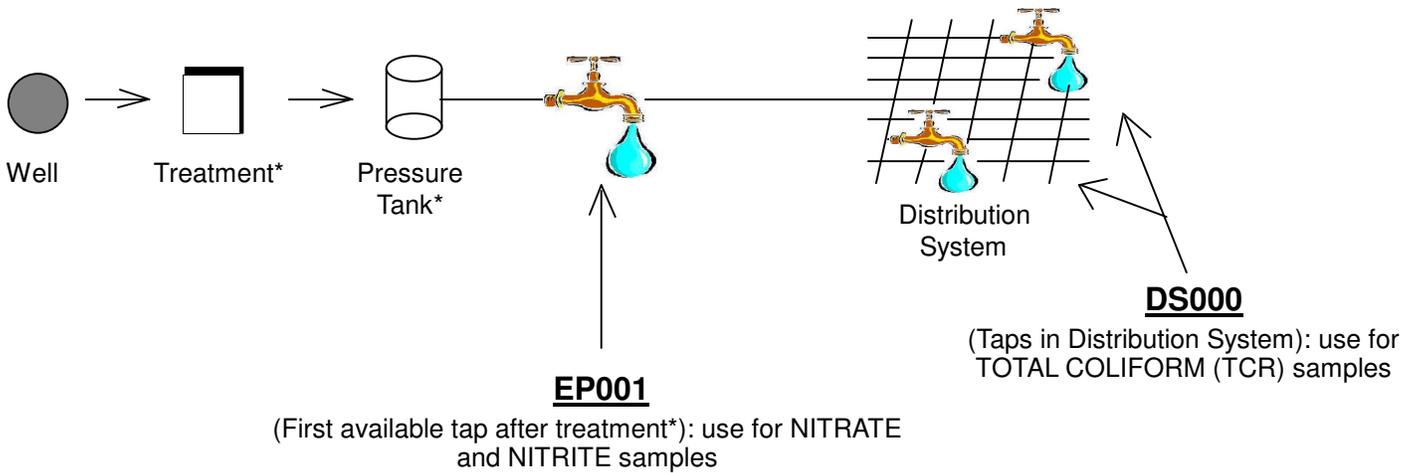

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes
Nitrate Sample Date(s):
Nitrite Sample Date(s):

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7951712 PWS NAME: CREEKSIDE COMMUNITY CENTER
PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Effective Date: 10/14/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7962510 FACILITY NAME: CREEKSIDE COMMUNITY CENTER

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

<i>Chemicals</i>	<i>Monitoring Requirements</i>	<i>Sample Monitoring Point</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

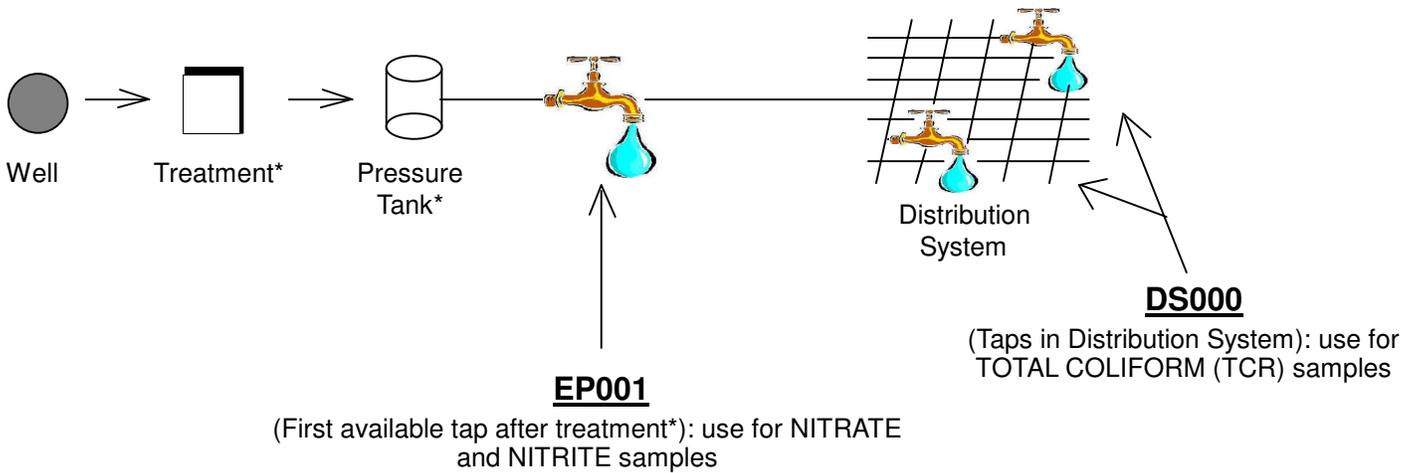

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes
Nitrate Sample Date(s):

2011 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH7900112 PWS NAME: BALTIC VILLAGE PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001

STATE FACILITY ID: 7959264 FACILITY NAME: BALTIC VILLAGE

Groundwater Rule Substantial Treatment System

Effective Date: 1/1/11

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011
NITRITE	NITRITE - 1041	Not Required
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

Unless Otherwise Noted, the Sample Monitoring Point for All Chemicals Listed Above is EP001 and the State Facility ID is 7959264. This Information Must Be Provided to the Laboratory for Results to be Submitted to Ohio EPA.

REMINDER: Consumer Confidence Report (CCR) is due July 1, 2011

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
<i>NITRATE Sample Date(s):</i>
<i>Date CCR sent to Ohio EPA:</i>

