



OH4300411 FAIRPORT HARBOR VILLAGE PWS

System Type: Community

Source: Surface Water

Annual Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location State Facility ID: 4355441 Facility Name: FAIRPORT HARBOR WTP SMP ID: EP001 Facility Source: Surface Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2012

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 1/1/2012 and 5/31/2012

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 1 Sample(s) Required between 1/1/2012 and 5/31/2012

NITRATE - 1040 1 Sample(s) Required between 1/1/2012 and 1/31/2012
1 Sample(s) Required between 2/1/2012 and 2/29/2012
1 Sample(s) Required between 3/1/2012 and 3/31/2012
1 Sample(s) Required between 4/1/2012 and 4/30/2012
1 Sample(s) Required between 5/1/2012 and 5/31/2012
1 Sample(s) Required between 6/1/2012 and 6/30/2012
1 Sample(s) Required between 7/1/2012 and 7/31/2012
1 Sample(s) Required between 8/1/2012 and 8/31/2012
1 Sample(s) Required between 9/1/2012 and 9/30/2012
1 Sample(s) Required between 10/1/2012 and 10/31/2012
1 Sample(s) Required between 11/1/2012 and 11/30/2012
1 Sample(s) Required between 12/1/2012 and 12/31/2012

RADIOLOGICALS Not Required

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 1 Sample(s) Required between 4/1/2012 and 6/30/2012

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 1/1/2012 and 3/31/2012

TOTAL ORGANIC CARBON (TOC) 1 Paired Sample Set Required between 1/1/2012 and 1/31/2012
1 Paired Sample Set Required between 2/1/2012 and 2/29/2012
1 Paired Sample Set Required between 3/1/2012 and 3/31/2012
1 Paired Sample Set Required between 4/1/2012 and 4/30/2012
1 Paired Sample Set Required between 5/1/2012 and 5/31/2012
1 Paired Sample Set Required between 6/1/2012 and 6/30/2012
1 Paired Sample Set Required between 7/1/2012 and 7/31/2012
1 Paired Sample Set Required between 8/1/2012 and 8/31/2012
1 Paired Sample Set Required between 9/1/2012 and 9/30/2012
1 Paired Sample Set Required between 10/1/2012 and 10/31/2012
1 Paired Sample Set Required between 11/1/2012 and 11/30/2012
1 Paired Sample Set Required between 12/1/2012 and 12/31/2012

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



OH4300411 FAIRPORT HARBOR VILLAGE PWS

System Type: Community

Source: Surface Water

Annual Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2012

DISTRIBUTION POINT MONITORING SCHEDULE

Table with 3 columns: Sampling Location, State Facility ID (DS1), SMP ID (DS000), and Facility Name (FAIRPORT HARBOR, VLG. OF DISTRIBUTION)

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

DISINFECTION BYPRODUCTS
1 Sample(s) Required between 1/1/2012 and 3/31/2012
1 Sample(s) Required between 4/1/2012 and 6/30/2012
1 Sample(s) Required between 7/1/2012 and 9/30/2012
1 Sample(s) Required between 10/1/2012 and 12/31/2012

Sample for all the analytes listed below:
TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950

TOTAL COLIFORM (TCR) - 3100
3 Sample(s) Required between 1/1/2012 and 1/31/2012
3 Sample(s) Required between 2/1/2012 and 2/29/2012
3 Sample(s) Required between 3/1/2012 and 3/31/2012
3 Sample(s) Required between 4/1/2012 and 4/30/2012
3 Sample(s) Required between 5/1/2012 and 5/31/2012
3 Sample(s) Required between 6/1/2012 and 6/30/2012
3 Sample(s) Required between 7/1/2012 and 7/31/2012
3 Sample(s) Required between 8/1/2012 and 8/31/2012
3 Sample(s) Required between 9/1/2012 and 9/30/2012
3 Sample(s) Required between 10/1/2012 and 10/31/2012
3 Sample(s) Required between 11/1/2012 and 11/30/2012
3 Sample(s) Required between 12/1/2012 and 12/31/2012

TOTAL CHLORINE - 1000
3 Sample(s) Required between 1/1/2012 and 1/31/2012
3 Sample(s) Required between 2/1/2012 and 2/29/2012
3 Sample(s) Required between 3/1/2012 and 3/31/2012
3 Sample(s) Required between 4/1/2012 and 4/30/2012
3 Sample(s) Required between 5/1/2012 and 5/31/2012
3 Sample(s) Required between 6/1/2012 and 6/30/2012
3 Sample(s) Required between 7/1/2012 and 7/31/2012
3 Sample(s) Required between 8/1/2012 and 8/31/2012
3 Sample(s) Required between 9/1/2012 and 9/30/2012
3 Sample(s) Required between 10/1/2012 and 10/31/2012
3 Sample(s) Required between 11/1/2012 and 11/30/2012
3 Sample(s) Required between 12/1/2012 and 12/31/2012

Samples should be collected at the same time and place as the Total Coliform samples.



OH4300903 MADISON VILLAGE PWS

System Type: Community

Source: Purchased Surface Water

Annual Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2012

DISTRIBUTION POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: DS1 SMP ID: DS000	Facility Name: MADISON, VILLAGE OF DISTRIBUTION
--------------------------	---	--

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2012 and 9/30/2012

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950

ASBESTOS - 1094 1 Sample(s) Required between 1/1/2012 and 5/31/2012

Collect one sample at a tap served by asbestos-cement pipe. Due to limited Laboratory capacity and a 48 hour filtering requirement, contact your lab early in the monitoring period to schedule a sampling date.

TOTAL COLIFORM (TCR) - 3100	3 Sample(s) Required between 1/1/2012 and 1/31/2012
	3 Sample(s) Required between 2/1/2012 and 2/29/2012
	3 Sample(s) Required between 3/1/2012 and 3/31/2012
	3 Sample(s) Required between 4/1/2012 and 4/30/2012
	3 Sample(s) Required between 5/1/2012 and 5/31/2012
	3 Sample(s) Required between 6/1/2012 and 6/30/2012
	3 Sample(s) Required between 7/1/2012 and 7/31/2012
	3 Sample(s) Required between 8/1/2012 and 8/31/2012
	3 Sample(s) Required between 9/1/2012 and 9/30/2012
	3 Sample(s) Required between 10/1/2012 and 10/31/2012
	3 Sample(s) Required between 11/1/2012 and 11/30/2012
	3 Sample(s) Required between 12/1/2012 and 12/31/2012

TOTAL CHLORINE - 1000	3 Sample(s) Required between 1/1/2012 and 1/31/2012
	3 Sample(s) Required between 2/1/2012 and 2/29/2012
	3 Sample(s) Required between 3/1/2012 and 3/31/2012
	3 Sample(s) Required between 4/1/2012 and 4/30/2012
	3 Sample(s) Required between 5/1/2012 and 5/31/2012
	3 Sample(s) Required between 6/1/2012 and 6/30/2012
	3 Sample(s) Required between 7/1/2012 and 7/31/2012
	3 Sample(s) Required between 8/1/2012 and 8/31/2012
	3 Sample(s) Required between 9/1/2012 and 9/30/2012
	3 Sample(s) Required between 10/1/2012 and 10/31/2012
	3 Sample(s) Required between 11/1/2012 and 11/30/2012
	3 Sample(s) Required between 12/1/2012 and 12/31/2012

Samples should be collected at the same time and place as the Total Coliform samples.



OH4301012 MENTOR RIDGE FARMS ASSOCIATION PWS

System Type: Community

Source: Ground Water

Annual Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: 4355444 SMP ID: EP001	Facility Name: MENTOR RIDGE FARMS ASSOCIATION Facility Source: Ground Water
--------------------------	---	--

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2012

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 1/1/2012 and 5/31/2012

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 1 Sample(s) Required between 1/1/2012 and 5/31/2012

NITRATE - 1040 1 Sample(s) Required between 1/1/2012 and 5/31/2012

RADIOLOGICALS Not Required

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 1 Sample(s) Required between 1/1/2012 and 5/31/2012

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 1/1/2012 and 5/31/2012



OH4301012 MENTOR RIDGE FARMS ASSOCIATION PWS

System Type: Community

Source: Ground Water

Annual Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2012

DISTRIBUTION POINT MONITORING SCHEDULE

Table with 3 columns: Sampling Location, State Facility ID: DS1, SMP ID: DS000, Facility Name: MENTOR RIDGE FARMS ASSN. DISTRIBUTION

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2012 and 9/30/2012

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950

TOTAL COLIFORM (TCR) - 3100 1 Sample(s) Required between 1/1/2012 and 1/31/2012
1 Sample(s) Required between 2/1/2012 and 2/29/2012
1 Sample(s) Required between 3/1/2012 and 3/31/2012
1 Sample(s) Required between 4/1/2012 and 4/30/2012
1 Sample(s) Required between 5/1/2012 and 5/31/2012
1 Sample(s) Required between 6/1/2012 and 6/30/2012
1 Sample(s) Required between 7/1/2012 and 7/31/2012
1 Sample(s) Required between 8/1/2012 and 8/31/2012
1 Sample(s) Required between 9/1/2012 and 9/30/2012
1 Sample(s) Required between 10/1/2012 and 10/31/2012
1 Sample(s) Required between 11/1/2012 and 11/30/2012
1 Sample(s) Required between 12/1/2012 and 12/31/2012

TOTAL CHLORINE - 1000 1 Sample(s) Required between 1/1/2012 and 1/31/2012
1 Sample(s) Required between 2/1/2012 and 2/29/2012
1 Sample(s) Required between 3/1/2012 and 3/31/2012
1 Sample(s) Required between 4/1/2012 and 4/30/2012
1 Sample(s) Required between 5/1/2012 and 5/31/2012
1 Sample(s) Required between 6/1/2012 and 6/30/2012
1 Sample(s) Required between 7/1/2012 and 7/31/2012
1 Sample(s) Required between 8/1/2012 and 8/31/2012
1 Sample(s) Required between 9/1/2012 and 9/30/2012
1 Sample(s) Required between 10/1/2012 and 10/31/2012
1 Sample(s) Required between 11/1/2012 and 11/30/2012
1 Sample(s) Required between 12/1/2012 and 12/31/2012

Samples should be collected at the same time and place as the Total Coliform samples.



OH4301511 AQUA OHIO INC - MENTOR

System Type: Community

Source: Surface Water

Annual Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: 4355445 SMP ID: EP001	Facility Name: AQUA OHIO INC - MENTOR Facility Source: Surface Water
--------------------------	---	---

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2012**

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 1/1/2012 and 5/31/2012

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 1 Sample(s) Required between 1/1/2012 and 5/31/2012

NITRATE - 1040 1 Sample(s) Required between 1/1/2012 and 1/31/2012
1 Sample(s) Required between 2/1/2012 and 2/29/2012
1 Sample(s) Required between 3/1/2012 and 3/31/2012
1 Sample(s) Required between 4/1/2012 and 4/30/2012
1 Sample(s) Required between 5/1/2012 and 5/31/2012
1 Sample(s) Required between 6/1/2012 and 6/30/2012
1 Sample(s) Required between 7/1/2012 and 7/31/2012
1 Sample(s) Required between 8/1/2012 and 8/31/2012
1 Sample(s) Required between 9/1/2012 and 9/30/2012
1 Sample(s) Required between 10/1/2012 and 10/31/2012
1 Sample(s) Required between 11/1/2012 and 11/30/2012
1 Sample(s) Required between 12/1/2012 and 12/31/2012

RADIOLOGICALS Not Required

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 1 Sample(s) Required between 4/1/2012 and 6/30/2012

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 1/1/2012 and 5/31/2012

TOTAL ORGANIC CARBON (TOC) 1 Paired Sample Set Required between 1/1/2012 and 1/31/2012
1 Paired Sample Set Required between 2/1/2012 and 2/29/2012
1 Paired Sample Set Required between 3/1/2012 and 3/31/2012
1 Paired Sample Set Required between 4/1/2012 and 4/30/2012
1 Paired Sample Set Required between 5/1/2012 and 5/31/2012
1 Paired Sample Set Required between 6/1/2012 and 6/30/2012
1 Paired Sample Set Required between 7/1/2012 and 7/31/2012
1 Paired Sample Set Required between 8/1/2012 and 8/31/2012
1 Paired Sample Set Required between 9/1/2012 and 9/30/2012
1 Paired Sample Set Required between 10/1/2012 and 10/31/2012
1 Paired Sample Set Required between 11/1/2012 and 11/30/2012
1 Paired Sample Set Required between 12/1/2012 and 12/31/2012

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



OH4301511 AQUA OHIO INC - MENTOR

System Type: Community

Source: Surface Water

Annual Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2012

DISTRIBUTION POINT MONITORING SCHEDULE

Table with 3 columns: Sampling Location, State Facility ID: DS1 SMP ID: DS000, Facility Name: AQUA OHIO INC - MENTOR DISTRIBUTION

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

ASBESTOS - 1094 1 Sample(s) Required between 1/1/2012 and 5/31/2012

Collect one sample at a tap served by asbestos-cement pipe. Due to limited Laboratory capacity and a 48 hour filtering requirement, contact your lab early in the monitoring period to schedule a sampling date.

TOTAL COLIFORM (TCR) - 3100 80 Sample(s) Required between 1/1/2012 and 1/31/2012 ... 80 Sample(s) Required between 12/1/2012 and 12/31/2012

TOTAL CHLORINE - 1000 80 Sample(s) Required between 1/1/2012 and 1/31/2012 ... 80 Sample(s) Required between 12/1/2012 and 12/31/2012

Samples should be collected at the same time and place as the Total Coliform samples.

Table with 3 columns: Sampling Location, State Facility ID: DS1 SMP ID: DS201, Facility Name: AQUA OHIO INC - MENTOR DISTRIBUTION KIRTLAND CITY HALL

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 1/1/2012 and 3/31/2012 ... 1 Sample(s) Required between 10/1/2012 and 12/31/2012

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950

OH4301511 AQUA OHIO INC - MENTOR

System Type: Community

Source: Surface Water

Annual Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2012**

DISTRIBUTION POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: DS1 SMP ID: DS202	Facility Name: AQUA OHIO INC - MENTOR DISTRIBUTION KIRTLAND LIBRARY
--------------------------	---	--

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/1/2012 and 3/31/2012 1 Sample(s) Required between 4/1/2012 and 6/30/2012 1 Sample(s) Required between 7/1/2012 and 9/30/2012 1 Sample(s) Required between 10/1/2012 and 12/31/2012

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950

Sampling Location	State Facility ID: DS1 SMP ID: DS203	Facility Name: AQUA OHIO INC - MENTOR DISTRIBUTION BAXTER BOOSTER
--------------------------	---	--

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/1/2012 and 3/31/2012 1 Sample(s) Required between 4/1/2012 and 6/30/2012 1 Sample(s) Required between 7/1/2012 and 9/30/2012 1 Sample(s) Required between 10/1/2012 and 12/31/2012

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950

Sampling Location	State Facility ID: DS1 SMP ID: DS204	Facility Name: AQUA OHIO INC - MENTOR DISTRIBUTION METRO COOSTER STATION
--------------------------	---	---

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/1/2012 and 3/31/2012 1 Sample(s) Required between 4/1/2012 and 6/30/2012 1 Sample(s) Required between 7/1/2012 and 9/30/2012 1 Sample(s) Required between 10/1/2012 and 12/31/2012

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950

Sampling Location	State Facility ID: DS1 SMP ID: DS205	Facility Name: AQUA OHIO INC - MENTOR DISTRIBUTION BILLINGS BOOSTER
--------------------------	---	--

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/1/2012 and 3/31/2012 1 Sample(s) Required between 4/1/2012 and 6/30/2012 1 Sample(s) Required between 7/1/2012 and 9/30/2012 1 Sample(s) Required between 10/1/2012 and 12/31/2012

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950

OH4301511 AQUA OHIO INC - MENTOR

System Type: Community

Source: Surface Water

Annual Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2012**

DISTRIBUTION POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: DS1 SMP ID: DS206	Facility Name: AQUA OHIO INC - MENTOR DISTRIBUTION WAITE HILL SERVICE
--------------------------	---	--

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/1/2012 and 3/31/2012
	1 Sample(s) Required between 4/1/2012 and 6/30/2012
	1 Sample(s) Required between 7/1/2012 and 9/30/2012
	1 Sample(s) Required between 10/1/2012 and 12/31/2012

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950

Sampling Location	State Facility ID: DS1 SMP ID: DS207	Facility Name: AQUA OHIO INC - MENTOR DISTRIBUTION KIRTLAND BOOSTER
--------------------------	---	--

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/1/2012 and 3/31/2012
	1 Sample(s) Required between 4/1/2012 and 6/30/2012
	1 Sample(s) Required between 7/1/2012 and 9/30/2012
	1 Sample(s) Required between 10/1/2012 and 12/31/2012

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950

Sampling Location	State Facility ID: DS1 SMP ID: DS208	Facility Name: AQUA OHIO INC - MENTOR DISTRIBUTION CARRIGE HILLS
--------------------------	---	---

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/1/2012 and 3/31/2012
	1 Sample(s) Required between 4/1/2012 and 6/30/2012
	1 Sample(s) Required between 7/1/2012 and 9/30/2012
	1 Sample(s) Required between 10/1/2012 and 12/31/2012

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950



OH4301611 PAINESVILLE CITY PWS

System Type: Community

Source: Surface Water

Annual Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: 4355446 SMP ID: EP001	Facility Name: PAINESVILLE CITY Facility Source: Surface Water
--------------------------	---	---

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2012

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 1/1/2012 and 5/31/2012

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 1 Sample(s) Required between 1/1/2012 and 5/31/2012

NITRATE - 1040 1 Sample(s) Required between 1/1/2012 and 1/31/2012
1 Sample(s) Required between 2/1/2012 and 2/29/2012
1 Sample(s) Required between 3/1/2012 and 3/31/2012
1 Sample(s) Required between 4/1/2012 and 4/30/2012
1 Sample(s) Required between 5/1/2012 and 5/31/2012
1 Sample(s) Required between 6/1/2012 and 6/30/2012
1 Sample(s) Required between 7/1/2012 and 7/31/2012
1 Sample(s) Required between 8/1/2012 and 8/31/2012
1 Sample(s) Required between 9/1/2012 and 9/30/2012
1 Sample(s) Required between 10/1/2012 and 10/31/2012
1 Sample(s) Required between 11/1/2012 and 11/30/2012
1 Sample(s) Required between 12/1/2012 and 12/31/2012

RADIOLOGICALS Not Required

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 1 Sample(s) Required between 4/1/2012 and 6/30/2012

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 1/1/2012 and 5/31/2012

TOTAL ORGANIC CARBON (TOC) 1 Paired Sample Set Required between 1/1/2012 and 1/31/2012
1 Paired Sample Set Required between 2/1/2012 and 2/29/2012
1 Paired Sample Set Required between 3/1/2012 and 3/31/2012
1 Paired Sample Set Required between 4/1/2012 and 4/30/2012
1 Paired Sample Set Required between 5/1/2012 and 5/31/2012
1 Paired Sample Set Required between 6/1/2012 and 6/30/2012
1 Paired Sample Set Required between 7/1/2012 and 7/31/2012
1 Paired Sample Set Required between 8/1/2012 and 8/31/2012
1 Paired Sample Set Required between 9/1/2012 and 9/30/2012
1 Paired Sample Set Required between 10/1/2012 and 10/31/2012
1 Paired Sample Set Required between 11/1/2012 and 11/30/2012
1 Paired Sample Set Required between 12/1/2012 and 12/31/2012

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



OH4301611 PAINESVILLE CITY PWS

System Type: Community

Source: Surface Water

Annual Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2012

DISTRIBUTION POINT MONITORING SCHEDULE

Table with 3 columns: Sampling Location, State Facility ID: DS1 SMP ID: DS000, Facility Name: PAINESVILLE, CITY OF DISTRIBUTION

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 30 Sample(s) Required between 6/1/2012 and 9/30/2012

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period.

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 1/1/2012 and 3/31/2012
1 Sample(s) Required between 4/1/2012 and 6/30/2012
1 Sample(s) Required between 7/1/2012 and 9/30/2012
1 Sample(s) Required between 10/1/2012 and 12/31/2012

Sample for all the analytes listed below:
TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950

ASBESTOS - 1094 1 Sample(s) Required between 1/1/2012 and 5/31/2012

Collect one sample at a tap served by asbestos-cement pipe. Due to limited Laboratory capacity and a 48 hour filtering requirement, contact your lab early in the monitoring period to schedule a sampling date.

TOTAL COLIFORM (TCR) - 3100 25 Sample(s) Required between 1/1/2012 and 1/31/2012
25 Sample(s) Required between 2/1/2012 and 2/29/2012
25 Sample(s) Required between 3/1/2012 and 3/31/2012
25 Sample(s) Required between 4/1/2012 and 4/30/2012
25 Sample(s) Required between 5/1/2012 and 5/31/2012
25 Sample(s) Required between 6/1/2012 and 6/30/2012
25 Sample(s) Required between 7/1/2012 and 7/31/2012
25 Sample(s) Required between 8/1/2012 and 8/31/2012
25 Sample(s) Required between 9/1/2012 and 9/30/2012
25 Sample(s) Required between 10/1/2012 and 10/31/2012
25 Sample(s) Required between 11/1/2012 and 11/30/2012
25 Sample(s) Required between 12/1/2012 and 12/31/2012

TOTAL CHLORINE - 1000 25 Sample(s) Required between 1/1/2012 and 1/31/2012
25 Sample(s) Required between 2/1/2012 and 2/29/2012
25 Sample(s) Required between 3/1/2012 and 3/31/2012
25 Sample(s) Required between 4/1/2012 and 4/30/2012
25 Sample(s) Required between 5/1/2012 and 5/31/2012
25 Sample(s) Required between 6/1/2012 and 6/30/2012
25 Sample(s) Required between 7/1/2012 and 7/31/2012
25 Sample(s) Required between 8/1/2012 and 8/31/2012
25 Sample(s) Required between 9/1/2012 and 9/30/2012
25 Sample(s) Required between 10/1/2012 and 10/31/2012
25 Sample(s) Required between 11/1/2012 and 11/30/2012
25 Sample(s) Required between 12/1/2012 and 12/31/2012

Samples should be collected at the same time and place as the Total Coliform samples.



OH4302212 STEWART LODGE

System Type: Community

Source: Ground Water

Annual Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: 4355448 SMP ID: EP001	Facility Name: STEWART LODGE Facility Source: Ground Water
--------------------------	---	---

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2012

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 1/1/2012 and 5/31/2012

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 1 Sample(s) Required between 1/1/2012 and 5/31/2012

NITRATE - 1040 1 Sample(s) Required between 1/1/2012 and 5/31/2012

RADIOLOGICALS Not Required

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 1 Sample(s) Required between 1/1/2012 and 5/31/2012

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 1/1/2012 and 5/31/2012



OH4302212 STEWART LODGE

System Type: Community

Source: Ground Water

Annual Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2012

DISTRIBUTION POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: DS1 SMP ID: DS000	Facility Name: STEWART LODGE DISTRIBUTION
--------------------------	---	--

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2012 and 9/30/2012
<i>Sample for all the analytes listed below:</i>	
TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2012 and 1/31/2012 1 Sample(s) Required between 2/1/2012 and 2/29/2012 1 Sample(s) Required between 3/1/2012 and 3/31/2012 1 Sample(s) Required between 4/1/2012 and 4/30/2012 1 Sample(s) Required between 5/1/2012 and 5/31/2012 1 Sample(s) Required between 6/1/2012 and 6/30/2012 1 Sample(s) Required between 7/1/2012 and 7/31/2012 1 Sample(s) Required between 8/1/2012 and 8/31/2012 1 Sample(s) Required between 9/1/2012 and 9/30/2012 1 Sample(s) Required between 10/1/2012 and 10/31/2012 1 Sample(s) Required between 11/1/2012 and 11/30/2012 1 Sample(s) Required between 12/1/2012 and 12/31/2012
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2012 and 1/31/2012 1 Sample(s) Required between 2/1/2012 and 2/29/2012 1 Sample(s) Required between 3/1/2012 and 3/31/2012 1 Sample(s) Required between 4/1/2012 and 4/30/2012 1 Sample(s) Required between 5/1/2012 and 5/31/2012 1 Sample(s) Required between 6/1/2012 and 6/30/2012 1 Sample(s) Required between 7/1/2012 and 7/31/2012 1 Sample(s) Required between 8/1/2012 and 8/31/2012 1 Sample(s) Required between 9/1/2012 and 9/30/2012 1 Sample(s) Required between 10/1/2012 and 10/31/2012 1 Sample(s) Required between 11/1/2012 and 11/30/2012 1 Sample(s) Required between 12/1/2012 and 12/31/2012

Samples should be collected at the same time and place as the Total Coliform samples.



OH4302411 LAKE COUNTY WEST WATER SUBDISTRICT

System Type: Community

Source: Surface Water

Annual Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: 4355449 SMP ID: EP001	Facility Name: LAKE CO WEST SUBDIST WTP Facility Source: Surface Water
--------------------------	---	---

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2012

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 1/1/2012 and 5/31/2012

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 1 Sample(s) Required between 1/1/2012 and 5/31/2012

NITRATE - 1040 1 Sample(s) Required between 1/1/2012 and 1/31/2012
1 Sample(s) Required between 2/1/2012 and 2/29/2012
1 Sample(s) Required between 3/1/2012 and 3/31/2012
1 Sample(s) Required between 4/1/2012 and 4/30/2012
1 Sample(s) Required between 5/1/2012 and 5/31/2012
1 Sample(s) Required between 6/1/2012 and 6/30/2012
1 Sample(s) Required between 7/1/2012 and 7/31/2012
1 Sample(s) Required between 8/1/2012 and 8/31/2012
1 Sample(s) Required between 9/1/2012 and 9/30/2012
1 Sample(s) Required between 10/1/2012 and 10/31/2012
1 Sample(s) Required between 11/1/2012 and 11/30/2012
1 Sample(s) Required between 12/1/2012 and 12/31/2012

RADIOLOGICALS Not Required

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 1 Sample(s) Required between 4/1/2012 and 6/30/2012

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 1/1/2012 and 5/31/2012

TOTAL ORGANIC CARBON (TOC) 1 Paired Sample Set Required between 1/1/2012 and 1/31/2012
1 Paired Sample Set Required between 2/1/2012 and 2/29/2012
1 Paired Sample Set Required between 3/1/2012 and 3/31/2012
1 Paired Sample Set Required between 4/1/2012 and 4/30/2012
1 Paired Sample Set Required between 5/1/2012 and 5/31/2012
1 Paired Sample Set Required between 6/1/2012 and 6/30/2012
1 Paired Sample Set Required between 7/1/2012 and 7/31/2012
1 Paired Sample Set Required between 8/1/2012 and 8/31/2012
1 Paired Sample Set Required between 9/1/2012 and 9/30/2012
1 Paired Sample Set Required between 10/1/2012 and 10/31/2012
1 Paired Sample Set Required between 11/1/2012 and 11/30/2012
1 Paired Sample Set Required between 12/1/2012 and 12/31/2012

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.

OH4302411 LAKE COUNTY WEST WATER SUBDISTRICT

System Type: Community

Source: Surface Water

Annual Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2012**
DISTRIBUTION POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: DS1 SMP ID: DS000	Facility Name: LAKE CO WEST SUBDIST DISTRIBUTION
--------------------------	---	---

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

ASBESTOS - 1094	1 Sample(s) Required between 1/1/2012 and 5/31/2012
-----------------	---

Collect one sample at a tap served by asbestos-cement pipe. Due to limited Laboratory capacity and a 48 hour filtering requirement, contact your lab early in the monitoring period to schedule a sampling date.

TOTAL COLIFORM (TCR) - 3100	90 Sample(s) Required between 1/1/2012 and 1/31/2012
	90 Sample(s) Required between 2/1/2012 and 2/29/2012
	90 Sample(s) Required between 3/1/2012 and 3/31/2012
	90 Sample(s) Required between 4/1/2012 and 4/30/2012
	90 Sample(s) Required between 5/1/2012 and 5/31/2012
	90 Sample(s) Required between 6/1/2012 and 6/30/2012
	90 Sample(s) Required between 7/1/2012 and 7/31/2012
	90 Sample(s) Required between 8/1/2012 and 8/31/2012
	90 Sample(s) Required between 9/1/2012 and 9/30/2012
	90 Sample(s) Required between 10/1/2012 and 10/31/2012
	90 Sample(s) Required between 11/1/2012 and 11/30/2012
	90 Sample(s) Required between 12/1/2012 and 12/31/2012

TOTAL CHLORINE - 1000	90 Sample(s) Required between 1/1/2012 and 1/31/2012
	90 Sample(s) Required between 2/1/2012 and 2/29/2012
	90 Sample(s) Required between 3/1/2012 and 3/31/2012
	90 Sample(s) Required between 4/1/2012 and 4/30/2012
	90 Sample(s) Required between 5/1/2012 and 5/31/2012
	90 Sample(s) Required between 6/1/2012 and 6/30/2012
	90 Sample(s) Required between 7/1/2012 and 7/31/2012
	90 Sample(s) Required between 8/1/2012 and 8/31/2012
	90 Sample(s) Required between 9/1/2012 and 9/30/2012
	90 Sample(s) Required between 10/1/2012 and 10/31/2012
	90 Sample(s) Required between 11/1/2012 and 11/30/2012
	90 Sample(s) Required between 12/1/2012 and 12/31/2012

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	State Facility ID: DS1 SMP ID: DS201	Facility Name: LAKE CO WEST SUBDIST DISTRIBUTION RIVER RD. BY I-90
--------------------------	---	---

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/1/2012 and 3/31/2012
	1 Sample(s) Required between 4/1/2012 and 6/30/2012
	1 Sample(s) Required between 7/1/2012 and 9/30/2012
	1 Sample(s) Required between 10/1/2012 and 12/31/2012

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950

OH4302411 LAKE COUNTY WEST WATER SUBDISTRICT

System Type: Community

Source: Surface Water

Annual Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2012**
DISTRIBUTION POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: DS1 SMP ID: DS202	Facility Name: LAKE CO WEST SUBDIST DISTRIBUTION WHITE RD. TANK
--------------------------	---	--

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/1/2012 and 3/31/2012 1 Sample(s) Required between 4/1/2012 and 6/30/2012 1 Sample(s) Required between 7/1/2012 and 9/30/2012 1 Sample(s) Required between 10/1/2012 and 12/31/2012

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950

Sampling Location	State Facility ID: DS1 SMP ID: DS203	Facility Name: LAKE CO WEST SUBDIST DISTRIBUTION RODGERS RD.
--------------------------	---	---

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/1/2012 and 3/31/2012 1 Sample(s) Required between 4/1/2012 and 6/30/2012 1 Sample(s) Required between 7/1/2012 and 9/30/2012 1 Sample(s) Required between 10/1/2012 and 12/31/2012

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950

Sampling Location	State Facility ID: DS1 SMP ID: DS204	Facility Name: LAKE CO WEST SUBDIST DISTRIBUTION BRYN MAWR
--------------------------	---	---

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/1/2012 and 3/31/2012 1 Sample(s) Required between 4/1/2012 and 6/30/2012 1 Sample(s) Required between 7/1/2012 and 9/30/2012 1 Sample(s) Required between 10/1/2012 and 12/31/2012

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950

Sampling Location	State Facility ID: DS1 SMP ID: DS205	Facility Name: LAKE CO WEST SUBDIST DISTRIBUTION 27400 CHARDON RD.
--------------------------	---	---

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/1/2012 and 3/31/2012 1 Sample(s) Required between 4/1/2012 and 6/30/2012 1 Sample(s) Required between 7/1/2012 and 9/30/2012 1 Sample(s) Required between 10/1/2012 and 12/31/2012

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950

OH4302411 LAKE COUNTY WEST WATER SUBDISTRICT

System Type: Community

Source: Surface Water

Annual Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2012**

DISTRIBUTION POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: DS1 SMP ID: DS206	Facility Name: LAKE CO WEST SUBDIST DISTRIBUTION 28601 CHARDON RD.
--------------------------	---	---

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/1/2012 and 3/31/2012
	1 Sample(s) Required between 4/1/2012 and 6/30/2012
	1 Sample(s) Required between 7/1/2012 and 9/30/2012
	1 Sample(s) Required between 10/1/2012 and 12/31/2012

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950

Sampling Location	State Facility ID: DS1 SMP ID: DS207	Facility Name: LAKE CO WEST SUBDIST DISTRIBUTION RT. 306 AND 90 (BURGER KING)
--------------------------	---	--

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/1/2012 and 3/31/2012
	1 Sample(s) Required between 4/1/2012 and 6/30/2012
	1 Sample(s) Required between 7/1/2012 and 9/30/2012
	1 Sample(s) Required between 10/1/2012 and 12/31/2012

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950

Sampling Location	State Facility ID: DS1 SMP ID: DS208	Facility Name: LAKE CO WEST SUBDIST DISTRIBUTION TRAILARD
--------------------------	---	--

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/1/2012 and 3/31/2012
	1 Sample(s) Required between 4/1/2012 and 6/30/2012
	1 Sample(s) Required between 7/1/2012 and 9/30/2012
	1 Sample(s) Required between 10/1/2012 and 12/31/2012

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950



OH4302911 LAKE COUNTY EAST WATER SUBDISTRICT

System Type: Community

Source: Surface Water

Annual Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location State Facility ID: 4355450 Facility Name: LAKE CO EAST WTR SUBDISTRICT SMP ID: EP001 Facility Source: Surface Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2012

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 1/1/2012 and 5/31/2012

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 1 Sample(s) Required between 1/1/2012 and 5/31/2012

NITRATE - 1040 1 Sample(s) Required between 1/1/2012 and 1/31/2012
1 Sample(s) Required between 2/1/2012 and 2/29/2012
1 Sample(s) Required between 3/1/2012 and 3/31/2012
1 Sample(s) Required between 4/1/2012 and 4/30/2012
1 Sample(s) Required between 5/1/2012 and 5/31/2012
1 Sample(s) Required between 6/1/2012 and 6/30/2012
1 Sample(s) Required between 7/1/2012 and 7/31/2012
1 Sample(s) Required between 8/1/2012 and 8/31/2012
1 Sample(s) Required between 9/1/2012 and 9/30/2012
1 Sample(s) Required between 10/1/2012 and 10/31/2012
1 Sample(s) Required between 11/1/2012 and 11/30/2012
1 Sample(s) Required between 12/1/2012 and 12/31/2012

RADIOLOGICALS Not Required

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 1 Sample(s) Required between 4/1/2012 and 6/30/2012

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 1/1/2012 and 5/31/2012

TOTAL ORGANIC CARBON (TOC) 1 Paired Sample Set Required between 1/1/2012 and 1/31/2012
1 Paired Sample Set Required between 2/1/2012 and 2/29/2012
1 Paired Sample Set Required between 3/1/2012 and 3/31/2012
1 Paired Sample Set Required between 4/1/2012 and 4/30/2012
1 Paired Sample Set Required between 5/1/2012 and 5/31/2012
1 Paired Sample Set Required between 6/1/2012 and 6/30/2012
1 Paired Sample Set Required between 7/1/2012 and 7/31/2012
1 Paired Sample Set Required between 8/1/2012 and 8/31/2012
1 Paired Sample Set Required between 9/1/2012 and 9/30/2012
1 Paired Sample Set Required between 10/1/2012 and 10/31/2012
1 Paired Sample Set Required between 11/1/2012 and 11/30/2012
1 Paired Sample Set Required between 12/1/2012 and 12/31/2012

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



OH4302911 LAKE COUNTY EAST WATER SUBDISTRICT

System Type: Community

Source: Surface Water

Annual Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2012

DISTRIBUTION POINT MONITORING SCHEDULE

Table with 3 columns: Sampling Location, State Facility ID: DS1, SMP ID: DS000, Facility Name: LAKE CO EAST WTR SUBDIST DISTRIBUTION

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 1/1/2012 and 3/31/2012
1 Sample(s) Required between 4/1/2012 and 6/30/2012
1 Sample(s) Required between 7/1/2012 and 9/30/2012
1 Sample(s) Required between 10/1/2012 and 12/31/2012

Sample for all the analytes listed below:
TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950

ASBESTOS - 1094 1 Sample(s) Required between 1/1/2012 and 5/31/2012

Collect one sample at a tap served by asbestos-cement pipe. Due to limited Laboratory capacity and a 48 hour filtering requirement, contact your lab early in the monitoring period to schedule a sampling date.

TOTAL COLIFORM (TCR) - 3100 30 Sample(s) Required between 1/1/2012 and 1/31/2012
30 Sample(s) Required between 2/1/2012 and 2/29/2012
30 Sample(s) Required between 3/1/2012 and 3/31/2012
30 Sample(s) Required between 4/1/2012 and 4/30/2012
30 Sample(s) Required between 5/1/2012 and 5/31/2012
30 Sample(s) Required between 6/1/2012 and 6/30/2012
30 Sample(s) Required between 7/1/2012 and 7/31/2012
30 Sample(s) Required between 8/1/2012 and 8/31/2012
30 Sample(s) Required between 9/1/2012 and 9/30/2012
30 Sample(s) Required between 10/1/2012 and 10/31/2012
30 Sample(s) Required between 11/1/2012 and 11/30/2012
30 Sample(s) Required between 12/1/2012 and 12/31/2012

TOTAL CHLORINE - 1000 30 Sample(s) Required between 1/1/2012 and 1/31/2012
30 Sample(s) Required between 2/1/2012 and 2/29/2012
30 Sample(s) Required between 3/1/2012 and 3/31/2012
30 Sample(s) Required between 4/1/2012 and 4/30/2012
30 Sample(s) Required between 5/1/2012 and 5/31/2012
30 Sample(s) Required between 6/1/2012 and 6/30/2012
30 Sample(s) Required between 7/1/2012 and 7/31/2012
30 Sample(s) Required between 8/1/2012 and 8/31/2012
30 Sample(s) Required between 9/1/2012 and 9/30/2012
30 Sample(s) Required between 10/1/2012 and 10/31/2012
30 Sample(s) Required between 11/1/2012 and 11/30/2012
30 Sample(s) Required between 12/1/2012 and 12/31/2012

Samples should be collected at the same time and place as the Total Coliform samples.



OH4303103 LAKE COUNTY PINECREST SUBDISTRICT

System Type: Community

Source: Purchased Surface Water

Annual Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2012

DISTRIBUTION POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: DS1 SMP ID: DS000	Facility Name: PINECREST SUBDIVISION DISTRIBUTION
--------------------------	---	--

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2012 and 9/30/2012

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period.

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between 1/1/2012 and 1/31/2012
1 Sample(s) Required between 2/1/2012 and 2/29/2012
1 Sample(s) Required between 3/1/2012 and 3/31/2012
1 Sample(s) Required between 4/1/2012 and 4/30/2012
1 Sample(s) Required between 5/1/2012 and 5/31/2012
1 Sample(s) Required between 6/1/2012 and 6/30/2012
1 Sample(s) Required between 7/1/2012 and 7/31/2012
1 Sample(s) Required between 8/1/2012 and 8/31/2012
1 Sample(s) Required between 9/1/2012 and 9/30/2012
1 Sample(s) Required between 10/1/2012 and 10/31/2012
1 Sample(s) Required between 11/1/2012 and 11/30/2012
1 Sample(s) Required between 12/1/2012 and 12/31/2012

TOTAL CHLORINE - 1000

1 Sample(s) Required between 1/1/2012 and 1/31/2012
1 Sample(s) Required between 2/1/2012 and 2/29/2012
1 Sample(s) Required between 3/1/2012 and 3/31/2012
1 Sample(s) Required between 4/1/2012 and 4/30/2012
1 Sample(s) Required between 5/1/2012 and 5/31/2012
1 Sample(s) Required between 6/1/2012 and 6/30/2012
1 Sample(s) Required between 7/1/2012 and 7/31/2012
1 Sample(s) Required between 8/1/2012 and 8/31/2012
1 Sample(s) Required between 9/1/2012 and 9/30/2012
1 Sample(s) Required between 10/1/2012 and 10/31/2012
1 Sample(s) Required between 11/1/2012 and 11/30/2012
1 Sample(s) Required between 12/1/2012 and 12/31/2012

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	State Facility ID: DS1 SMP ID: DS201	Facility Name: PINECREST SUBDIVISION DISTRIBUTION 8242 WHITNEY LANE
--------------------------	---	--

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2012 and 9/30/2012

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950

OH4330217 BUNKYS PUB

System Type: Transient Noncommunity

Source: Ground Water

Annual Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: DS1 SMP ID: DS000	Facility Name: BUNKYS PUB DISTRIBUTION
--------------------------	---	---


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2012 and 3/31/2012
	1 Sample(s) Required between 4/1/2012 and 6/30/2012
	1 Sample(s) Required between 7/1/2012 and 9/30/2012
	1 Sample(s) Required between 10/1/2012 and 12/31/2012

ENTRY POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: 4355453 SMP ID: EP001	Facility Name: BUNKYS PUB Facility Source: Ground Water
--------------------------	---	--

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2012 and 5/31/2012
NITRATE - 1040	1 Sample(s) Required between 1/1/2012 and 5/31/2012

Where to Collect Samples For a Small Public Water System

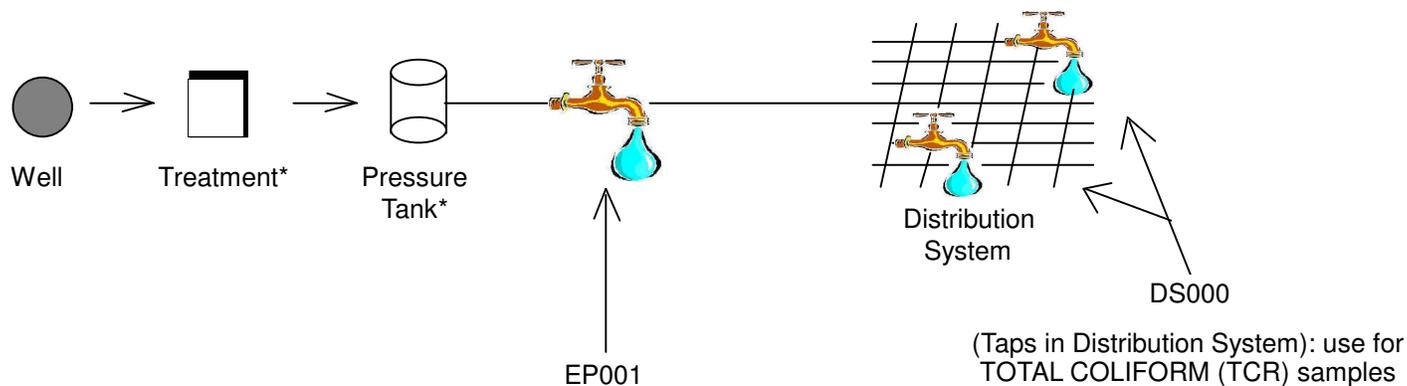

(First available tap after treatment*): use for NITRATE and NITRITE samples

(Taps in Distribution System): use for TOTAL COLIFORM (TCR) samples

* If system does not have treatment, EP001 is the first tap after the well.



OH4331612 LEROY ELEMENTARY SCHOOL

System Type: Nontransient Noncommunity Source: Ground Water

Annual Operating Period: 9/1 to 6/30

ENTRY POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: 4355459 SMP ID: EP001	Facility Name: LEROY ELEM SCH Facility Source: Ground Water
--------------------------	---	--

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 1/1/2012 and 5/31/2012

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 1 Sample(s) Required between 1/1/2012 and 5/31/2012

NITRATE - 1040 1 Sample(s) Required between 1/1/2012 and 5/31/2012

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 1 Sample(s) Required between 1/1/2012 and 5/31/2012

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 1/1/2012 and 5/31/2012



OH4331612 LEROY ELEMENTARY SCHOOL

System Type: Nontransient Noncommunity Source: Ground Water
Groundwater Rule Substantial Treatment System

Annual Operating Period: 9/1 to 6/30

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: DS1 SMP ID: DS000	Facility Name: LEROY ELEMENTARY SCHOOL DISTRIBUTION
--------------------------	---	--

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2012 and 9/30/2012
<i>Sample for all the analytes listed below:</i>	
<i>TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950</i>	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2012 and 3/31/2012 1 Sample(s) Required between 4/1/2012 and 6/30/2012 1 Sample(s) Required between 7/1/2012 and 9/30/2012 1 Sample(s) Required between 10/1/2012 and 12/31/2012
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2012 and 3/31/2012 1 Sample(s) Required between 4/1/2012 and 6/30/2012 1 Sample(s) Required between 7/1/2012 and 9/30/2012 1 Sample(s) Required between 10/1/2012 and 12/31/2012

Samples should be collected at the same time and place as the Total Coliform samples.

OH4333017 BP OIL - VROOMAN PWS

System Type: Transient Noncommunity Source: Ground Water

Annual Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: DS1 SMP ID: DS000	Facility Name: BP OIL - VROOMAN DISTRIBUTION
--------------------------	---	---


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2012 and 3/31/2012
	1 Sample(s) Required between 4/1/2012 and 6/30/2012
	1 Sample(s) Required between 7/1/2012 and 9/30/2012
	1 Sample(s) Required between 10/1/2012 and 12/31/2012

ENTRY POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: 4355462 SMP ID: EP001	Facility Name: BP OIL - VROOMAN Facility Source: Ground Water
--------------------------	---	--

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2012 and 5/31/2012
NITRATE - 1040	1 Sample(s) Required between 1/1/2012 and 5/31/2012

Where to Collect Samples For a Small Public Water System

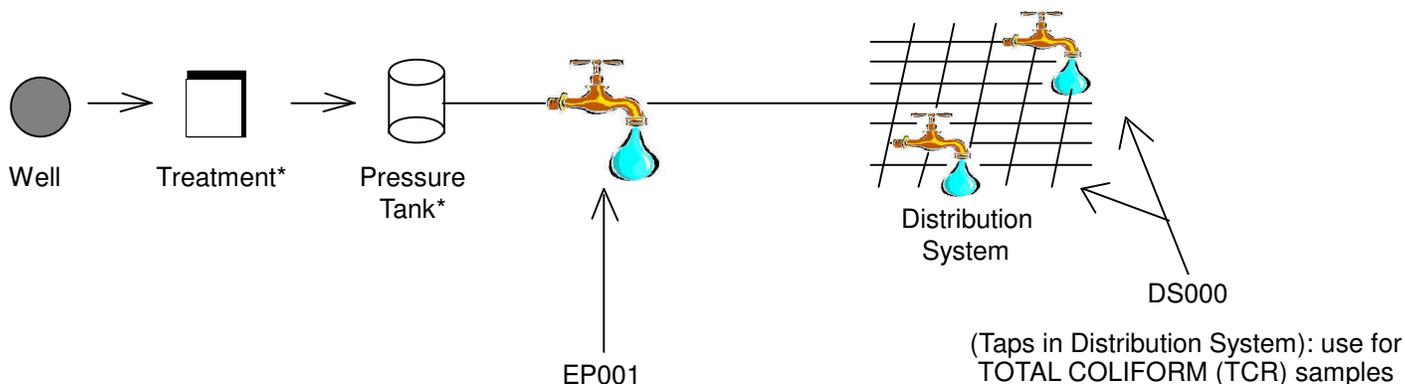

(First available tap after treatment*): use for NITRATE and NITRITE samples

(Taps in Distribution System): use for TOTAL COLIFORM (TCR) samples

* If system does not have treatment, EP001 is the first tap after the well.

OH4333617 CEDAR HILLS CONFERENCE CENTER

System Type: Transient Noncommunity Source: Ground Water

Annual Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: DS1 SMP ID: DS000	Facility Name: CEDAR HILLS CONFERENCE C DISTRIBUTION
--------------------------	---	---


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2012 and 3/31/2012
	1 Sample(s) Required between 4/1/2012 and 6/30/2012
	1 Sample(s) Required between 7/1/2012 and 9/30/2012
	1 Sample(s) Required between 10/1/2012 and 12/31/2012

ENTRY POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: 4355465 SMP ID: EP001	Facility Name: CEDAR HILLS CONFERENCE CENTER Facility Source: Ground Water
--------------------------	---	---

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2012 and 5/31/2012
NITRATE - 1040	1 Sample(s) Required between 1/1/2012 and 5/31/2012

Where to Collect Samples For a Small Public Water System

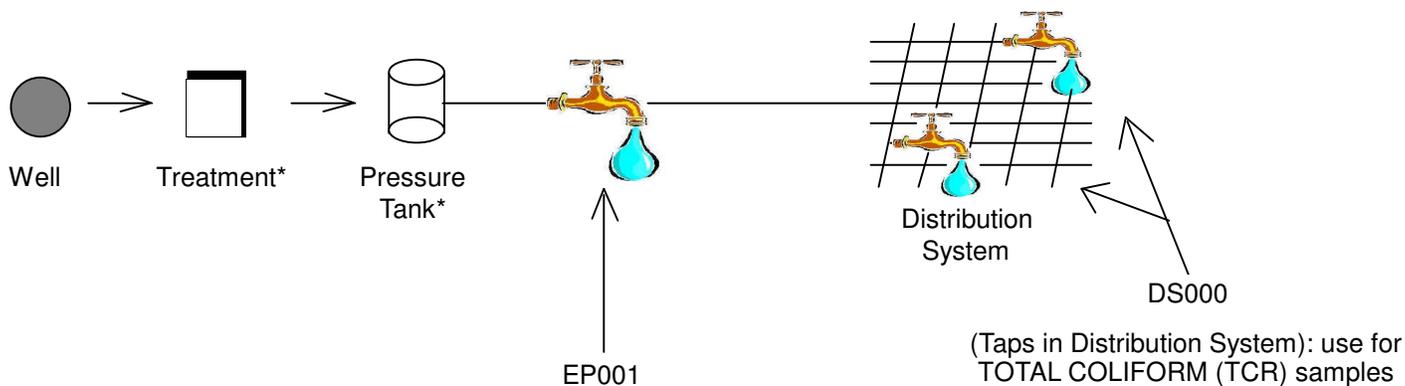

(First available tap after treatment*): use for NITRATE and NITRITE samples

(Taps in Distribution System): use for TOTAL COLIFORM (TCR) samples

* If system does not have treatment, EP001 is the first tap after the well.

OH4334612 CAPPS TAVERN

System Type: Transient Noncommunity

Source: Ground Water

Annual Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: DS1 SMP ID: DS000	Facility Name: CAPPS TAVERN DISTRIBUTION
--------------------------	---	---


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2012 and 3/31/2012
	1 Sample(s) Required between 4/1/2012 and 6/30/2012
	1 Sample(s) Required between 7/1/2012 and 9/30/2012
	1 Sample(s) Required between 10/1/2012 and 12/31/2012

ENTRY POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: 4355467 SMP ID: EP001	Facility Name: CAPPS TAVERN Facility Source: Ground Water
--------------------------	---	--

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2012 and 5/31/2012
NITRATE - 1040	1 Sample(s) Required between 1/1/2012 and 5/31/2012

Where to Collect Samples For a Small Public Water System

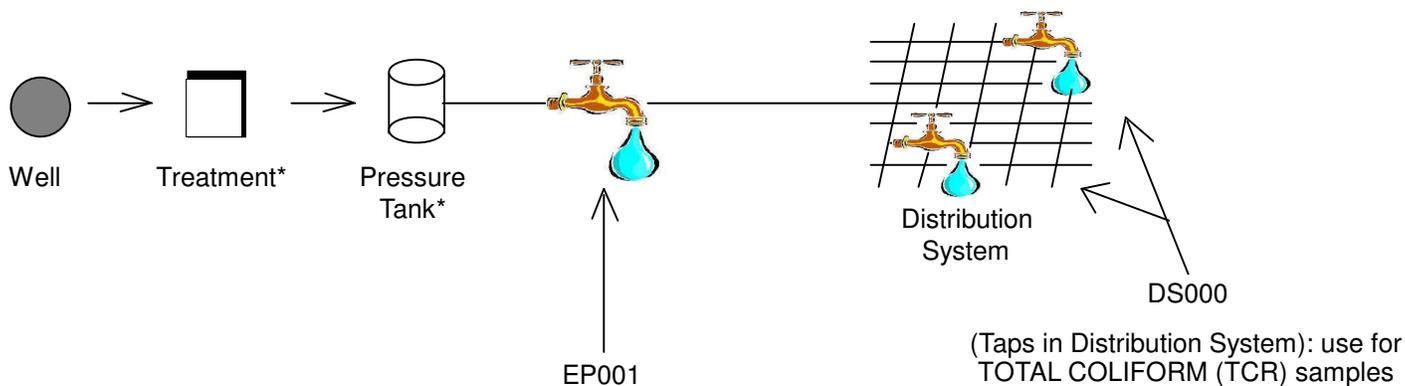

(First available tap after treatment*): use for NITRATE and NITRITE samples

* If system does not have treatment, EP001 is the first tap after the well.

OH4335212 THE RESERVE AT THUNDER HILL

System Type: Transient Noncommunity Source: Ground Water

Annual Operating Period: 4/1 to 11/30

Groundwater Rule Substantial Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: DS1 SMP ID: DS000	Facility Name: THE RESERVE AT THUNDER HILL DISTRIBUTION
--------------------------	---	--


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2012 and 6/30/2012 1 Sample(s) Required between 7/1/2012 and 9/30/2012 1 Sample(s) Required between 10/1/2012 and 12/31/2012

ENTRY POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: 4355468 SMP ID: EP001	Facility Name: THE RESERVE AT THUNDER HILL Facility Source: Ground Water
--------------------------	---	---

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2012 and 5/31/2012
NITRATE - 1040	1 Sample(s) Required between 1/1/2012 and 5/31/2012

Where to Collect Samples For a Small Public Water System

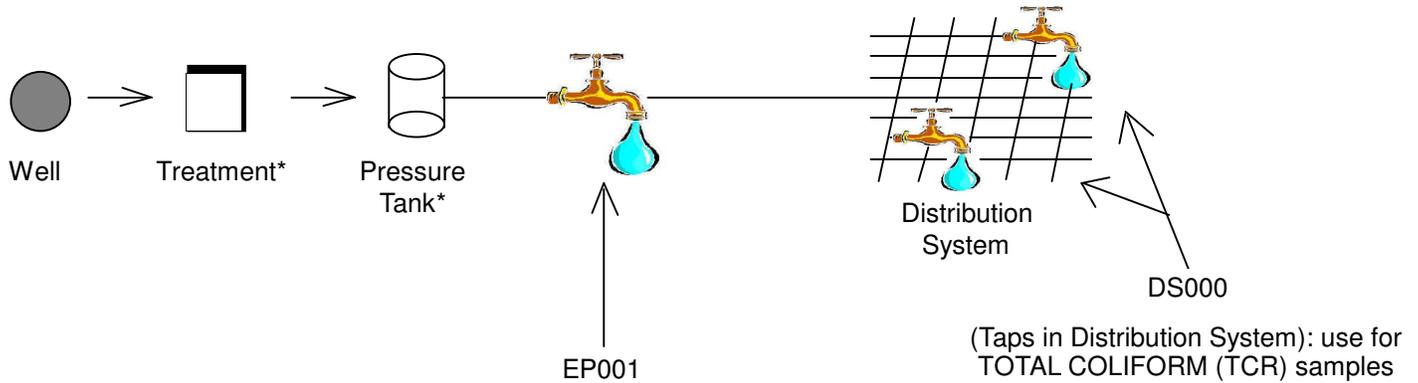

(First available tap after treatment*): use for NITRATE and NITRITE samples

* If system does not have treatment, EP001 is the first tap after the well.

OH4336012 CAMP LEJNAR PUMP HOUSE

System Type: Transient Noncommunity Source: Ground Water

Annual Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: DS1 SMP ID: DS000	Facility Name: CAMP LEJNAR PUMP HOUSE DISTRIBUTION
--------------------------	---	---


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2012 and 3/31/2012
	1 Sample(s) Required between 4/1/2012 and 6/30/2012
	1 Sample(s) Required between 7/1/2012 and 9/30/2012
	1 Sample(s) Required between 10/1/2012 and 12/31/2012

ENTRY POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: 4355469 SMP ID: EP001	Facility Name: CAMP LEJNAR PUMP HOUSE Facility Source: Ground Water
--------------------------	---	--

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2012 and 5/31/2012
NITRATE - 1040	1 Sample(s) Required between 1/1/2012 and 5/31/2012

Where to Collect Samples For a Small Public Water System

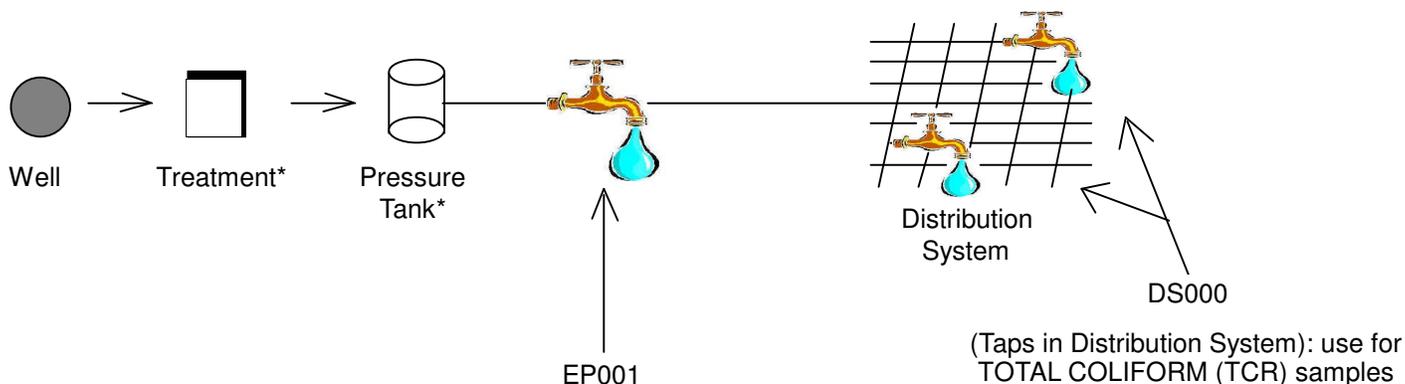

(First available tap after treatment*): use for NITRATE and NITRITE samples

(Taps in Distribution System): use for TOTAL COLIFORM (TCR) samples

* If system does not have treatment, EP001 is the first tap after the well.



OH4337419 HOLDEN ARBORETUM

System Type: Nontransient Noncommunity Source: Ground Water

Annual Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: 4355476 SMP ID: EP001	Facility Name: HOLDEN ARBORETUM Facility Source: Ground Water
--------------------------	---	--

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 1/1/2012 and 5/31/2012

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 1 Sample(s) Required between 1/1/2012 and 5/31/2012

NITRATE - 1040 1 Sample(s) Required between 1/1/2012 and 5/31/2012

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 1 Sample(s) Required between 1/1/2012 and 5/31/2012

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 1/1/2012 and 5/31/2012



OH4337419 HOLDEN ARBORETUM

System Type: Nontransient Noncommunity Source: Ground Water
Groundwater Rule Substantial Treatment System

Annual Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION POINT MONITORING SCHEDULE

Table with 3 columns: Sampling Location, State Facility ID: DS1, SMP ID: DS000, Facility Name: HOLDEN ARBORETUM DISTRIBUTION

Table with 2 columns: Chemicals, Monitoring Requirements. Lists various chemical monitoring requirements such as LEAD, DISINFECTION BYPRODUCTS, and TOTAL COLIFORM.

Samples should be collected at the same time and place as the Total Coliform samples.

OH4338112 KIRTLAND CITY TAVERN PWS

System Type: Transient Noncommunity Source: Ground Water

Annual Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: DS1 SMP ID: DS000	Facility Name: PJS PUB DISTRIBUTION
--------------------------	---	--


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2012 and 3/31/2012
	1 Sample(s) Required between 4/1/2012 and 6/30/2012
	1 Sample(s) Required between 7/1/2012 and 9/30/2012
	1 Sample(s) Required between 10/1/2012 and 12/31/2012

ENTRY POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: 4355479 SMP ID: EP001	Facility Name: KIRTLAND CITY TAVERN Facility Source: Ground Water
--------------------------	---	--

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2012 and 5/31/2012
NITRATE - 1040	1 Sample(s) Required between 1/1/2012 and 5/31/2012

Where to Collect Samples For a Small Public Water System

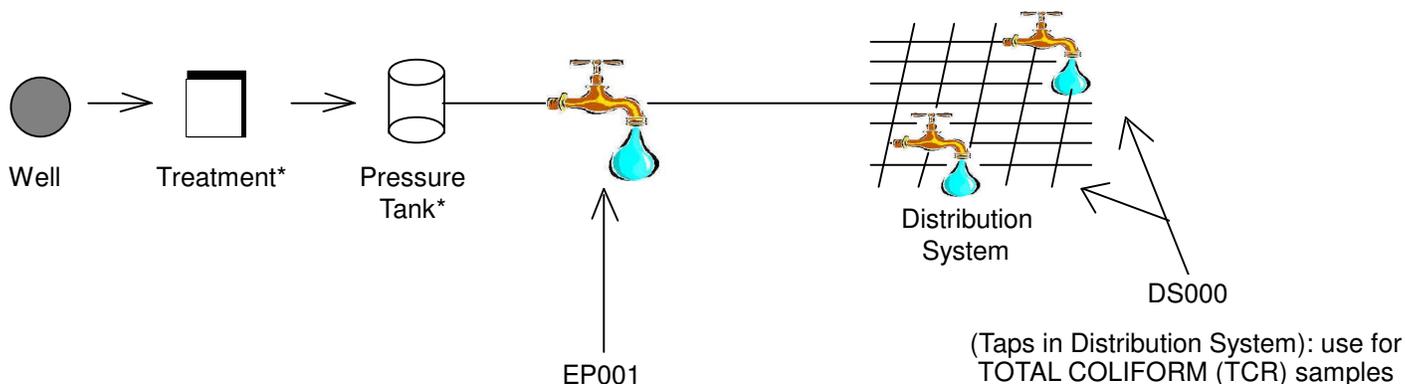

(First available tap after treatment*): use for NITRATE and NITRITE samples

(Taps in Distribution System): use for TOTAL COLIFORM (TCR) samples

* If system does not have treatment, EP001 is the first tap after the well.

OH4338312 STONY GLEN CAMP

System Type: Transient Noncommunity

Source: Ground Water

Annual Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: DS1 SMP ID: DS000	Facility Name: STONY GLEN CAMP DISTRIBUTION
--------------------------	---	--


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2012 and 3/31/2012
	1 Sample(s) Required between 4/1/2012 and 6/30/2012
	1 Sample(s) Required between 7/1/2012 and 9/30/2012
	1 Sample(s) Required between 10/1/2012 and 12/31/2012

ENTRY POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: 4355480 SMP ID: EP001	Facility Name: STONY GLEN CAMP Facility Source: Ground Water
--------------------------	---	---

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2012 and 5/31/2012
NITRATE - 1040	1 Sample(s) Required between 1/1/2012 and 5/31/2012

Where to Collect Samples For a Small Public Water System

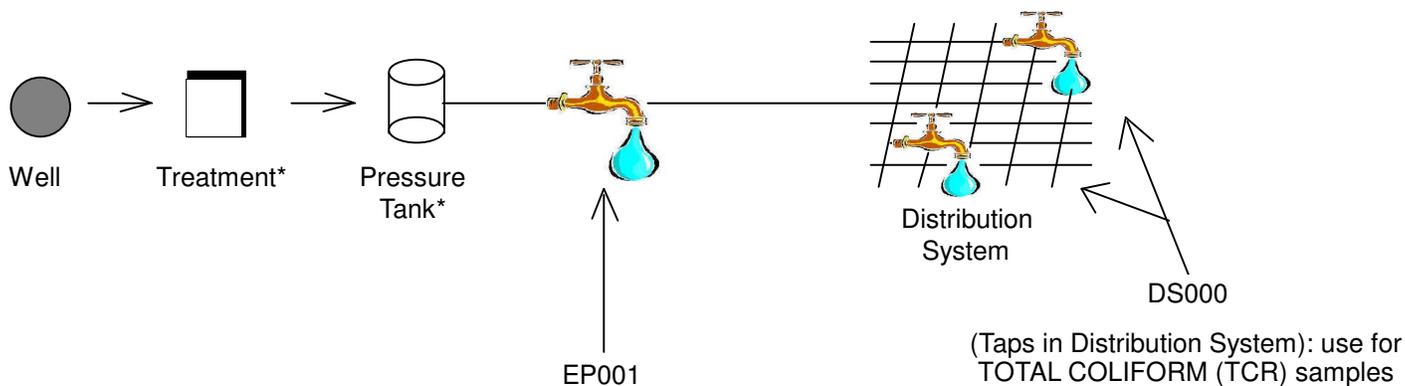

(First available tap after treatment*): use for NITRATE and NITRITE samples

* If system does not have treatment, EP001 is the first tap after the well.



OH4339112 LITTLE LEARNER'S DAYCARE

System Type: Nontransient Noncommunity Source: Ground Water

Annual Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: 4355482 SMP ID: EP001	Facility Name: LITTLE LEARNER'S DAYCARE Facility Source: Ground Water
--------------------------	---	--

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 1/1/2012 and 5/31/2012

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 1 Sample(s) Required between 1/1/2012 and 5/31/2012

NITRATE - 1040 1 Sample(s) Required between 1/1/2012 and 5/31/2012

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 1 Sample(s) Required between 1/1/2012 and 5/31/2012

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 1/1/2012 and 5/31/2012



OH4339112 LITTLE LEARNER'S DAYCARE

System Type: Nontransient Noncommunity Source: Ground Water
Groundwater Rule Minimal Treatment System

Annual Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: DS1 SMP ID: DS000	Facility Name: LITTLE LEARNER'S DAYCARE DISTRIBUTION
--------------------------	---	---

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2012 and 9/30/2012
-------------------------------	---

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period.

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2012 and 3/31/2012
	1 Sample(s) Required between 4/1/2012 and 6/30/2012
	1 Sample(s) Required between 7/1/2012 and 9/30/2012
	1 Sample(s) Required between 10/1/2012 and 12/31/2012

OH4339612 MADISON CONG. OF JEHOVAHS WITNESS

System Type: Transient Noncommunity Source: Ground Water

Annual Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: DS1 SMP ID: DS000	Facility Name: MADISON CONG. OF JEH.WIT DISTRIBUTION
--------------------------	---	---


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2012 and 3/31/2012
	1 Sample(s) Required between 4/1/2012 and 6/30/2012
	1 Sample(s) Required between 7/1/2012 and 9/30/2012
	1 Sample(s) Required between 10/1/2012 and 12/31/2012

ENTRY POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: 4355484 SMP ID: EP001	Facility Name: MADISON CONG OF JEH WITNESS Facility Source: Ground Water
--------------------------	---	---

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2012 and 5/31/2012
NITRATE - 1040	1 Sample(s) Required between 1/1/2012 and 5/31/2012

Where to Collect Samples For a Small Public Water System

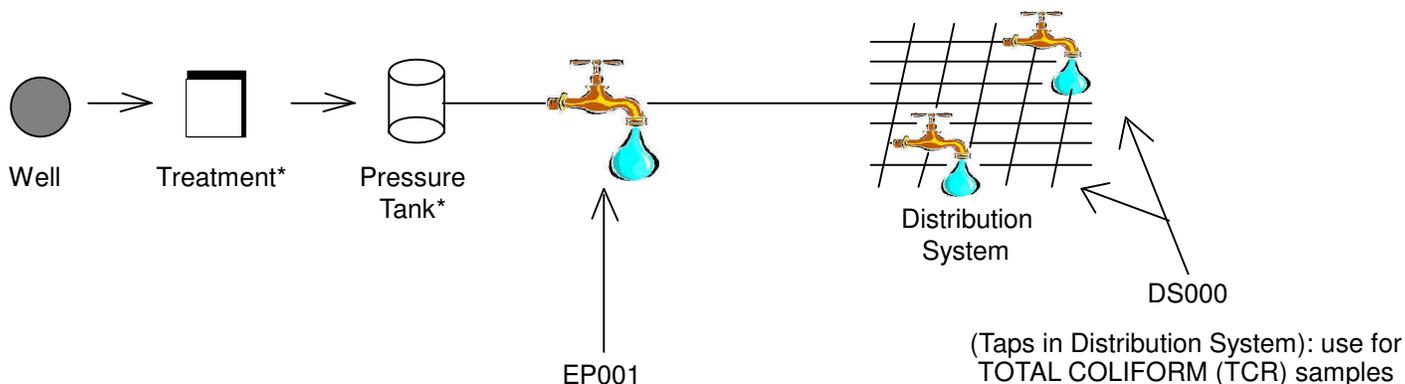

(First available tap after treatment*): use for NITRATE and NITRITE samples

* If system does not have treatment, EP001 is the first tap after the well.

OH4339812 LAKE CO.-RED SCHOOL HOUSE

System Type: Transient Noncommunity Source: Ground Water

Annual Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: DS1 SMP ID: DS000	Facility Name: LAKE CO.-RED SCHOOL HOUS DISTRIBUTION
--------------------------	---	---


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2012 and 3/31/2012
	1 Sample(s) Required between 4/1/2012 and 6/30/2012
	1 Sample(s) Required between 7/1/2012 and 9/30/2012
	1 Sample(s) Required between 10/1/2012 and 12/31/2012

ENTRY POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: 4355486 SMP ID: EP001	Facility Name: LAKE CO RED SCHOOL HOUSE NTR Facility Source: Ground Water
--------------------------	---	--

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2012 and 5/31/2012
NITRATE - 1040	1 Sample(s) Required between 1/1/2012 and 5/31/2012

Where to Collect Samples For a Small Public Water System

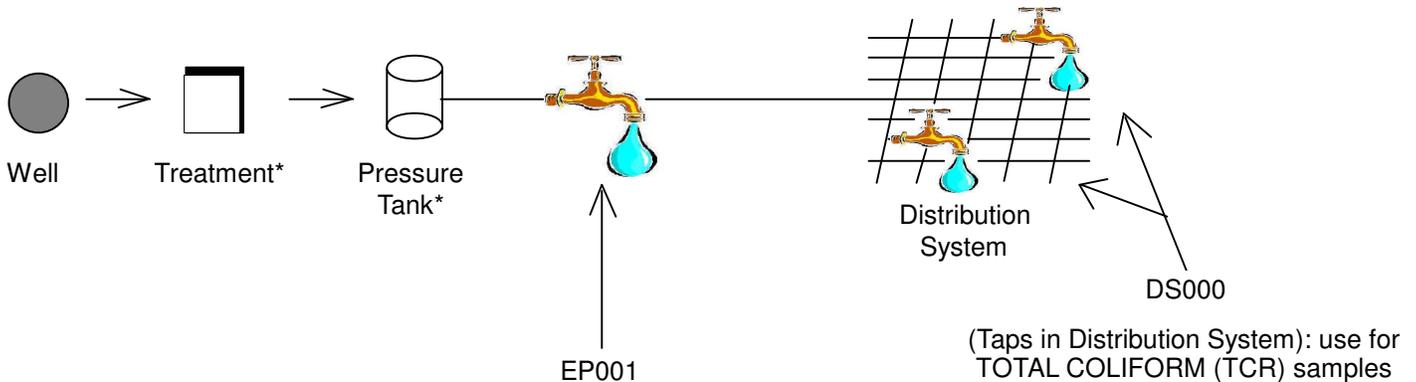

(First available tap after treatment*): use for NITRATE and NITRITE samples

(Taps in Distribution System): use for TOTAL COLIFORM (TCR) samples

* If system does not have treatment, EP001 is the first tap after the well.

OH4340111 CAMP STIGWANDISH

System Type: Transient Noncommunity

Source: Ground Water

Annual Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: DS1 SMP ID: DS000	Facility Name: CAMP STIGWANDISH DISTRIBUTION
--------------------------	---	---


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2012 and 3/31/2012
	1 Sample(s) Required between 4/1/2012 and 6/30/2012
	1 Sample(s) Required between 7/1/2012 and 9/30/2012
	1 Sample(s) Required between 10/1/2012 and 12/31/2012

ENTRY POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: 4355489 SMP ID: EP001	Facility Name: CAMP STIGWANDISH Facility Source: Ground Water
--------------------------	---	--

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2012 and 5/31/2012
NITRATE - 1040	1 Sample(s) Required between 1/1/2012 and 5/31/2012

Where to Collect Samples For a Small Public Water System

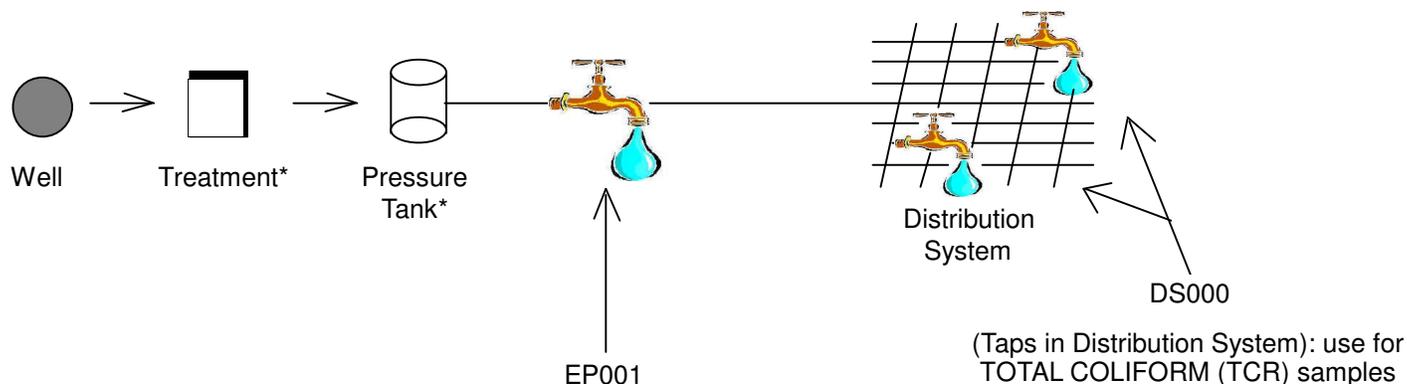

(First available tap after treatment*): use for **NITRATE** and **NITRITE** samples

* If system does not have treatment, EP001 is the first tap after the well.

OH4340812 LEROY COUNTRY STORE

System Type: Transient Noncommunity

Source: Ground Water

Annual Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: DS1 SMP ID: DS000	Facility Name: LEROY COUNTRY STORE DISTRIBUTION
--------------------------	---	--


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2012 and 3/31/2012
	1 Sample(s) Required between 4/1/2012 and 6/30/2012
	1 Sample(s) Required between 7/1/2012 and 9/30/2012
	1 Sample(s) Required between 10/1/2012 and 12/31/2012

ENTRY POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: 4355493 SMP ID: EP001	Facility Name: LEROY COUNTRY STORE Facility Source: Ground Water
--------------------------	---	---

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2012 and 5/31/2012
NITRATE - 1040	1 Sample(s) Required between 1/1/2012 and 5/31/2012

Where to Collect Samples For a Small Public Water System

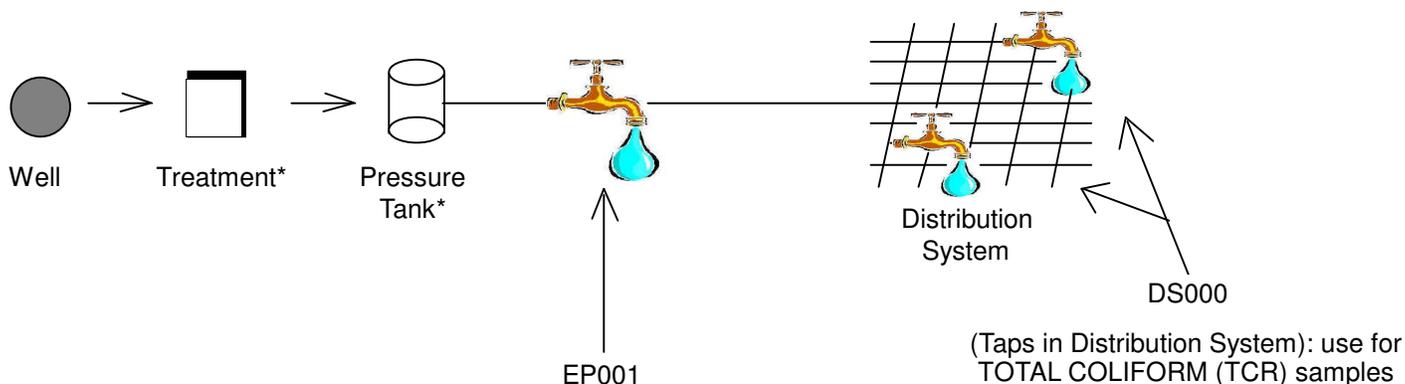

(First available tap after treatment*): use for NITRATE and NITRITE samples

* If system does not have treatment, EP001 is the first tap after the well.

OH4341112 STONY GLEN CAMP-CABIN

System Type: Transient Noncommunity Source: Ground Water

Annual Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: DS1 SMP ID: DS000	Facility Name: STONY GLEN CAMP-CABIN DISTRIBUTION
--------------------------	---	--


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2012 and 3/31/2012
	1 Sample(s) Required between 4/1/2012 and 6/30/2012
	1 Sample(s) Required between 7/1/2012 and 9/30/2012
	1 Sample(s) Required between 10/1/2012 and 12/31/2012

ENTRY POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: 4355495 SMP ID: EP001	Facility Name: STONY GLEN CAMP CABIN Facility Source: Ground Water
--------------------------	---	---

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2012 and 5/31/2012
NITRATE - 1040	1 Sample(s) Required between 1/1/2012 and 5/31/2012

Where to Collect Samples For a Small Public Water System

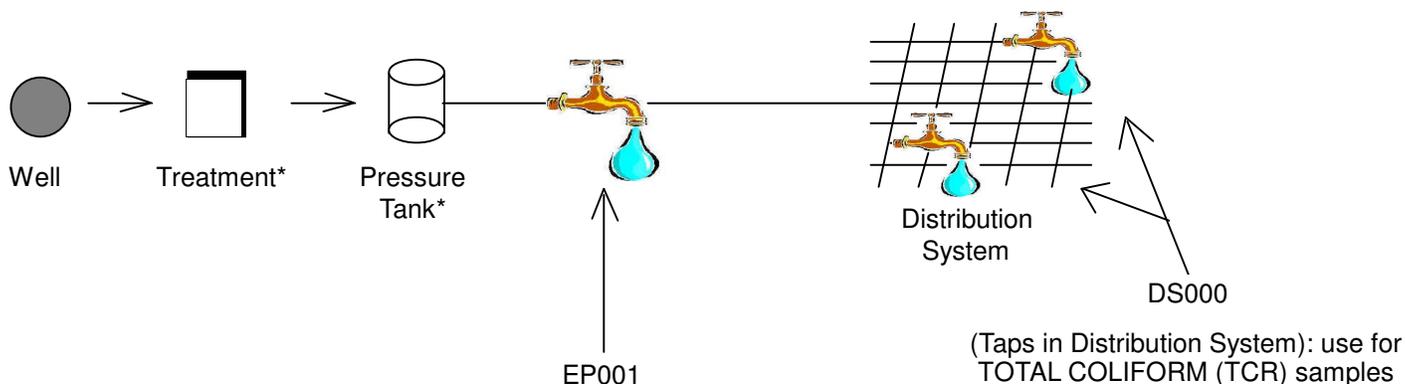

(First available tap after treatment*): use for NITRATE and NITRITE samples

(Taps in Distribution System): use for TOTAL COLIFORM (TCR) samples

* If system does not have treatment, EP001 is the first tap after the well.

OH4341211 CHALET DEBONNE VINEYARD

System Type: Transient Noncommunity Source: Ground Water

Annual Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: DS1 SMP ID: DS000	Facility Name: CHALET DEBONNE VINEYARD DISTRIBUTION
--------------------------	---	--


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2012 and 3/31/2012
	1 Sample(s) Required between 4/1/2012 and 6/30/2012
	1 Sample(s) Required between 7/1/2012 and 9/30/2012
	1 Sample(s) Required between 10/1/2012 and 12/31/2012

ENTRY POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: 4355496 SMP ID: EP001	Facility Name: CHALET DEBONNE VINEYARD Facility Source: Ground Water
--------------------------	---	---

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2012 and 5/31/2012
NITRATE - 1040	1 Sample(s) Required between 1/1/2012 and 5/31/2012

Where to Collect Samples For a Small Public Water System

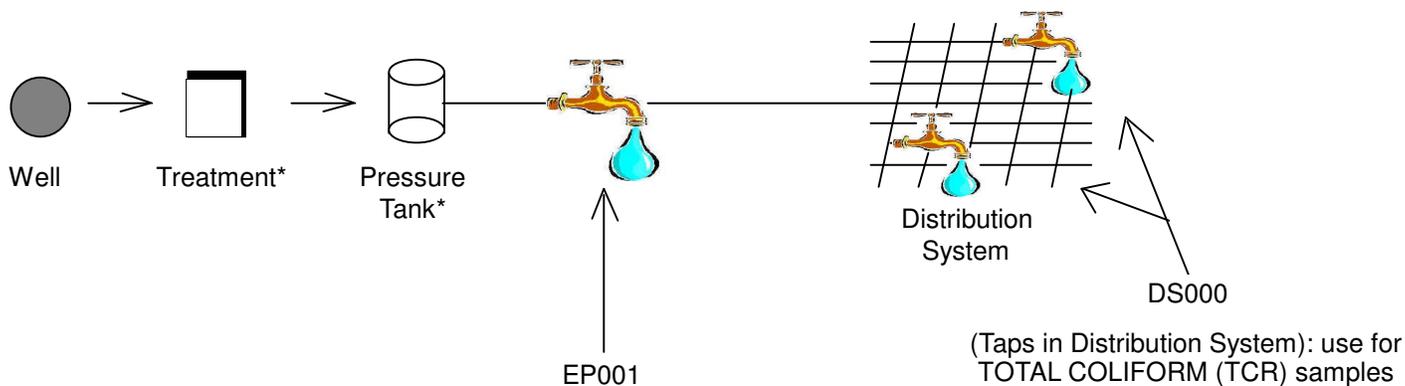

(First available tap after treatment*): use for NITRATE and NITRITE samples

(Taps in Distribution System): use for TOTAL COLIFORM (TCR) samples

* If system does not have treatment, EP001 is the first tap after the well.

OH4341612 LEROY COMMUNITY CHAPEL CORNERSTONE PWS

System Type: Transient Noncommunity Source: Ground Water

Annual Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: DS1 SMP ID: DS000	Facility Name: LEROY COMMUNITY CHAPEL CORNERSTONE DISTR
--------------------------	---	--


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2012 and 3/31/2012
	1 Sample(s) Required between 4/1/2012 and 6/30/2012
	1 Sample(s) Required between 7/1/2012 and 9/30/2012
	1 Sample(s) Required between 10/1/2012 and 12/31/2012

ENTRY POINT MONITORING SCHEDULE

Sampling Location	State Facility ID: 4361545 SMP ID: EP001	Facility Name: LEROY COMMUNITY CHAPEL CORNERSTONE BLDG Facility Source: Ground Water
--------------------------	---	---

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2012 and 5/31/2012
NITRATE - 1040	1 Sample(s) Required between 1/1/2012 and 5/31/2012

Where to Collect Samples For a Small Public Water System

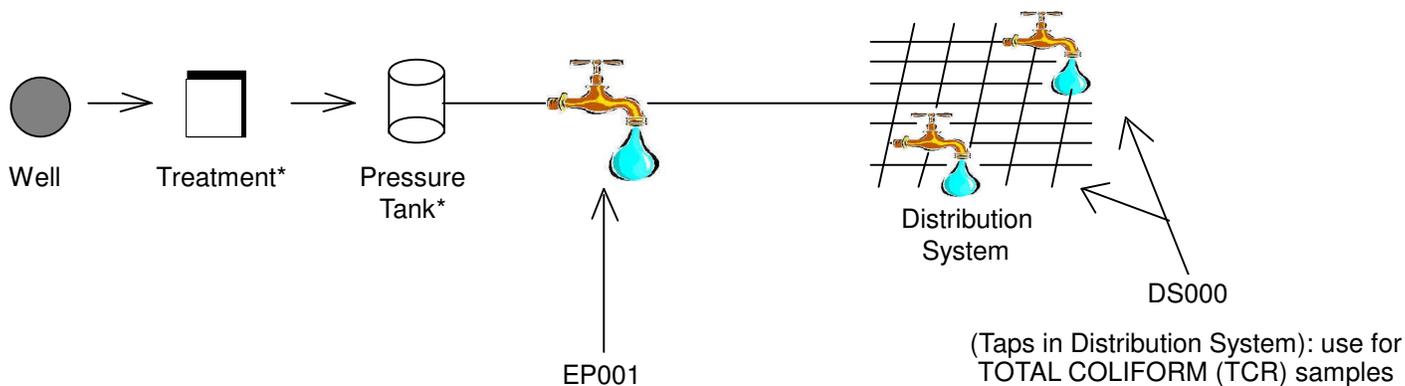

(First available tap after treatment*): use for NITRATE and NITRITE samples

* If system does not have treatment, EP001 is the first tap after the well.