

Jay
(IN)


Mercer

Auglaize

Needed Percent Reduction in Total Phosphorus Load for Meeting Water Quality Goals 2009 TMDL

Shelby

Randolph
(IN)

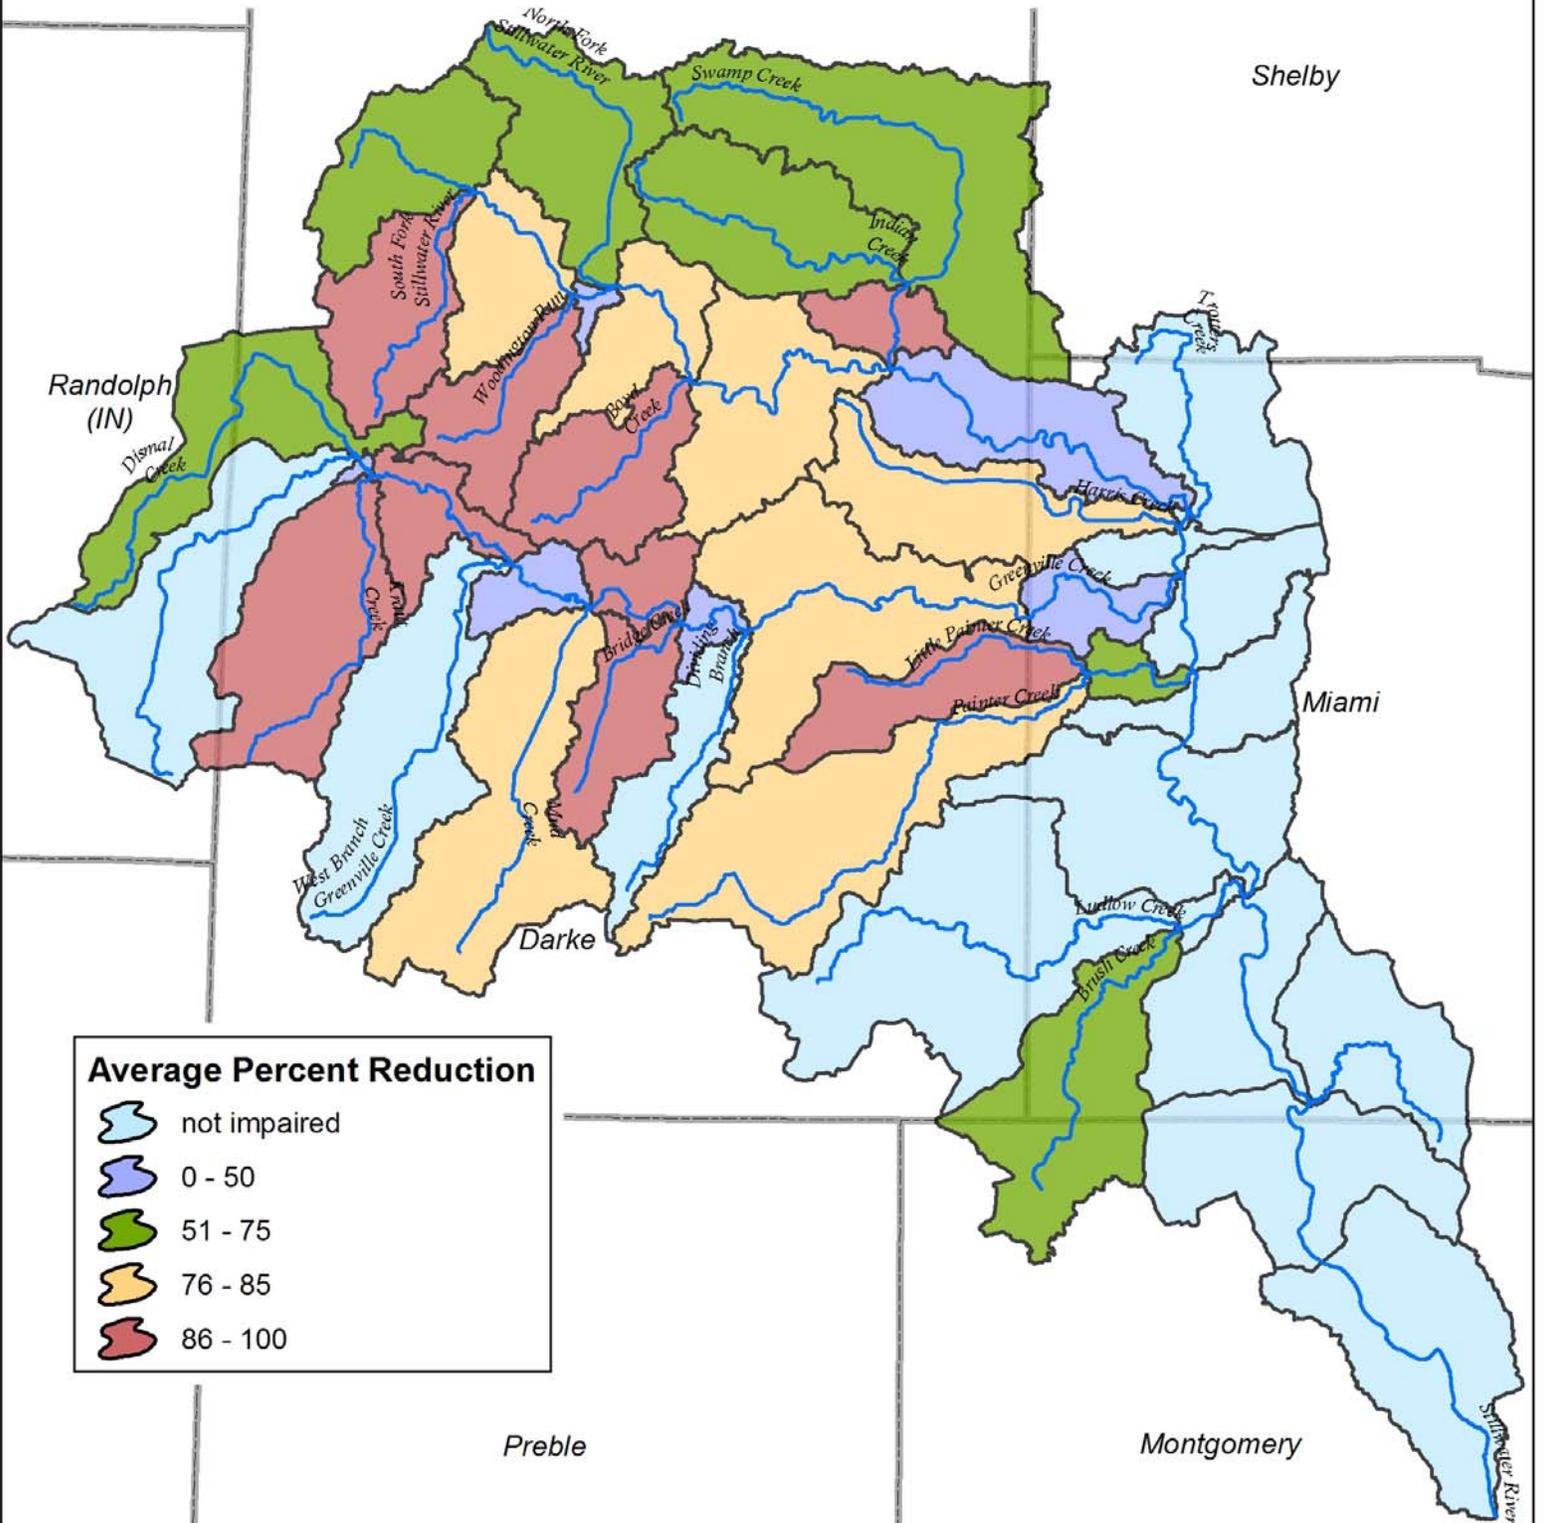

Miami

Darke

Average Percent Reduction

-  not impaired
-  0 - 50
-  51 - 75
-  76 - 85
-  86 - 100

Preble

Montgomery

