



OH2100011 ASHLEY VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

| | | | |
|--------------------------|---|--|--------------------------------|
| Sampling Location | Facility ID: DS1 SMP ID: DS000 | Facility Name: ASHLEY, VILLAGE DISTRIBUTION | Facility Class: CLASS 1 |
|--------------------------|---|--|--------------------------------|

Chemicals Monitoring Requirements

| | | | | |
|-----------------------------|------------------------------|-----------|-----|------------|
| TOTAL COLIFORM (TCR) - 3100 | 2 Sample(s) Required between | 1/1/2018 | and | 1/31/2018 |
| | 2 Sample(s) Required between | 2/1/2018 | and | 2/28/2018 |
| | 2 Sample(s) Required between | 3/1/2018 | and | 3/31/2018 |
| | 2 Sample(s) Required between | 4/1/2018 | and | 4/30/2018 |
| | 2 Sample(s) Required between | 5/1/2018 | and | 5/31/2018 |
| | 2 Sample(s) Required between | 6/1/2018 | and | 6/30/2018 |
| | 2 Sample(s) Required between | 7/1/2018 | and | 7/31/2018 |
| | 2 Sample(s) Required between | 8/1/2018 | and | 8/31/2018 |
| | 2 Sample(s) Required between | 9/1/2018 | and | 9/30/2018 |
| | 2 Sample(s) Required between | 10/1/2018 | and | 10/31/2018 |
| | 2 Sample(s) Required between | 11/1/2018 | and | 11/30/2018 |
| | 2 Sample(s) Required between | 12/1/2018 | and | 12/31/2018 |

| | | | | |
|-----------------------|------------------------------|-----------|-----|------------|
| TOTAL CHLORINE - 1000 | 2 Sample(s) Required between | 1/1/2018 | and | 1/31/2018 |
| | 2 Sample(s) Required between | 2/1/2018 | and | 2/28/2018 |
| | 2 Sample(s) Required between | 3/1/2018 | and | 3/31/2018 |
| | 2 Sample(s) Required between | 4/1/2018 | and | 4/30/2018 |
| | 2 Sample(s) Required between | 5/1/2018 | and | 5/31/2018 |
| | 2 Sample(s) Required between | 6/1/2018 | and | 6/30/2018 |
| | 2 Sample(s) Required between | 7/1/2018 | and | 7/31/2018 |
| | 2 Sample(s) Required between | 8/1/2018 | and | 8/31/2018 |
| | 2 Sample(s) Required between | 9/1/2018 | and | 9/30/2018 |
| | 2 Sample(s) Required between | 10/1/2018 | and | 10/31/2018 |
| | 2 Sample(s) Required between | 11/1/2018 | and | 11/30/2018 |
| | 2 Sample(s) Required between | 12/1/2018 | and | 12/31/2018 |

Samples should be collected at the same time and place as the Total Coliform samples.

| | | | |
|--------------------------|---|--|--------------------------------|
| Sampling Location | Facility ID: DS1 SMP ID: DS201 | Facility Name: ASHLEY, VILLAGE DISTRIBUTION DELAWARE CO. EMS - 245 W. HIGH ST | Facility Class: CLASS 1 |
|--------------------------|---|--|--------------------------------|

Chemicals Monitoring Requirements

| | | | | |
|-------------------------|------------------------------|-----------|-----|----------------------|
| DISINFECTION BYPRODUCTS | Dual Sample Required between | 2/8/2018 | and | 2/14/2018 at: DS201 |
| | Dual Sample Required between | 5/8/2018 | and | 5/14/2018 at: DS201 |
| | Dual Sample Required between | 8/8/2018 | and | 8/14/2018 at: DS201 |
| | Dual Sample Required between | 11/8/2018 | and | 11/14/2018 at: DS201 |

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH2100011 ASHLEY VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

| | | | |
|--------------------------|---|---|--------------------------------|
| Sampling Location | Facility ID: DS1 SMP ID: DS202 | Facility Name: ASHLEY, VILLAGE DISTRIBUTION DELAWARE MANOR APTS - 200 CENTER ST. | Facility Class: CLASS 1 |
|--------------------------|---|---|--------------------------------|

| Chemicals | Monitoring Requirements |
|-------------------------|--|
| DISINFECTION BYPRODUCTS | Dual Sample Required between 2/8/2018 and 2/14/2018 at: DS202 Dual Sample Required between 5/8/2018 and 5/14/2018 at: DS202 Dual Sample Required between 8/8/2018 and 8/14/2018 at: DS202 Dual Sample Required between 11/8/2018 and 11/14/2018 at: DS202 |

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

| | | | |
|--------------------------|---|---|--------------------------------|
| Sampling Location | Facility ID: DS1 SMP ID: LC### | Facility Name: ASHLEY, VILLAGE DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs | Facility Class: CLASS 1 |
|--------------------------|---|---|--------------------------------|

| Chemicals | Monitoring Requirements |
|-------------------------------|--|
| LEAD - 1030 AND COPPER - 1022 | 10 Sample(s) Required between 6/1/2018 and 9/30/2018 |

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



OH2100311 DELAWARE CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

| | | | |
|--------------------------|---|---|--------------------------------|
| Sampling Location | Facility ID: 2153877 SMP ID: EP001 | Facility Name: DELAWARE WTP Facility Source: Surface Water | Facility Class: CLASS 4 |
|--------------------------|---|---|--------------------------------|

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

| Chemicals | Monitoring Requirements |
|-----------|-------------------------|
|-----------|-------------------------|

| | |
|------------|---|
| INORGANICS | 1 Sample(s) Required between 1/1/2018 and 5/31/2018 |
|------------|---|

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020
 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

| | |
|----------------|--------------|
| NITRITE - 1041 | Not Required |
|----------------|--------------|

| | |
|----------------|---|
| NITRATE - 1040 | 1 Sample(s) Required between 1/1/2018 and 1/31/2018 |
| | 1 Sample(s) Required between 2/1/2018 and 2/28/2018 |
| | 1 Sample(s) Required between 3/1/2018 and 3/31/2018 |
| | 1 Sample(s) Required between 4/1/2018 and 4/30/2018 |
| | 1 Sample(s) Required between 5/1/2018 and 5/31/2018 |
| | 1 Sample(s) Required between 6/1/2018 and 6/30/2018 |
| | 1 Sample(s) Required between 7/1/2018 and 7/31/2018 |
| | 1 Sample(s) Required between 8/1/2018 and 8/31/2018 |
| | 1 Sample(s) Required between 9/1/2018 and 9/30/2018 |
| | 1 Sample(s) Required between 10/1/2018 and 10/31/2018 |
| | 1 Sample(s) Required between 11/1/2018 and 11/30/2018 |
| | 1 Sample(s) Required between 12/1/2018 and 12/31/2018 |

| | |
|---------------|--------------|
| RADIOLOGICALS | Not Required |
|---------------|--------------|

| | |
|---|---|
| SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 | 1 Sample(s) Required between 4/1/2018 and 4/30/2018 |
| | 1 Sample(s) Required between 5/1/2018 and 5/31/2018 |
| | 1 Sample(s) Required between 6/1/2018 and 6/30/2018 |

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

| | |
|----------------------------------|---|
| VOLATILE ORGANIC CHEMICALS (VOC) | 1 Sample(s) Required between 1/1/2018 and 3/31/2018 |
|----------------------------------|---|

| | |
|----------------------------|---|
| TOTAL ORGANIC CARBON (TOC) | 1 Paired Sample Set Required between 1/1/2018 and 1/31/2018 |
| | 1 Paired Sample Set Required between 2/1/2018 and 2/28/2018 |
| | 1 Paired Sample Set Required between 3/1/2018 and 3/31/2018 |
| | 1 Paired Sample Set Required between 4/1/2018 and 4/30/2018 |
| | 1 Paired Sample Set Required between 5/1/2018 and 5/31/2018 |
| | 1 Paired Sample Set Required between 6/1/2018 and 6/30/2018 |
| | 1 Paired Sample Set Required between 7/1/2018 and 7/31/2018 |
| | 1 Paired Sample Set Required between 8/1/2018 and 8/31/2018 |
| | 1 Paired Sample Set Required between 9/1/2018 and 9/30/2018 |
| | 1 Paired Sample Set Required between 10/1/2018 and 10/31/2018 |
| | 1 Paired Sample Set Required between 11/1/2018 and 11/30/2018 |
| | 1 Paired Sample Set Required between 12/1/2018 and 12/31/2018 |

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH2100311 DELAWARE CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

| | | | |
|-----------------|-----------------------------|---------------------------------------|--------------------------------|
| Sampling | Facility ID: 2153877 | Facility Name: DELAWARE WTP | |
| Location | SMP ID: EP001/LT2001 | Facility Source: Surface Water | Facility Class: CLASS 4 |

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

| Chemicals | Monitoring Requirements |
|------------------|--------------------------------|
|------------------|--------------------------------|

| | |
|--------------------|-------------------------------|
| TOTAL MICROCYSTINS | 1 Sample Set Required WEEKLY* |
|--------------------|-------------------------------|

Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. A week is defined as Sunday through Saturday.

**Weekly sampling unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. Reduced monitoring is contingent on a public water system continuing to experience NO raw or finished water total microcystins detections. Any total microcystins detections during routine (weekly) or reduced sampling will trigger additional sampling. Please refer to the website above for specifics on follow-up sampling requirements.*



OH2100311 DELAWARE CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

| | | | |
|--------------------------|-----------------------------|---------------------------------------|--------------------------------|
| Sampling Location | Facility ID: 2153877 | Facility Name: DELAWARE WTP | Facility Class: CLASS 4 |
| | SMP ID: LT2001 | Facility Source: Surface Water | |

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

| Chemicals | Monitoring Requirements |
|--|--|
| CYANOBACTERIA SCREENING | 1 Sample(s) Required between 1/7/2018 and 1/13/2018 |
| | 1 Sample(s) Required between 1/21/2018 and 1/27/2018 |
| | 1 Sample(s) Required between 2/4/2018 and 2/10/2018 |
| | 1 Sample(s) Required between 2/18/2018 and 2/24/2018 |
| | 1 Sample(s) Required between 3/4/2018 and 3/10/2018 |
| | 1 Sample(s) Required between 3/18/2018 and 3/24/2018 |
| | 1 Sample(s) Required between 4/1/2018 and 4/7/2018 |
| | 1 Sample(s) Required between 4/15/2018 and 4/21/2018 |
| | 1 Sample(s) Required between 4/29/2018 and 5/5/2018 |
| | 1 Sample(s) Required between 5/13/2018 and 5/19/2018 |
| | 1 Sample(s) Required between 5/27/2018 and 6/2/2018 |
| | 1 Sample(s) Required between 6/10/2018 and 6/16/2018 |
| | 1 Sample(s) Required between 6/24/2018 and 6/30/2018 |
| | 1 Sample(s) Required between 7/8/2018 and 7/14/2018 |
| | 1 Sample(s) Required between 7/22/2018 and 7/28/2018 |
| | 1 Sample(s) Required between 8/5/2018 and 8/11/2018 |
| | 1 Sample(s) Required between 8/19/2018 and 8/25/2018 |
| | 1 Sample(s) Required between 9/2/2018 and 9/8/2018 |
| | 1 Sample(s) Required between 9/16/2018 and 9/22/2018 |
| | 1 Sample(s) Required between 9/30/2018 and 10/6/2018 |
| 1 Sample(s) Required between 10/14/2018 and 10/20/2018 | |
| 1 Sample(s) Required between 10/28/2018 and 11/3/2018 | |
| 1 Sample(s) Required between 11/11/2018 and 11/17/2018 | |
| 1 Sample(s) Required between 11/25/2018 and 12/1/2018 | |
| 1 Sample(s) Required between 12/9/2018 and 12/15/2018 | |
| 1 Sample(s) Required between 12/23/2018 and 12/29/2018 | |

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. As of 12/31/17, all public water systems are responsible for contracting with a lab certified to perform cyanobacteria screening (qPCR). Please review the website for further information pertaining to follow-up sampling requirements for cyanobacteria screening gene detections, and certified labs that can perform analysis.

OH2100311 DELAWARE CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

| | | | |
|--------------------------|---|---|--------------------------------|
| Sampling Location | Facility ID: DS1 SMP ID: DS000 | Facility Name: DELAWARE, CITY DISTRIBUTION | Facility Class: CLASS 2 |
|--------------------------|---|---|--------------------------------|

| Chemicals | Monitoring Requirements |
|-----------------------------|--|
| ASBESTOS - 1094 | Not Required |
| TOTAL COLIFORM (TCR) - 3100 | 40 Sample(s) Required between 1/1/2018 and 1/31/2018 40 Sample(s) Required between 2/1/2018 and 2/28/2018 40 Sample(s) Required between 3/1/2018 and 3/31/2018 40 Sample(s) Required between 4/1/2018 and 4/30/2018 40 Sample(s) Required between 5/1/2018 and 5/31/2018 40 Sample(s) Required between 6/1/2018 and 6/30/2018 40 Sample(s) Required between 7/1/2018 and 7/31/2018 40 Sample(s) Required between 8/1/2018 and 8/31/2018 40 Sample(s) Required between 9/1/2018 and 9/30/2018 40 Sample(s) Required between 10/1/2018 and 10/31/2018 40 Sample(s) Required between 11/1/2018 and 11/30/2018 40 Sample(s) Required between 12/1/2018 and 12/31/2018 |
| TOTAL CHLORINE - 1000 | 40 Sample(s) Required between 1/1/2018 and 1/31/2018 40 Sample(s) Required between 2/1/2018 and 2/28/2018 40 Sample(s) Required between 3/1/2018 and 3/31/2018 40 Sample(s) Required between 4/1/2018 and 4/30/2018 40 Sample(s) Required between 5/1/2018 and 5/31/2018 40 Sample(s) Required between 6/1/2018 and 6/30/2018 40 Sample(s) Required between 7/1/2018 and 7/31/2018 40 Sample(s) Required between 8/1/2018 and 8/31/2018 40 Sample(s) Required between 9/1/2018 and 9/30/2018 40 Sample(s) Required between 10/1/2018 and 10/31/2018 40 Sample(s) Required between 11/1/2018 and 11/30/2018 40 Sample(s) Required between 12/1/2018 and 12/31/2018 |

Samples should be collected at the same time and place as the Total Coliform samples.

| | | | |
|--------------------------|---|---|--------------------------------|
| Sampling Location | Facility ID: DS1 SMP ID: DS201 | Facility Name: DELAWARE, CITY DISTRIBUTION TARA GLEN & KITDARE DE. | Facility Class: CLASS 2 |
|--------------------------|---|---|--------------------------------|

| Chemicals | Monitoring Requirements |
|-------------------------|--|
| DISINFECTION BYPRODUCTS | Dual Sample Required between 1/8/2018 and 1/14/2018 at: DS201 Dual Sample Required between 4/8/2018 and 4/14/2018 at: DS201 Dual Sample Required between 7/8/2018 and 7/14/2018 at: DS201 Dual Sample Required between 10/8/2018 and 10/14/2018 at: DS201 |

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH2100311 DELAWARE CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

| | | | |
|--------------------------|---|---|--------------------------------|
| Sampling Location | Facility ID: DS1 SMP ID: DS202 | Facility Name: DELAWARE, CITY DISTRIBUTION WENDYS 1850 COLUMBUS PIKE | Facility Class: CLASS 2 |
|--------------------------|---|---|--------------------------------|

| Chemicals | Monitoring Requirements |
|-------------------------|---|
| DISINFECTION BYPRODUCTS | Dual Sample Required between 1/8/2018 and 1/14/2018 at: DS202 |
| | Dual Sample Required between 4/8/2018 and 4/14/2018 at: DS202 |
| | Dual Sample Required between 7/8/2018 and 7/14/2018 at: DS202 |
| | Dual Sample Required between 10/8/2018 and 10/14/2018 at: DS202 |

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

| | | | |
|--------------------------|---|--|--------------------------------|
| Sampling Location | Facility ID: DS1 SMP ID: DS203 | Facility Name: DELAWARE, CITY DISTRIBUTION MCDONALDS 279 S SANDUSKY ST. | Facility Class: CLASS 2 |
|--------------------------|---|--|--------------------------------|

| Chemicals | Monitoring Requirements |
|-------------------------|---|
| DISINFECTION BYPRODUCTS | Dual Sample Required between 1/8/2018 and 1/14/2018 at: DS203 |
| | Dual Sample Required between 4/8/2018 and 4/14/2018 at: DS203 |
| | Dual Sample Required between 7/8/2018 and 7/14/2018 at: DS203 |
| | Dual Sample Required between 10/8/2018 and 10/14/2018 at: DS203 |

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

| | | | |
|--------------------------|---|---|--------------------------------|
| Sampling Location | Facility ID: DS1 SMP ID: DS204 | Facility Name: DELAWARE, CITY DISTRIBUTION PITTSBURGH DR AND COLUMET | Facility Class: CLASS 2 |
|--------------------------|---|---|--------------------------------|

| Chemicals | Monitoring Requirements |
|-------------------------|---|
| DISINFECTION BYPRODUCTS | Dual Sample Required between 1/8/2018 and 1/14/2018 at: DS204 |
| | Dual Sample Required between 4/8/2018 and 4/14/2018 at: DS204 |
| | Dual Sample Required between 7/8/2018 and 7/14/2018 at: DS204 |
| | Dual Sample Required between 10/8/2018 and 10/14/2018 at: DS204 |

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH2100311 DELAWARE CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

| | | | |
|--------------------------|---|--|--------------------------------|
| Sampling Location | Facility ID: DS1 SMP ID: LC### | Facility Name: DELAWARE, CITY DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs | Facility Class: CLASS 2 |
|--------------------------|---|--|--------------------------------|

| Chemicals | Monitoring Requirements |
|-------------------------------|--|
| LEAD - 1030 AND COPPER - 1022 | 30 Sample(s) Required between 6/1/2018 and 9/30/2018 |

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



OH2101203 WESTERVILLE ESTATES MHP

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

| | | | |
|--------------------------|---|--|--------------------------------|
| Sampling Location | Facility ID: DS1 SMP ID: DS000 | Facility Name: WESTERVILLE ESTATES MHP DISTRIBUTION | Facility Class: CLASS 1 |
|--------------------------|---|--|--------------------------------|

Chemicals Monitoring Requirements

| | | | | |
|-----------------------------|------------------------------|-----------|-----|------------|
| TOTAL COLIFORM (TCR) - 3100 | 1 Sample(s) Required between | 1/1/2018 | and | 1/31/2018 |
| | 1 Sample(s) Required between | 2/1/2018 | and | 2/28/2018 |
| | 1 Sample(s) Required between | 3/1/2018 | and | 3/31/2018 |
| | 1 Sample(s) Required between | 4/1/2018 | and | 4/30/2018 |
| | 1 Sample(s) Required between | 5/1/2018 | and | 5/31/2018 |
| | 1 Sample(s) Required between | 6/1/2018 | and | 6/30/2018 |
| | 1 Sample(s) Required between | 7/1/2018 | and | 7/31/2018 |
| | 1 Sample(s) Required between | 8/1/2018 | and | 8/31/2018 |
| | 1 Sample(s) Required between | 9/1/2018 | and | 9/30/2018 |
| | 1 Sample(s) Required between | 10/1/2018 | and | 10/31/2018 |
| | 1 Sample(s) Required between | 11/1/2018 | and | 11/30/2018 |
| | 1 Sample(s) Required between | 12/1/2018 | and | 12/31/2018 |

| | | | | |
|-----------------------|------------------------------|-----------|-----|------------|
| TOTAL CHLORINE - 1000 | 1 Sample(s) Required between | 1/1/2018 | and | 1/31/2018 |
| | 1 Sample(s) Required between | 2/1/2018 | and | 2/28/2018 |
| | 1 Sample(s) Required between | 3/1/2018 | and | 3/31/2018 |
| | 1 Sample(s) Required between | 4/1/2018 | and | 4/30/2018 |
| | 1 Sample(s) Required between | 5/1/2018 | and | 5/31/2018 |
| | 1 Sample(s) Required between | 6/1/2018 | and | 6/30/2018 |
| | 1 Sample(s) Required between | 7/1/2018 | and | 7/31/2018 |
| | 1 Sample(s) Required between | 8/1/2018 | and | 8/31/2018 |
| | 1 Sample(s) Required between | 9/1/2018 | and | 9/30/2018 |
| | 1 Sample(s) Required between | 10/1/2018 | and | 10/31/2018 |
| | 1 Sample(s) Required between | 11/1/2018 | and | 11/30/2018 |
| | 1 Sample(s) Required between | 12/1/2018 | and | 12/31/2018 |

Samples should be collected at the same time and place as the Total Coliform samples.

| | | | |
|--------------------------|---|--|--------------------------------|
| Sampling Location | Facility ID: DS1 SMP ID: DS201 | Facility Name: WESTERVILLE ESTATES MHP DISTRIBUTION 11050 FANCHER RD. LOT 114 | Facility Class: CLASS 1 |
|--------------------------|---|--|--------------------------------|

Chemicals Monitoring Requirements

| | | | | | |
|-------------------------|------------------------------|-----------|-----|------------|-----------|
| DISINFECTION BYPRODUCTS | Dual Sample Required between | 1/8/2018 | and | 1/14/2018 | at: DS201 |
| | Dual Sample Required between | 4/8/2018 | and | 4/14/2018 | at: DS201 |
| | Dual Sample Required between | 7/8/2018 | and | 7/14/2018 | at: DS201 |
| | Dual Sample Required between | 10/8/2018 | and | 10/14/2018 | at: DS201 |

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH2101203 WESTERVILLE ESTATES MHP

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

| | | | |
|--------------------------|---|--|--------------------------------|
| Sampling Location | Facility ID: DS1 SMP ID: DS202 | Facility Name: WESTERVILLE ESTATES MHP DISTRIBUTION ADDRESS NOT KNOWN | Facility Class: CLASS 1 |
|--------------------------|---|--|--------------------------------|

| Chemicals | Monitoring Requirements |
|-------------------------|--|
| DISINFECTION BYPRODUCTS | Dual Sample Required between 1/8/2018 and 1/14/2018 at: DS202 Dual Sample Required between 4/8/2018 and 4/14/2018 at: DS202 Dual Sample Required between 7/8/2018 and 7/14/2018 at: DS202 Dual Sample Required between 10/8/2018 and 10/14/2018 at: DS202 |

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

| | | | |
|--------------------------|---|---|--------------------------------|
| Sampling Location | Facility ID: DS1 SMP ID: LC### | Facility Name: WESTERVILLE ESTATES MHP DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs | Facility Class: CLASS 1 |
|--------------------------|---|---|--------------------------------|

| Chemicals | Monitoring Requirements |
|-------------------------------|--|
| LEAD - 1030 AND COPPER - 1022 | 10 Sample(s) Required between 6/1/2018 and 9/30/2018 |

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



OH2101303 WORTHINGTON ARMS MHC

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

| | | | |
|--------------------------|---|---|--------------------------------|
| Sampling Location | Facility ID: DS1 SMP ID: DS000 | Facility Name: WORTHINGTON ARMS MHC DISTRIBUTION | Facility Class: CLASS 1 |
|--------------------------|---|---|--------------------------------|

Chemicals Monitoring Requirements

| | | |
|-----------------------------|------------------------------|--------------------------|
| TOTAL COLIFORM (TCR) - 3100 | 1 Sample(s) Required between | 1/1/2018 and 1/31/2018 |
| | 1 Sample(s) Required between | 2/1/2018 and 2/28/2018 |
| | 1 Sample(s) Required between | 3/1/2018 and 3/31/2018 |
| | 1 Sample(s) Required between | 4/1/2018 and 4/30/2018 |
| | 1 Sample(s) Required between | 5/1/2018 and 5/31/2018 |
| | 1 Sample(s) Required between | 6/1/2018 and 6/30/2018 |
| | 1 Sample(s) Required between | 7/1/2018 and 7/31/2018 |
| | 1 Sample(s) Required between | 8/1/2018 and 8/31/2018 |
| | 1 Sample(s) Required between | 9/1/2018 and 9/30/2018 |
| | 1 Sample(s) Required between | 10/1/2018 and 10/31/2018 |
| | 1 Sample(s) Required between | 11/1/2018 and 11/30/2018 |
| | 1 Sample(s) Required between | 12/1/2018 and 12/31/2018 |

| | | |
|-----------------------|------------------------------|--------------------------|
| TOTAL CHLORINE - 1000 | 1 Sample(s) Required between | 1/1/2018 and 1/31/2018 |
| | 1 Sample(s) Required between | 2/1/2018 and 2/28/2018 |
| | 1 Sample(s) Required between | 3/1/2018 and 3/31/2018 |
| | 1 Sample(s) Required between | 4/1/2018 and 4/30/2018 |
| | 1 Sample(s) Required between | 5/1/2018 and 5/31/2018 |
| | 1 Sample(s) Required between | 6/1/2018 and 6/30/2018 |
| | 1 Sample(s) Required between | 7/1/2018 and 7/31/2018 |
| | 1 Sample(s) Required between | 8/1/2018 and 8/31/2018 |
| | 1 Sample(s) Required between | 9/1/2018 and 9/30/2018 |
| | 1 Sample(s) Required between | 10/1/2018 and 10/31/2018 |
| | 1 Sample(s) Required between | 11/1/2018 and 11/30/2018 |
| | 1 Sample(s) Required between | 12/1/2018 and 12/31/2018 |

Samples should be collected at the same time and place as the Total Coliform samples.

| | | | |
|--------------------------|---|--|--------------------------------|
| Sampling Location | Facility ID: DS1 SMP ID: DS201 | Facility Name: WORTHINGTON ARMS MHC DISTRIBUTION 5277 COLUMBUS PIKE | Facility Class: CLASS 1 |
|--------------------------|---|--|--------------------------------|

Chemicals Monitoring Requirements

| | | |
|-------------------------|------------------------------|----------------------------------|
| DISINFECTION BYPRODUCTS | Dual Sample Required between | 7/1/2018 and 9/30/2018 at: DS201 |
|-------------------------|------------------------------|----------------------------------|

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2018

2018 DISTRIBUTION SCHEDULE

OH2101303 WORTHINGTON ARMS MHC

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

| | | | |
|--------------------------|-------------------------|---|--------------------------------|
| Sampling Location | Facility ID: DS1 | Facility Name: WORTHINGTON ARMS MHC DISTRIBUTION | Facility Class: CLASS 1 |
| | SMP ID: LC### | Refer to your Lead and Copper plan for SMP IDs | |

| Chemicals | Monitoring Requirements |
|------------------|--------------------------------|
|------------------|--------------------------------|

| | |
|-------------------------------|---|
| LEAD - 1030 AND COPPER - 1022 | 5 Sample(s) Required between 6/1/2018 and 9/30/2018 |
|-------------------------------|---|

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



OH2101412 DEL-CO WATER COMPANY, INC.

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

| | | | |
|--------------------------|---|---|--------------------------------|
| Sampling Location | Facility ID: 2153875 SMP ID: EP001 | Facility Name: DEL-CO OLENTANGY WTP Facility Source: Surface Water | Facility Class: CLASS 4 |
|--------------------------|---|---|--------------------------------|

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

| Chemicals | Monitoring Requirements |
|--|--|
| INORGANICS | 1 Sample(s) Required between 1/1/2018 and 5/31/2018 |
| <i>Sample for all the analytes listed below:</i> | |
| ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085 | |
| NITRITE - 1041 | Not Required |
| NITRATE - 1040 | 1 Sample(s) Required between 1/1/2018 and 1/31/2018 1 Sample(s) Required between 2/1/2018 and 2/28/2018 1 Sample(s) Required between 3/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 4/30/2018 1 Sample(s) Required between 5/1/2018 and 5/31/2018 1 Sample(s) Required between 6/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 7/31/2018 1 Sample(s) Required between 8/1/2018 and 8/31/2018 1 Sample(s) Required between 9/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 10/31/2018 1 Sample(s) Required between 11/1/2018 and 11/30/2018 1 Sample(s) Required between 12/1/2018 and 12/31/2018 |
| RADIOLOGICALS | Not Required |
| SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 | 1 Sample(s) Required between 4/1/2018 and 4/30/2018 1 Sample(s) Required between 5/1/2018 and 5/31/2018 1 Sample(s) Required between 6/1/2018 and 6/30/2018 |
| <i>Sample for all the analytes listed below:</i> | |
| ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037 | |
| VOLATILE ORGANIC CHEMICALS (VOC) | 1 Sample(s) Required between 1/1/2018 and 5/31/2018 |
| TOTAL ORGANIC CARBON (TOC) | 1 Paired Sample Set Required between 1/1/2018 and 1/31/2018 1 Paired Sample Set Required between 2/1/2018 and 2/28/2018 1 Paired Sample Set Required between 3/1/2018 and 3/31/2018 1 Paired Sample Set Required between 4/1/2018 and 4/30/2018 1 Paired Sample Set Required between 5/1/2018 and 5/31/2018 1 Paired Sample Set Required between 6/1/2018 and 6/30/2018 1 Paired Sample Set Required between 7/1/2018 and 7/31/2018 1 Paired Sample Set Required between 8/1/2018 and 8/31/2018 1 Paired Sample Set Required between 9/1/2018 and 9/30/2018 1 Paired Sample Set Required between 10/1/2018 and 10/31/2018 1 Paired Sample Set Required between 11/1/2018 and 11/30/2018 1 Paired Sample Set Required between 12/1/2018 and 12/31/2018 |

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH2101412 DEL-CO WATER COMPANY, INC.

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

| | | | |
|-----------------|-----------------------------|--|--------------------------------|
| Sampling | Facility ID: 2153875 | Facility Name: DEL-CO OLENTANGY WTP | |
| Location | SMP ID: EP001/LT2001 | Facility Source: Surface Water | Facility Class: CLASS 4 |

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

Chemicals

Monitoring Requirements

TOTAL MICROCYSTINS

1 Sample Set Required WEEKLY*

Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. A week is defined as Sunday through Saturday.

**Weekly sampling unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. Reduced monitoring is contingent on a public water system continuing to experience NO raw or finished water total microcystins detections. Any total microcystins detections during routine (weekly) or reduced sampling will trigger additional sampling. Please refer to the website above for specifics on follow-up sampling requirements.*



OH2101412 DEL-CO WATER COMPANY, INC.

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

| | | | |
|-----------------|-----------------------------|--|--------------------------------|
| Sampling | Facility ID: 2153875 | Facility Name: DEL-CO OLENTANGY WTP | |
| Location | SMP ID: LT2001 | Facility Source: Surface Water | Facility Class: CLASS 4 |

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

| Chemicals | Monitoring Requirements | | |
|------------------------------|--------------------------------|---------------|-----------|
| CYANOBACTERIA SCREENING | 1 Sample(s) Required between | 1/7/2018 and | 1/13/2018 |
| | 1 Sample(s) Required between | 1/21/2018 and | 1/27/2018 |
| | 1 Sample(s) Required between | 2/4/2018 and | 2/10/2018 |
| | 1 Sample(s) Required between | 2/18/2018 and | 2/24/2018 |
| | 1 Sample(s) Required between | 3/4/2018 and | 3/10/2018 |
| | 1 Sample(s) Required between | 3/18/2018 and | 3/24/2018 |
| | 1 Sample(s) Required between | 4/1/2018 and | 4/7/2018 |
| | 1 Sample(s) Required between | 4/15/2018 and | 4/21/2018 |
| | 1 Sample(s) Required between | 4/29/2018 and | 5/5/2018 |
| | 1 Sample(s) Required between | 5/13/2018 and | 5/19/2018 |
| | 1 Sample(s) Required between | 5/27/2018 and | 6/2/2018 |
| | 1 Sample(s) Required between | 6/10/2018 and | 6/16/2018 |
| | 1 Sample(s) Required between | 6/24/2018 and | 6/30/2018 |
| | 1 Sample(s) Required between | 7/8/2018 and | 7/14/2018 |
| | 1 Sample(s) Required between | 7/22/2018 and | 7/28/2018 |
| | 1 Sample(s) Required between | 8/5/2018 and | 8/11/2018 |
| | 1 Sample(s) Required between | 8/19/2018 and | 8/25/2018 |
| | 1 Sample(s) Required between | 9/2/2018 and | 9/8/2018 |
| | 1 Sample(s) Required between | 9/16/2018 and | 9/22/2018 |
| | 1 Sample(s) Required between | 9/30/2018 and | 10/6/2018 |
| 1 Sample(s) Required between | 10/14/2018 and | 10/20/2018 | |
| 1 Sample(s) Required between | 10/28/2018 and | 11/3/2018 | |
| 1 Sample(s) Required between | 11/11/2018 and | 11/17/2018 | |
| 1 Sample(s) Required between | 11/25/2018 and | 12/1/2018 | |
| 1 Sample(s) Required between | 12/9/2018 and | 12/15/2018 | |
| 1 Sample(s) Required between | 12/23/2018 and | 12/29/2018 | |

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. As of 12/31/17, all public water systems are responsible for contracting with a lab certified to perform cyanobacteria screening (qPCR). Please review the website for further information pertaining to follow-up sampling requirements for cyanobacteria screening gene detections, and certified labs that can perform analysis.



OH2101412 DEL-CO WATER COMPANY, INC.

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

| | | | |
|--------------------------|-----------------------------|--|--------------------------------|
| Sampling Location | Facility ID: 2153876 | Facility Name: RE SCOTT WTP (ALUM CK) | Facility Class: CLASS 4 |
| | SMP ID: EP002 | Facility Source: Surface Water | |

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

| Chemicals | Monitoring Requirements |
|--|--|
| INORGANICS | 1 Sample(s) Required between 1/1/2018 and 5/31/2018 |
| <i>Sample for all the analytes listed below:</i> | |
| ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085 | |
| NITRITE - 1041 | Not Required |
| NITRATE - 1040 | 1 Sample(s) Required between 1/1/2018 and 1/31/2018 1 Sample(s) Required between 2/1/2018 and 2/28/2018 1 Sample(s) Required between 3/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 4/30/2018 1 Sample(s) Required between 5/1/2018 and 5/31/2018 1 Sample(s) Required between 6/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 7/31/2018 1 Sample(s) Required between 8/1/2018 and 8/31/2018 1 Sample(s) Required between 9/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 10/31/2018 1 Sample(s) Required between 11/1/2018 and 11/30/2018 1 Sample(s) Required between 12/1/2018 and 12/31/2018 |
| SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 | 1 Sample(s) Required between 4/1/2018 and 4/30/2018 1 Sample(s) Required between 5/1/2018 and 5/31/2018 1 Sample(s) Required between 6/1/2018 and 6/30/2018 |
| <i>Sample for all the analytes listed below:</i> | |
| ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037 | |
| VOLATILE ORGANIC CHEMICALS (VOC) | 1 Sample(s) Required between 1/1/2018 and 5/31/2018 |
| TOTAL ORGANIC CARBON (TOC) | 1 Paired Sample Set Required between 1/1/2018 and 1/31/2018 1 Paired Sample Set Required between 2/1/2018 and 2/28/2018 1 Paired Sample Set Required between 3/1/2018 and 3/31/2018 1 Paired Sample Set Required between 4/1/2018 and 4/30/2018 1 Paired Sample Set Required between 5/1/2018 and 5/31/2018 1 Paired Sample Set Required between 6/1/2018 and 6/30/2018 1 Paired Sample Set Required between 7/1/2018 and 7/31/2018 1 Paired Sample Set Required between 8/1/2018 and 8/31/2018 1 Paired Sample Set Required between 9/1/2018 and 9/30/2018 1 Paired Sample Set Required between 10/1/2018 and 10/31/2018 1 Paired Sample Set Required between 11/1/2018 and 11/30/2018 1 Paired Sample Set Required between 12/1/2018 and 12/31/2018 |

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



OH2101412 DEL-CO WATER COMPANY, INC.

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

| | | | |
|-----------------|-----------------------------|--|--------------------------------|
| Sampling | Facility ID: 2153876 | Facility Name: RE SCOTT WTP (ALUM CK) | |
| Location | SMP ID: EP002/LT2002 | Facility Source: Surface Water | Facility Class: CLASS 4 |

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

Chemicals

Monitoring Requirements

TOTAL MICROCYSTINS

1 Sample Set Required WEEKLY*

Total microcystins sample set refers to one raw source water sample at LT2002 and one finished water sample at EP002. A week is defined as Sunday through Saturday.

**Weekly sampling unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. Reduced monitoring is contingent on a public water system continuing to experience NO raw or finished water total microcystins detections. Any total microcystins detections during routine (weekly) or reduced sampling will trigger additional sampling. Please refer to the website above for specifics on follow-up sampling requirements.*



OH2101412 DEL-CO WATER COMPANY, INC.

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

| | | | |
|--------------------------|-----------------------------|--|--------------------------------|
| Sampling Location | Facility ID: 2153876 | Facility Name: RE SCOTT WTP (ALUM CK) | Facility Class: CLASS 4 |
| | SMP ID: LT2002 | Facility Source: Surface Water | |

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

| Chemicals | Monitoring Requirements |
|--|--|
| CYANOBACTERIA SCREENING | 1 Sample(s) Required between 1/7/2018 and 1/13/2018 |
| | 1 Sample(s) Required between 1/21/2018 and 1/27/2018 |
| | 1 Sample(s) Required between 2/4/2018 and 2/10/2018 |
| | 1 Sample(s) Required between 2/18/2018 and 2/24/2018 |
| | 1 Sample(s) Required between 3/4/2018 and 3/10/2018 |
| | 1 Sample(s) Required between 3/18/2018 and 3/24/2018 |
| | 1 Sample(s) Required between 4/1/2018 and 4/7/2018 |
| | 1 Sample(s) Required between 4/15/2018 and 4/21/2018 |
| | 1 Sample(s) Required between 4/29/2018 and 5/5/2018 |
| | 1 Sample(s) Required between 5/13/2018 and 5/19/2018 |
| | 1 Sample(s) Required between 5/27/2018 and 6/2/2018 |
| | 1 Sample(s) Required between 6/10/2018 and 6/16/2018 |
| | 1 Sample(s) Required between 6/24/2018 and 6/30/2018 |
| | 1 Sample(s) Required between 7/8/2018 and 7/14/2018 |
| | 1 Sample(s) Required between 7/22/2018 and 7/28/2018 |
| | 1 Sample(s) Required between 8/5/2018 and 8/11/2018 |
| | 1 Sample(s) Required between 8/19/2018 and 8/25/2018 |
| | 1 Sample(s) Required between 9/2/2018 and 9/8/2018 |
| | 1 Sample(s) Required between 9/16/2018 and 9/22/2018 |
| | 1 Sample(s) Required between 9/30/2018 and 10/6/2018 |
| 1 Sample(s) Required between 10/14/2018 and 10/20/2018 | |
| 1 Sample(s) Required between 10/28/2018 and 11/3/2018 | |
| 1 Sample(s) Required between 11/11/2018 and 11/17/2018 | |
| 1 Sample(s) Required between 11/25/2018 and 12/1/2018 | |
| 1 Sample(s) Required between 12/9/2018 and 12/15/2018 | |
| 1 Sample(s) Required between 12/23/2018 and 12/29/2018 | |

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. As of 12/31/17, all public water systems are responsible for contracting with a lab certified to perform cyanobacteria screening (qPCR). Please review the website for further information pertaining to follow-up sampling requirements for cyanobacteria screening gene detections, and certified labs that can perform analysis.



OH2101412 DEL-CO WATER COMPANY, INC.

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

| | | | |
|--------------------------|-----------------------------|---|--------------------------------|
| Sampling Location | Facility ID: 2160741 | Facility Name: TF MCNAMARA WTF (OLD STATE) | Facility Class: CLASS 3 |
| | SMP ID: EP004 | Facility Source: Surface Water | |

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

| Chemicals | Monitoring Requirements | |
|--|--------------------------------------|-------------------------|
| INORGANICS | 1 Sample(s) Required between | 6/1/2018 and 10/31/2018 |
| <i>Sample for all the analytes listed below:</i> | | |
| ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 | | |
| CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085 | | |
| NITRITE - 1041 | Not Required | |
| NITRATE - 1040 | 1 Sample(s) Required between | 6/1/2018 and 6/30/2018 |
| | 1 Sample(s) Required between | 7/1/2018 and 7/31/2018 |
| | 1 Sample(s) Required between | 8/1/2018 and 8/31/2018 |
| RADIOLOGICALS | Not Required | |
| SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 | 1 Sample(s) Required between | 4/1/2018 and 4/30/2018 |
| | 1 Sample(s) Required between | 5/1/2018 and 5/31/2018 |
| | 1 Sample(s) Required between | 6/1/2018 and 6/30/2018 |
| <i>Sample for all the analytes listed below:</i> | | |
| ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037 | | |
| VOLATILE ORGANIC CHEMICALS (VOC) | 1 Sample(s) Required between | 6/1/2018 and 10/31/2018 |
| TOTAL ORGANIC CARBON (TOC) | 1 Paired Sample Set Required between | 6/1/2018 and 6/30/2018 |
| | 1 Paired Sample Set Required between | 7/1/2018 and 7/31/2018 |
| | 1 Paired Sample Set Required between | 8/1/2018 and 8/31/2018 |

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH2101412 DEL-CO WATER COMPANY, INC.

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

| | | |
|-----------------|-----------------------------|--|
| Sampling | Facility ID: 2160741 | Facility Name: TF MCNAMARA WTF (OLD STATE) |
| Location | SMP ID: EP004/LT2004 | Facility Source: Surface Water Facility Class: CLASS 3 |

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

Chemicals

Monitoring Requirements

TOTAL MICROCYSTINS

1 Sample Set Required WEEKLY*

Total microcystins sample set refers to one raw source water sample at LT2004 and one finished water sample at EP004. A week is defined as Sunday through Saturday.

**Weekly sampling unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. Reduced monitoring is contingent on a public water system continuing to experience NO raw or finished water total microcystins detections. Any total microcystins detections during routine (weekly) or reduced sampling will trigger additional sampling. Please refer to the website above for specifics on follow-up sampling requirements.*



OH2101412 DEL-CO WATER COMPANY, INC.

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

| | | |
|-----------------|-----------------------------|---|
| Sampling | Facility ID: 2160741 | Facility Name: TF MCNAMARA WTF (OLD STATE) |
| Location | SMP ID: LT2004 | Facility Source: Surface Water |
| | | Facility Class: CLASS 3 |

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

| Chemicals | Monitoring Requirements |
|-------------------------|--|
| CYANOBACTERIA SCREENING | 1 Sample(s) Required between 6/10/2018 and 6/16/2018 |
| | 1 Sample(s) Required between 6/24/2018 and 6/30/2018 |
| | 1 Sample(s) Required between 7/8/2018 and 7/14/2018 |
| | 1 Sample(s) Required between 7/22/2018 and 7/28/2018 |
| | 1 Sample(s) Required between 8/5/2018 and 8/11/2018 |
| | 1 Sample(s) Required between 8/19/2018 and 8/25/2018 |
| | 1 Sample(s) Required between 9/2/2018 and 9/8/2018 |

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. As of 12/31/17, all public water systems are responsible for contracting with a lab certified to perform cyanobacteria screening (qPCR). Please review the website for further information pertaining to follow-up sampling requirements for cyanobacteria screening gene detections, and certified labs that can perform analysis.



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH2101412 DEL-CO WATER COMPANY, INC.

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

| | | | |
|--------------------------|-----------------------------|---|--------------------------------|
| Sampling Location | Facility ID: 4260740 | Facility Name: THOMAS E. STEWARD WTF | Facility Class: CLASS 3 |
| | SMP ID: EP003 | Facility Source: Ground Water | |

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

| Chemicals | Monitoring Requirements |
|--|---|
| INORGANICS | 1 Sample(s) Required between 1/1/2018 and 5/31/2018 |
| <i>Sample for all the analytes listed below:</i> | |
| ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 | |
| CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085 | |
| NITRITE - 1041 | Not Required |
| NITRATE - 1040 | 1 Sample(s) Required between 1/1/2018 and 5/31/2018 |
| RADIOLOGICALS | Not Required |
| SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 | Not Required |
| VOLATILE ORGANIC CHEMICALS (VOC) | Not Required |

OH2101412 DEL-CO WATER COMPANY, INC.

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

| | | | |
|--------------------------|---|---|--------------------------------|
| Sampling Location | Facility ID: DS1 SMP ID: DS000 | Facility Name: DEL-CO DISTRIBUTION | Facility Class: CLASS 2 |
|--------------------------|---|---|--------------------------------|

| Chemicals | Monitoring Requirements |
|------------------|--------------------------------|
|------------------|--------------------------------|

| | |
|-----------------|--------------|
| ASBESTOS - 1094 | Not Required |
|-----------------|--------------|

| | | |
|-----------------------------|--------------------------------|--------------------------|
| TOTAL COLIFORM (TCR) - 3100 | 120 Sample(s) Required between | 1/1/2018 and 1/31/2018 |
| | 120 Sample(s) Required between | 2/1/2018 and 2/28/2018 |
| | 120 Sample(s) Required between | 3/1/2018 and 3/31/2018 |
| | 120 Sample(s) Required between | 4/1/2018 and 4/30/2018 |
| | 120 Sample(s) Required between | 5/1/2018 and 5/31/2018 |
| | 120 Sample(s) Required between | 6/1/2018 and 6/30/2018 |
| | 120 Sample(s) Required between | 7/1/2018 and 7/31/2018 |
| | 120 Sample(s) Required between | 8/1/2018 and 8/31/2018 |
| | 120 Sample(s) Required between | 9/1/2018 and 9/30/2018 |
| | 120 Sample(s) Required between | 10/1/2018 and 10/31/2018 |
| | 120 Sample(s) Required between | 11/1/2018 and 11/30/2018 |
| | 120 Sample(s) Required between | 12/1/2018 and 12/31/2018 |

| | | |
|-----------------------|--------------------------------|--------------------------|
| TOTAL CHLORINE - 1000 | 120 Sample(s) Required between | 1/1/2018 and 1/31/2018 |
| | 120 Sample(s) Required between | 2/1/2018 and 2/28/2018 |
| | 120 Sample(s) Required between | 3/1/2018 and 3/31/2018 |
| | 120 Sample(s) Required between | 4/1/2018 and 4/30/2018 |
| | 120 Sample(s) Required between | 5/1/2018 and 5/31/2018 |
| | 120 Sample(s) Required between | 6/1/2018 and 6/30/2018 |
| | 120 Sample(s) Required between | 7/1/2018 and 7/31/2018 |
| | 120 Sample(s) Required between | 8/1/2018 and 8/31/2018 |
| | 120 Sample(s) Required between | 9/1/2018 and 9/30/2018 |
| | 120 Sample(s) Required between | 10/1/2018 and 10/31/2018 |
| | 120 Sample(s) Required between | 11/1/2018 and 11/30/2018 |
| | 120 Sample(s) Required between | 12/1/2018 and 12/31/2018 |

Samples should be collected at the same time and place as the Total Coliform samples.

| | | | |
|--------------------------|---|--|--------------------------------|
| Sampling Location | Facility ID: DS1 SMP ID: DS201 | Facility Name: DEL-CO DISTRIBUTION 55 LAZELLE RD. | Facility Class: CLASS 2 |
|--------------------------|---|--|--------------------------------|

| Chemicals | Monitoring Requirements |
|------------------|--------------------------------|
|------------------|--------------------------------|

| | | |
|-------------------------|------------------------------|------------------------------------|
| DISINFECTION BYPRODUCTS | Dual Sample Required between | 2/8/2018 and 2/14/2018 at: DS201 |
| | Dual Sample Required between | 5/8/2018 and 5/14/2018 at: DS201 |
| | Dual Sample Required between | 8/8/2018 and 8/14/2018 at: DS201 |
| | Dual Sample Required between | 11/8/2018 and 11/14/2018 at: DS201 |

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH2101412 DEL-CO WATER COMPANY, INC.

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

| | | | |
|--------------------------|---|--|--------------------------------|
| Sampling Location | Facility ID: DS1 SMP ID: DS202 | Facility Name: DEL-CO DISTRIBUTION 61 NORTH THIRD ST. | Facility Class: CLASS 2 |
|--------------------------|---|--|--------------------------------|

| Chemicals | Monitoring Requirements |
|-------------------------|---|
| DISINFECTION BYPRODUCTS | Dual Sample Required between 2/8/2018 and 2/14/2018 at: DS202 |
| | Dual Sample Required between 5/8/2018 and 5/14/2018 at: DS202 |
| | Dual Sample Required between 8/8/2018 and 8/14/2018 at: DS202 |
| | Dual Sample Required between 11/8/2018 and 11/14/2018 at: DS202 |

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

| | | | |
|--------------------------|---|--|--------------------------------|
| Sampling Location | Facility ID: DS1 SMP ID: DS203 | Facility Name: DEL-CO DISTRIBUTION 8961 POLARIS PKWY. | Facility Class: CLASS 2 |
|--------------------------|---|--|--------------------------------|

| Chemicals | Monitoring Requirements |
|-------------------------|---|
| DISINFECTION BYPRODUCTS | Dual Sample Required between 2/8/2018 and 2/14/2018 at: DS203 |
| | Dual Sample Required between 5/8/2018 and 5/14/2018 at: DS203 |
| | Dual Sample Required between 8/8/2018 and 8/14/2018 at: DS203 |
| | Dual Sample Required between 11/8/2018 and 11/14/2018 at: DS203 |

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

| | | | |
|--------------------------|---|--|--------------------------------|
| Sampling Location | Facility ID: DS1 SMP ID: DS204 | Facility Name: DEL-CO DISTRIBUTION 1680 E. ORANGE RD. | Facility Class: CLASS 2 |
|--------------------------|---|--|--------------------------------|

| Chemicals | Monitoring Requirements |
|-------------------------|---|
| DISINFECTION BYPRODUCTS | Dual Sample Required between 2/8/2018 and 2/14/2018 at: DS204 |
| | Dual Sample Required between 5/8/2018 and 5/14/2018 at: DS204 |
| | Dual Sample Required between 8/8/2018 and 8/14/2018 at: DS204 |
| | Dual Sample Required between 11/8/2018 and 11/14/2018 at: DS204 |

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

| | | | |
|--------------------------|---|--|--------------------------------|
| Sampling Location | Facility ID: DS1 SMP ID: DS205 | Facility Name: DEL-CO DISTRIBUTION 6658 OLENTANGY RIVER RD. | Facility Class: CLASS 2 |
|--------------------------|---|--|--------------------------------|

| Chemicals | Monitoring Requirements |
|-------------------------|---|
| DISINFECTION BYPRODUCTS | Dual Sample Required between 2/8/2018 and 2/14/2018 at: DS205 |
| | Dual Sample Required between 5/8/2018 and 5/14/2018 at: DS205 |
| | Dual Sample Required between 8/8/2018 and 8/14/2018 at: DS205 |

OH2101412 DEL-CO WATER COMPANY, INC.

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

| | | | |
|--------------------------|---|--|--------------------------------|
| Sampling Location | Facility ID: DS1 SMP ID: DS205 | Facility Name: DEL-CO DISTRIBUTION 6658 OLENTANGY RIVER RD. | Facility Class: CLASS 2 |
|--------------------------|---|--|--------------------------------|

| Chemicals | Monitoring Requirements |
|-----------|-------------------------|
|-----------|-------------------------|

| | |
|-------------------------|---|
| DISINFECTION BYPRODUCTS | Dual Sample Required between 11/8/2018 and 11/14/2018 at: DS205 |
|-------------------------|---|

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

| | | | |
|--------------------------|---|---|--------------------------------|
| Sampling Location | Facility ID: DS1 SMP ID: DS206 | Facility Name: DEL-CO DISTRIBUTION 7259 PENN RD. | Facility Class: CLASS 2 |
|--------------------------|---|---|--------------------------------|

| Chemicals | Monitoring Requirements |
|-----------|-------------------------|
|-----------|-------------------------|

| | |
|-------------------------|---|
| DISINFECTION BYPRODUCTS | Dual Sample Required between 2/8/2018 and 2/14/2018 at: DS206 |
| | Dual Sample Required between 5/8/2018 and 5/14/2018 at: DS206 |
| | Dual Sample Required between 8/8/2018 and 8/14/2018 at: DS206 |
| | Dual Sample Required between 11/8/2018 and 11/14/2018 at: DS206 |

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

| | | | |
|--------------------------|---|--|--------------------------------|
| Sampling Location | Facility ID: DS1 SMP ID: DS207 | Facility Name: DEL-CO DISTRIBUTION 7080 OLENTANGY RIVER RD. | Facility Class: CLASS 2 |
|--------------------------|---|--|--------------------------------|

| Chemicals | Monitoring Requirements |
|-----------|-------------------------|
|-----------|-------------------------|

| | |
|-------------------------|---|
| DISINFECTION BYPRODUCTS | Dual Sample Required between 2/8/2018 and 2/14/2018 at: DS207 |
| | Dual Sample Required between 5/8/2018 and 5/14/2018 at: DS207 |
| | Dual Sample Required between 8/8/2018 and 8/14/2018 at: DS207 |
| | Dual Sample Required between 11/8/2018 and 11/14/2018 at: DS207 |

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

| | | | |
|--------------------------|---|--|--------------------------------|
| Sampling Location | Facility ID: DS1 SMP ID: DS208 | Facility Name: DEL-CO DISTRIBUTION 6195 GLICK RD. | Facility Class: CLASS 2 |
|--------------------------|---|--|--------------------------------|

| Chemicals | Monitoring Requirements |
|-----------|-------------------------|
|-----------|-------------------------|

| | |
|-------------------------|---|
| DISINFECTION BYPRODUCTS | Dual Sample Required between 2/8/2018 and 2/14/2018 at: DS208 |
| | Dual Sample Required between 5/8/2018 and 5/14/2018 at: DS208 |
| | Dual Sample Required between 8/8/2018 and 8/14/2018 at: DS208 |
| | Dual Sample Required between 11/8/2018 and 11/14/2018 at: DS208 |

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2018

2018 DISTRIBUTION SCHEDULE

OH2101412 DEL-CO WATER COMPANY, INC.

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

| | | | |
|--------------------------|-------------------------|---|--------------------------------|
| Sampling Location | Facility ID: DS1 | Facility Name: DEL-CO DISTRIBUTION | Facility Class: CLASS 2 |
| | SMP ID: LC### | Refer to your Lead and Copper plan for SMP IDs | |

| Chemicals | Monitoring Requirements |
|-------------------------------|--|
| LEAD - 1030 AND COPPER - 1022 | 50 Sample(s) Required between 6/1/2018 and 9/30/2018 |

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH2131612 HOLMES LUMBER OFFICE

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

| | | | |
|--------------------------|-----------------------------|---|--------------------------------|
| Sampling Location | Facility ID: 2153890 | Facility Name: HOLMES LUMBER BUILDING COMPONENTS | Facility Class: CLASS A |
| | SMP ID: EP001 | Facility Source: Ground Water | |

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

| Chemicals | Monitoring Requirements |
|---|---|
| INORGANICS | Not Required |
| NITRITE - 1041 | Not Required |
| NITRATE - 1040 | 1 Sample(s) Required between 1/1/2018 and 5/31/2018 |
| SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 | Not Required |
| VOLATILE ORGANIC CHEMICALS (VOC) | Not Required |



OH2131612 HOLMES LUMBER OFFICE

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

| | | |
|--------------------------|-------------------------|---|
| Sampling Location | Facility ID: DS1 | Facility Name: HOLMES LUMBER OFFICE DISTRIBUTION |
| | SMP ID: DS000 | |

| Chemicals | Monitoring Requirements |
|-----------------------------|---|
| TOTAL COLIFORM (TCR) - 3100 | 1 Sample(s) Required between 1/1/2018 and 3/31/2018 |
| | 1 Sample(s) Required between 4/1/2018 and 6/30/2018 |
| | 1 Sample(s) Required between 7/1/2018 and 9/30/2018 |
| | 1 Sample(s) Required between 10/1/2018 and 12/31/2018 |

| | | |
|--------------------------|-------------------------|---|
| Sampling Location | Facility ID: DS1 | Facility Name: HOLMES LUMBER OFFICE DISTRIBUTION |
| | SMP ID: LC### | Refer to your Lead and Copper plan for SMP IDs |

| Chemicals | Monitoring Requirements |
|-------------------------------|---|
| LEAD - 1030 AND COPPER - 1022 | 5 Sample(s) Required between 6/1/2018 and 9/30/2018 |

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

OH2133712 WHITE SANDS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: WHITE SANDS DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

| Chemicals | Monitoring Requirements |
|-----------------------------|---|
| TOTAL COLIFORM (TCR) - 3100 | 1 Sample(s) Required between 1/1/2018 and 3/31/2018 |
| | 1 Sample(s) Required between 4/1/2018 and 6/30/2018 |
| | 1 Sample(s) Required between 7/1/2018 and 9/30/2018 |
| | 1 Sample(s) Required between 10/1/2018 and 12/31/2018 |

Where to Collect Samples For a Small Public Water System

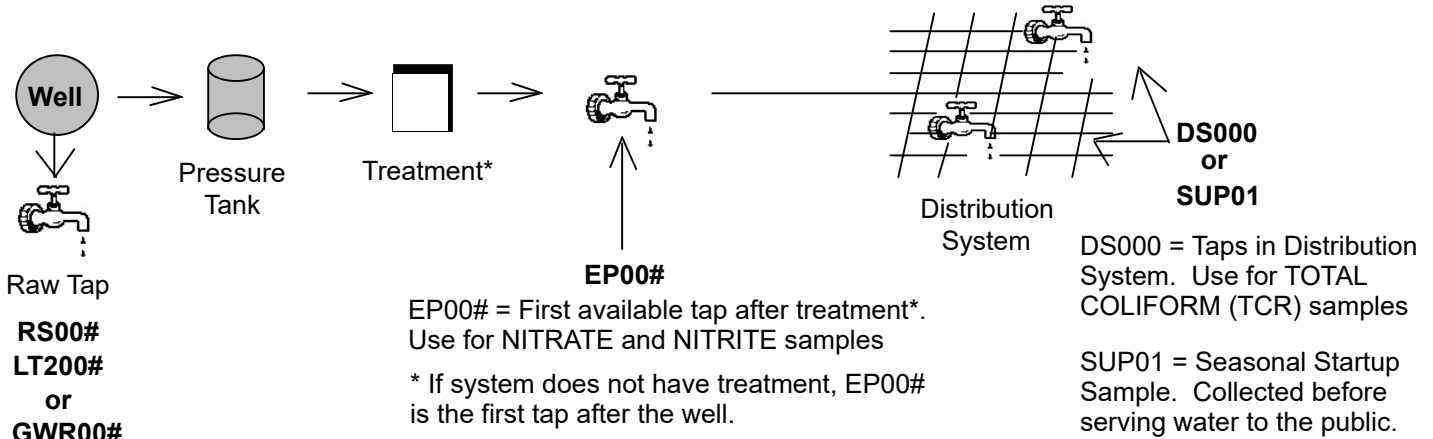

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH2133712 WHITE SANDS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 2153900 Facility Name: WHITE SANDS
Location SMP ID: EP001 Facility Source: Ground Water

| Chemicals | Monitoring Requirements |
|----------------|---|
| NITRITE - 1041 | Not Required |
| NITRATE - 1040 | 1 Sample(s) Required between 1/1/2018 and 5/31/2018 |

Where to Collect Samples For a Small Public Water System

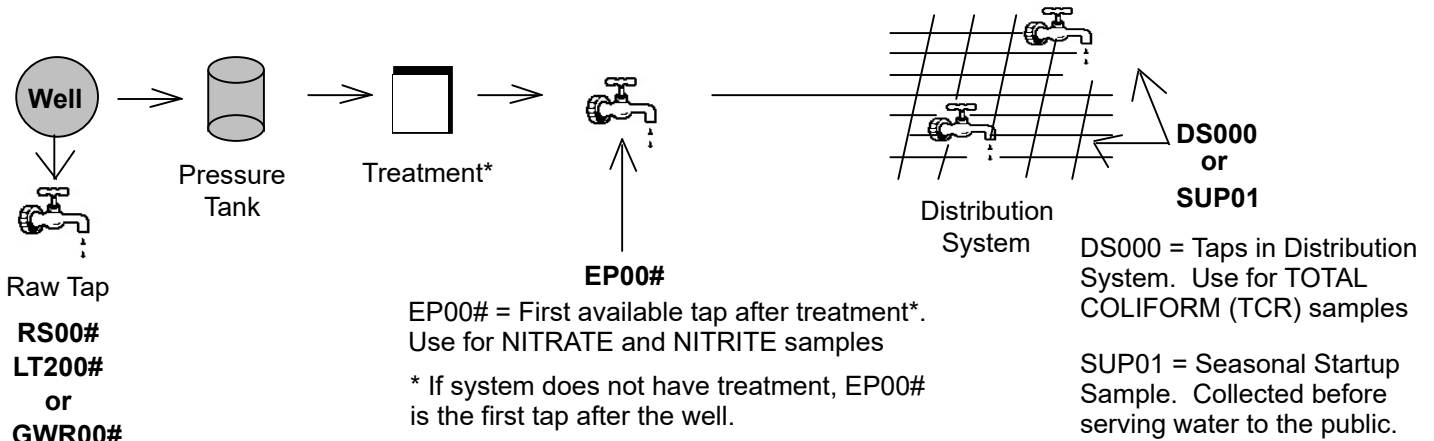

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH2134512 RIVER COMMUNITY CHURCH PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

| | |
|----------------------------------|---|
| Sampling Facility ID: DS1 | Facility Name: RIVER COMMUNITY CHURCH DISTRIBUTION |
| Location SMP ID: DS000 | Facility Source: Ground Water |

| Chemicals | Monitoring Requirements |
|-----------------------------|---|
| TOTAL COLIFORM (TCR) - 3100 | 1 Sample(s) Required between 1/1/2018 and 3/31/2018 |
| | 1 Sample(s) Required between 4/1/2018 and 6/30/2018 |
| | 1 Sample(s) Required between 7/1/2018 and 9/30/2018 |
| | 1 Sample(s) Required between 10/1/2018 and 12/31/2018 |

Where to Collect Samples For a Small Public Water System

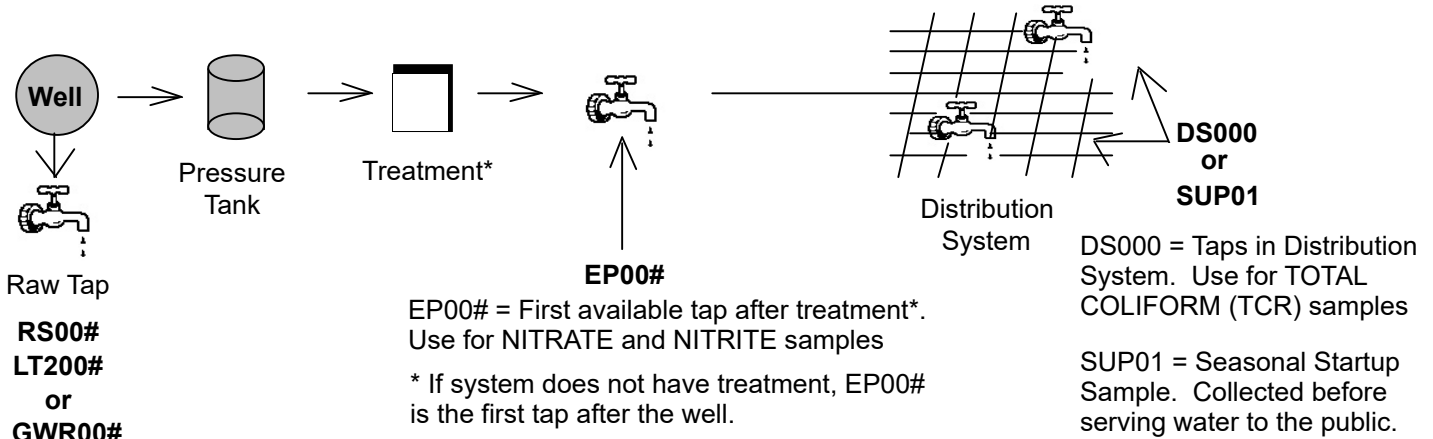

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH2134512 RIVER COMMUNITY CHURCH PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 2160823 Facility Name: RIVER COMMUNITY CHURCH
Location SMP ID: EP001 Facility Source: Ground Water

| Chemicals | Monitoring Requirements |
|----------------|---|
| NITRITE - 1041 | Not Required |
| NITRATE - 1040 | 1 Sample(s) Required between 1/1/2018 and 5/31/2018 |

Where to Collect Samples For a Small Public Water System

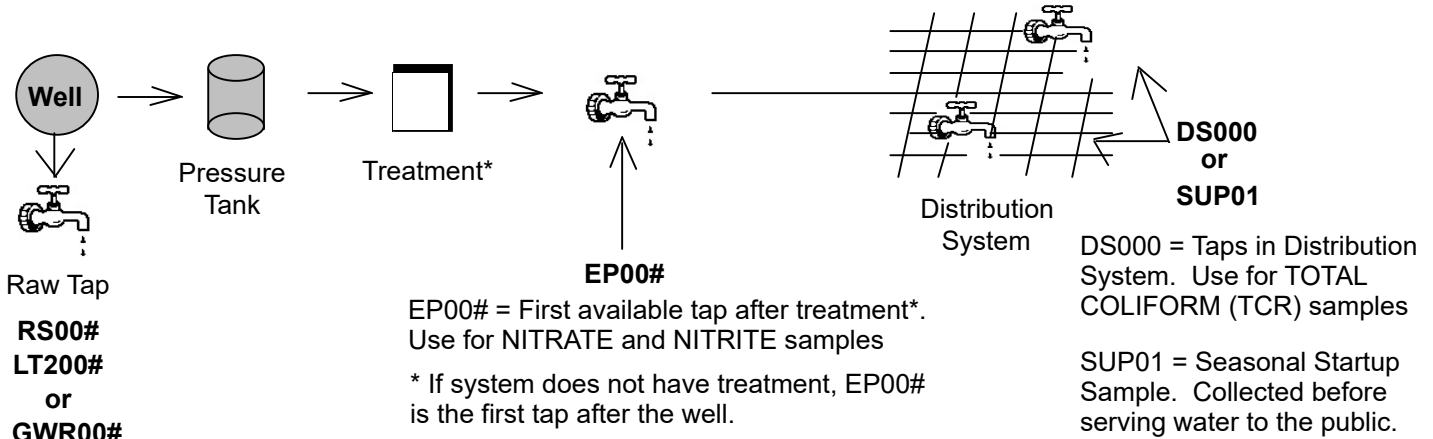

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!