



OH3500112 DESHLER VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 3562299 SMP ID: EP002	Facility Name: DESHLER VILLAGE RO MEMBRANE PLANT Facility Source: Ground Water	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

Chemicals	Monitoring Requirements
INORGANICS <i>Sample for all the analytes listed below:</i> ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	1 Sample(s) Required between 1/1/2018 and 5/31/2018
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
RADIOLOGICALS <i>Sample for all the analytes listed below:</i> GROSS ALPHA - 4002 RADIUM-228 - 4030	1 Sample(s) Required between 1/1/2018 and 5/31/2018
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 <i>Sample for all the analytes listed below:</i> ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	1 Sample(s) Required between 1/1/2018 and 5/31/2018
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2018 and 5/31/2018



OH3500112 DESHLER VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: DESHLER VILLAGE DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

ASBESTOS - 1094	Not Required
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2018 and 1/31/2018 2 Sample(s) Required between 2/1/2018 and 2/28/2018 2 Sample(s) Required between 3/1/2018 and 3/31/2018 2 Sample(s) Required between 4/1/2018 and 4/30/2018 2 Sample(s) Required between 5/1/2018 and 5/31/2018 2 Sample(s) Required between 6/1/2018 and 6/30/2018 2 Sample(s) Required between 7/1/2018 and 7/31/2018 2 Sample(s) Required between 8/1/2018 and 8/31/2018 2 Sample(s) Required between 9/1/2018 and 9/30/2018 2 Sample(s) Required between 10/1/2018 and 10/31/2018 2 Sample(s) Required between 11/1/2018 and 11/30/2018 2 Sample(s) Required between 12/1/2018 and 12/31/2018
TOTAL CHLORINE - 1000	2 Sample(s) Required between 1/1/2018 and 1/31/2018 2 Sample(s) Required between 2/1/2018 and 2/28/2018 2 Sample(s) Required between 3/1/2018 and 3/31/2018 2 Sample(s) Required between 4/1/2018 and 4/30/2018 2 Sample(s) Required between 5/1/2018 and 5/31/2018 2 Sample(s) Required between 6/1/2018 and 6/30/2018 2 Sample(s) Required between 7/1/2018 and 7/31/2018 2 Sample(s) Required between 8/1/2018 and 8/31/2018 2 Sample(s) Required between 9/1/2018 and 9/30/2018 2 Sample(s) Required between 10/1/2018 and 10/31/2018 2 Sample(s) Required between 11/1/2018 and 11/30/2018 2 Sample(s) Required between 12/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: DESHLER VILLAGE DISTRIBUTION 140 S WOOD ST	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2018 and 9/30/2018at: DS201
-------------------------	--

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH3500112 DESHLER VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: DESHLER VILLAGE DISTRIBUTION 2-301 RD C	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2018 and 9/30/2018at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: DESHLER VILLAGE DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 10 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH3500312 HAMLER VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 3554985	Facility Name: HAMLER VILLAGE	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

Chemicals	Monitoring Requirements	
INORGANICS	1 Sample(s) Required between	1/1/2018 and 5/31/2018
<i>Sample for all the analytes listed below:</i>		
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085		
NITRITE - 1041	Not Required	
NITRATE - 1040	1 Sample(s) Required between	1/1/2018 and 5/31/2018
RADIOLOGICALS	1 Sample(s) Required between	1/1/2018 and 5/31/2018
<i>Sample for all the analytes listed below:</i>		
GROSS ALPHA - 4002 RADIUM-228 - 4030		
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	1/1/2018 and 5/31/2018
<i>Sample for all the analytes listed below:</i>		
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037		
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	1/1/2018 and 5/31/2018

OH3500312 HAMLER VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: HAMLER, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

ASBESTOS - 1094	Not Required
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 1/31/2018 1 Sample(s) Required between 2/1/2018 and 2/28/2018 1 Sample(s) Required between 3/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 4/30/2018 1 Sample(s) Required between 5/1/2018 and 5/31/2018 1 Sample(s) Required between 6/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 7/31/2018 1 Sample(s) Required between 8/1/2018 and 8/31/2018 1 Sample(s) Required between 9/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 10/31/2018 1 Sample(s) Required between 11/1/2018 and 11/30/2018 1 Sample(s) Required between 12/1/2018 and 12/31/2018
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2018 and 1/31/2018 1 Sample(s) Required between 2/1/2018 and 2/28/2018 1 Sample(s) Required between 3/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 4/30/2018 1 Sample(s) Required between 5/1/2018 and 5/31/2018 1 Sample(s) Required between 6/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 7/31/2018 1 Sample(s) Required between 8/1/2018 and 8/31/2018 1 Sample(s) Required between 9/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 10/31/2018 1 Sample(s) Required between 11/1/2018 and 11/30/2018 1 Sample(s) Required between 12/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: HAMLER, VILLAGE OF DISTRIBUTION SR 18 AND CO RD 7	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 3/8/2018 and 3/14/2018at: DS201 Dual Sample Required between 6/8/2018 and 6/14/2018at: DS201 Dual Sample Required between 9/8/2018 and 9/14/2018at: DS201 Dual Sample Required between 12/8/2018 and 12/14/2018at: DS201
-------------------------	--

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH3500312 HAMLER VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: HAMLER, VILLAGE OF DISTRIBUTION RANDOLPH ST AND MAIN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 3/8/2018 and 3/14/2018at: DS202
	Dual Sample Required between 6/8/2018 and 6/14/2018at: DS202
	Dual Sample Required between 9/8/2018 and 9/14/2018at: DS202
	Dual Sample Required between 12/8/2018 and 12/14/2018at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: HAMLER, VILLAGE OF DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	20 Sample(s) Required between 7/1/2018 and 12/31/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH3500512 HOLGATE VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 3554986 SMP ID: EP001	Facility Name: HOLGATE WTP Facility Source: Ground Water	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
INORGANICS <i>Sample for all the analytes listed below:</i> ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	1 Sample(s) Required between 1/1/2018 and 5/31/2018
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2018 and 5/31/2018
RADIOLOGICALS <i>Sample for all the analytes listed below:</i> GROSS ALPHA - 4002 RADIUM-228 - 4030	1 Sample(s) Required between 1/1/2018 and 5/31/2018
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 <i>Sample for all the analytes listed below:</i> ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	1 Sample(s) Required between 1/1/2018 and 5/31/2018
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2018 and 5/31/2018



OH3500512 HOLGATE VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: HOLGATE, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

ASBESTOS - 1094	Not Required		
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between	1/1/2018 and	1/31/2018
	2 Sample(s) Required between	2/1/2018 and	2/28/2018
	2 Sample(s) Required between	3/1/2018 and	3/31/2018
	2 Sample(s) Required between	4/1/2018 and	4/30/2018
	2 Sample(s) Required between	5/1/2018 and	5/31/2018
	2 Sample(s) Required between	6/1/2018 and	6/30/2018
	2 Sample(s) Required between	7/1/2018 and	7/31/2018
	2 Sample(s) Required between	8/1/2018 and	8/31/2018
	2 Sample(s) Required between	9/1/2018 and	9/30/2018
	2 Sample(s) Required between	10/1/2018 and	10/31/2018
	2 Sample(s) Required between	11/1/2018 and	11/30/2018
	2 Sample(s) Required between	12/1/2018 and	12/31/2018
TOTAL CHLORINE - 1000	2 Sample(s) Required between	1/1/2018 and	1/31/2018
	2 Sample(s) Required between	2/1/2018 and	2/28/2018
	2 Sample(s) Required between	3/1/2018 and	3/31/2018
	2 Sample(s) Required between	4/1/2018 and	4/30/2018
	2 Sample(s) Required between	5/1/2018 and	5/31/2018
	2 Sample(s) Required between	6/1/2018 and	6/30/2018
	2 Sample(s) Required between	7/1/2018 and	7/31/2018
	2 Sample(s) Required between	8/1/2018 and	8/31/2018
	2 Sample(s) Required between	9/1/2018 and	9/30/2018
	2 Sample(s) Required between	10/1/2018 and	10/31/2018
	2 Sample(s) Required between	11/1/2018 and	11/30/2018
	2 Sample(s) Required between	12/1/2018 and	12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: HOLGATE, VILLAGE OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS	Dual Sample Required between	2/1/2018 and	2/7/2018	at: DS201
	Dual Sample Required between	5/1/2018 and	5/7/2018	at: DS201
	Dual Sample Required between	8/1/2018 and	8/7/2018	at: DS201
	Dual Sample Required between	11/1/2018 and	11/7/2018	at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH3500512 HOLGATE VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: HOLGATE, VILLAGE OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/1/2018 and 2/7/2018at: DS202 Dual Sample Required between 5/1/2018 and 5/7/2018at: DS202 Dual Sample Required between 8/1/2018 and 8/7/2018at: DS202 Dual Sample Required between 11/1/2018 and 11/7/2018at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: HOLGATE, VILLAGE OF DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



OH3500603 LIBERTY CENTER VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: LIBERTY CENTER, VLG. OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between	1/1/2018	and	1/31/2018
	2 Sample(s) Required between	2/1/2018	and	2/28/2018
	2 Sample(s) Required between	3/1/2018	and	3/31/2018
	2 Sample(s) Required between	4/1/2018	and	4/30/2018
	2 Sample(s) Required between	5/1/2018	and	5/31/2018
	2 Sample(s) Required between	6/1/2018	and	6/30/2018
	2 Sample(s) Required between	7/1/2018	and	7/31/2018
	2 Sample(s) Required between	8/1/2018	and	8/31/2018
	2 Sample(s) Required between	9/1/2018	and	9/30/2018
	2 Sample(s) Required between	10/1/2018	and	10/31/2018
	2 Sample(s) Required between	11/1/2018	and	11/30/2018
	2 Sample(s) Required between	12/1/2018	and	12/31/2018

TOTAL CHLORINE - 1000	2 Sample(s) Required between	1/1/2018	and	1/31/2018
	2 Sample(s) Required between	2/1/2018	and	2/28/2018
	2 Sample(s) Required between	3/1/2018	and	3/31/2018
	2 Sample(s) Required between	4/1/2018	and	4/30/2018
	2 Sample(s) Required between	5/1/2018	and	5/31/2018
	2 Sample(s) Required between	6/1/2018	and	6/30/2018
	2 Sample(s) Required between	7/1/2018	and	7/31/2018
	2 Sample(s) Required between	8/1/2018	and	8/31/2018
	2 Sample(s) Required between	9/1/2018	and	9/30/2018
	2 Sample(s) Required between	10/1/2018	and	10/31/2018
	2 Sample(s) Required between	11/1/2018	and	11/30/2018
	2 Sample(s) Required between	12/1/2018	and	12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: LIBERTY CENTER, VLG. OF DISTRIBUTION US 24 BETWEEN 4-352 AND 4-380	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS	Dual Sample Required between	2/8/2018	and	2/14/2018	at: DS201
	Dual Sample Required between	5/8/2018	and	5/14/2018	at: DS201
	Dual Sample Required between	8/8/2018	and	8/14/2018	at: DS201
	Dual Sample Required between	11/8/2018	and	11/14/2018	at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH3500603 LIBERTY CENTER VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: LIBERTY CENTER, VLG. OF DISTRIBUTION HYDRANT RD T BETWEEN 5804 & 5954 CO RD T	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/8/2018 and 2/14/2018at: DS202 Dual Sample Required between 5/8/2018 and 5/14/2018at: DS202 Dual Sample Required between 8/8/2018 and 8/14/2018at: DS202 Dual Sample Required between 11/8/2018 and 11/14/2018at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: LIBERTY CENTER, VLG. OF DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	20 Sample(s) Required between 7/1/2018 and 12/31/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



OH3500711 HENRY COUNTY REGIONAL WSD - MCCLURE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: MCCLURE DISTRIBUTION SYSTEM	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2018	and	1/31/2018
	1 Sample(s) Required between	2/1/2018	and	2/28/2018
	1 Sample(s) Required between	3/1/2018	and	3/31/2018
	1 Sample(s) Required between	4/1/2018	and	4/30/2018
	1 Sample(s) Required between	5/1/2018	and	5/31/2018
	1 Sample(s) Required between	6/1/2018	and	6/30/2018
	1 Sample(s) Required between	7/1/2018	and	7/31/2018
	1 Sample(s) Required between	8/1/2018	and	8/31/2018
	1 Sample(s) Required between	9/1/2018	and	9/30/2018
	1 Sample(s) Required between	10/1/2018	and	10/31/2018
	1 Sample(s) Required between	11/1/2018	and	11/30/2018
	1 Sample(s) Required between	12/1/2018	and	12/31/2018

TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2018	and	1/31/2018
	1 Sample(s) Required between	2/1/2018	and	2/28/2018
	1 Sample(s) Required between	3/1/2018	and	3/31/2018
	1 Sample(s) Required between	4/1/2018	and	4/30/2018
	1 Sample(s) Required between	5/1/2018	and	5/31/2018
	1 Sample(s) Required between	6/1/2018	and	6/30/2018
	1 Sample(s) Required between	7/1/2018	and	7/31/2018
	1 Sample(s) Required between	8/1/2018	and	8/31/2018
	1 Sample(s) Required between	9/1/2018	and	9/30/2018
	1 Sample(s) Required between	10/1/2018	and	10/31/2018
	1 Sample(s) Required between	11/1/2018	and	11/30/2018
	1 Sample(s) Required between	12/1/2018	and	12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: MCCLURE DISTRIBUTION SYSTEM 575 W CROSS	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS	Dual Sample Required between	3/1/2018	and	3/7/2018	at: DS201
	Dual Sample Required between	6/1/2018	and	6/7/2018	at: DS201
	Dual Sample Required between	9/1/2018	and	9/7/2018	at: DS201
	Dual Sample Required between	12/1/2018	and	12/7/2018	at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH3500711 HENRY COUNTY REGIONAL WSD - MCCLURE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: MCCLURE DISTRIBUTION SYSTEM 745 S HANLEY ST	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 3/1/2018 and 3/7/2018at: DS202
	Dual Sample Required between 6/1/2018 and 6/7/2018at: DS202
	Dual Sample Required between 9/1/2018 and 9/7/2018at: DS202
	Dual Sample Required between 12/1/2018 and 12/7/2018at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: MCCLURE DISTRIBUTION SYSTEM Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	20 Sample(s) Required between 7/1/2018 and 12/31/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



OH3500811 NAPOLEON CITY

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 3554989	Facility Name: NAPOLEON CITY	Facility Class: CLASS 3
	SMP ID: EP001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

Chemicals	Monitoring Requirements	
INORGANICS	1 Sample(s) Required between	1/1/2018 and 5/31/2018
<i>Sample for all the analytes listed below:</i>		
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020		
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085		
NITRITE - 1041	Not Required	
NITRATE - 1040	1 Sample(s) Required between	1/1/2018 and 1/31/2018
	1 Sample(s) Required between	2/1/2018 and 2/28/2018
	1 Sample(s) Required between	3/1/2018 and 3/31/2018
	1 Sample(s) Required between	4/1/2018 and 4/30/2018
	1 Sample(s) Required between	5/1/2018 and 5/31/2018
	1 Sample(s) Required between	6/1/2018 and 6/30/2018
	1 Sample(s) Required between	7/1/2018 and 7/31/2018
	1 Sample(s) Required between	8/1/2018 and 8/31/2018
	1 Sample(s) Required between	9/1/2018 and 9/30/2018
	1 Sample(s) Required between	10/1/2018 and 10/31/2018
	1 Sample(s) Required between	11/1/2018 and 11/30/2018
	1 Sample(s) Required between	12/1/2018 and 12/31/2018
RADIOLOGICALS	Not Required	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	4/1/2018 and 4/30/2018
	1 Sample(s) Required between	5/1/2018 and 5/31/2018
	1 Sample(s) Required between	6/1/2018 and 6/30/2018
	1 Sample(s) Required between	7/1/2018 and 7/31/2018
	1 Sample(s) Required between	8/1/2018 and 8/31/2018
	1 Sample(s) Required between	9/1/2018 and 9/30/2018
	1 Sample(s) Required between	10/1/2018 and 10/31/2018
	1 Sample(s) Required between	11/1/2018 and 11/30/2018
<i>Sample for all the analytes listed below:</i>		
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037		
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 2	Not Required	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 3	1 Sample(s) Required between	4/1/2018 and 6/30/2018
<i>Sample for all the analytes listed below:</i>		
BHC-GAMMA (LINDANE) - 2010 DIQUAT - 2032 GLYPHOSATE - 2034		
METHOXYCHLOR - 2015 POLYCHLORINATED BIPHENYLS (PCB) - 2383		
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 4	Not Required	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	1/1/2018 and 3/31/2018
	1 Sample(s) Required between	4/1/2018 and 6/30/2018
	1 Sample(s) Required between	7/1/2018 and 9/30/2018
	1 Sample(s) Required between	10/1/2018 and 12/31/2018
TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between	1/1/2018 and 1/31/2018
	1 Paired Sample Set Required between	2/1/2018 and 2/28/2018



OH3500811 NAPOLEON CITY

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 3554989	Facility Name: NAPOLEON CITY	
Location	SMP ID: EP001	Facility Source: Surface Water	Facility Class: CLASS 3

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

Chemicals	Monitoring Requirements		
TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between	3/1/2018 and	3/31/2018
	1 Paired Sample Set Required between	4/1/2018 and	4/30/2018
	1 Paired Sample Set Required between	5/1/2018 and	5/31/2018
	1 Paired Sample Set Required between	6/1/2018 and	6/30/2018
	1 Paired Sample Set Required between	7/1/2018 and	7/31/2018
	1 Paired Sample Set Required between	8/1/2018 and	8/31/2018
	1 Paired Sample Set Required between	9/1/2018 and	9/30/2018
	1 Paired Sample Set Required between	10/1/2018 and	10/31/2018
	1 Paired Sample Set Required between	11/1/2018 and	11/30/2018
	1 Paired Sample Set Required between	12/1/2018 and	12/31/2018

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



OH3500811 NAPOLEON CITY

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 3554989	Facility Name: NAPOLEON CITY	
Location	SMP ID: EP001/LT2001	Facility Source: Surface Water	Facility Class: CLASS 3

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

Chemicals	Monitoring Requirements
------------------	--------------------------------

TOTAL MICROCYSTINS	1 Sample Set Required WEEKLY*
--------------------	-------------------------------

Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. A week is defined as Sunday through Saturday.

**Weekly sampling unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. Reduced monitoring is contingent on a public water system continuing to experience NO raw or finished water total microcystins detections. Any total microcystins detections during routine (weekly) or reduced sampling will trigger additional sampling. Please refer to the website above for specifics on follow-up sampling requirements.*



OH3500811 NAPOLEON CITY

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 3554989	Facility Name: NAPOLEON CITY	
Location	SMP ID: LT2001	Facility Source: Surface Water	Facility Class: CLASS 3

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

Chemicals	Monitoring Requirements
CYANOBACTERIA SCREENING	1 Sample(s) Required between 12/31/2017 and 1/6/2018
	1 Sample(s) Required between 1/14/2018 and 1/20/2018
	1 Sample(s) Required between 1/28/2018 and 2/3/2018
	1 Sample(s) Required between 2/11/2018 and 2/17/2018
	1 Sample(s) Required between 2/25/2018 and 3/3/2018
	1 Sample(s) Required between 3/11/2018 and 3/17/2018
	1 Sample(s) Required between 3/25/2018 and 3/31/2018
	1 Sample(s) Required between 4/8/2018 and 4/14/2018
	1 Sample(s) Required between 4/22/2018 and 4/28/2018
	1 Sample(s) Required between 5/6/2018 and 5/12/2018
	1 Sample(s) Required between 5/20/2018 and 5/26/2018
	1 Sample(s) Required between 6/3/2018 and 6/9/2018
	1 Sample(s) Required between 6/17/2018 and 6/23/2018
	1 Sample(s) Required between 7/1/2018 and 7/7/2018
	1 Sample(s) Required between 7/15/2018 and 7/21/2018
	1 Sample(s) Required between 7/29/2018 and 8/4/2018
	1 Sample(s) Required between 8/12/2018 and 8/18/2018
	1 Sample(s) Required between 8/26/2018 and 9/1/2018
	1 Sample(s) Required between 9/9/2018 and 9/15/2018
	1 Sample(s) Required between 9/23/2018 and 9/29/2018
1 Sample(s) Required between 10/7/2018 and 10/13/2018	
1 Sample(s) Required between 10/21/2018 and 10/27/2018	
1 Sample(s) Required between 11/4/2018 and 11/10/2018	
1 Sample(s) Required between 11/18/2018 and 11/24/2018	
1 Sample(s) Required between 12/2/2018 and 12/8/2018	
1 Sample(s) Required between 12/16/2018 and 12/22/2018	

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. As of 12/31/17, all public water systems are responsible for contracting with a lab certified to perform cyanobacteria screening (qPCR). Please review the website for further information pertaining to follow-up sampling requirements for cyanobacteria screening gene detections, and certified labs that can perform analysis.

OH3500811 NAPOLEON CITY

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: NAPOLEON CITY DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

ASBESTOS - 1094	Not Required
TOTAL COLIFORM (TCR) - 3100	10 Sample(s) Required between 1/1/2018 and 1/31/2018 10 Sample(s) Required between 2/1/2018 and 2/28/2018 10 Sample(s) Required between 3/1/2018 and 3/31/2018 10 Sample(s) Required between 4/1/2018 and 4/30/2018 10 Sample(s) Required between 5/1/2018 and 5/31/2018 10 Sample(s) Required between 6/1/2018 and 6/30/2018 10 Sample(s) Required between 7/1/2018 and 7/31/2018 10 Sample(s) Required between 8/1/2018 and 8/31/2018 10 Sample(s) Required between 9/1/2018 and 9/30/2018 10 Sample(s) Required between 10/1/2018 and 10/31/2018 10 Sample(s) Required between 11/1/2018 and 11/30/2018 10 Sample(s) Required between 12/1/2018 and 12/31/2018
TOTAL CHLORINE - 1000	10 Sample(s) Required between 1/1/2018 and 1/31/2018 10 Sample(s) Required between 2/1/2018 and 2/28/2018 10 Sample(s) Required between 3/1/2018 and 3/31/2018 10 Sample(s) Required between 4/1/2018 and 4/30/2018 10 Sample(s) Required between 5/1/2018 and 5/31/2018 10 Sample(s) Required between 6/1/2018 and 6/30/2018 10 Sample(s) Required between 7/1/2018 and 7/31/2018 10 Sample(s) Required between 8/1/2018 and 8/31/2018 10 Sample(s) Required between 9/1/2018 and 9/30/2018 10 Sample(s) Required between 10/1/2018 and 10/31/2018 10 Sample(s) Required between 11/1/2018 and 11/30/2018 10 Sample(s) Required between 12/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: NAPOLEON CITY DISTRIBUTION 1600 E RIVERVIEW	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 2/8/2018 and 2/14/2018at: DS201 Dual Sample Required between 5/8/2018 and 5/14/2018at: DS201 Dual Sample Required between 8/8/2018 and 8/14/2018at: DS201 Dual Sample Required between 11/8/2018 and 11/14/2018at: DS201
-------------------------	--

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH3500811 NAPOLEON CITY

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: NAPOLEON CITY DISTRIBUTION 213 MEEKINSON ST	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/8/2018 and 2/14/2018at: DS202
	Dual Sample Required between 5/8/2018 and 5/14/2018at: DS202
	Dual Sample Required between 8/8/2018 and 8/14/2018at: DS202
	Dual Sample Required between 11/8/2018 and 11/14/2018at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: NAPOLEON CITY DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	40 Sample(s) Required between 7/1/2018 and 12/31/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



OH3500912 LHS MAUMEE YOUTH CENTER

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 3554990 SMP ID: EP001	Facility Name: LHS MAUMEE YOUTH CENTER Facility Source: Ground Water	Facility Class: CLASS A
--------------------------	---	---	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
FLUORIDE - 1025	1 Sample(s) Required between 1/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 12/31/2018
INORGANICS	1 Sample(s) Required between 1/1/2018 and 5/31/2018
<u>Sample for all the analytes listed below:</u>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2018 and 5/31/2018
RADIOLOGICALS	1 Sample(s) Required between 1/1/2018 and 5/31/2018
<u>Sample for all the analytes listed below:</u>	
GROSS ALPHA - 4002 RADIUM-228 - 4030	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2018 and 5/31/2018
<u>Sample for all the analytes listed below:</u>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2018 and 5/31/2018



OH3500912 LHS MAUMEE YOUTH CENTER

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: **DS1** Facility Name: **LHS MAUMEE YOUTH CENTER DISTRIBUTION**
SMP ID: **DS000**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location Facility ID: **DS1** Facility Name: **LHS MAUMEE YOUTH CENTER DISTRIBUTION**
SMP ID: **DS201** **MEN'S RESTROOM IN CHAPEL**

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2018 and 9/30/2018at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH3501203 FLORIDA VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: FLORIDA, VLG OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2018	and	1/31/2018
	1 Sample(s) Required between	2/1/2018	and	2/28/2018
	1 Sample(s) Required between	3/1/2018	and	3/31/2018
	1 Sample(s) Required between	4/1/2018	and	4/30/2018
	1 Sample(s) Required between	5/1/2018	and	5/31/2018
	1 Sample(s) Required between	6/1/2018	and	6/30/2018
	1 Sample(s) Required between	7/1/2018	and	7/31/2018
	1 Sample(s) Required between	8/1/2018	and	8/31/2018
	1 Sample(s) Required between	9/1/2018	and	9/30/2018
	1 Sample(s) Required between	10/1/2018	and	10/31/2018
	1 Sample(s) Required between	11/1/2018	and	11/30/2018
	1 Sample(s) Required between	12/1/2018	and	12/31/2018

TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2018	and	1/31/2018
	1 Sample(s) Required between	2/1/2018	and	2/28/2018
	1 Sample(s) Required between	3/1/2018	and	3/31/2018
	1 Sample(s) Required between	4/1/2018	and	4/30/2018
	1 Sample(s) Required between	5/1/2018	and	5/31/2018
	1 Sample(s) Required between	6/1/2018	and	6/30/2018
	1 Sample(s) Required between	7/1/2018	and	7/31/2018
	1 Sample(s) Required between	8/1/2018	and	8/31/2018
	1 Sample(s) Required between	9/1/2018	and	9/30/2018
	1 Sample(s) Required between	10/1/2018	and	10/31/2018
	1 Sample(s) Required between	11/1/2018	and	11/30/2018
	1 Sample(s) Required between	12/1/2018	and	12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: FLORIDA, VLG OF DISTRIBUTION FLORIDA WATER TOWER	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS	Dual Sample Required between	1/1/2018	and	1/7/2018	at: DS201
	Dual Sample Required between	4/1/2018	and	4/7/2018	at: DS201
	Dual Sample Required between	7/1/2018	and	7/7/2018	at: DS201
	Dual Sample Required between	10/1/2018	and	10/7/2018	at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 04/20/2018

2018 DISTRIBUTION SCHEDULE

OH3501203 FLORIDA VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: FLORIDA, VLG OF DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 7/1/2018 and 12/31/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



OH3501403 MALINTA VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: MALINTA, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2018	and	1/31/2018
	1 Sample(s) Required between	2/1/2018	and	2/28/2018
	1 Sample(s) Required between	3/1/2018	and	3/31/2018
	1 Sample(s) Required between	4/1/2018	and	4/30/2018
	1 Sample(s) Required between	5/1/2018	and	5/31/2018
	1 Sample(s) Required between	6/1/2018	and	6/30/2018
	1 Sample(s) Required between	7/1/2018	and	7/31/2018
	1 Sample(s) Required between	8/1/2018	and	8/31/2018
	1 Sample(s) Required between	9/1/2018	and	9/30/2018
	1 Sample(s) Required between	10/1/2018	and	10/31/2018
	1 Sample(s) Required between	11/1/2018	and	11/30/2018
	1 Sample(s) Required between	12/1/2018	and	12/31/2018

TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2018	and	1/31/2018
	1 Sample(s) Required between	2/1/2018	and	2/28/2018
	1 Sample(s) Required between	3/1/2018	and	3/31/2018
	1 Sample(s) Required between	4/1/2018	and	4/30/2018
	1 Sample(s) Required between	5/1/2018	and	5/31/2018
	1 Sample(s) Required between	6/1/2018	and	6/30/2018
	1 Sample(s) Required between	7/1/2018	and	7/31/2018
	1 Sample(s) Required between	8/1/2018	and	8/31/2018
	1 Sample(s) Required between	9/1/2018	and	9/30/2018
	1 Sample(s) Required between	10/1/2018	and	10/31/2018
	1 Sample(s) Required between	11/1/2018	and	11/30/2018
	1 Sample(s) Required between	12/1/2018	and	12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: MALINTA, VILLAGE OF DISTRIBUTION 201 FREASE	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS	Dual Sample Required between	3/1/2018	and	3/7/2018	at: DS201
	Dual Sample Required between	6/1/2018	and	6/7/2018	at: DS201
	Dual Sample Required between	9/1/2018	and	9/7/2018	at: DS201
	Dual Sample Required between	12/1/2018	and	12/7/2018	at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 04/20/2018

2018 DISTRIBUTION SCHEDULE

OH3501403 MALINTA VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: MALINTA, VILLAGE OF DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 7/1/2018 and 12/31/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

OH3530712 AMERICAN LEGION POST 454

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: AMERICAN LEGION POST 454 DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3530712 AMERICAN LEGION POST 454

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3554994 Facility Name: AMERICAN LEGION POST 454
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2018 and 5/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3531112 BAVARIAN CLUB INC

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **BAVARIAN CLUB INC DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3531112 BAVARIAN CLUB INC

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3554995 Facility Name: BAVARIAN CLUB INC

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2018 and 5/31/2018
NITRATE - 1040	1 Sample(s) Required between 1/1/2018 and 5/31/2018

Where to Collect Samples For a Small Public Water System

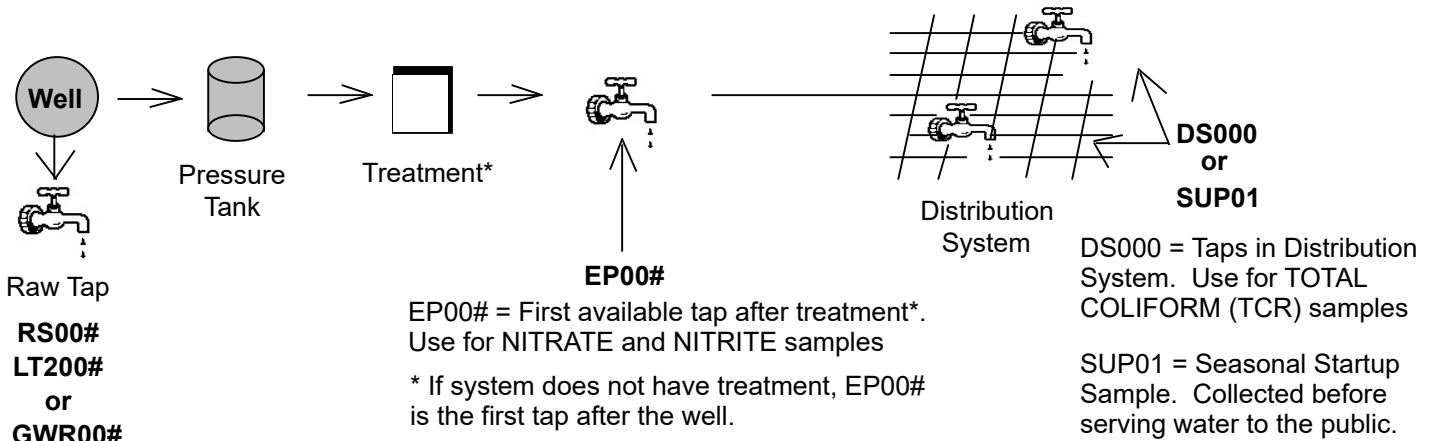

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



OH3531411 CAMPBELL SOUP SUPPLY CO

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 3554996	Facility Name: CAMPBELL SOUP SUPPLY CO	Facility Class: CLASS 4
	SMP ID: EP001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.
 Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
 Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
CHLORITE - 1009	1 Sample daily when Chlorine Dioxide is applied.
CHLORINE DIOXIDE - 1008	1 Sample daily when Chlorine Dioxide is applied.
INORGANICS	1 Sample(s) Required between 1/1/2018 and 5/31/2018
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2018 and 1/31/2018 1 Sample(s) Required between 2/1/2018 and 2/28/2018 1 Sample(s) Required between 3/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 4/30/2018 1 Sample(s) Required between 5/1/2018 and 5/31/2018 1 Sample(s) Required between 6/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 7/31/2018 1 Sample(s) Required between 8/1/2018 and 8/31/2018 1 Sample(s) Required between 9/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 10/31/2018 1 Sample(s) Required between 11/1/2018 and 11/30/2018 1 Sample(s) Required between 12/1/2018 and 12/31/2018
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 4/15/2018 1 Sample(s) Required between 4/16/2018 and 4/30/2018 1 Sample(s) Required between 5/1/2018 and 5/15/2018 1 Sample(s) Required between 5/16/2018 and 5/31/2018 1 Sample(s) Required between 6/1/2018 and 6/15/2018 1 Sample(s) Required between 6/16/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 12/31/2018
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 2	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 3	1 Sample(s) Required between 4/1/2018 and 6/30/2018
<i>Sample for all the analytes listed below:</i>	
BHC-GAMMA (LINDANE) - 2010 DIQUAT - 2032 GLYPHOSATE - 2034 METHOXYCHLOR - 2015 POLYCHLORINATED BIPHENYLS (PCB) - 2383	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 4	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2018 and 3/31/2018



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH3531411 CAMPBELL SOUP SUPPLY CO

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 3554996	Facility Name: CAMPBELL SOUP SUPPLY CO	
Location	SMP ID: EP001	Facility Source: Surface Water	Facility Class: CLASS 4

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

Chemicals	Monitoring Requirements
TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between 1/1/2018 and 1/31/2018
	1 Paired Sample Set Required between 2/1/2018 and 2/28/2018
	1 Paired Sample Set Required between 3/1/2018 and 3/31/2018
	1 Paired Sample Set Required between 4/1/2018 and 4/30/2018
	1 Paired Sample Set Required between 5/1/2018 and 5/31/2018
	1 Paired Sample Set Required between 6/1/2018 and 6/30/2018
	1 Paired Sample Set Required between 7/1/2018 and 7/31/2018
	1 Paired Sample Set Required between 8/1/2018 and 8/31/2018
	1 Paired Sample Set Required between 9/1/2018 and 9/30/2018
	1 Paired Sample Set Required between 10/1/2018 and 10/31/2018
	1 Paired Sample Set Required between 11/1/2018 and 11/30/2018
	1 Paired Sample Set Required between 12/1/2018 and 12/31/2018

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH3531411 CAMPBELL SOUP SUPPLY CO

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 3554996	Facility Name: CAMPBELL SOUP SUPPLY CO	
Location	SMP ID: EP001/LT2001	Facility Source: Surface Water	Facility Class: CLASS 4

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

TOTAL MICROCYSTINS

1 Sample Set Required WEEKLY*

Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. A week is defined as Sunday through Saturday.

**Weekly sampling unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. Reduced monitoring is contingent on a public water system continuing to experience NO raw or finished water total microcystins detections. Any total microcystins detections during routine (weekly) or reduced sampling will trigger additional sampling. Please refer to the website above for specifics on follow-up sampling requirements.*



OH3531411 CAMPBELL SOUP SUPPLY CO

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 3554996	Facility Name: CAMPBELL SOUP SUPPLY CO	
Location	SMP ID: LT2001	Facility Source: Surface Water	Facility Class: CLASS 4

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

Chemicals	Monitoring Requirements
CYANOBACTERIA SCREENING	1 Sample(s) Required between 12/31/2017 and 1/6/2018
	1 Sample(s) Required between 1/14/2018 and 1/20/2018
	1 Sample(s) Required between 1/28/2018 and 2/3/2018
	1 Sample(s) Required between 2/11/2018 and 2/17/2018
	1 Sample(s) Required between 2/25/2018 and 3/3/2018
	1 Sample(s) Required between 3/11/2018 and 3/17/2018
	1 Sample(s) Required between 3/25/2018 and 3/31/2018
	1 Sample(s) Required between 4/8/2018 and 4/14/2018
	1 Sample(s) Required between 4/22/2018 and 4/28/2018
	1 Sample(s) Required between 5/6/2018 and 5/12/2018
	1 Sample(s) Required between 5/20/2018 and 5/26/2018
	1 Sample(s) Required between 6/3/2018 and 6/9/2018
	1 Sample(s) Required between 6/17/2018 and 6/23/2018
	1 Sample(s) Required between 7/1/2018 and 7/7/2018
	1 Sample(s) Required between 7/15/2018 and 7/21/2018
	1 Sample(s) Required between 7/29/2018 and 8/4/2018
	1 Sample(s) Required between 8/12/2018 and 8/18/2018
	1 Sample(s) Required between 8/26/2018 and 9/1/2018
	1 Sample(s) Required between 9/9/2018 and 9/15/2018
	1 Sample(s) Required between 9/23/2018 and 9/29/2018
1 Sample(s) Required between 10/7/2018 and 10/13/2018	
1 Sample(s) Required between 10/21/2018 and 10/27/2018	
1 Sample(s) Required between 11/4/2018 and 11/10/2018	
1 Sample(s) Required between 11/18/2018 and 11/24/2018	
1 Sample(s) Required between 12/2/2018 and 12/8/2018	
1 Sample(s) Required between 12/16/2018 and 12/22/2018	

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. As of 12/31/17, all public water systems are responsible for contracting with a lab certified to perform cyanobacteria screening (qPCR). Please review the website for further information pertaining to follow-up sampling requirements for cyanobacteria screening gene detections, and certified labs that can perform analysis.



OH3531411 CAMPBELL SOUP SUPPLY CO

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: **DS1** Facility Name: **CAMPBELL SOUP SUPPLY CO DISTRIBUTION** Facility Class: **CLASS 1**
SMP ID: **DS000**

Chemicals Monitoring Requirements

CHLORITE - 1009	3 Sample(s) Required between	1/1/2018	and	1/31/2018
	3 Sample(s) Required between	2/1/2018	and	2/28/2018
	3 Sample(s) Required between	3/1/2018	and	3/31/2018
	3 Sample(s) Required between	4/1/2018	and	4/30/2018
	3 Sample(s) Required between	5/1/2018	and	5/31/2018
	3 Sample(s) Required between	6/1/2018	and	6/30/2018
	3 Sample(s) Required between	7/1/2018	and	7/31/2018
	3 Sample(s) Required between	8/1/2018	and	8/31/2018
	3 Sample(s) Required between	9/1/2018	and	9/30/2018
	3 Sample(s) Required between	10/1/2018	and	10/31/2018
	3 Sample(s) Required between	11/1/2018	and	11/30/2018
	3 Sample(s) Required between	12/1/2018	and	12/31/2018

One sample at each of the following locations: near the first customer, at a location representative of the average residence time, and at a location reflecting maximum residence time of the water in the distribution system. Consult Chlorine Dioxide plan approval for additional distribution requirements unique to your system.

TOTAL COLIFORM (TCR) - 3100	4 Sample(s) Required between	1/1/2018	and	1/31/2018
	4 Sample(s) Required between	2/1/2018	and	2/28/2018
	4 Sample(s) Required between	3/1/2018	and	3/31/2018
	4 Sample(s) Required between	4/1/2018	and	4/30/2018
	4 Sample(s) Required between	5/1/2018	and	5/31/2018
	4 Sample(s) Required between	6/1/2018	and	6/30/2018
	4 Sample(s) Required between	7/1/2018	and	7/31/2018
	4 Sample(s) Required between	8/1/2018	and	8/31/2018
	4 Sample(s) Required between	9/1/2018	and	9/30/2018
	4 Sample(s) Required between	10/1/2018	and	10/31/2018
	4 Sample(s) Required between	11/1/2018	and	11/30/2018
	4 Sample(s) Required between	12/1/2018	and	12/31/2018

TOTAL CHLORINE - 1000	4 Sample(s) Required between	1/1/2018	and	1/31/2018
	4 Sample(s) Required between	2/1/2018	and	2/28/2018
	4 Sample(s) Required between	3/1/2018	and	3/31/2018
	4 Sample(s) Required between	4/1/2018	and	4/30/2018
	4 Sample(s) Required between	5/1/2018	and	5/31/2018
	4 Sample(s) Required between	6/1/2018	and	6/30/2018
	4 Sample(s) Required between	7/1/2018	and	7/31/2018
	4 Sample(s) Required between	8/1/2018	and	8/31/2018
	4 Sample(s) Required between	9/1/2018	and	9/30/2018
	4 Sample(s) Required between	10/1/2018	and	10/31/2018
	4 Sample(s) Required between	11/1/2018	and	11/30/2018



OH3531411 CAMPBELL SOUP SUPPLY CO

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **CAMPBELL SOUP SUPPLY CO DISTRIBUTION** Facility Class: **CLASS 1**
Location SMP ID: **DS000**

Chemicals

Monitoring Requirements

TOTAL CHLORINE - 1000 4 Sample(s) Required between 12/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Facility ID: **DS1** Facility Name: **CAMPBELL SOUP SUPPLY CO DISTRIBUTION** Facility Class: **CLASS 1**
Location SMP ID: **DS201** **GATE 1 GUARDHOUSE**

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 2/1/2018 and 2/7/2018at: DS201
Dual Sample Required between 5/1/2018 and 5/7/2018at: DS201
Dual Sample Required between 8/1/2018 and 8/7/2018at: DS201
Dual Sample Required between 11/1/2018 and 11/7/2018at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Facility ID: **DS1** Facility Name: **CAMPBELL SOUP SUPPLY CO DISTRIBUTION** Facility Class: **CLASS 1**
Location SMP ID: **DS202** **WASTE TREATMENT PLANT TAP**

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 2/1/2018 and 2/7/2018at: DS202
Dual Sample Required between 5/1/2018 and 5/7/2018at: DS202
Dual Sample Required between 8/1/2018 and 8/7/2018at: DS202
Dual Sample Required between 11/1/2018 and 11/7/2018at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Facility ID: **DS1** Facility Name: **CAMPBELL SOUP SUPPLY CO DISTRIBUTION** Facility Class: **CLASS 1**
Location SMP ID: **LC###** **Refer to your Lead and Copper plan for SMP IDs**

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 10 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

OH3532012 EMANUEL'S CHRISTIAN CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **EMANUELS CHRISTIAN CHURCH DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3532012 EMANUEL'S CHRISTIAN CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3554997 Facility Name: EMANUELS UN CHURCH OF CHRIST
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2018 and 5/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3533412 LIBERTY CHAPEL U M CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: LIBERTY CHAPEL UM CHURCH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3533412 LIBERTY CHAPEL U M CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3555001 Facility Name: LIBERTY CHAPEL UM CHURCH
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2018 and 5/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3534712 PEACE EVANGELICAL LUTH - DESHLER

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: PEACE EVANGELICAL LUTHERAN DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

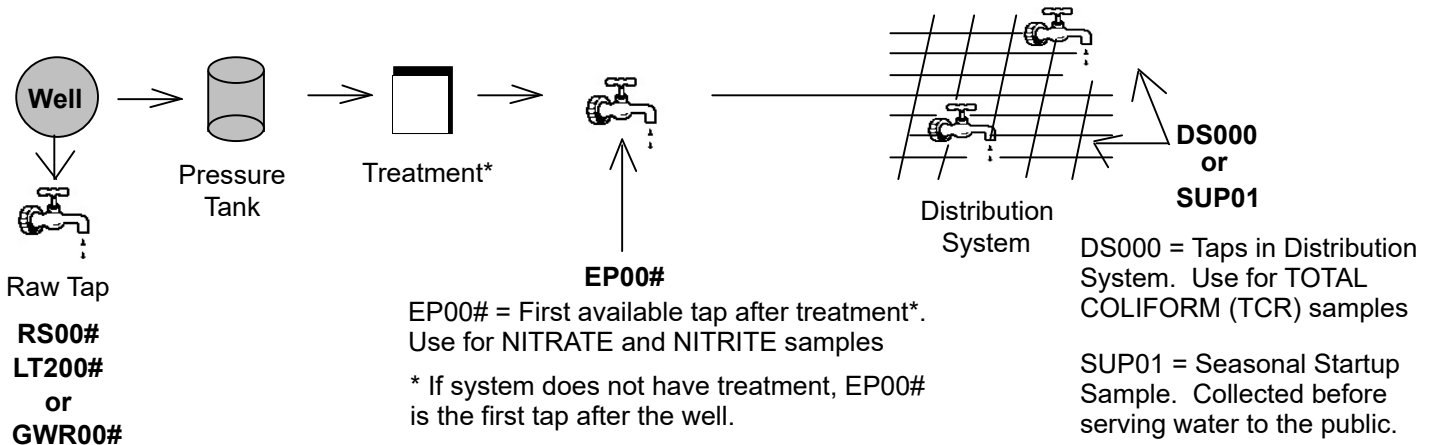

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3534712 PEACE EVANGELICAL LUTH - DESHLER

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3555004 Facility Name: PEACE EVANGELICAL LUTHERAN - DESHLER
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2018 and 5/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3536012 ST JOHN LUTHERAN CHURCH DESHLER

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ST JOHN LUTHERAN CHURCH DESHLER DS
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3536012 ST JOHN LUTHERAN CHURCH DESHLER

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3555008 Facility Name: ST JOHN LUTHERAN CHURCH DESHLER
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2018 and 5/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH3536112 ST JOHN LUTHERAN SCHOOL-NAPOLEON

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 3555009	Facility Name: SAINT JOHN LUTHERAN SCH-NAP	Facility Class: CLASS A
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 1/1/2018 and 5/31/2018

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 1/1/2018 and 5/31/2018

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 1 Sample(s) Required between 1/1/2018 and 5/31/2018

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 1/1/2018 and 5/31/2018



Effective Date: 01/01/2018

2018 DISTRIBUTION SCHEDULE

OH3536112 ST JOHN LUTHERAN SCHOOL-NAPOLEON

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **SAINT JOHN LUTHERAN SCH DIST**
Location SMP ID: **DS000**

Chemicals

Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2018	and	3/31/2018
	1 Sample(s) Required between	4/1/2018	and	6/30/2018
	1 Sample(s) Required between	7/1/2018	and	9/30/2018
	1 Sample(s) Required between	10/1/2018	and	12/31/2018

Sampling Facility ID: **DS1** Facility Name: **SAINT JOHN LUTHERAN SCH DIST**
Location SMP ID: **LC###** Refer to your Lead and Copper plan for SMP IDs

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between	6/1/2018	and	9/30/2018
-------------------------------	------------------------------	----------	-----	-----------

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

OH3536212 ST PAUL LUTHERAN CHURCH-NAPOLEON

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **ST PAUL LUTHERAN CHURCH DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

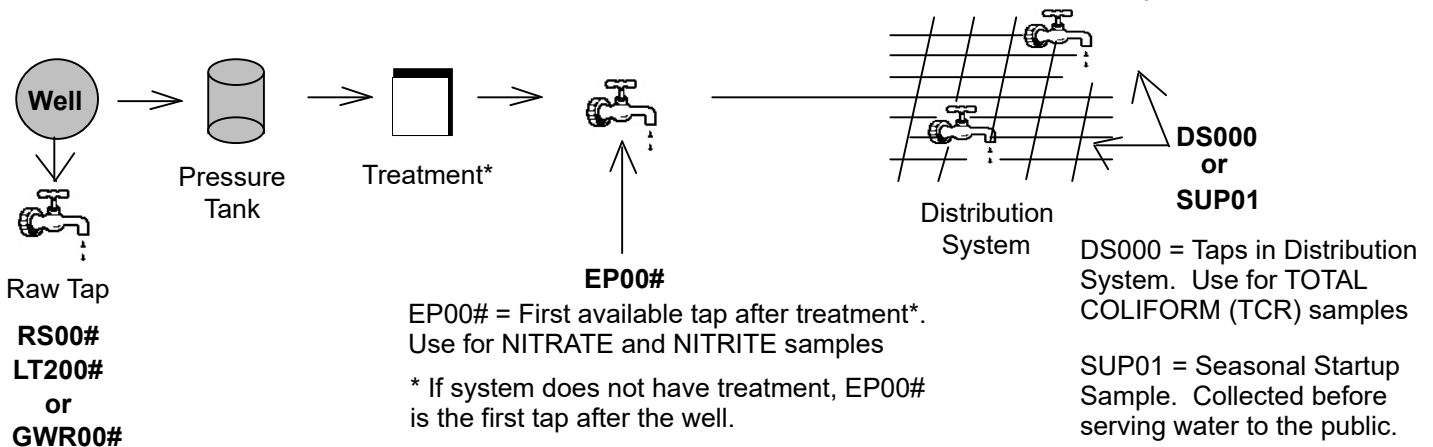

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3536212 ST PAUL LUTHERAN CHURCH-NAPOLEON

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3555010 Facility Name: SAINT PAUL LUTHERAN CHURCH
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2018 and 5/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3537112 VFW POST 8847

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: VFW POST 8847 DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3537112 VFW POST 8847

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3555014 Facility Name: VFW POST 8847

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2018 and 5/31/2018

Where to Collect Samples For a Small Public Water System

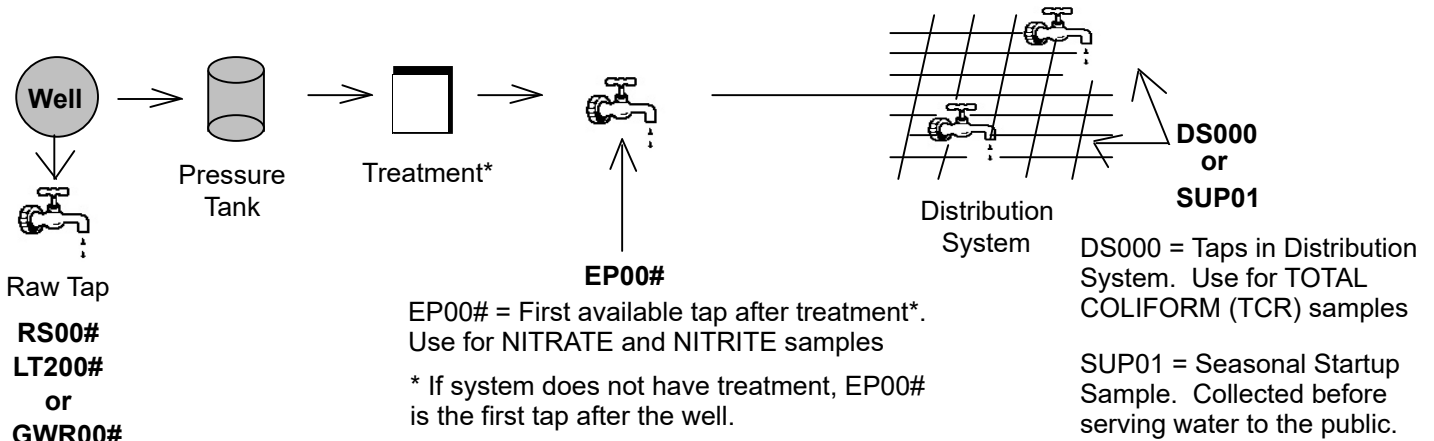

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3538112 LOG CABIN TAVERN

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **LOG CABIN TAVERN DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

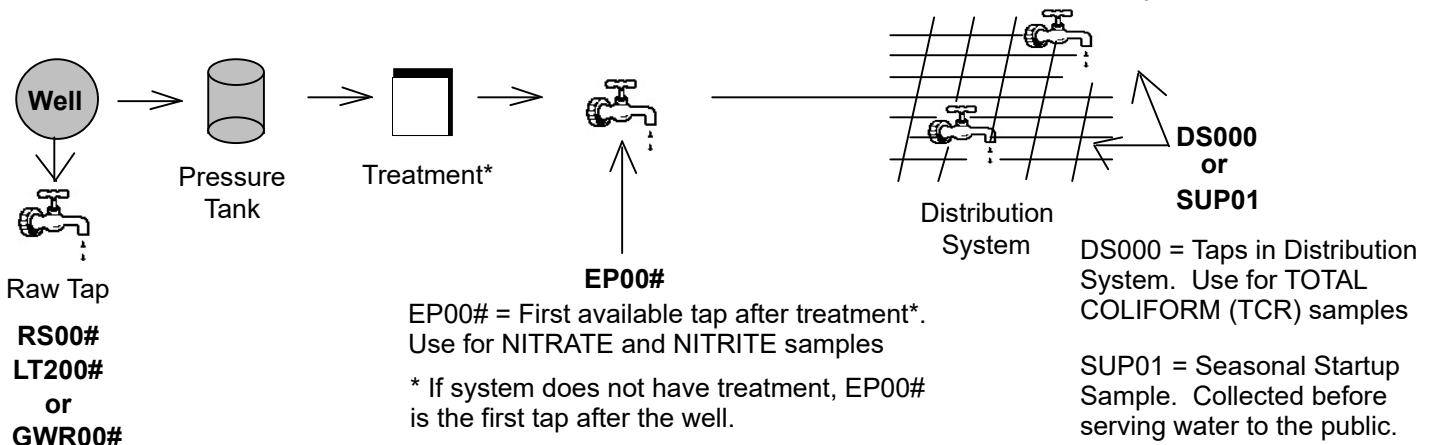

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3538112 LOG CABIN TAVERN

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3555015 Facility Name: LOG CABIN TAVERN
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2018 and 5/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3538512 PATHSTONE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **PATHSTONE DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

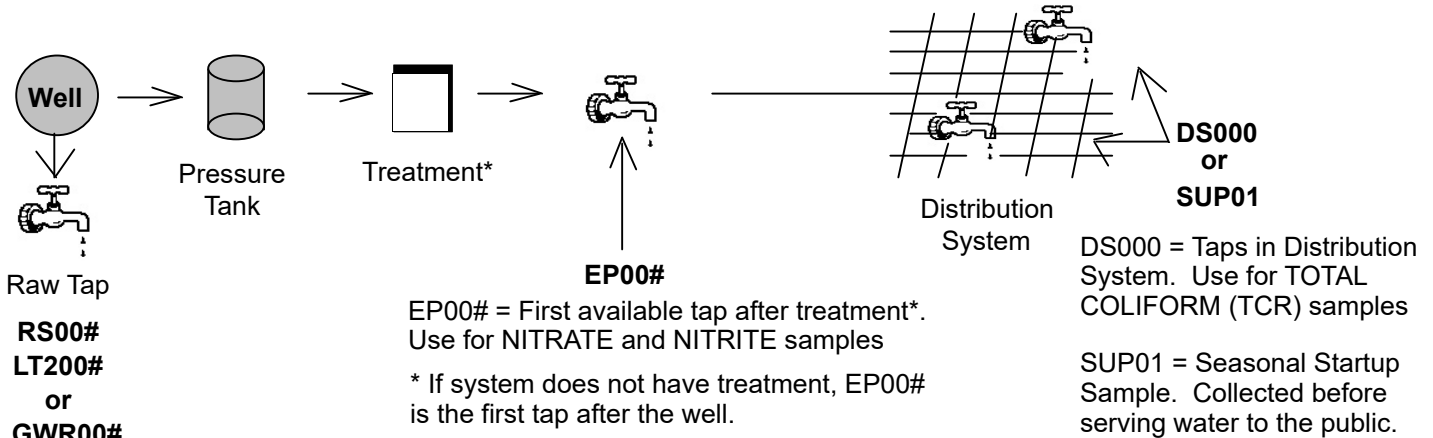

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3538512 PATHSTONE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: PATHSTONE DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/23/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

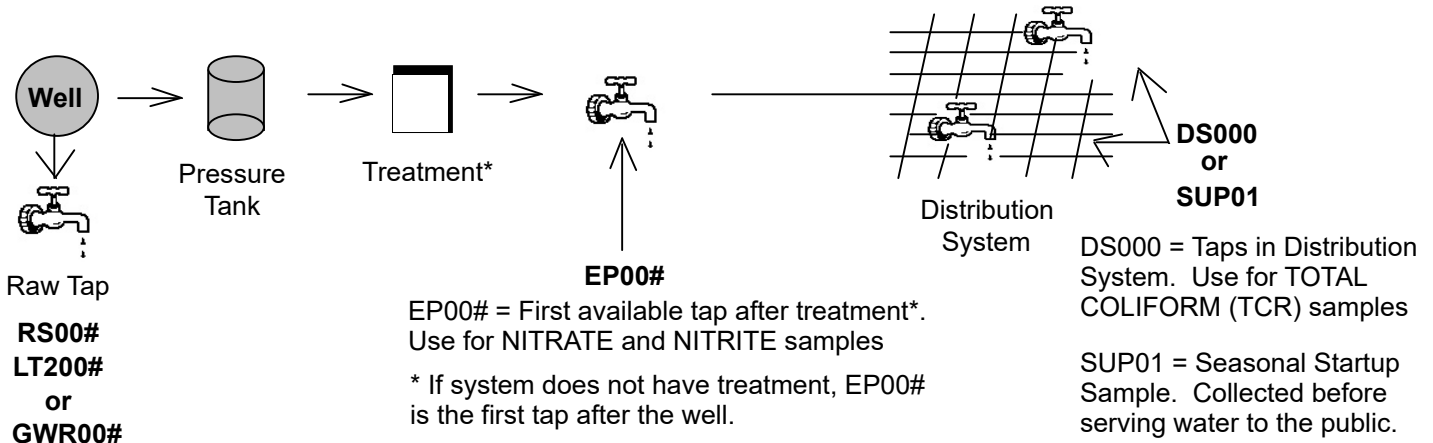

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3538512 PATHSTONE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3555017 Facility Name: PATHSTONE
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2018 and 5/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3538712 HARVEST FELLOWSHIP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: HARVEST FELLOWSHIP DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3538712 HARVEST FELLOWSHIP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3555018 Facility Name: HARVEST FELLOWSHIP
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2018 and 5/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3538812 LEATHERMAN AMLC

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **LEATHERMAN AMLC DISTRIBUTION SYSTEM**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3538812 LEATHERMAN AMLC

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: LEATHERMAN AMLC DISTRIBUTION SYSTEM
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/20/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

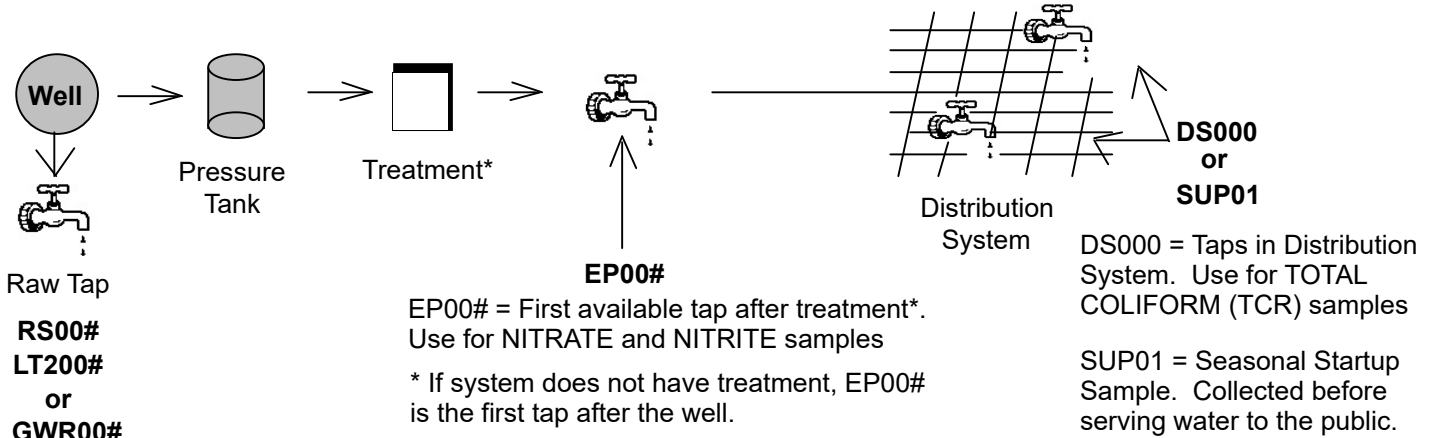

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3538812 LEATHERMAN AMLC

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3555019 Facility Name: LEATHERMAN AMLC
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2018 and 5/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3539012 LUCYS 22 CAMPGROUND

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **LUCYS 22 CAMPGROUND DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

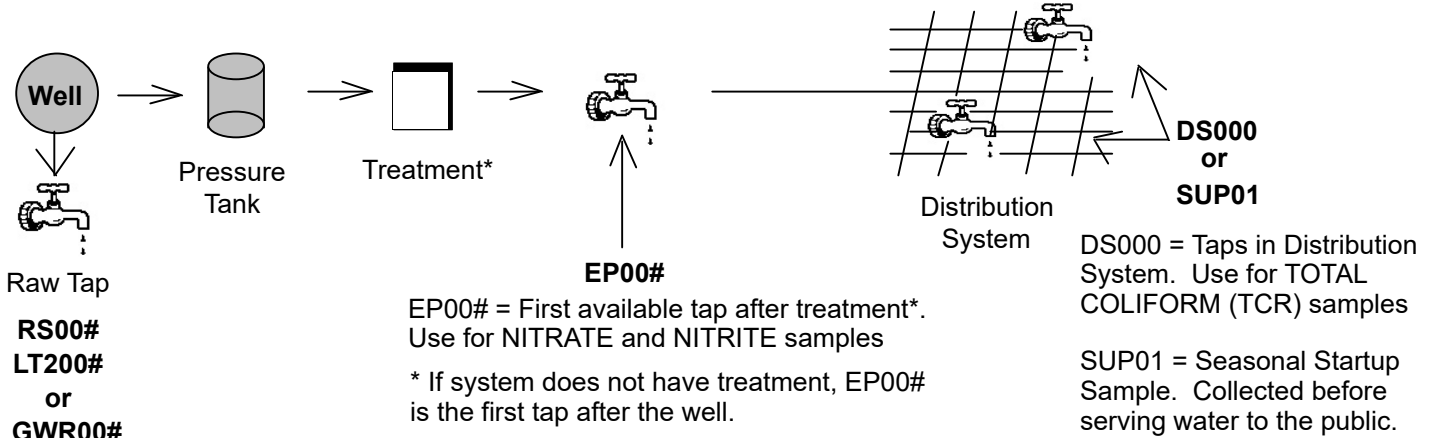

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3539012 LUCYS 22 CAMPGROUND

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: LUCYS 22 CAMPGROUND DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/22/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

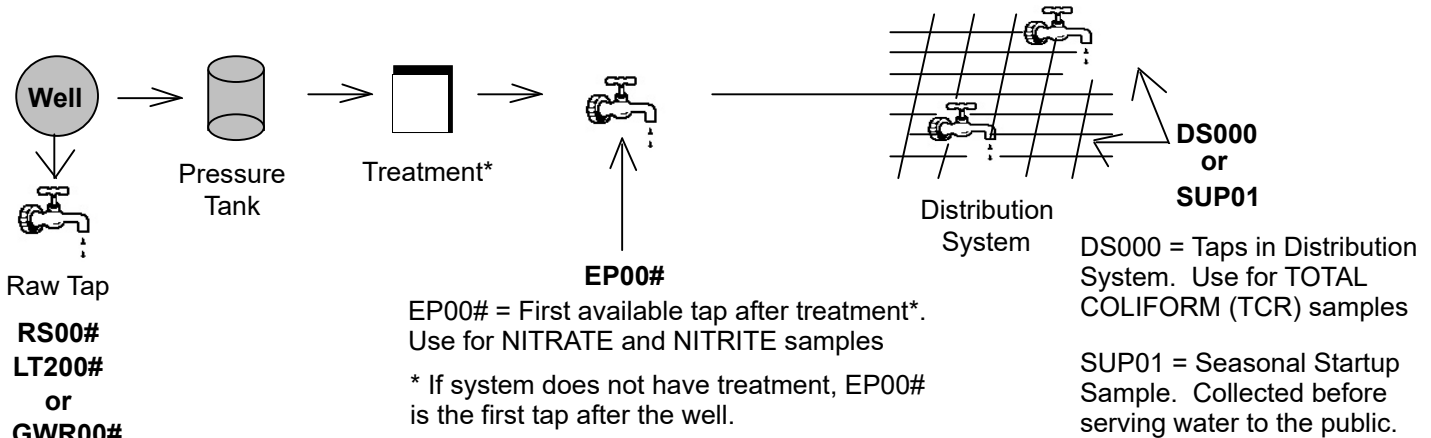

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3539012 LUCYS 22 CAMPGROUND

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3560885 Facility Name: LUCYS 22 CAMPGROUND
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2018 and 5/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



OH3539212 HENRY COUNTY REGIONAL WSD - CO RD P

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: **DS1** Facility Name: **DISTRIBUTION**
SMP ID: **DS000**

Chemicals

Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2018	and	1/31/2018
	1 Sample(s) Required between	2/1/2018	and	2/28/2018
	1 Sample(s) Required between	3/1/2018	and	3/31/2018
	1 Sample(s) Required between	4/1/2018	and	4/30/2018
	1 Sample(s) Required between	5/1/2018	and	5/31/2018
	1 Sample(s) Required between	6/1/2018	and	6/30/2018
	1 Sample(s) Required between	7/1/2018	and	7/31/2018
	1 Sample(s) Required between	8/1/2018	and	8/31/2018
	1 Sample(s) Required between	9/1/2018	and	9/30/2018
	1 Sample(s) Required between	10/1/2018	and	10/31/2018
	1 Sample(s) Required between	11/1/2018	and	11/30/2018
	1 Sample(s) Required between	12/1/2018	and	12/31/2018

TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2018	and	1/31/2018
	1 Sample(s) Required between	2/1/2018	and	2/28/2018
	1 Sample(s) Required between	3/1/2018	and	3/31/2018
	1 Sample(s) Required between	4/1/2018	and	4/30/2018
	1 Sample(s) Required between	5/1/2018	and	5/31/2018
	1 Sample(s) Required between	6/1/2018	and	6/30/2018
	1 Sample(s) Required between	7/1/2018	and	7/31/2018
	1 Sample(s) Required between	8/1/2018	and	8/31/2018
	1 Sample(s) Required between	9/1/2018	and	9/30/2018
	1 Sample(s) Required between	10/1/2018	and	10/31/2018
	1 Sample(s) Required between	11/1/2018	and	11/30/2018
	1 Sample(s) Required between	12/1/2018	and	12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location Facility ID: **DS1** Facility Name: **DISTRIBUTION**
SMP ID: **DS201** **N160 STATE ROUTE 108**

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS	Dual Sample Required between	3/8/2018	and	3/14/2018	at: DS201
	Dual Sample Required between	6/8/2018	and	6/14/2018	at: DS201
	Dual Sample Required between	9/8/2018	and	9/14/2018	at: DS201
	Dual Sample Required between	12/8/2018	and	12/14/2018	at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 04/20/2018

2018 DISTRIBUTION SCHEDULE

OH3539212 HENRY COUNTY REGIONAL WSD - CO RD P

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: DISTRIBUTION
Location	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 7/1/2018 and 12/31/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

OH3539213 ST JOHNS UNITED CHURCH OF CHRIST

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

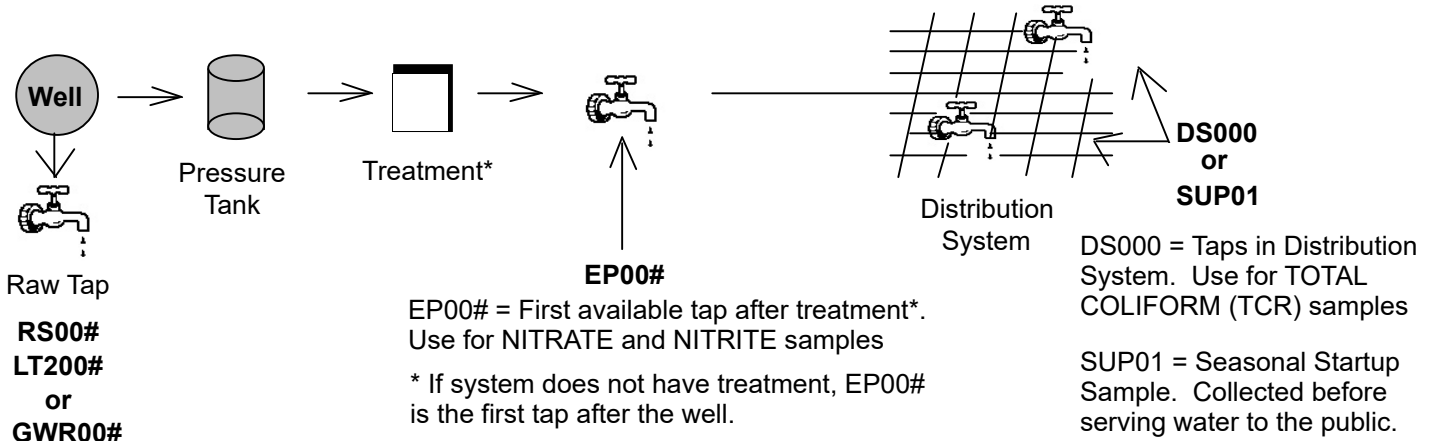

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3539213 ST JOHNS UNITED CHURCH OF CHRIST

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3562301 Facility Name: ST JOHNS UNITED CHURCH OF CHRIST
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2018 and 5/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



OH3539214 HENRY CO REGIONAL WSD- SR 108

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 3/8/2018 and 3/14/2018at: DS201
	Dual Sample Required between 6/8/2018 and 6/14/2018at: DS201
	Dual Sample Required between 9/8/2018 and 9/14/2018at: DS201
	Dual Sample Required between 12/8/2018 and 12/14/2018at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 7/1/2018 and 12/31/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.