

Effective Date: 04/17/2020

OH3000111 CAMBRIDGE, CITY OF

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 3054707 SMP ID: EP001	Facility Name: WTP-CAMBRIDGE Facility Source: Surface Water	Facility Class: CLASS 4
--------------------------	---	--	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 1/1/2020 and 5/31/2020
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	1 Sample(s) Required between 1/1/2020 and 5/31/2020
NITRATE - 1040	1 Sample(s) Required between 1/1/2020 and 1/31/2020 1 Sample(s) Required between 2/1/2020 and 2/29/2020 1 Sample(s) Required between 3/1/2020 and 3/31/2020 1 Sample(s) Required between 4/1/2020 and 4/30/2020 1 Sample(s) Required between 5/1/2020 and 5/31/2020 1 Sample(s) Required between 6/1/2020 and 6/30/2020 1 Sample(s) Required between 7/1/2020 and 7/31/2020 1 Sample(s) Required between 8/1/2020 and 8/31/2020 1 Sample(s) Required between 9/1/2020 and 9/30/2020 1 Sample(s) Required between 10/1/2020 and 10/31/2020 1 Sample(s) Required between 11/1/2020 and 11/30/2020 1 Sample(s) Required between 12/1/2020 and 12/31/2020
RADIOLOGICALS	1 Sample(s) Required between 6/1/2020 and 10/31/2020
<i>Sample for all the analytes listed below:</i>	
GROSS ALPHA - 4002 RADIUM-228 - 4030	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2020 and 6/30/2020
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2020 and 5/31/2020
TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between 1/1/2020 and 1/31/2020 1 Paired Sample Set Required between 2/1/2020 and 2/29/2020 1 Paired Sample Set Required between 3/1/2020 and 3/31/2020 1 Paired Sample Set Required between 4/1/2020 and 4/30/2020 1 Paired Sample Set Required between 5/1/2020 and 5/31/2020 1 Paired Sample Set Required between 6/1/2020 and 6/30/2020 1 Paired Sample Set Required between 7/1/2020 and 7/31/2020 1 Paired Sample Set Required between 8/1/2020 and 8/31/2020 1 Paired Sample Set Required between 9/1/2020 and 9/30/2020 1 Paired Sample Set Required between 10/1/2020 and 10/31/2020 1 Paired Sample Set Required between 11/1/2020 and 11/30/2020 1 Paired Sample Set Required between 12/1/2020 and 12/31/2020

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.

Effective Date: 04/17/2020

OH3000111 CAMBRIDGE, CITY OF

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 3054707	Facility Name: WTP-CAMBRIDGE	
Location	SMP ID: EP001/LT2001	Facility Source: Surface Water	Facility Class: CLASS 4

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020****Chemicals****Monitoring Requirements**

TOTAL MICROCYSTINS

1 Sample Set Required WEEKLY*

*Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. A week is defined as Sunday through Saturday.***Weekly sampling unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. Reduced monitoring is contingent on a public water system continuing to experience NO raw or finished water total microcystins detections. Any total microcystins detections during routine (weekly) or reduced sampling will trigger additional sampling. Please refer to the website above for specifics on follow-up sampling requirements.*

Effective Date: 04/17/2020

OH3000111 CAMBRIDGE, CITY OF

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 3054707	Facility Name: WTP-CAMBRIDGE	
Location	SMP ID: LT2001	Facility Source: Surface Water	Facility Class: CLASS 4

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

Chemicals	Monitoring Requirements
CYANOBACTERIA SCREENING	1 Sample(s) Required between 12/29/2019 and 1/4/2020
	1 Sample(s) Required between 1/12/2020 and 1/18/2020
	1 Sample(s) Required between 1/26/2020 and 2/1/2020
	1 Sample(s) Required between 2/9/2020 and 2/15/2020
	1 Sample(s) Required between 2/23/2020 and 2/29/2020
	1 Sample(s) Required between 3/8/2020 and 3/14/2020
	1 Sample(s) Required between 3/22/2020 and 3/28/2020
	1 Sample(s) Required between 4/5/2020 and 4/11/2020
	1 Sample(s) Required between 4/19/2020 and 4/25/2020
	1 Sample(s) Required between 5/3/2020 and 5/9/2020
	1 Sample(s) Required between 5/17/2020 and 5/23/2020
	1 Sample(s) Required between 5/31/2020 and 6/6/2020
	1 Sample(s) Required between 6/14/2020 and 6/20/2020
	1 Sample(s) Required between 6/28/2020 and 7/4/2020
	1 Sample(s) Required between 7/12/2020 and 7/18/2020
	1 Sample(s) Required between 7/26/2020 and 8/1/2020
	1 Sample(s) Required between 8/9/2020 and 8/15/2020
	1 Sample(s) Required between 8/23/2020 and 8/29/2020
	1 Sample(s) Required between 9/6/2020 and 9/12/2020
	1 Sample(s) Required between 9/20/2020 and 9/26/2020
	1 Sample(s) Required between 10/4/2020 and 10/10/2020
	1 Sample(s) Required between 10/18/2020 and 10/24/2020
	1 Sample(s) Required between 11/1/2020 and 11/7/2020
	1 Sample(s) Required between 11/15/2020 and 11/21/2020
	1 Sample(s) Required between 11/29/2020 and 12/5/2020
	1 Sample(s) Required between 12/13/2020 and 12/19/2020

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. As of 12/31/17, all public water systems are responsible for contracting with a lab certified to perform cyanobacteria screening (qPCR). Please review the website for further information pertaining to follow-up sampling requirements for cyanobacteria screening gene detections, and certified labs that can perform analysis.

Effective Date: 01/01/2020

OH3000111 CAMBRIDGE, CITY OF

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020****DISTRIBUTION MONITORING SCHEDULE**

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: DISTRIBUTION-CAMBRIDGE	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
------------------	--------------------------------

ASBESTOS - 1094	1 Sample(s) Required between 6/1/2020 and 10/31/2020
-----------------	--

Collect one sample at a tap served by asbestos-cement pipe. Due to limited Laboratory capacity and a 48 hour filtering requirement, contact your lab early in the monitoring period to schedule a sampling date.

TOTAL COLIFORM (TCR) - 3100	10 Sample(s) Required between 1/1/2020 and 1/31/2020
	10 Sample(s) Required between 2/1/2020 and 2/29/2020
	10 Sample(s) Required between 3/1/2020 and 3/31/2020
	10 Sample(s) Required between 4/1/2020 and 4/30/2020
	10 Sample(s) Required between 5/1/2020 and 5/31/2020
	10 Sample(s) Required between 6/1/2020 and 6/30/2020
	10 Sample(s) Required between 7/1/2020 and 7/31/2020
	10 Sample(s) Required between 8/1/2020 and 8/31/2020
	10 Sample(s) Required between 9/1/2020 and 9/30/2020
	10 Sample(s) Required between 10/1/2020 and 10/31/2020
	10 Sample(s) Required between 11/1/2020 and 11/30/2020
	10 Sample(s) Required between 12/1/2020 and 12/31/2020

TOTAL CHLORINE - 1000	10 Sample(s) Required between 1/1/2020 and 1/31/2020
	10 Sample(s) Required between 2/1/2020 and 2/29/2020
	10 Sample(s) Required between 3/1/2020 and 3/31/2020
	10 Sample(s) Required between 4/1/2020 and 4/30/2020
	10 Sample(s) Required between 5/1/2020 and 5/31/2020
	10 Sample(s) Required between 6/1/2020 and 6/30/2020
	10 Sample(s) Required between 7/1/2020 and 7/31/2020
	10 Sample(s) Required between 8/1/2020 and 8/31/2020
	10 Sample(s) Required between 9/1/2020 and 9/30/2020
	10 Sample(s) Required between 10/1/2020 and 10/31/2020
	10 Sample(s) Required between 11/1/2020 and 11/30/2020
	10 Sample(s) Required between 12/1/2020 and 12/31/2020

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: DISTRIBUTION-CAMBRIDGE 9900 BRICK CHURCH RD.	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 2/1/2020 and 2/7/2020 at: DS201
	Dual Sample Required between 5/1/2020 and 5/7/2020 at: DS201
	Dual Sample Required between 8/1/2020 and 8/7/2020 at: DS201

Effective Date: 01/01/2020

OH3000111 CAMBRIDGE, CITY OF

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020****DISTRIBUTION MONITORING SCHEDULE**

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: DISTRIBUTION-CAMBRIDGE 9900 BRICK CHURCH RD.	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 11/1/2020 and 11/7/2020 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: DISTRIBUTION-CAMBRIDGE 1000 WATER ST.	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 2/1/2020 and 2/7/2020 at: DS202

Dual Sample Required between 5/1/2020 and 5/7/2020 at: DS202

Dual Sample Required between 8/1/2020 and 8/7/2020 at: DS202

Dual Sample Required between 11/1/2020 and 11/7/2020 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS203	Facility Name: DISTRIBUTION-CAMBRIDGE 1300 CLARK ST.	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 2/1/2020 and 2/7/2020 at: DS203

Dual Sample Required between 5/1/2020 and 5/7/2020 at: DS203

Dual Sample Required between 8/1/2020 and 8/7/2020 at: DS203

Dual Sample Required between 11/1/2020 and 11/7/2020 at: DS203

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS204	Facility Name: DISTRIBUTION-CAMBRIDGE 9547 CADIZ ROAD	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 2/1/2020 and 2/7/2020 at: DS204

Dual Sample Required between 5/1/2020 and 5/7/2020 at: DS204

Dual Sample Required between 8/1/2020 and 8/7/2020 at: DS204

OH3000111 CAMBRIDGE, CITY OF

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS204	Facility Name: DISTRIBUTION-CAMBRIDGE 9547 CADIZ ROAD	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS Dual Sample Required between 11/1/2020 and 11/7/2020 at: DS204

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: DISTRIBUTION-CAMBRIDGE Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022 Not Required

Effective Date: 01/01/2020

OH3000603 GUERNSEY CO. WATER DEPT.

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020****DISTRIBUTION MONITORING SCHEDULE**

Sampling Location	Facility ID: DS1	Facility Name: DISTRIBUTION-GUERNSEY CO. WATER DEPT.	Facility Class: CLASS 1
	SMP ID: DS000		

Chemicals**Monitoring Requirements**

ASBESTOS - 1094	1 Sample(s) Required between	6/1/2020	and 10/31/2020
-----------------	------------------------------	----------	----------------

Collect one sample at a tap served by asbestos-cement pipe. Due to limited Laboratory capacity and a 48 hour filtering requirement, contact your lab early in the monitoring period to schedule a sampling date.

TOTAL COLIFORM (TCR) - 3100	10 Sample(s) Required between	1/1/2020	and 1/31/2020
	10 Sample(s) Required between	2/1/2020	and 2/29/2020
	10 Sample(s) Required between	3/1/2020	and 3/31/2020
	10 Sample(s) Required between	4/1/2020	and 4/30/2020
	10 Sample(s) Required between	5/1/2020	and 5/31/2020
	10 Sample(s) Required between	6/1/2020	and 6/30/2020
	10 Sample(s) Required between	7/1/2020	and 7/31/2020
	10 Sample(s) Required between	8/1/2020	and 8/31/2020
	10 Sample(s) Required between	9/1/2020	and 9/30/2020
	10 Sample(s) Required between	10/1/2020	and 10/31/2020
	10 Sample(s) Required between	11/1/2020	and 11/30/2020
	10 Sample(s) Required between	12/1/2020	and 12/31/2020

TOTAL CHLORINE - 1000	10 Sample(s) Required between	1/1/2020	and 1/31/2020
	10 Sample(s) Required between	2/1/2020	and 2/29/2020
	10 Sample(s) Required between	3/1/2020	and 3/31/2020
	10 Sample(s) Required between	4/1/2020	and 4/30/2020
	10 Sample(s) Required between	5/1/2020	and 5/31/2020
	10 Sample(s) Required between	6/1/2020	and 6/30/2020
	10 Sample(s) Required between	7/1/2020	and 7/31/2020
	10 Sample(s) Required between	8/1/2020	and 8/31/2020
	10 Sample(s) Required between	9/1/2020	and 9/30/2020
	10 Sample(s) Required between	10/1/2020	and 10/31/2020
	10 Sample(s) Required between	11/1/2020	and 11/30/2020
	10 Sample(s) Required between	12/1/2020	and 12/31/2020

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: DISTRIBUTION-GUERNSEY CO. WATER DEPT.	Facility Class: CLASS 1
	SMP ID: DS201	16869 CADIZ RD. LORE CITY	

Chemicals**Monitoring Requirements**

DISINFECTION BYPRODUCTS	Dual Sample Required between	2/1/2020	and 2/7/2020 at: DS201
	Dual Sample Required between	5/1/2020	and 5/7/2020 at: DS201
	Dual Sample Required between	8/1/2020	and 8/7/2020 at: DS201

Effective Date: 01/01/2020

OH3000603 GUERNSEY CO. WATER DEPT.

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020****DISTRIBUTION MONITORING SCHEDULE**

Sampling Location	Facility ID: DS1	Facility Name: DISTRIBUTION-GUERNSEY CO. WATER DEPT.	Facility Class: CLASS 1
	SMP ID: DS201	16869 CADIZ RD. LORE CITY	

Chemicals**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 11/1/2020 and 11/7/2020 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1	Facility Name: DISTRIBUTION-GUERNSEY CO. WATER DEPT.	Facility Class: CLASS 1
	SMP ID: DS202	SR 313 AND SR 660 CAMBRIDGE	

Chemicals**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 2/1/2020 and 2/7/2020 at: DS202

Dual Sample Required between 5/1/2020 and 5/7/2020 at: DS202

Dual Sample Required between 8/1/2020 and 8/7/2020 at: DS202

Dual Sample Required between 11/1/2020 and 11/7/2020 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1	Facility Name: DISTRIBUTION-GUERNSEY CO. WATER DEPT.	Facility Class: CLASS 1
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs	

Chemicals**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022

20 Sample(s) Required between 6/1/2020 and 9/30/2020

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

OH3000912 PLEASANT CITY, VILLAGE OF

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 3054714 SMP ID: EP001	Facility Name: WTP-PLEASANT CITY Facility Source: Ground Water	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

Chemicals	Monitoring Requirements	
ARSENIC - 1005	1 Sample(s) Required between	1/1/2020 and 3/31/2020
	1 Sample(s) Required between	4/1/2020 and 6/30/2020
	1 Sample(s) Required between	7/1/2020 and 9/30/2020
	1 Sample(s) Required between	10/1/2020 and 12/31/2020
INORGANICS	1 Sample(s) Required between	6/1/2020 and 10/31/2020
<i>Sample for all the analytes listed below:</i>		
ANTIMONY, TOTAL - 1074 BARIUM - 1010 BERYLLIUM, TOTAL - 1015 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024		
FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL		
NITRITE - 1041	1 Sample(s) Required between	1/1/2020 and 3/31/2020
	1 Sample(s) Required between	4/1/2020 and 6/30/2020
	1 Sample(s) Required between	7/1/2020 and 9/30/2020
	1 Sample(s) Required between	10/1/2020 and 12/31/2020
NITRATE - 1040	1 Sample(s) Required between	1/1/2020 and 5/31/2020
RADIOLOGICALS	1 Sample(s) Required between	6/1/2020 and 10/31/2020
<i>Sample for all the analytes listed below:</i>		
GROSS ALPHA - 4002 RADIUM-228 - 4030		
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	6/1/2020 and 10/31/2020

Effective Date: 01/01/2020

OH3000912 PLEASANT CITY, VILLAGE OF

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020****DISTRIBUTION MONITORING SCHEDULE**

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: DISTRIBUTION-PLEASANT CITY	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals**Monitoring Requirements**

ASBESTOS - 1094	1 Sample(s) Required between	6/1/2020	and	10/31/2020
-----------------	------------------------------	----------	-----	------------

Collect one sample at a tap served by asbestos-cement pipe. Due to limited Laboratory capacity and a 48 hour filtering requirement, contact your lab early in the monitoring period to schedule a sampling date.

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2020	and	1/31/2020
	1 Sample(s) Required between	2/1/2020	and	2/29/2020
	1 Sample(s) Required between	3/1/2020	and	3/31/2020
	1 Sample(s) Required between	4/1/2020	and	4/30/2020
	1 Sample(s) Required between	5/1/2020	and	5/31/2020
	1 Sample(s) Required between	6/1/2020	and	6/30/2020
	1 Sample(s) Required between	7/1/2020	and	7/31/2020
	1 Sample(s) Required between	8/1/2020	and	8/31/2020
	1 Sample(s) Required between	9/1/2020	and	9/30/2020
	1 Sample(s) Required between	10/1/2020	and	10/31/2020
	1 Sample(s) Required between	11/1/2020	and	11/30/2020
	1 Sample(s) Required between	12/1/2020	and	12/31/2020

TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2020	and	1/31/2020
	1 Sample(s) Required between	2/1/2020	and	2/29/2020
	1 Sample(s) Required between	3/1/2020	and	3/31/2020
	1 Sample(s) Required between	4/1/2020	and	4/30/2020
	1 Sample(s) Required between	5/1/2020	and	5/31/2020
	1 Sample(s) Required between	6/1/2020	and	6/30/2020
	1 Sample(s) Required between	7/1/2020	and	7/31/2020
	1 Sample(s) Required between	8/1/2020	and	8/31/2020
	1 Sample(s) Required between	9/1/2020	and	9/30/2020
	1 Sample(s) Required between	10/1/2020	and	10/31/2020
	1 Sample(s) Required between	11/1/2020	and	11/30/2020
	1 Sample(s) Required between	12/1/2020	and	12/31/2020

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: DISTRIBUTION-PLEASANT CITY ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals**Monitoring Requirements**

DISINFECTION BYPRODUCTS	Dual Sample Required between	2/8/2020	and	2/14/2020	at: DS201
	Dual Sample Required between	5/8/2020	and	5/14/2020	at: DS201
	Dual Sample Required between	8/8/2020	and	8/14/2020	at: DS201

Effective Date: 01/01/2020

OH3000912 PLEASANT CITY, VILLAGE OF

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020****DISTRIBUTION MONITORING SCHEDULE**

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: DISTRIBUTION-PLEASANT CITY ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 11/8/2020 and 11/14/2020 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: DISTRIBUTION-PLEASANT CITY ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 2/8/2020 and 2/14/2020 at: DS202

Dual Sample Required between 5/8/2020 and 5/14/2020 at: DS202

Dual Sample Required between 8/8/2020 and 8/14/2020 at: DS202

Dual Sample Required between 11/8/2020 and 11/14/2020 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: DISTRIBUTION-PLEASANT CITY Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022

5 Sample(s) Required between 6/1/2020 and 9/30/2020

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

OH3001011 QUAKER CITY

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: DISTRIBUTION-QUAKER CITY	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 1/31/2020 1 Sample(s) Required between 2/1/2020 and 2/29/2020 1 Sample(s) Required between 3/1/2020 and 3/31/2020 1 Sample(s) Required between 4/1/2020 and 4/30/2020 1 Sample(s) Required between 5/1/2020 and 5/31/2020 1 Sample(s) Required between 6/1/2020 and 6/30/2020 1 Sample(s) Required between 7/1/2020 and 7/31/2020 1 Sample(s) Required between 8/1/2020 and 8/31/2020 1 Sample(s) Required between 9/1/2020 and 9/30/2020 1 Sample(s) Required between 10/1/2020 and 10/31/2020 1 Sample(s) Required between 11/1/2020 and 11/30/2020 1 Sample(s) Required between 12/1/2020 and 12/31/2020
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2020 and 1/31/2020 1 Sample(s) Required between 2/1/2020 and 2/29/2020 1 Sample(s) Required between 3/1/2020 and 3/31/2020 1 Sample(s) Required between 4/1/2020 and 4/30/2020 1 Sample(s) Required between 5/1/2020 and 5/31/2020 1 Sample(s) Required between 6/1/2020 and 6/30/2020 1 Sample(s) Required between 7/1/2020 and 7/31/2020 1 Sample(s) Required between 8/1/2020 and 8/31/2020 1 Sample(s) Required between 9/1/2020 and 9/30/2020 1 Sample(s) Required between 10/1/2020 and 10/31/2020 1 Sample(s) Required between 11/1/2020 and 11/30/2020 1 Sample(s) Required between 12/1/2020 and 12/31/2020

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: DISTRIBUTION-QUAKER CITY STATE ROUTE 800	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 1/1/2020 and 1/7/2020 at: DS201 Dual Sample Required between 4/1/2020 and 4/7/2020 at: DS201 Dual Sample Required between 7/1/2020 and 7/7/2020 at: DS201 Dual Sample Required between 10/1/2020 and 10/7/2020 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH3001011 QUAKER CITY

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: **** Consumer Confidence Report (CCR) is due July 1, 2020

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: DISTRIBUTION-QUAKER CITY 126 FAIR STREET	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals**Monitoring Requirements**

DISINFECTION BYPRODUCTS	Dual Sample Required between 1/1/2020 and 1/7/2020 at: DS202
	Dual Sample Required between 4/1/2020 and 4/7/2020 at: DS202
	Dual Sample Required between 7/1/2020 and 7/7/2020 at: DS202
	Dual Sample Required between 10/1/2020 and 10/7/2020 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: DISTRIBUTION-QUAKER CITY Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2020 and 9/30/2020
-------------------------------	--

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

Effective Date: 01/01/2020

OH3001103 WESTERN GUERNSEY REGIONAL WATER DISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020****DISTRIBUTION MONITORING SCHEDULE**

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: DISTRIBUTION-WESTERN GUERNSEY	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements		
TOTAL COLIFORM (TCR) - 3100	3 Sample(s) Required between	1/1/2020	and 1/31/2020
	3 Sample(s) Required between	2/1/2020	and 2/29/2020
	3 Sample(s) Required between	3/1/2020	and 3/31/2020
	3 Sample(s) Required between	4/1/2020	and 4/30/2020
	3 Sample(s) Required between	5/1/2020	and 5/31/2020
	3 Sample(s) Required between	6/1/2020	and 6/30/2020
	3 Sample(s) Required between	7/1/2020	and 7/31/2020
	3 Sample(s) Required between	8/1/2020	and 8/31/2020
	3 Sample(s) Required between	9/1/2020	and 9/30/2020
	3 Sample(s) Required between	10/1/2020	and 10/31/2020
	3 Sample(s) Required between	11/1/2020	and 11/30/2020
	3 Sample(s) Required between	12/1/2020	and 12/31/2020
TOTAL CHLORINE - 1000	3 Sample(s) Required between	1/1/2020	and 1/31/2020
	3 Sample(s) Required between	2/1/2020	and 2/29/2020
	3 Sample(s) Required between	3/1/2020	and 3/31/2020
	3 Sample(s) Required between	4/1/2020	and 4/30/2020
	3 Sample(s) Required between	5/1/2020	and 5/31/2020
	3 Sample(s) Required between	6/1/2020	and 6/30/2020
	3 Sample(s) Required between	7/1/2020	and 7/31/2020
	3 Sample(s) Required between	8/1/2020	and 8/31/2020
	3 Sample(s) Required between	9/1/2020	and 9/30/2020
	3 Sample(s) Required between	10/1/2020	and 10/31/2020
	3 Sample(s) Required between	11/1/2020	and 11/30/2020
	3 Sample(s) Required between	12/1/2020	and 12/31/2020

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: DISTRIBUTION-WESTERN GUERNSEY 2703 BLOOMFIELD ROAD	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements		
DISINFECTION BYPRODUCTS	Dual Sample Required between	2/1/2020	and 2/7/2020 at: DS201
	Dual Sample Required between	5/1/2020	and 5/7/2020 at: DS201
	Dual Sample Required between	8/1/2020	and 8/7/2020 at: DS201
	Dual Sample Required between	11/1/2020	and 11/7/2020 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH3001103 WESTERN GUERNSEY REGIONAL WATER DISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: **** Consumer Confidence Report (CCR) is due July 1, 2020

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: DISTRIBUTION-WESTERN GUERNSEY 56032 CLAYSVILLE ROAD	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/1/2020 and 2/7/2020 at: DS202
	Dual Sample Required between 5/1/2020 and 5/7/2020 at: DS202
	Dual Sample Required between 8/1/2020 and 8/7/2020 at: DS202
	Dual Sample Required between 11/1/2020 and 11/7/2020 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: DISTRIBUTION-WESTERN GUERNSEY Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2020 and 9/30/2020

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

OH3001212 BYESVILLE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 3054706 SMP ID: EP002	Facility Name: BYESVILLE WTP-PLANT #2 Facility Source: Surface Water	Facility Class: CLASS 3
--------------------------	---	---	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

Chemicals	Monitoring Requirements	
INORGANICS	1 Sample(s) Required between	1/1/2020 and 5/31/2020
<i>Sample for all the analytes listed below:</i>		
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085		
NITRITE - 1041	1 Sample(s) Required between	1/1/2020 and 5/31/2020
NITRATE - 1040	1 Sample(s) Required between	1/1/2020 and 1/31/2020
	1 Sample(s) Required between	2/1/2020 and 2/29/2020
	1 Sample(s) Required between	3/1/2020 and 3/31/2020
	1 Sample(s) Required between	4/1/2020 and 4/30/2020
	1 Sample(s) Required between	5/1/2020 and 5/31/2020
	1 Sample(s) Required between	6/1/2020 and 6/30/2020
	1 Sample(s) Required between	7/1/2020 and 7/31/2020
	1 Sample(s) Required between	8/1/2020 and 8/31/2020
	1 Sample(s) Required between	9/1/2020 and 9/30/2020
	1 Sample(s) Required between	10/1/2020 and 10/31/2020
	1 Sample(s) Required between	11/1/2020 and 11/30/2020
	1 Sample(s) Required between	12/1/2020 and 12/31/2020
RADIOLOGICALS	1 Sample(s) Required between	6/1/2020 and 10/31/2020
<i>Sample for all the analytes listed below:</i>		
GROSS ALPHA - 4002 RADIUM-228 - 4030		
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	4/1/2020 and 6/30/2020
<i>Sample for all the analytes listed below:</i>		
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037		
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	7/1/2020 and 9/30/2020
	1 Sample(s) Required between	10/1/2020 and 12/31/2020

Effective Date: 08/14/2020

OH3001212 BYESVILLE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 3054706	Facility Name: BYESVILLE WTP-PLANT #2	
Location	SMP ID: LT2002	Facility Source: Surface Water	Facility Class: CLASS 3

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020****Chemicals****Monitoring Requirements**

Chemicals	Monitoring Requirements
CYANOBACTERIA SCREENING	1 Sample(s) Required between 1/1/2020 and 1/31/2020
	1 Sample(s) Required between 2/1/2020 and 2/29/2020
	1 Sample(s) Required between 3/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 4/30/2020
	1 Sample(s) Required between 5/1/2020 and 5/31/2020
	1 Sample(s) Required between 6/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 7/31/2020
	1 Sample(s) Required between 8/1/2020 and 8/31/2020
	1 Sample(s) Required between 9/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 10/31/2020
	1 Sample(s) Required between 11/1/2020 and 11/30/2020
	1 Sample(s) Required between 12/1/2020 and 12/31/2020

Effective Date: 01/01/2020

OH3001212 BYESVILLE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: DISTRIBUTION-BYESVILLE	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
------------------	--------------------------------

ASBESTOS - 1094	1 Sample(s) Required between 6/1/2020 and 10/31/2020
-----------------	--

Collect one sample at a tap served by asbestos-cement pipe. Due to limited Laboratory capacity and a 48 hour filtering requirement, contact your lab early in the monitoring period to schedule a sampling date.

TOTAL COLIFORM (TCR) - 3100	5 Sample(s) Required between 1/1/2020 and 1/31/2020
	5 Sample(s) Required between 2/1/2020 and 2/29/2020
	5 Sample(s) Required between 3/1/2020 and 3/31/2020
	5 Sample(s) Required between 4/1/2020 and 4/30/2020
	5 Sample(s) Required between 5/1/2020 and 5/31/2020
	5 Sample(s) Required between 6/1/2020 and 6/30/2020
	5 Sample(s) Required between 7/1/2020 and 7/31/2020
	5 Sample(s) Required between 8/1/2020 and 8/31/2020
	5 Sample(s) Required between 9/1/2020 and 9/30/2020
	5 Sample(s) Required between 10/1/2020 and 10/31/2020
	5 Sample(s) Required between 11/1/2020 and 11/30/2020
	5 Sample(s) Required between 12/1/2020 and 12/31/2020

TOTAL CHLORINE - 1000	5 Sample(s) Required between 1/1/2020 and 1/31/2020
	5 Sample(s) Required between 2/1/2020 and 2/29/2020
	5 Sample(s) Required between 3/1/2020 and 3/31/2020
	5 Sample(s) Required between 4/1/2020 and 4/30/2020
	5 Sample(s) Required between 5/1/2020 and 5/31/2020
	5 Sample(s) Required between 6/1/2020 and 6/30/2020
	5 Sample(s) Required between 7/1/2020 and 7/31/2020
	5 Sample(s) Required between 8/1/2020 and 8/31/2020
	5 Sample(s) Required between 9/1/2020 and 9/30/2020
	5 Sample(s) Required between 10/1/2020 and 10/31/2020
	5 Sample(s) Required between 11/1/2020 and 11/30/2020
	5 Sample(s) Required between 12/1/2020 and 12/31/2020

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: DISTRIBUTION-BYESVILLE 431 CARL STREET	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 3/1/2020 and 3/7/2020 at: DS201
	Dual Sample Required between 6/1/2020 and 6/7/2020 at: DS201
	Dual Sample Required between 9/1/2020 and 9/7/2020 at: DS201

OH3001212 BYESVILLE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: DISTRIBUTION-BYESVILLE 431 CARL STREET	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 12/1/2020 and 12/7/2020 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: DISTRIBUTION-BYESVILLE 357 NORTH CAMBRIDGE STREET	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 3/1/2020 and 3/7/2020 at: DS202

Dual Sample Required between 6/1/2020 and 6/7/2020 at: DS202

Dual Sample Required between 9/1/2020 and 9/7/2020 at: DS202

Dual Sample Required between 12/1/2020 and 12/7/2020 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: DISTRIBUTION-BYESVILLE Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022

20 Sample(s) Required between 6/1/2020 and 9/30/2020

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

Effective Date: 01/01/2020

OH3033712 MWCD PIEDMONT CAMP P2 PWS

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **MWCD,PIEDMONT CAMP P2 DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

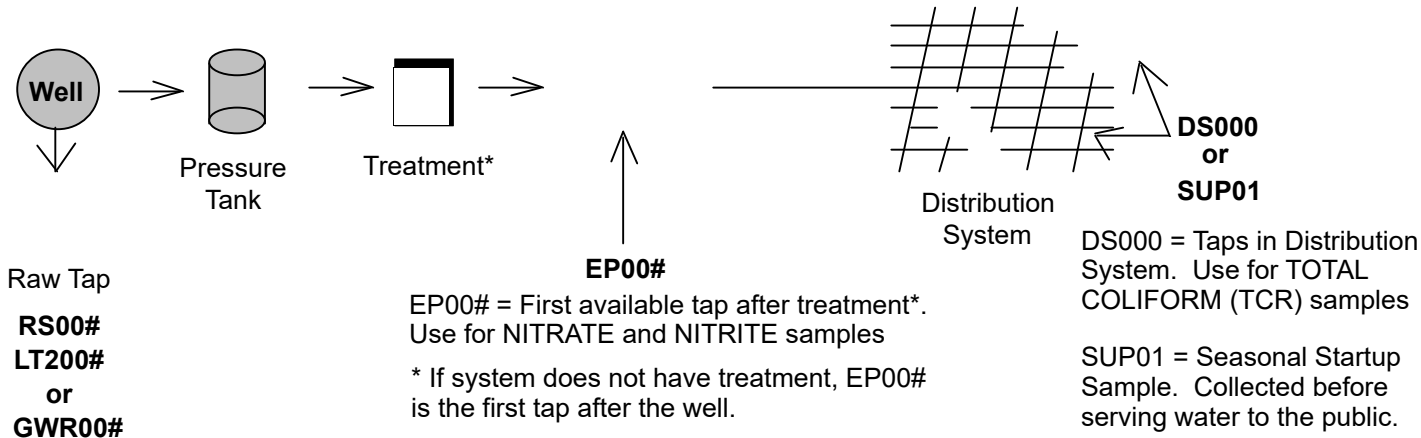

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH3033712 MWCD PIEDMONT CAMP P2 PWS

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: MWCD,PIEDMONT CAMP P2 DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2020 and 6/30/2020 1 Sample(s) Required between 7/1/2020 and 9/30/2020 1 Sample(s) Required between 10/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

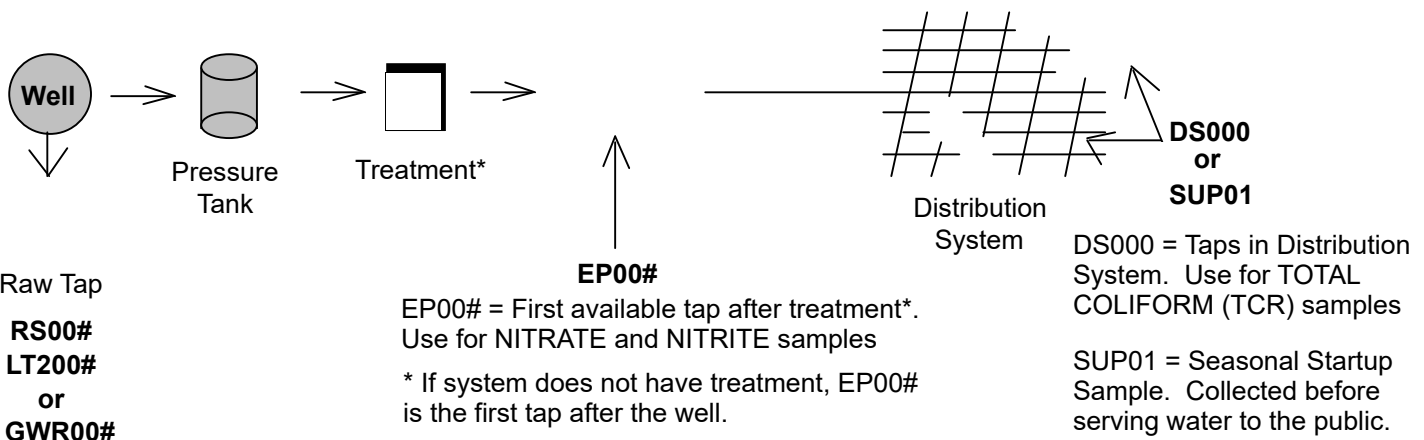

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH3033712 MWCD PIEDMONT CAMP P2 PWS

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3054726 Facility Name: MWCD PIEDMONT CAMP P2

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2020 and 5/31/2020
NITRATE - 1040	1 Sample(s) Required between 1/1/2020 and 5/31/2020

Where to Collect Samples For a Small Public Water System

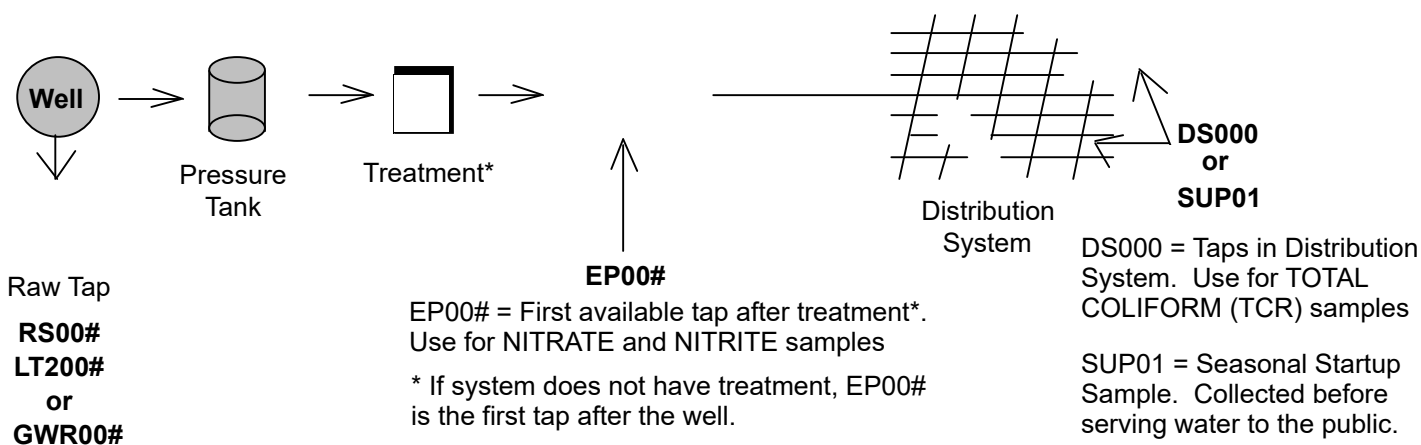

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH3034212 I70 FUEL MART 727

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **I70 FUEL MART 727 DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 12/31/2020

Where to Collect Samples For a Small Public Water System

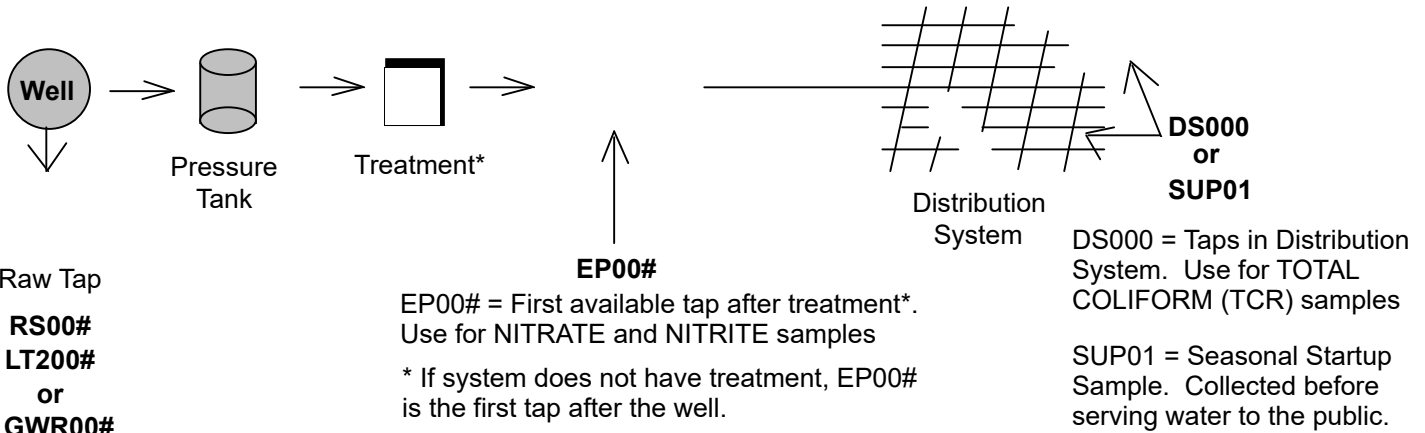

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH3034212 I70 FUEL MART 727

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3054728 Facility Name: PORTS PETROLEUM CO INC GAS MART NO 727

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2020 and 5/31/2020
NITRATE - 1040	1 Sample(s) Required between 1/1/2020 and 5/31/2020

Where to Collect Samples For a Small Public Water System

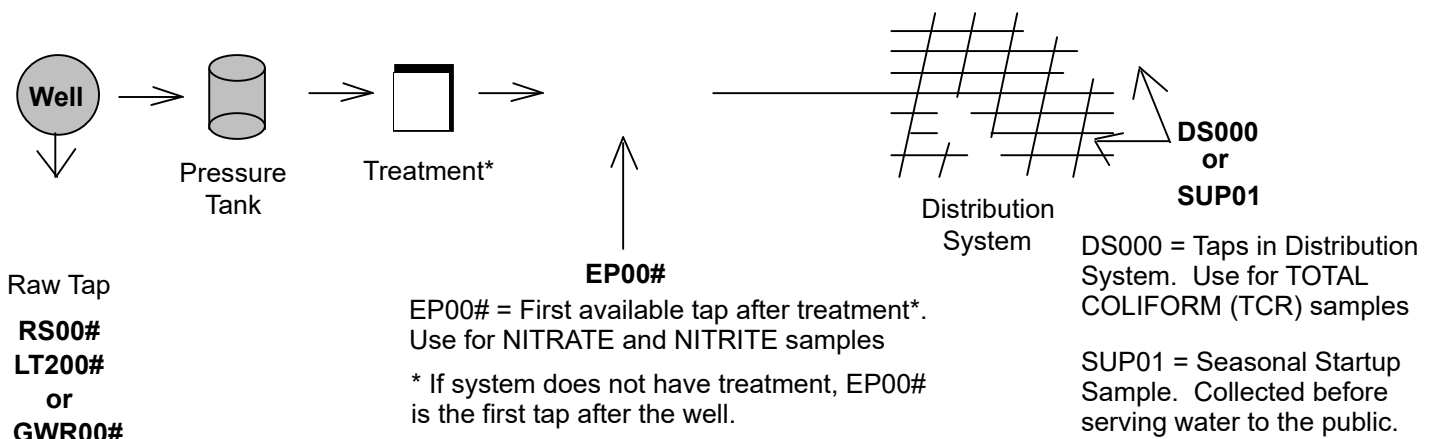

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH3034312 SPRING VALLEY OUTDOORS, INC

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **SPRING VALLEY CAMPGROUND DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 12/31/2020

Where to Collect Samples For a Small Public Water System

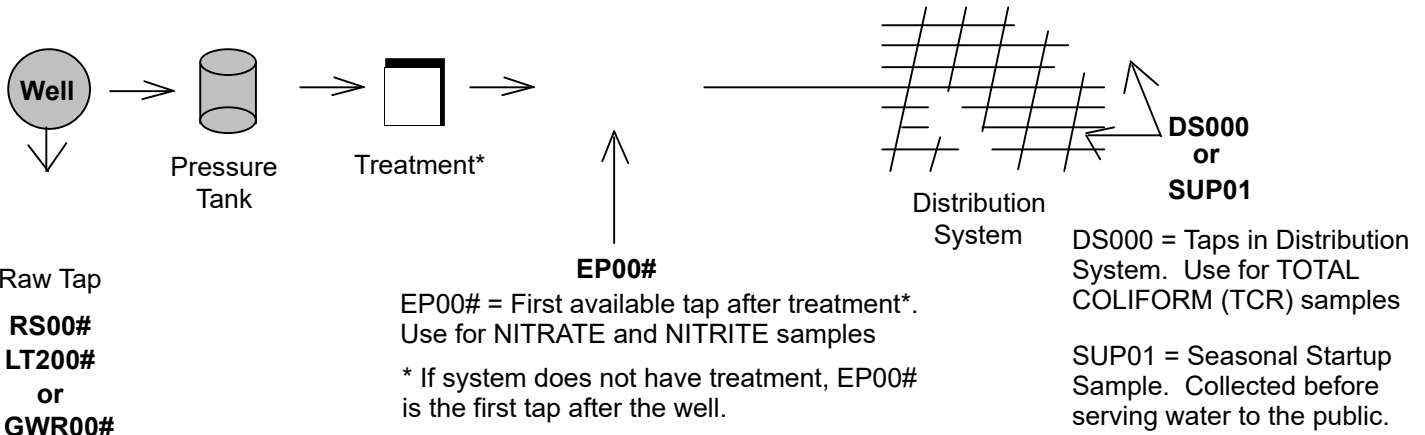

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH3034312 SPRING VALLEY OUTDOORS, INC

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3054729 Facility Name: SPRING VALLEY CAMPGROUND

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2020 and 5/31/2020
NITRATE - 1040	1 Sample(s) Required between 1/1/2020 and 5/31/2020

Where to Collect Samples For a Small Public Water System

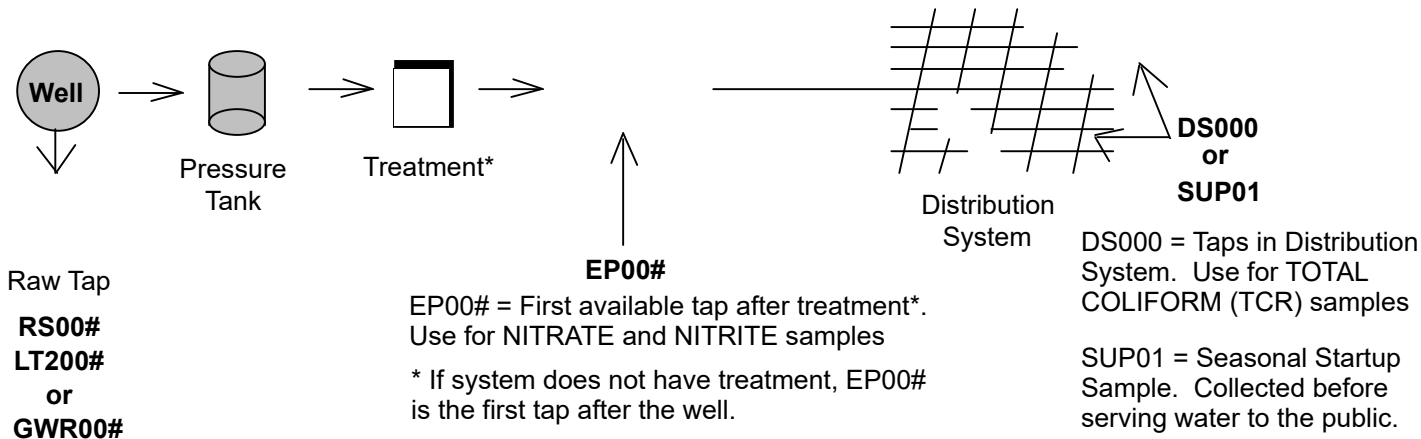

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3053012 SALT FORK UTILITY CO.

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 3054731 SMP ID: EP001	Facility Name: SALT FORK UTILITY CO Facility Source: Ground Water	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2020 and 10/31/2020

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 1 Sample(s) Required between 1/1/2020 and 5/31/2020

NITRATE - 1040 1 Sample(s) Required between 1/1/2020 and 5/31/2020

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 1 Sample(s) Required between 6/1/2020 and 10/31/2020

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 6/1/2020 and 10/31/2020

Effective Date: 01/01/2020

OH3053012 SALT FORK UTILITY CO.

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: SALT FORK UTILITY CO. DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2020 and 1/31/2020
	2 Sample(s) Required between 2/1/2020 and 2/29/2020
	2 Sample(s) Required between 3/1/2020 and 3/31/2020
	2 Sample(s) Required between 4/1/2020 and 4/30/2020
	2 Sample(s) Required between 5/1/2020 and 5/31/2020
	2 Sample(s) Required between 6/1/2020 and 6/30/2020
	2 Sample(s) Required between 7/1/2020 and 7/31/2020
	2 Sample(s) Required between 8/1/2020 and 8/31/2020
	2 Sample(s) Required between 9/1/2020 and 9/30/2020
	2 Sample(s) Required between 10/1/2020 and 10/31/2020
	2 Sample(s) Required between 11/1/2020 and 11/30/2020
	2 Sample(s) Required between 12/1/2020 and 12/31/2020

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: SALT FORK UTILITY CO. DISTRIBUTION PIKES PEAK CLUBHOUSE (PPCH) MOP SINK	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2020 and 9/30/2020 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: SALT FORK UTILITY CO. DISTRIBUTION CABIN L-44 KITCHEN SINK	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2020 and 9/30/2020 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Effective Date: 01/01/2020

OH3053012 SALT FORK UTILITY CO.

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System***THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: SALT FORK UTILITY CO. DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022

5 Sample(s) Required between 6/1/2020 and 9/30/2020

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

Sampling Location	Facility ID: DS1 SMP ID: SUP01	Facility Name: SALT FORK UTILITY CO. DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals**Monitoring Requirements**

TOTAL COLIFORM - SEASONAL STARTUP

At least 1 negative Total Coliform
Bacteria sample prior to serving
water to the public

***** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative. *****

Effective Date: 01/01/2020

OH3053312 GENIE MANAGEMENT, LLC PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **B P FOOD MART DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 3/31/2020 1 Sample(s) Required between 4/1/2020 and 6/30/2020 1 Sample(s) Required between 7/1/2020 and 9/30/2020 1 Sample(s) Required between 10/1/2020 and 12/31/2020

Where to Collect Samples For a Small Public Water System

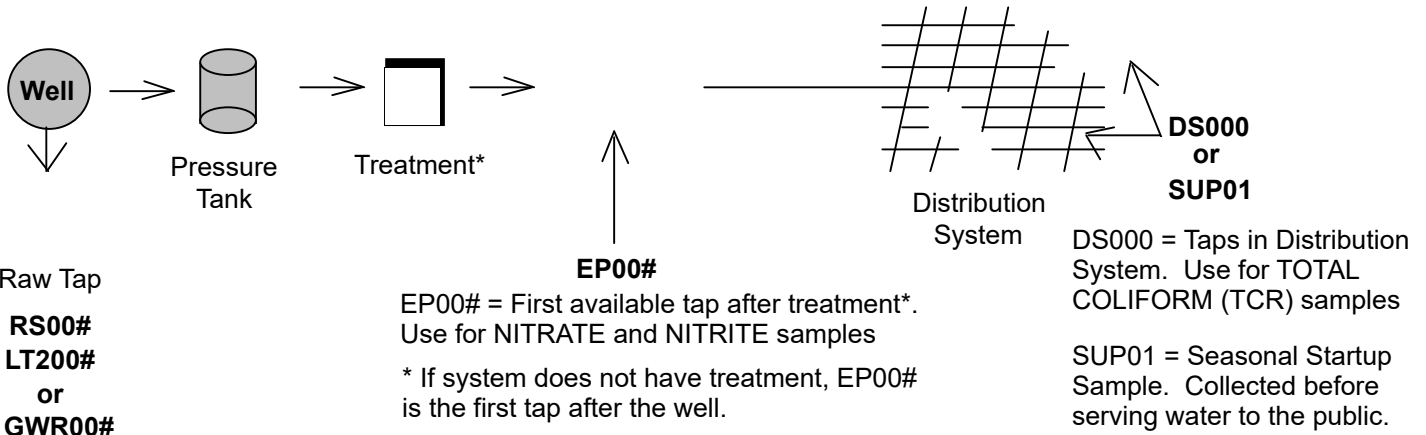

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH3053312 GENIE MANAGEMENT, LLC PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3054732 Facility Name: GENIE MANAGEMENT LLC

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2020 and 5/31/2020
NITRATE - 1040	1 Sample(s) Required between 1/1/2020 and 5/31/2020

Where to Collect Samples For a Small Public Water System

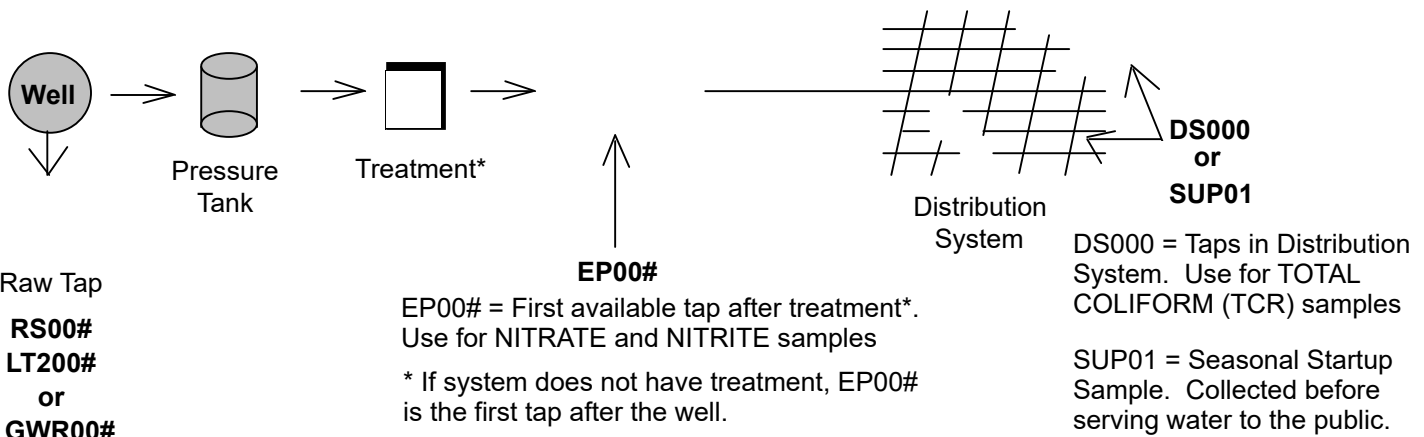

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH3053912 KIMBOLTON MARATHON

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **GARYS BP DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 12/31/2020

Where to Collect Samples For a Small Public Water System

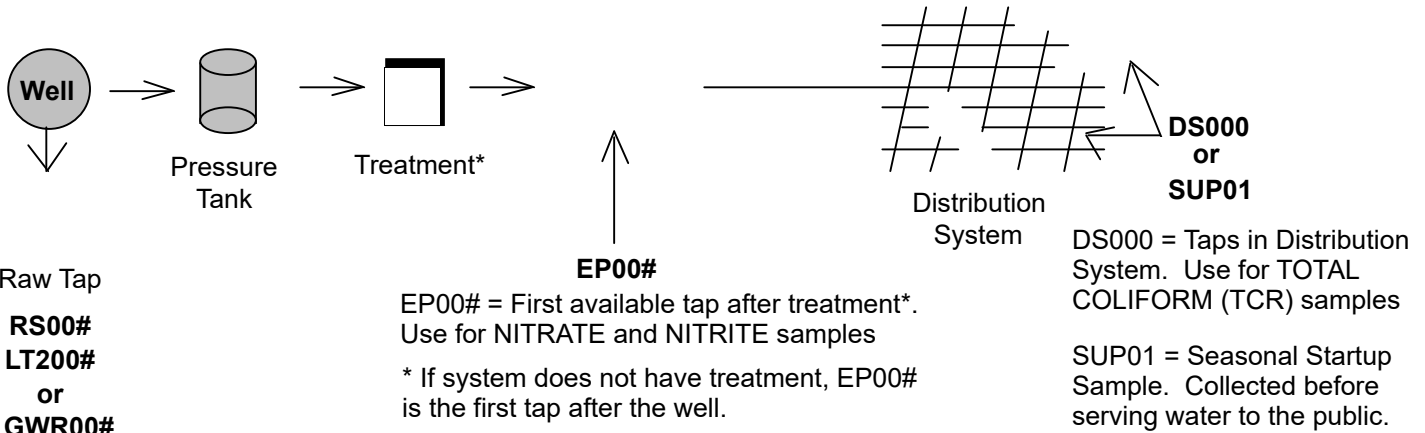

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH3053912 KIMBOLTON MARATHON

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3054736 Facility Name: GARYS BP

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2020 and 5/31/2020
NITRATE - 1040	1 Sample(s) Required between 1/1/2020 and 5/31/2020

Where to Collect Samples For a Small Public Water System

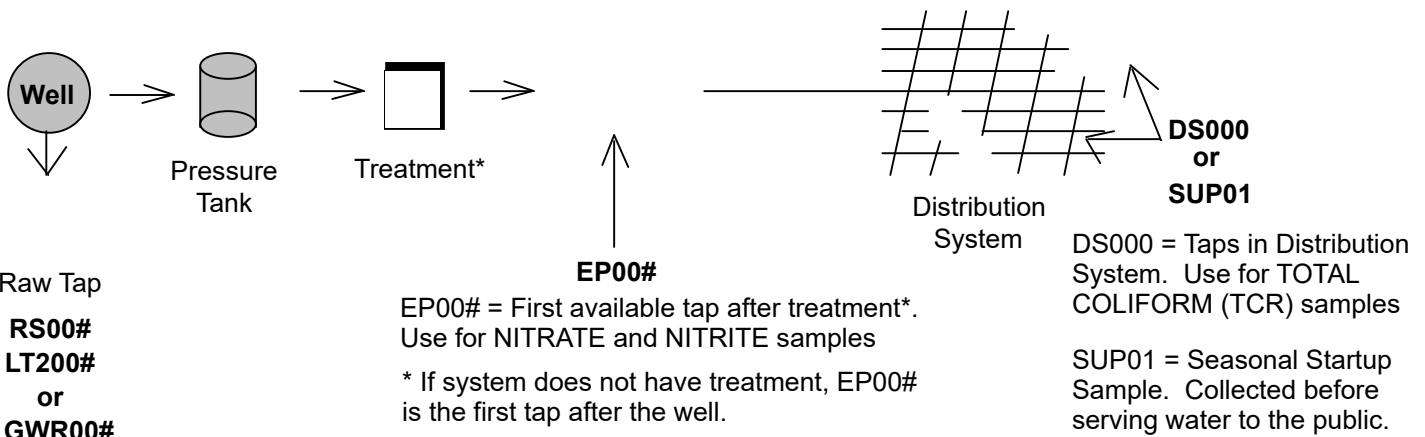

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH3054212 BIG SKY CAMPGROUND

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: BIG SKY CAMPGROUND DISTRIBUTION
Location SMP ID: SUP01 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

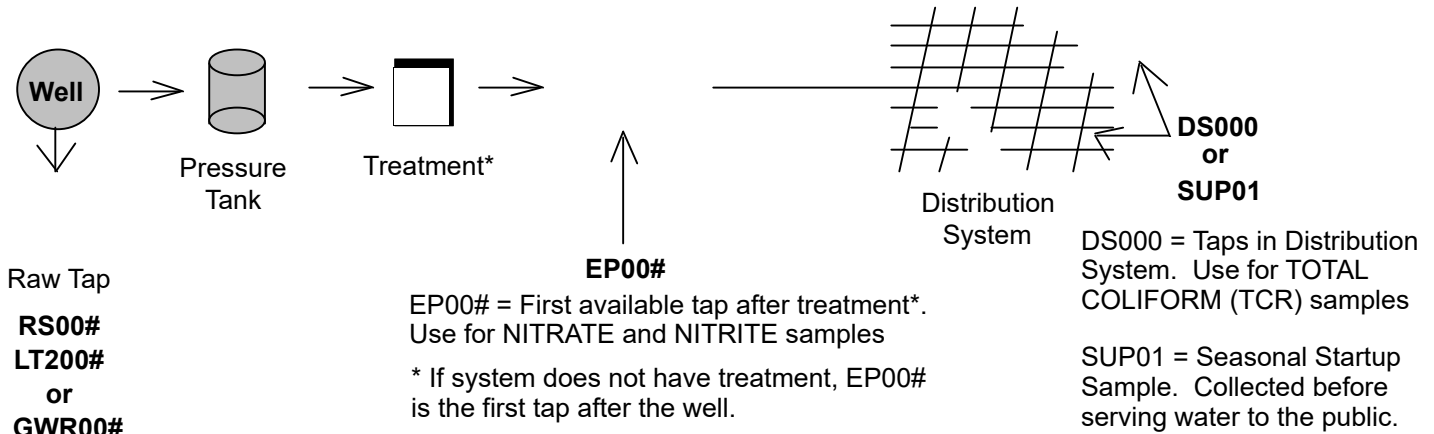

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH3054212 BIG SKY CAMPGROUND

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: BIG SKY CAMPGROUND DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2020 and 6/30/2020 1 Sample(s) Required between 7/1/2020 and 9/30/2020

Where to Collect Samples For a Small Public Water System

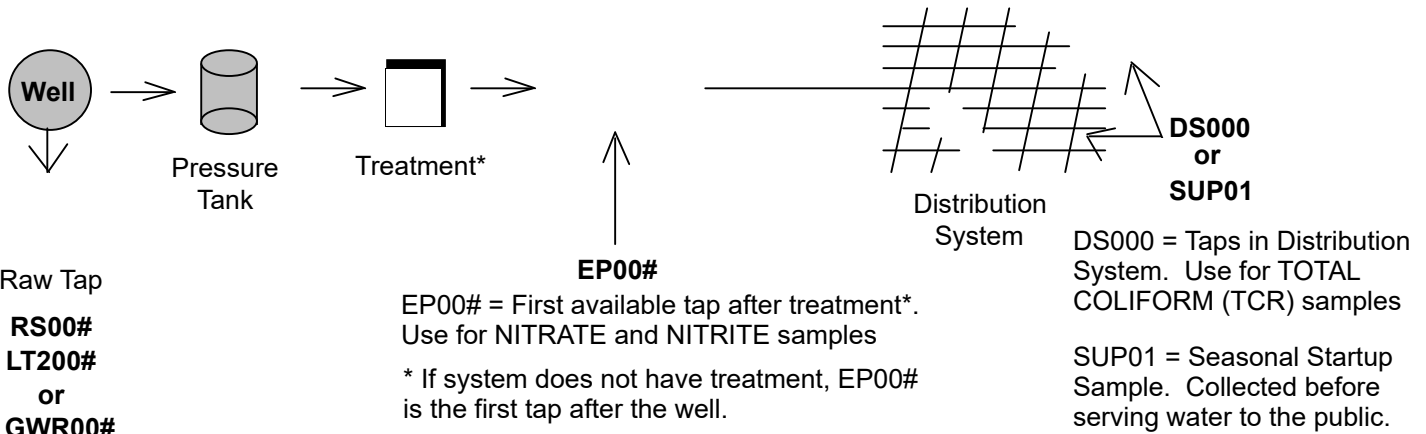

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH3054212 BIG SKY CAMPGROUND

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3054739 Facility Name: BIG SKY CAMPGROUND

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2020 and 5/31/2020
NITRATE - 1040	1 Sample(s) Required between 1/1/2020 and 5/31/2020

Where to Collect Samples For a Small Public Water System

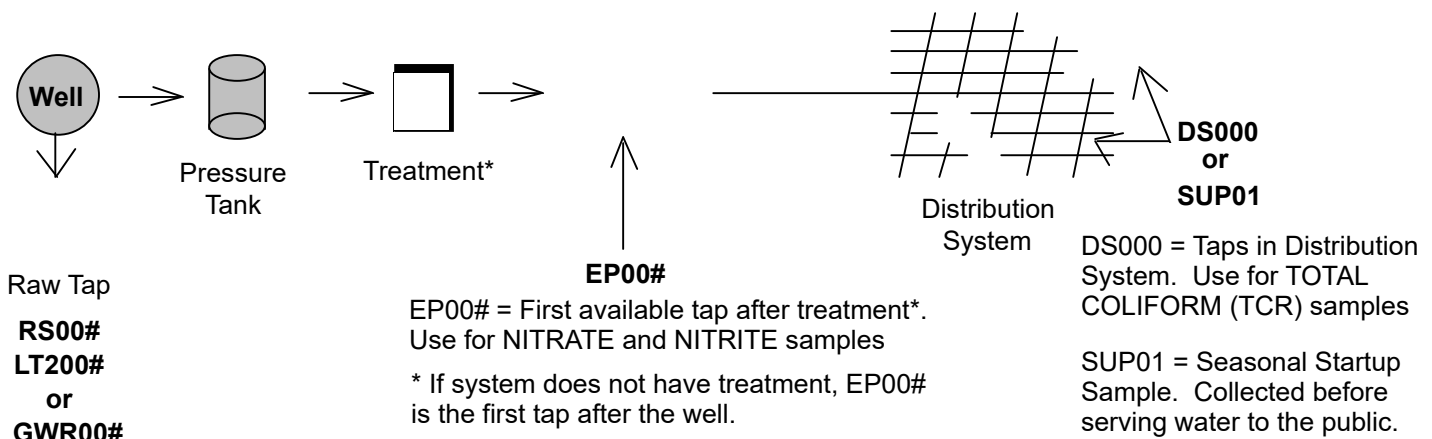

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH3054312 JACKIES FAMILY RESTAURANT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **JACKIES FAMILY RESTAURANT DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 12/31/2020

Where to Collect Samples For a Small Public Water System

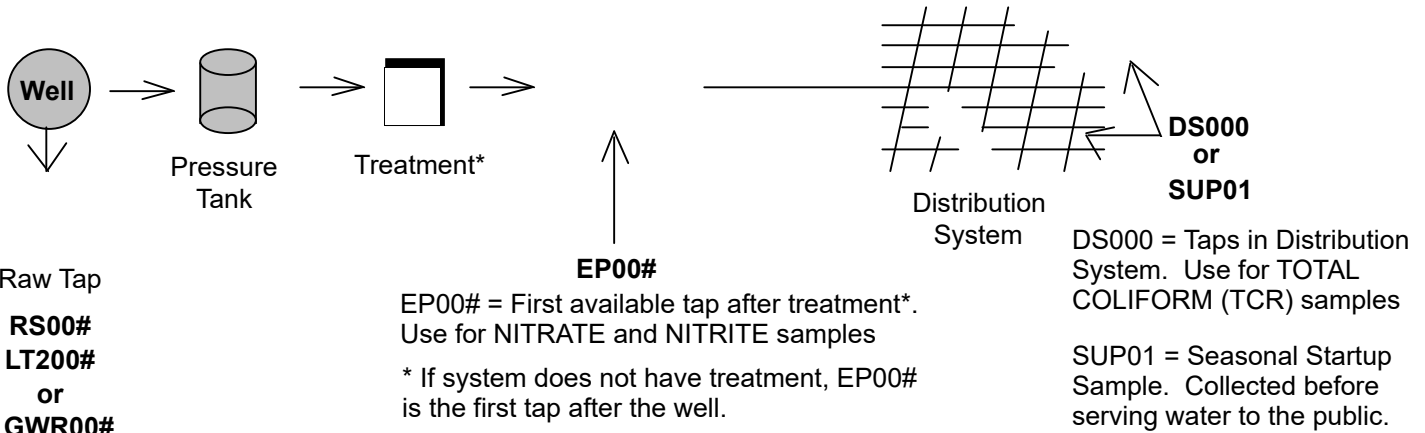

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH3054312 JACKIES FAMILY RESTAURANT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3054740 Facility Name: JACKIES FAMILY RESTAURANT

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2020 and 5/31/2020
NITRATE - 1040	1 Sample(s) Required between 1/1/2020 and 3/31/2020

Where to Collect Samples For a Small Public Water System

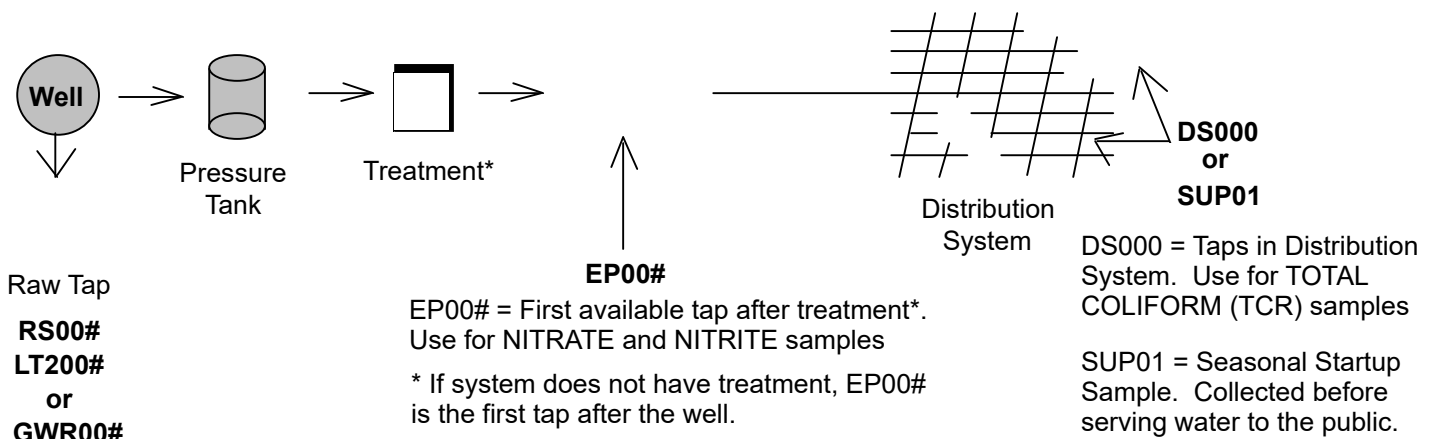

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH3054512 GEORGETOWN WINERY PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **GEORGETOWN WINERY DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 12/31/2020

Where to Collect Samples For a Small Public Water System

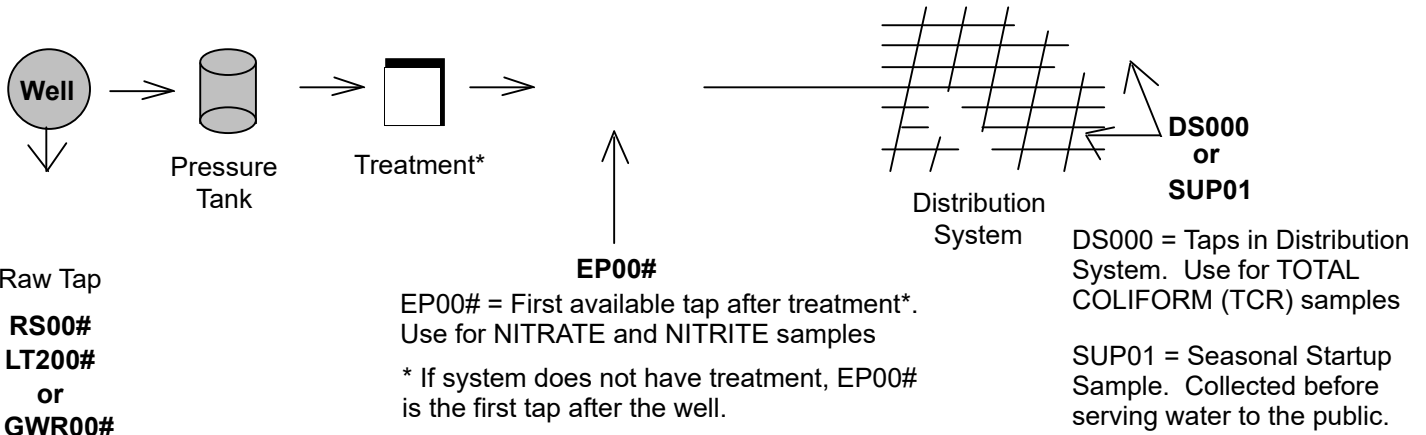

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH3054512 GEORGETOWN WINERY PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3062156 Facility Name: GEORGETOWN WINERY

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2020 and 5/31/2020

Where to Collect Samples For a Small Public Water System

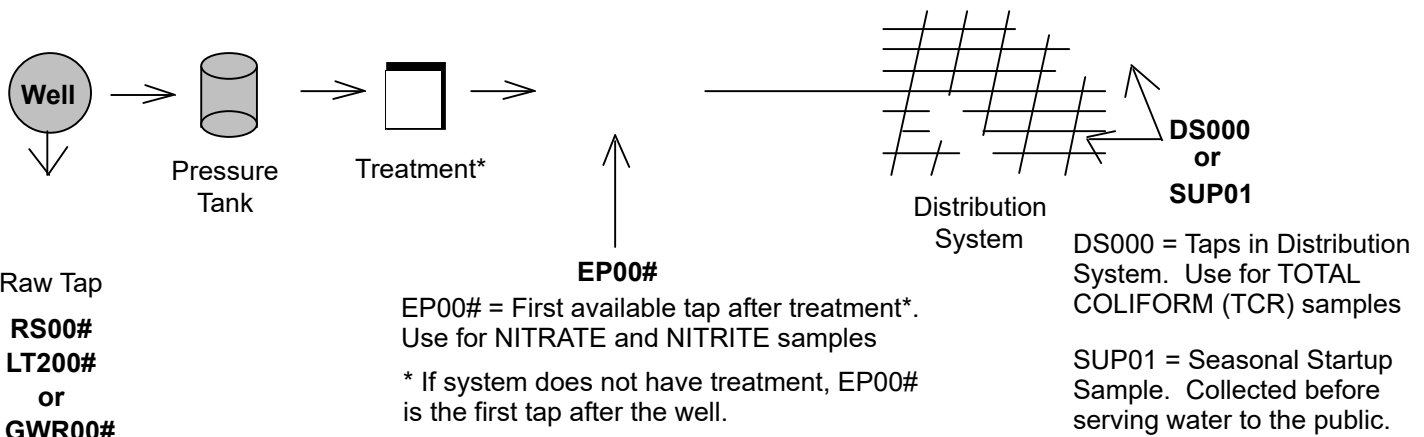

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!