



Effective Date: 01/01/2021

2021 ENTRY POINT SCHEDULE

OH6000212 DRESDEN PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 6056810 SMP ID: EP001	Facility Name: DRESDEN WTP Facility Source: Ground Water	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2021

Chemicals	Monitoring Requirements
INORGANICS <i>Sample for all the analytes listed below:</i> ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	1 Sample(s) Required between 6/1/2021 and 10/31/2021
NITRITE - 1041	1 Sample(s) Required between 6/1/2021 and 10/31/2021
NITRATE - 1040	1 Sample(s) Required between 6/1/2021 and 10/31/2021
RADIOLOGICALS <i>Sample for all the analytes listed below:</i> GROSS ALPHA - 4002 RADIUM-228 - 4030	1 Sample(s) Required between 6/1/2021 and 10/31/2021
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH6000212 DRESDEN PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2021**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: DRESDEN DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2021 and 1/31/2021
	2 Sample(s) Required between 2/1/2021 and 2/28/2021
	2 Sample(s) Required between 3/1/2021 and 3/31/2021
	2 Sample(s) Required between 4/1/2021 and 4/30/2021
	2 Sample(s) Required between 5/1/2021 and 5/31/2021
	2 Sample(s) Required between 6/1/2021 and 6/30/2021
	2 Sample(s) Required between 7/1/2021 and 7/31/2021
	2 Sample(s) Required between 8/1/2021 and 8/31/2021
	2 Sample(s) Required between 9/1/2021 and 9/30/2021
	2 Sample(s) Required between 10/1/2021 and 10/31/2021
	2 Sample(s) Required between 11/1/2021 and 11/30/2021
	2 Sample(s) Required between 12/1/2021 and 12/31/2021
TOTAL CHLORINE - 1000	2 Sample(s) Required between 1/1/2021 and 1/31/2021
	2 Sample(s) Required between 2/1/2021 and 2/28/2021
	2 Sample(s) Required between 3/1/2021 and 3/31/2021
	2 Sample(s) Required between 4/1/2021 and 4/30/2021
	2 Sample(s) Required between 5/1/2021 and 5/31/2021
	2 Sample(s) Required between 6/1/2021 and 6/30/2021
	2 Sample(s) Required between 7/1/2021 and 7/31/2021
	2 Sample(s) Required between 8/1/2021 and 8/31/2021
	2 Sample(s) Required between 9/1/2021 and 9/30/2021
	2 Sample(s) Required between 10/1/2021 and 10/31/2021
	2 Sample(s) Required between 11/1/2021 and 11/30/2021
	2 Sample(s) Required between 12/1/2021 and 12/31/2021

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: DRESDEN DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2021 and 9/30/2021 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH6000212 DRESDEN PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2021**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: DRESDEN DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2021 and 9/30/2021 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: DRESDEN DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 10 Sample(s) Required between 6/1/2021 and 9/30/2021

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



OH6000303 DUNFALLS ASSOCIATION, INC.

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2021

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: DUNFALLS ASSOCIATION, IN DISTRIBUTION	Facility Class: CLASS 1
	SMP ID: DS000		

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2021 and 1/31/2021
	1 Sample(s) Required between 2/1/2021 and 2/28/2021
	1 Sample(s) Required between 3/1/2021 and 3/31/2021
	1 Sample(s) Required between 4/1/2021 and 4/30/2021
	1 Sample(s) Required between 5/1/2021 and 5/31/2021
	1 Sample(s) Required between 6/1/2021 and 6/30/2021
	1 Sample(s) Required between 7/1/2021 and 7/31/2021
	1 Sample(s) Required between 8/1/2021 and 8/31/2021
	1 Sample(s) Required between 9/1/2021 and 9/30/2021
	1 Sample(s) Required between 10/1/2021 and 10/31/2021
	1 Sample(s) Required between 11/1/2021 and 11/30/2021
	1 Sample(s) Required between 12/1/2021 and 12/31/2021
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2021 and 1/31/2021
	1 Sample(s) Required between 2/1/2021 and 2/28/2021
	1 Sample(s) Required between 3/1/2021 and 3/31/2021
	1 Sample(s) Required between 4/1/2021 and 4/30/2021
	1 Sample(s) Required between 5/1/2021 and 5/31/2021
	1 Sample(s) Required between 6/1/2021 and 6/30/2021
	1 Sample(s) Required between 7/1/2021 and 7/31/2021
	1 Sample(s) Required between 8/1/2021 and 8/31/2021
	1 Sample(s) Required between 9/1/2021 and 9/30/2021
	1 Sample(s) Required between 10/1/2021 and 10/31/2021
	1 Sample(s) Required between 11/1/2021 and 11/30/2021
	1 Sample(s) Required between 12/1/2021 and 12/31/2021

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: DUNFALLS ASSOCIATION, IN DISTRIBUTION	Facility Class: CLASS 1
	SMP ID: DS201	ADDRESS NOT KNOWN	

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2021 and 9/30/2021 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2021

2021 DISTRIBUTION SCHEDULE

OH6000303 DUNFALLS ASSOCIATION, INC.

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2021**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: DUNFALLS ASSOCIATION, IN DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022

5 Sample(s) Required between 6/1/2021 and 9/30/2021

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



Effective Date: 01/01/2021

2021 ENTRY POINT SCHEDULE

OH6000412 MUSKINGUM COUNTY WATER - SE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 6056812 SMP ID: EP001	Facility Name: MUSKINGUM COUNTY WATER - SE Facility Source: Ground Water	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2021

Chemicals	Monitoring Requirements
INORGANICS <i>Sample for all the analytes listed below:</i> ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	1 Sample(s) Required between 6/1/2021 and 10/31/2021
NITRITE - 1041	1 Sample(s) Required between 6/1/2021 and 10/31/2021
NITRATE - 1040	1 Sample(s) Required between 6/1/2021 and 10/31/2021
RADIOLOGICALS <i>Sample for all the analytes listed below:</i> GROSS ALPHA - 4002 RADIUM-228 - 4030	1 Sample(s) Required between 6/1/2021 and 10/31/2021
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2021 and 10/31/2021



Effective Date: 01/01/2021

2021 DISTRIBUTION SCHEDULE

OH6000412 MUSKINGUM COUNTY WATER - SE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2021**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: **DS1** Facility Name: **MUSKINGUM COUNTY WATER - SE DISTRIBUT** Facility Class: **CLASS 1**
SMP ID: **DS000**

Chemicals Monitoring Requirements

ASBESTOS - 1094 1 Sample(s) Required between 6/1/2021 and 10/31/2021

Collect one sample at a tap served by asbestos-cement pipe. Due to limited Laboratory capacity and a 48 hour filtering requirement, contact your lab early in the monitoring period to schedule a sampling date.

TOTAL COLIFORM (TCR) - 3100
20 Sample(s) Required between 1/1/2021 and 1/31/2021
20 Sample(s) Required between 2/1/2021 and 2/28/2021
20 Sample(s) Required between 3/1/2021 and 3/31/2021
20 Sample(s) Required between 4/1/2021 and 4/30/2021
20 Sample(s) Required between 5/1/2021 and 5/31/2021
20 Sample(s) Required between 6/1/2021 and 6/30/2021
20 Sample(s) Required between 7/1/2021 and 7/31/2021
20 Sample(s) Required between 8/1/2021 and 8/31/2021
20 Sample(s) Required between 9/1/2021 and 9/30/2021
20 Sample(s) Required between 10/1/2021 and 10/31/2021
20 Sample(s) Required between 11/1/2021 and 11/30/2021
20 Sample(s) Required between 12/1/2021 and 12/31/2021

TOTAL CHLORINE - 1000
20 Sample(s) Required between 1/1/2021 and 1/31/2021
20 Sample(s) Required between 2/1/2021 and 2/28/2021
20 Sample(s) Required between 3/1/2021 and 3/31/2021
20 Sample(s) Required between 4/1/2021 and 4/30/2021
20 Sample(s) Required between 5/1/2021 and 5/31/2021
20 Sample(s) Required between 6/1/2021 and 6/30/2021
20 Sample(s) Required between 7/1/2021 and 7/31/2021
20 Sample(s) Required between 8/1/2021 and 8/31/2021
20 Sample(s) Required between 9/1/2021 and 9/30/2021
20 Sample(s) Required between 10/1/2021 and 10/31/2021
20 Sample(s) Required between 11/1/2021 and 11/30/2021
20 Sample(s) Required between 12/1/2021 and 12/31/2021

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location Facility ID: **DS1** Facility Name: **MUSKINGUM COUNTY WATER - SE DISTRIBUT** Facility Class: **CLASS 1**
SMP ID: **DS201** **5345 MOLLIES ROCK RD.**

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS
Dual Sample Required between 2/1/2021 and 2/7/2021 at: DS201
Dual Sample Required between 5/1/2021 and 5/7/2021 at: DS201
Dual Sample Required between 8/1/2021 and 8/7/2021 at: DS201

OH6000412 MUSKINGUM COUNTY WATER - SE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2021**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: MUSKINGUM COUNTY WATER - SE DISTRIBUT 5345 MOLLIES ROCK RD.	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

Dual Sample Required between 11/1/2021 and 11/7/2021 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: MUSKINGUM COUNTY WATER - SE DISTRIBUT 8895 TUMBLIN RD.	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

Dual Sample Required between 2/1/2021 and 2/7/2021 at: DS202

Dual Sample Required between 5/1/2021 and 5/7/2021 at: DS202

Dual Sample Required between 8/1/2021 and 8/7/2021 at: DS202

Dual Sample Required between 11/1/2021 and 11/7/2021 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS203	Facility Name: MUSKINGUM COUNTY WATER - SE DISTRIBUT 7585 ELM DRIVE	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

Dual Sample Required between 2/1/2021 and 2/7/2021 at: DS203

Dual Sample Required between 5/1/2021 and 5/7/2021 at: DS203

Dual Sample Required between 8/1/2021 and 8/7/2021 at: DS203

Dual Sample Required between 11/1/2021 and 11/7/2021 at: DS203

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS204	Facility Name: MUSKINGUM COUNTY WATER - SE DISTRIBUT 17500 MAIN STREET	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

Dual Sample Required between 2/1/2021 and 2/7/2021 at: DS204

Dual Sample Required between 5/1/2021 and 5/7/2021 at: DS204

Dual Sample Required between 8/1/2021 and 8/7/2021 at: DS204



OH6000412 MUSKINGUM COUNTY WATER - SE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2021**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS204	Facility Name: MUSKINGUM COUNTY WATER - SE DISTRIBUT 17500 MAIN STREET	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 11/1/2021 and 11/7/2021 at: DS204

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: MUSKINGUM COUNTY WATER - SE DISTRIBUT Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 30 Sample(s) Required between 6/1/2021 and 9/30/2021

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



Effective Date: 01/01/2021

2021 ENTRY POINT SCHEDULE

OH6000612 FRAZEYSBURG PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 6056814	Facility Name: FRAZEYSBURG	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2021

Chemicals	Monitoring Requirements
ARSENIC - 1005	1 Sample(s) Required between 1/1/2021 and 3/31/2021 1 Sample(s) Required between 4/1/2021 and 6/30/2021 1 Sample(s) Required between 7/1/2021 and 9/30/2021 1 Sample(s) Required between 10/1/2021 and 12/31/2021
INORGANICS	1 Sample(s) Required between 6/1/2021 and 10/31/2021
<u>Sample for all the analytes listed below:</u>	
ANTIMONY, TOTAL - 1074 BARIUM - 1010 BERYLLIUM, TOTAL - 1011 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1046	
NITRITE - 1041	1 Sample(s) Required between 6/1/2021 and 10/31/2021
NITRATE - 1040	1 Sample(s) Required between 6/1/2021 and 10/31/2021
RADIOLOGICALS	1 Sample(s) Required between 6/1/2021 and 10/31/2021
<u>Sample for all the analytes listed below:</u>	
GROSS ALPHA - 4002 RADIUM-228 - 4030	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2021 and 10/31/2021



Effective Date: 01/01/2021

2021 DISTRIBUTION SCHEDULE

OH6000612 FRAZEYSBURG PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2021**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: FRAZEYSBURG DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2021 and 1/31/2021
	2 Sample(s) Required between 2/1/2021 and 2/28/2021
	2 Sample(s) Required between 3/1/2021 and 3/31/2021
	2 Sample(s) Required between 4/1/2021 and 4/30/2021
	2 Sample(s) Required between 5/1/2021 and 5/31/2021
	2 Sample(s) Required between 6/1/2021 and 6/30/2021
	2 Sample(s) Required between 7/1/2021 and 7/31/2021
	2 Sample(s) Required between 8/1/2021 and 8/31/2021
	2 Sample(s) Required between 9/1/2021 and 9/30/2021
	2 Sample(s) Required between 10/1/2021 and 10/31/2021
	2 Sample(s) Required between 11/1/2021 and 11/30/2021
	2 Sample(s) Required between 12/1/2021 and 12/31/2021
TOTAL CHLORINE - 1000	2 Sample(s) Required between 1/1/2021 and 1/31/2021
	2 Sample(s) Required between 2/1/2021 and 2/28/2021
	2 Sample(s) Required between 3/1/2021 and 3/31/2021
	2 Sample(s) Required between 4/1/2021 and 4/30/2021
	2 Sample(s) Required between 5/1/2021 and 5/31/2021
	2 Sample(s) Required between 6/1/2021 and 6/30/2021
	2 Sample(s) Required between 7/1/2021 and 7/31/2021
	2 Sample(s) Required between 8/1/2021 and 8/31/2021
	2 Sample(s) Required between 9/1/2021 and 9/30/2021
	2 Sample(s) Required between 10/1/2021 and 10/31/2021
	2 Sample(s) Required between 11/1/2021 and 11/30/2021
	2 Sample(s) Required between 12/1/2021 and 12/31/2021

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: FRAZEYSBURG DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2021 and 9/30/2021 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2021

2021 DISTRIBUTION SCHEDULE

OH6000612 FRAZEYSBURG PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2021**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: FRAZEYSBURG DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2021 and 9/30/2021 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: FRAZEYSBURG DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required



OH6001411 MAYSVILLE REGIONAL WATER

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 6056818	Facility Name: MAYSVILLE REGIONAL WATER DISTRICT	Facility Class: CLASS 3
	SMP ID: EP001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2021

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2021 and 10/31/2021
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020	
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	1 Sample(s) Required between 6/1/2021 and 10/31/2021
NITRATE - 1040	1 Sample(s) Required between 1/1/2021 and 1/31/2021 1 Sample(s) Required between 2/1/2021 and 2/28/2021 1 Sample(s) Required between 3/1/2021 and 3/31/2021 1 Sample(s) Required between 4/1/2021 and 4/30/2021 1 Sample(s) Required between 5/1/2021 and 5/31/2021 1 Sample(s) Required between 6/1/2021 and 6/30/2021 1 Sample(s) Required between 7/1/2021 and 7/31/2021 1 Sample(s) Required between 8/1/2021 and 8/31/2021 1 Sample(s) Required between 9/1/2021 and 9/30/2021 1 Sample(s) Required between 10/1/2021 and 10/31/2021 1 Sample(s) Required between 11/1/2021 and 11/30/2021 1 Sample(s) Required between 12/1/2021 and 12/31/2021
RADIOLOGICALS	1 Sample(s) Required between 6/1/2021 and 10/31/2021
<i>Sample for all the analytes listed below:</i>	
GROSS ALPHA - 4002 RADIUM-228 - 4030	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2021 and 6/30/2021
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2021 and 3/31/2021 1 Sample(s) Required between 4/1/2021 and 6/30/2021 1 Sample(s) Required between 7/1/2021 and 9/30/2021 1 Sample(s) Required between 10/1/2021 and 12/31/2021
TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between 1/1/2021 and 1/31/2021 1 Paired Sample Set Required between 2/1/2021 and 2/28/2021 1 Paired Sample Set Required between 3/1/2021 and 3/31/2021 1 Paired Sample Set Required between 4/1/2021 and 4/30/2021 1 Paired Sample Set Required between 5/1/2021 and 5/31/2021 1 Paired Sample Set Required between 6/1/2021 and 6/30/2021 1 Paired Sample Set Required between 7/1/2021 and 7/31/2021 1 Paired Sample Set Required between 8/1/2021 and 8/31/2021 1 Paired Sample Set Required between 9/1/2021 and 9/30/2021 1 Paired Sample Set Required between 10/1/2021 and 10/31/2021 1 Paired Sample Set Required between 11/1/2021 and 11/30/2021 1 Paired Sample Set Required between 12/1/2021 and 12/31/2021

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



Effective Date: 01/01/2021

2021 ENTRY POINT SCHEDULE

OH6001411 MAYSVILLE REGIONAL WATER

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 6056818	Facility Name: MAYSVILLE REGIONAL WATER DISTRICT
Location	SMP ID: EP001/LT2001	Facility Source: Surface Water Facility Class: CLASS 3

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2021**

Chemicals

Monitoring Requirements

TOTAL MICROCYSTINS

1 Sample Set Required WEEKLY*

Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. A week is defined as Sunday through Saturday.

**Weekly sampling unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. Reduced monitoring is contingent on a public water system continuing to experience NO raw or finished water total microcystins detections. Any total microcystins detections during routine (weekly) or reduced sampling will trigger additional sampling. Please refer to the website above for specifics on follow-up sampling requirements.*



OH6001411 MAYSVILLE REGIONAL WATER

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 6056818	Facility Name: MAYSVILLE REGIONAL WATER DISTRICT
Location	SMP ID: LT2001	Facility Source: Surface Water
		Facility Class: CLASS 3

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2021

Chemicals	Monitoring Requirements
-----------	-------------------------

CYANOBACTERIA SCREENING	1 Sample(s) Required between 12/27/2020 and 1/2/2021
	1 Sample(s) Required between 1/10/2021 and 1/16/2021
	1 Sample(s) Required between 1/24/2021 and 1/30/2021
	1 Sample(s) Required between 2/7/2021 and 2/13/2021
	1 Sample(s) Required between 2/21/2021 and 2/27/2021
	1 Sample(s) Required between 3/7/2021 and 3/13/2021
	1 Sample(s) Required between 3/21/2021 and 3/27/2021
	1 Sample(s) Required between 4/4/2021 and 4/10/2021
	1 Sample(s) Required between 4/18/2021 and 4/24/2021
	1 Sample(s) Required between 5/2/2021 and 5/8/2021
	1 Sample(s) Required between 5/16/2021 and 5/22/2021
	1 Sample(s) Required between 5/30/2021 and 6/5/2021
	1 Sample(s) Required between 6/13/2021 and 6/19/2021
	1 Sample(s) Required between 6/27/2021 and 7/3/2021
	1 Sample(s) Required between 7/11/2021 and 7/17/2021
	1 Sample(s) Required between 7/25/2021 and 7/31/2021
	1 Sample(s) Required between 8/8/2021 and 8/14/2021
	1 Sample(s) Required between 8/22/2021 and 8/28/2021
	1 Sample(s) Required between 9/5/2021 and 9/11/2021
	1 Sample(s) Required between 9/19/2021 and 9/25/2021
1 Sample(s) Required between 10/3/2021 and 10/9/2021	
1 Sample(s) Required between 10/17/2021 and 10/23/2021	
1 Sample(s) Required between 10/31/2021 and 11/6/2021	
1 Sample(s) Required between 11/14/2021 and 11/20/2021	
1 Sample(s) Required between 11/28/2021 and 12/4/2021	
1 Sample(s) Required between 12/12/2021 and 12/18/2021	

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. As of 12/31/17, all public water systems are responsible for contracting with a lab certified to perform cyanobacteria screening (qPCR). Please review the website for further information pertaining to follow-up sampling requirements for cyanobacteria screening gene detections, and certified labs that can perform analysis.

OH6001411 MAYSVILLE REGIONAL WATER

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2021**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: MAYSVILLE REGIONAL WATER DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
------------------	--------------------------------

TOTAL COLIFORM (TCR) - 3100	7 Sample(s) Required between 1/1/2021 and 1/31/2021
	7 Sample(s) Required between 2/1/2021 and 2/28/2021
	7 Sample(s) Required between 3/1/2021 and 3/31/2021
	7 Sample(s) Required between 4/1/2021 and 4/30/2021
	7 Sample(s) Required between 5/1/2021 and 5/31/2021
	7 Sample(s) Required between 6/1/2021 and 6/30/2021
	7 Sample(s) Required between 7/1/2021 and 7/31/2021
	7 Sample(s) Required between 8/1/2021 and 8/31/2021
	7 Sample(s) Required between 9/1/2021 and 9/30/2021
	7 Sample(s) Required between 10/1/2021 and 10/31/2021
	7 Sample(s) Required between 11/1/2021 and 11/30/2021
	7 Sample(s) Required between 12/1/2021 and 12/31/2021

TOTAL CHLORINE - 1000	7 Sample(s) Required between 1/1/2021 and 1/31/2021
	7 Sample(s) Required between 2/1/2021 and 2/28/2021
	7 Sample(s) Required between 3/1/2021 and 3/31/2021
	7 Sample(s) Required between 4/1/2021 and 4/30/2021
	7 Sample(s) Required between 5/1/2021 and 5/31/2021
	7 Sample(s) Required between 6/1/2021 and 6/30/2021
	7 Sample(s) Required between 7/1/2021 and 7/31/2021
	7 Sample(s) Required between 8/1/2021 and 8/31/2021
	7 Sample(s) Required between 9/1/2021 and 9/30/2021
	7 Sample(s) Required between 10/1/2021 and 10/31/2021
	7 Sample(s) Required between 11/1/2021 and 11/30/2021
	7 Sample(s) Required between 12/1/2021 and 12/31/2021

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: MAYSVILLE REGIONAL WATER DISTRIBUTION	Facility Class: CLASS 1
870 LENT ROAD			

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 1/8/2021 and 1/14/2021 at: DS201
	Dual Sample Required between 4/8/2021 and 4/14/2021 at: DS201
	Dual Sample Required between 7/8/2021 and 7/14/2021 at: DS201
	Dual Sample Required between 10/8/2021 and 10/14/2021 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH6001411 MAYSVILLE REGIONAL WATER

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2021

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: MAYSVILLE REGIONAL WATER DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 1/8/2021 and 1/14/2021 at: DS202
	Dual Sample Required between 4/8/2021 and 4/14/2021 at: DS202
	Dual Sample Required between 7/8/2021 and 7/14/2021 at: DS202
	Dual Sample Required between 10/8/2021 and 10/14/2021 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: MAYSVILLE REGIONAL WATER DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	40 Sample(s) Required between 1/1/2021 and 6/30/2021
	40 Sample(s) Required between 7/1/2021 and 12/31/2021

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



OH6001711 NEW CONCORD PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 6056819 SMP ID: EP001	Facility Name: NEW CONCORD WTP Facility Source: Surface Water	Facility Class: CLASS 3
--------------------------	---	--	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2021

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2021 and 10/31/2021
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	1 Sample(s) Required between 6/1/2021 and 10/31/2021
NITRATE - 1040	1 Sample(s) Required between 1/1/2021 and 1/31/2021 1 Sample(s) Required between 2/1/2021 and 2/28/2021 1 Sample(s) Required between 3/1/2021 and 3/31/2021 1 Sample(s) Required between 4/1/2021 and 4/30/2021 1 Sample(s) Required between 5/1/2021 and 5/31/2021 1 Sample(s) Required between 6/1/2021 and 6/30/2021 1 Sample(s) Required between 7/1/2021 and 7/31/2021 1 Sample(s) Required between 8/1/2021 and 8/31/2021 1 Sample(s) Required between 9/1/2021 and 9/30/2021 1 Sample(s) Required between 10/1/2021 and 10/31/2021 1 Sample(s) Required between 11/1/2021 and 11/30/2021 1 Sample(s) Required between 12/1/2021 and 12/31/2021
RADIOLOGICALS	1 Sample(s) Required between 6/1/2021 and 10/31/2021
<i>Sample for all the analytes listed below:</i>	
GROSS ALPHA - 4002 RADIUM-228 - 4030	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2021 and 6/30/2021
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2021 and 10/31/2021
TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between 1/1/2021 and 1/31/2021 1 Paired Sample Set Required between 2/1/2021 and 2/28/2021 1 Paired Sample Set Required between 3/1/2021 and 3/31/2021 1 Paired Sample Set Required between 4/1/2021 and 4/30/2021 1 Paired Sample Set Required between 5/1/2021 and 5/31/2021 1 Paired Sample Set Required between 6/1/2021 and 6/30/2021 1 Paired Sample Set Required between 7/1/2021 and 7/31/2021 1 Paired Sample Set Required between 8/1/2021 and 8/31/2021 1 Paired Sample Set Required between 9/1/2021 and 9/30/2021 1 Paired Sample Set Required between 10/1/2021 and 10/31/2021 1 Paired Sample Set Required between 11/1/2021 and 11/30/2021 1 Paired Sample Set Required between 12/1/2021 and 12/31/2021

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



Effective Date: 01/01/2021

2021 ENTRY POINT SCHEDULE

OH6001711 NEW CONCORD PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 6056819	Facility Name: NEW CONCORD WTP	
Location	SMP ID: EP001/LT2001	Facility Source: Surface Water	Facility Class: CLASS 3

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2021**

Chemicals

Monitoring Requirements

TOTAL MICROCYSTINS

1 Sample Set Required WEEKLY*

Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. A week is defined as Sunday through Saturday.

**Weekly sampling unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. Reduced monitoring is contingent on a public water system continuing to experience NO raw or finished water total microcystins detections. Any total microcystins detections during routine (weekly) or reduced sampling will trigger additional sampling. Please refer to the website above for specifics on follow-up sampling requirements.*



OH6001711 NEW CONCORD PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 6056819	Facility Name: NEW CONCORD WTP	
Location	SMP ID: LT2001	Facility Source: Surface Water	Facility Class: CLASS 3

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2021

Chemicals	Monitoring Requirements
CYANOBACTERIA SCREENING	1 Sample(s) Required between 12/27/2020 and 1/2/2021
	1 Sample(s) Required between 1/10/2021 and 1/16/2021
	1 Sample(s) Required between 1/24/2021 and 1/30/2021
	1 Sample(s) Required between 2/7/2021 and 2/13/2021
	1 Sample(s) Required between 2/21/2021 and 2/27/2021
	1 Sample(s) Required between 3/7/2021 and 3/13/2021
	1 Sample(s) Required between 3/21/2021 and 3/27/2021
	1 Sample(s) Required between 4/4/2021 and 4/10/2021
	1 Sample(s) Required between 4/18/2021 and 4/24/2021
	1 Sample(s) Required between 5/2/2021 and 5/8/2021
	1 Sample(s) Required between 5/16/2021 and 5/22/2021
	1 Sample(s) Required between 5/30/2021 and 6/5/2021
	1 Sample(s) Required between 6/13/2021 and 6/19/2021
	1 Sample(s) Required between 6/27/2021 and 7/3/2021
	1 Sample(s) Required between 7/11/2021 and 7/17/2021
	1 Sample(s) Required between 7/25/2021 and 7/31/2021
	1 Sample(s) Required between 8/8/2021 and 8/14/2021
	1 Sample(s) Required between 8/22/2021 and 8/28/2021
	1 Sample(s) Required between 9/5/2021 and 9/11/2021
	1 Sample(s) Required between 9/19/2021 and 9/25/2021
1 Sample(s) Required between 10/3/2021 and 10/9/2021	
1 Sample(s) Required between 10/17/2021 and 10/23/2021	
1 Sample(s) Required between 10/31/2021 and 11/6/2021	
1 Sample(s) Required between 11/14/2021 and 11/20/2021	
1 Sample(s) Required between 11/28/2021 and 12/4/2021	
1 Sample(s) Required between 12/12/2021 and 12/18/2021	

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. As of 12/31/17, all public water systems are responsible for contracting with a lab certified to perform cyanobacteria screening (qPCR). Please review the website for further information pertaining to follow-up sampling requirements for cyanobacteria screening gene detections, and certified labs that can perform analysis.



OH6001711 NEW CONCORD PWS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2021**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: NEW CONCORD DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
------------------	--------------------------------

ASBESTOS - 1094	1 Sample(s) Required between 6/1/2021 and 10/31/2021
-----------------	--

Collect one sample at a tap served by asbestos-cement pipe. Due to limited Laboratory capacity and a 48 hour filtering requirement, contact your lab early in the monitoring period to schedule a sampling date.

TOTAL COLIFORM (TCR) - 3100	4 Sample(s) Required between 1/1/2021 and 1/31/2021
	4 Sample(s) Required between 2/1/2021 and 2/28/2021
	4 Sample(s) Required between 3/1/2021 and 3/31/2021
	4 Sample(s) Required between 4/1/2021 and 4/30/2021
	4 Sample(s) Required between 5/1/2021 and 5/31/2021
	4 Sample(s) Required between 6/1/2021 and 6/30/2021
	4 Sample(s) Required between 7/1/2021 and 7/31/2021
	4 Sample(s) Required between 8/1/2021 and 8/31/2021
	4 Sample(s) Required between 9/1/2021 and 9/30/2021
	4 Sample(s) Required between 10/1/2021 and 10/31/2021
	4 Sample(s) Required between 11/1/2021 and 11/30/2021
	4 Sample(s) Required between 12/1/2021 and 12/31/2021

TOTAL CHLORINE - 1000	4 Sample(s) Required between 1/1/2021 and 1/31/2021
	4 Sample(s) Required between 2/1/2021 and 2/28/2021
	4 Sample(s) Required between 3/1/2021 and 3/31/2021
	4 Sample(s) Required between 4/1/2021 and 4/30/2021
	4 Sample(s) Required between 5/1/2021 and 5/31/2021
	4 Sample(s) Required between 6/1/2021 and 6/30/2021
	4 Sample(s) Required between 7/1/2021 and 7/31/2021
	4 Sample(s) Required between 8/1/2021 and 8/31/2021
	4 Sample(s) Required between 9/1/2021 and 9/30/2021
	4 Sample(s) Required between 10/1/2021 and 10/31/2021
	4 Sample(s) Required between 11/1/2021 and 11/30/2021
	4 Sample(s) Required between 12/1/2021 and 12/31/2021

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: NEW CONCORD DISTRIBUTION 2255 FRIENDSHIP DRIVE	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 2/1/2021 and 2/7/2021 at: DS201
	Dual Sample Required between 5/1/2021 and 5/7/2021 at: DS201
	Dual Sample Required between 8/1/2021 and 8/7/2021 at: DS201



OH6001711 NEW CONCORD PWS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2021**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: NEW CONCORD DISTRIBUTION 2255 FRIENDSHIP DRIVE	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 11/1/2021 and 11/7/2021 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: NEW CONCORD DISTRIBUTION 294 OLD RIX MILLS ROAD	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS

Dual Sample Required between 2/1/2021 and 2/7/2021 at: DS202

Dual Sample Required between 5/1/2021 and 5/7/2021 at: DS202

Dual Sample Required between 8/1/2021 and 8/7/2021 at: DS202

Dual Sample Required between 11/1/2021 and 11/7/2021 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: NEW CONCORD DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 10 Sample(s) Required between 6/1/2021 and 9/30/2021

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



Effective Date: 01/01/2021

2021 ENTRY POINT SCHEDULE

OH6001912 PHILO

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 6056821	Facility Name: PHILO WTP	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2021

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2021 and 10/31/2021
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020	
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	1 Sample(s) Required between 6/1/2021 and 10/31/2021
NITRATE - 1040	1 Sample(s) Required between 6/1/2021 and 10/31/2021
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2021 and 10/31/2021



OH6001912 PHILO

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2021

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: PHILO DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between	1/1/2021 and 1/31/2021
	2 Sample(s) Required between	2/1/2021 and 2/28/2021
	2 Sample(s) Required between	3/1/2021 and 3/31/2021
	2 Sample(s) Required between	4/1/2021 and 4/30/2021
	2 Sample(s) Required between	5/1/2021 and 5/31/2021
	2 Sample(s) Required between	6/1/2021 and 6/30/2021
	2 Sample(s) Required between	7/1/2021 and 7/31/2021
	2 Sample(s) Required between	8/1/2021 and 8/31/2021
	2 Sample(s) Required between	9/1/2021 and 9/30/2021
	2 Sample(s) Required between	10/1/2021 and 10/31/2021
	2 Sample(s) Required between	11/1/2021 and 11/30/2021
	2 Sample(s) Required between	12/1/2021 and 12/31/2021

TOTAL CHLORINE - 1000	2 Sample(s) Required between	1/1/2021 and 1/31/2021
	2 Sample(s) Required between	2/1/2021 and 2/28/2021
	2 Sample(s) Required between	3/1/2021 and 3/31/2021
	2 Sample(s) Required between	4/1/2021 and 4/30/2021
	2 Sample(s) Required between	5/1/2021 and 5/31/2021
	2 Sample(s) Required between	6/1/2021 and 6/30/2021
	2 Sample(s) Required between	7/1/2021 and 7/31/2021
	2 Sample(s) Required between	8/1/2021 and 8/31/2021
	2 Sample(s) Required between	9/1/2021 and 9/30/2021
	2 Sample(s) Required between	10/1/2021 and 10/31/2021
	2 Sample(s) Required between	11/1/2021 and 11/30/2021
	2 Sample(s) Required between	12/1/2021 and 12/31/2021

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: PHILO DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2021 and 9/30/2021 at: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2021

2021 DISTRIBUTION SCHEDULE

OH6001912 PHILO

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2021

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: PHILO DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2021 and 9/30/2021 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: PHILO DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022 Not Required



OH6002112 ROSEVILLE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2021**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: ROSEVILLE DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

ASBESTOS - 1094	1 Sample(s) Required between 6/1/2021 and 10/31/2021
<i>Collect one sample at a tap served by asbestos-cement pipe. Due to limited Laboratory capacity and a 48 hour filtering requirement, contact your lab early in the monitoring period to schedule a sampling date.</i>	

TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2021 and 1/31/2021
	2 Sample(s) Required between 2/1/2021 and 2/28/2021
	2 Sample(s) Required between 3/1/2021 and 3/31/2021
	2 Sample(s) Required between 4/1/2021 and 4/30/2021
	2 Sample(s) Required between 5/1/2021 and 5/31/2021
	2 Sample(s) Required between 6/1/2021 and 6/30/2021
	2 Sample(s) Required between 7/1/2021 and 7/31/2021
	2 Sample(s) Required between 8/1/2021 and 8/31/2021
	2 Sample(s) Required between 9/1/2021 and 9/30/2021
	2 Sample(s) Required between 10/1/2021 and 10/31/2021
	2 Sample(s) Required between 11/1/2021 and 11/30/2021
	2 Sample(s) Required between 12/1/2021 and 12/31/2021

TOTAL CHLORINE - 1000	2 Sample(s) Required between 1/1/2021 and 1/31/2021
	2 Sample(s) Required between 2/1/2021 and 2/28/2021
	2 Sample(s) Required between 3/1/2021 and 3/31/2021
	2 Sample(s) Required between 4/1/2021 and 4/30/2021
	2 Sample(s) Required between 5/1/2021 and 5/31/2021
	2 Sample(s) Required between 6/1/2021 and 6/30/2021
	2 Sample(s) Required between 7/1/2021 and 7/31/2021
	2 Sample(s) Required between 8/1/2021 and 8/31/2021
	2 Sample(s) Required between 9/1/2021 and 9/30/2021
	2 Sample(s) Required between 10/1/2021 and 10/31/2021
	2 Sample(s) Required between 11/1/2021 and 11/30/2021
	2 Sample(s) Required between 12/1/2021 and 12/31/2021

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: ROSEVILLE DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2021 and 9/30/2021 at: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2021

2021 DISTRIBUTION SCHEDULE

OH6002112 ROSEVILLE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2021**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: ROSEVILLE DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2021 and 9/30/2021 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: ROSEVILLE DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022

20 Sample(s) Required between 1/1/2021 and 6/30/2021

20 Sample(s) Required between 7/1/2021 and 12/31/2021

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



Effective Date: 01/01/2021

2021 ENTRY POINT SCHEDULE

OH6002212 SOUTH ZANESVILLE PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 6056824 SMP ID: EP001	Facility Name: SOUTH ZANESVILLE Facility Source: Ground Water	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2021

Chemicals	Monitoring Requirements
INORGANICS <i>Sample for all the analytes listed below:</i> ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	1 Sample(s) Required between 6/1/2021 and 10/31/2021
NITRITE - 1041	1 Sample(s) Required between 6/1/2021 and 10/31/2021
NITRATE - 1040	1 Sample(s) Required between 6/1/2021 and 10/31/2021
RADIOLOGICALS <i>Sample for all the analytes listed below:</i> GROSS ALPHA - 4002 RADIUM-228 - 4030	1 Sample(s) Required between 6/1/2021 and 10/31/2021
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2021 and 10/31/2021



OH6002212 SOUTH ZANESVILLE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2021**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: SOUTH ZANESVILLE DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
------------------	--------------------------------

TOTAL COLIFORM (TCR) - 3100	3 Sample(s) Required between 1/1/2021 and 1/31/2021
	3 Sample(s) Required between 2/1/2021 and 2/28/2021
	3 Sample(s) Required between 3/1/2021 and 3/31/2021
	3 Sample(s) Required between 4/1/2021 and 4/30/2021
	3 Sample(s) Required between 5/1/2021 and 5/31/2021
	3 Sample(s) Required between 6/1/2021 and 6/30/2021
	3 Sample(s) Required between 7/1/2021 and 7/31/2021
	3 Sample(s) Required between 8/1/2021 and 8/31/2021
	3 Sample(s) Required between 9/1/2021 and 9/30/2021
	3 Sample(s) Required between 10/1/2021 and 10/31/2021
	3 Sample(s) Required between 11/1/2021 and 11/30/2021
	3 Sample(s) Required between 12/1/2021 and 12/31/2021

TOTAL CHLORINE - 1000	3 Sample(s) Required between 1/1/2021 and 1/31/2021
	3 Sample(s) Required between 2/1/2021 and 2/28/2021
	3 Sample(s) Required between 3/1/2021 and 3/31/2021
	3 Sample(s) Required between 4/1/2021 and 4/30/2021
	3 Sample(s) Required between 5/1/2021 and 5/31/2021
	3 Sample(s) Required between 6/1/2021 and 6/30/2021
	3 Sample(s) Required between 7/1/2021 and 7/31/2021
	3 Sample(s) Required between 8/1/2021 and 8/31/2021
	3 Sample(s) Required between 9/1/2021 and 9/30/2021
	3 Sample(s) Required between 10/1/2021 and 10/31/2021
	3 Sample(s) Required between 11/1/2021 and 11/30/2021
	3 Sample(s) Required between 12/1/2021 and 12/31/2021

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: SOUTH ZANESVILLE DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2021 and 9/30/2021 at: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2021

2021 DISTRIBUTION SCHEDULE

OH6002212 SOUTH ZANESVILLE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2021**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: SOUTH ZANESVILLE DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2021 and 9/30/2021 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: SOUTH ZANESVILLE DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 10 Sample(s) Required between 6/1/2021 and 9/30/2021

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



Effective Date: 01/01/2021

2021 ENTRY POINT SCHEDULE

OH6002712 ZANESVILLE PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 6056826 SMP ID: EP001	Facility Name: ZANESVILLE Facility Source: Ground Water	Facility Class: CLASS 3
--------------------------	---	--	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2021

Chemicals	Monitoring Requirements
INORGANICS <i>Sample for all the analytes listed below:</i> ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	1 Sample(s) Required between 6/1/2021 and 10/31/2021
NITRITE - 1041	1 Sample(s) Required between 6/1/2021 and 10/31/2021
NITRATE - 1040	1 Sample(s) Required between 6/1/2021 and 10/31/2021
RADIOLOGICALS <i>Sample for all the analytes listed below:</i> GROSS ALPHA - 4002 RADIUM-228 - 4030	1 Sample(s) Required between 6/1/2021 and 10/31/2021
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 7/1/2021 and 9/30/2021



OH6002712 ZANESVILLE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2021

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: ZANESVILLE DISTRIBUTION	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

ASBESTOS - 1094	1 Sample(s) Required between 6/1/2021 and 10/31/2021
-----------------	--

Collect one sample at a tap served by asbestos-cement pipe. Due to limited Laboratory capacity and a 48 hour filtering requirement, contact your lab early in the monitoring period to schedule a sampling date.

TOTAL COLIFORM (TCR) - 3100	30 Sample(s) Required between 1/1/2021 and 1/31/2021
	30 Sample(s) Required between 2/1/2021 and 2/28/2021
	30 Sample(s) Required between 3/1/2021 and 3/31/2021
	30 Sample(s) Required between 4/1/2021 and 4/30/2021
	30 Sample(s) Required between 5/1/2021 and 5/31/2021
	30 Sample(s) Required between 6/1/2021 and 6/30/2021
	30 Sample(s) Required between 7/1/2021 and 7/31/2021
	30 Sample(s) Required between 8/1/2021 and 8/31/2021
	30 Sample(s) Required between 9/1/2021 and 9/30/2021
	30 Sample(s) Required between 10/1/2021 and 10/31/2021
	30 Sample(s) Required between 11/1/2021 and 11/30/2021
	30 Sample(s) Required between 12/1/2021 and 12/31/2021

TOTAL CHLORINE - 1000	30 Sample(s) Required between 1/1/2021 and 1/31/2021
	30 Sample(s) Required between 2/1/2021 and 2/28/2021
	30 Sample(s) Required between 3/1/2021 and 3/31/2021
	30 Sample(s) Required between 4/1/2021 and 4/30/2021
	30 Sample(s) Required between 5/1/2021 and 5/31/2021
	30 Sample(s) Required between 6/1/2021 and 6/30/2021
	30 Sample(s) Required between 7/1/2021 and 7/31/2021
	30 Sample(s) Required between 8/1/2021 and 8/31/2021
	30 Sample(s) Required between 9/1/2021 and 9/30/2021
	30 Sample(s) Required between 10/1/2021 and 10/31/2021
	30 Sample(s) Required between 11/1/2021 and 11/30/2021
	30 Sample(s) Required between 12/1/2021 and 12/31/2021

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: ZANESVILLE DISTRIBUTION 1403 JEWETT DR.	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2021 and 9/30/2021 at: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2021

2021 DISTRIBUTION SCHEDULE

OH6002712 ZANESVILLE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2021**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS203	Facility Name: ZANESVILLE DISTRIBUTION 804 GROVE RD	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2021 and 9/30/2021 at: DS203

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: ZANESVILLE DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

OH6035612 FRIENDLY HILLS GRANGE CAMP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: FRIENDLY HILLS GRANGE CA DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2021 and 3/31/2021
	1 Sample(s) Required between 4/1/2021 and 6/30/2021
	1 Sample(s) Required between 7/1/2021 and 9/30/2021
	1 Sample(s) Required between 10/1/2021 and 12/31/2021

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6035612 FRIENDLY HILLS GRANGE CAMP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6056843 Facility Name: FRIENDLY HILLS GRANGE CAMP

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 6/1/2021 and 10/31/2021
NITRATE - 1040	1 Sample(s) Required between 6/1/2021 and 10/31/2021

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6037912 WILDFIRE GOLF CLUB

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **WILDFIRE GOLF CLUB DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2021 and 3/31/2021
	1 Sample(s) Required between 4/1/2021 and 6/30/2021
	1 Sample(s) Required between 7/1/2021 and 9/30/2021
	1 Sample(s) Required between 10/1/2021 and 12/31/2021

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6037912 WILDFIRE GOLF CLUB

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **6056850** Facility Name: **WILDFIRE GOLF CLUB**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 6/1/2021 and 10/31/2021
NITRATE - 1040	1 Sample(s) Required between 6/1/2021 and 10/31/2021

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6041312 ODNR-DILLON STATE PARK SPORTS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ODNR-DILLON ST PK SPORTS DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2021 and 3/31/2021
	1 Sample(s) Required between 4/1/2021 and 6/30/2021
	1 Sample(s) Required between 7/1/2021 and 9/30/2021
	1 Sample(s) Required between 10/1/2021 and 12/31/2021

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6041312 ODNR-DILLON STATE PARK SPORTS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6056856 Facility Name: ODNR DILLON ST PK SPORTSMAN CR

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 6/1/2021 and 10/31/2021
NITRATE - 1040	1 Sample(s) Required between 6/1/2021 and 10/31/2021

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6041612 ODNR-ELLIS LOCK AND DAM 11

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: ODNR-ELLIS LOCK & DAM 11 DISTRIBUTION
Location SMP ID: SUP01 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

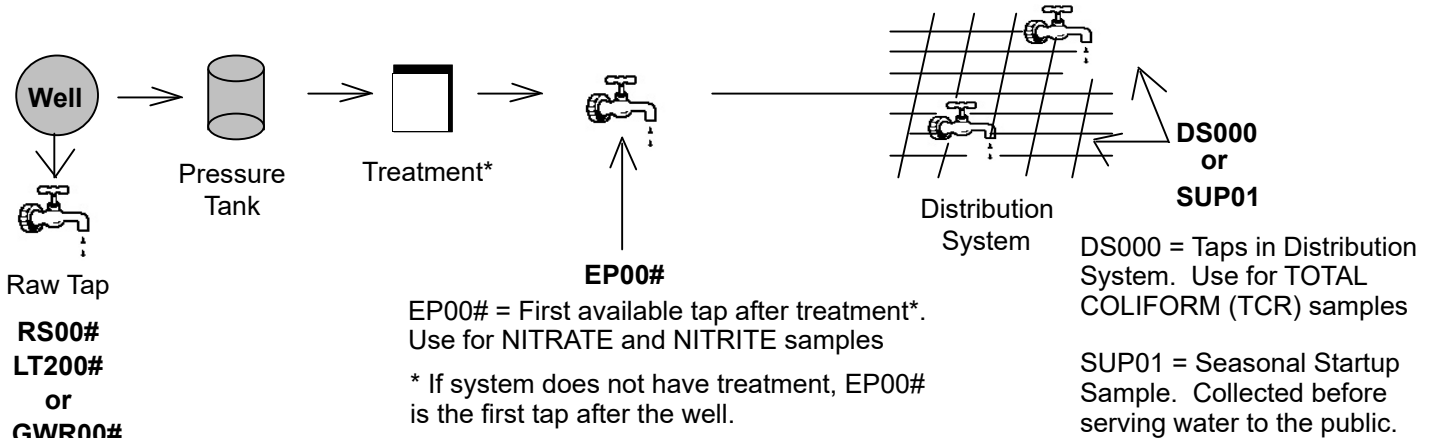

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6041612 ODNR-ELLIS LOCK AND DAM 11

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ODNR-ELLIS LOCK & DAM 11 DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2021 and 4/30/2021
	1 Sample(s) Required between 5/1/2021 and 5/31/2021
	1 Sample(s) Required between 6/1/2021 and 6/30/2021
	1 Sample(s) Required between 7/1/2021 and 7/31/2021
	1 Sample(s) Required between 8/1/2021 and 8/31/2021
	1 Sample(s) Required between 9/1/2021 and 9/30/2021

Where to Collect Samples For a Small Public Water System

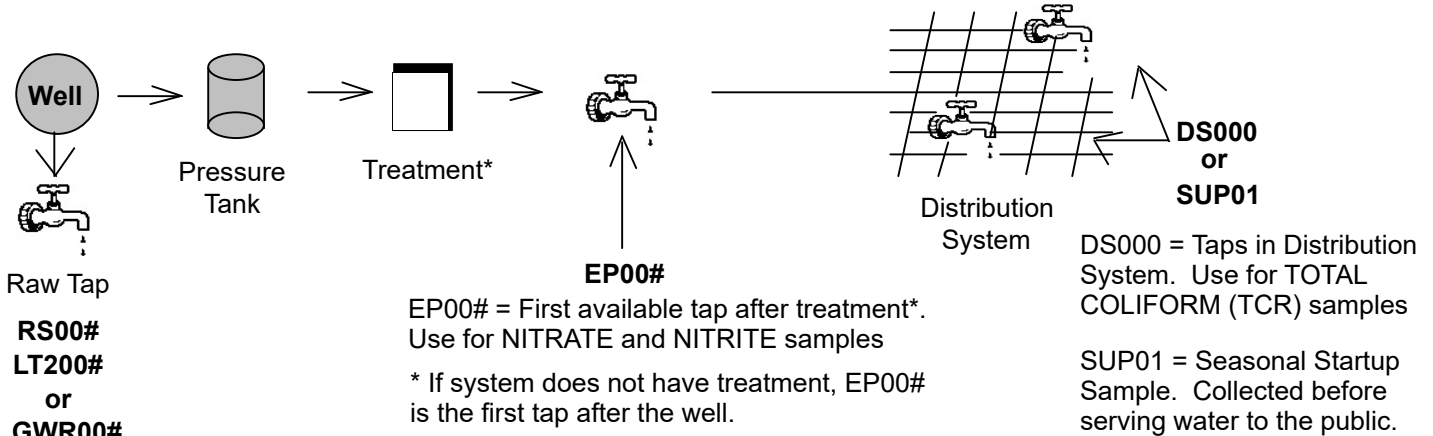

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6041612 ODNR-ELLIS LOCK AND DAM 11

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6056858 Facility Name: ODNR ELLIS LOCK & DAM NO 11
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 6/1/2021 and 10/31/2021
NITRATE - 1040	1 Sample(s) Required between 6/1/2021 and 10/31/2021

Where to Collect Samples For a Small Public Water System

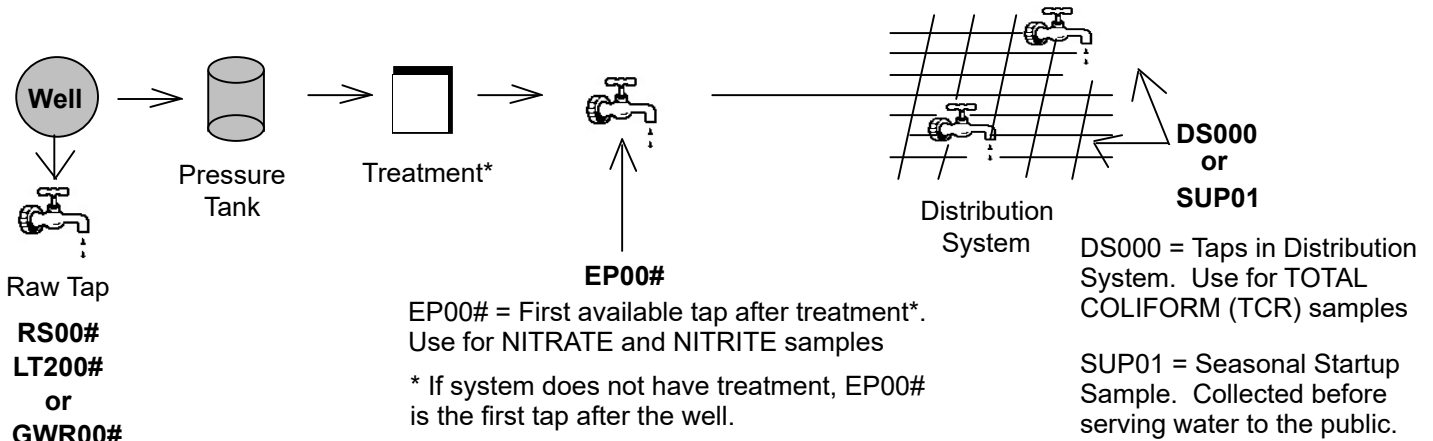

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2021

2021 ENTRY POINT SCHEDULE

OH6042812 EAST CENTRAL OHIO BUSINESS PARK

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 6060574	Facility Name: EAST CENTRAL OHIO BUS. PARK STU 2	Facility Class: CLASS 1
	SMP ID: EP002	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	
ARSENIC - 1005	1 Sample(s) Required between	1/1/2021 and 3/31/2021
	1 Sample(s) Required between	4/1/2021 and 6/30/2021
	1 Sample(s) Required between	7/1/2021 and 9/30/2021
	1 Sample(s) Required between	10/1/2021 and 12/31/2021
INORGANICS	1 Sample(s) Required between	6/1/2021 and 10/31/2021
<i>Sample for all the analytes listed below:</i>		
ANTIMONY, TOTAL - 1074 BARIUM - 1010 BERYLLIUM, TOTAL - 1015 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024		
FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1045		
NITRITE - 1041	1 Sample(s) Required between	6/1/2021 and 10/31/2021
NITRATE - 1040	1 Sample(s) Required between	6/1/2021 and 10/31/2021
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	6/1/2021 and 10/31/2021



OH6042812 EAST CENTRAL OHIO BUSINESS PARK

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: EAST CENTRAL OHIO BUS. PARK DISTRIBUTI	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2021 and 3/31/2021 1 Sample(s) Required between 4/1/2021 and 6/30/2021 1 Sample(s) Required between 7/1/2021 and 9/30/2021 1 Sample(s) Required between 10/1/2021 and 12/31/2021
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2021 and 3/31/2021 1 Sample(s) Required between 4/1/2021 and 6/30/2021 1 Sample(s) Required between 7/1/2021 and 9/30/2021 1 Sample(s) Required between 10/1/2021 and 12/31/2021

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: EAST CENTRAL OHIO BUS. PARK DISTRIBUTI ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2021 and 9/30/2021 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: EAST CENTRAL OHIO BUS. PARK DISTRIBUTI Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required

OH6043112 NORTHGATE OPEN BIBLE CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: NORTHGATE OPEN BIBLE CHURCH DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2021 and 3/31/2021
	1 Sample(s) Required between 4/1/2021 and 6/30/2021
	1 Sample(s) Required between 7/1/2021 and 9/30/2021
	1 Sample(s) Required between 10/1/2021 and 12/31/2021

Where to Collect Samples For a Small Public Water System

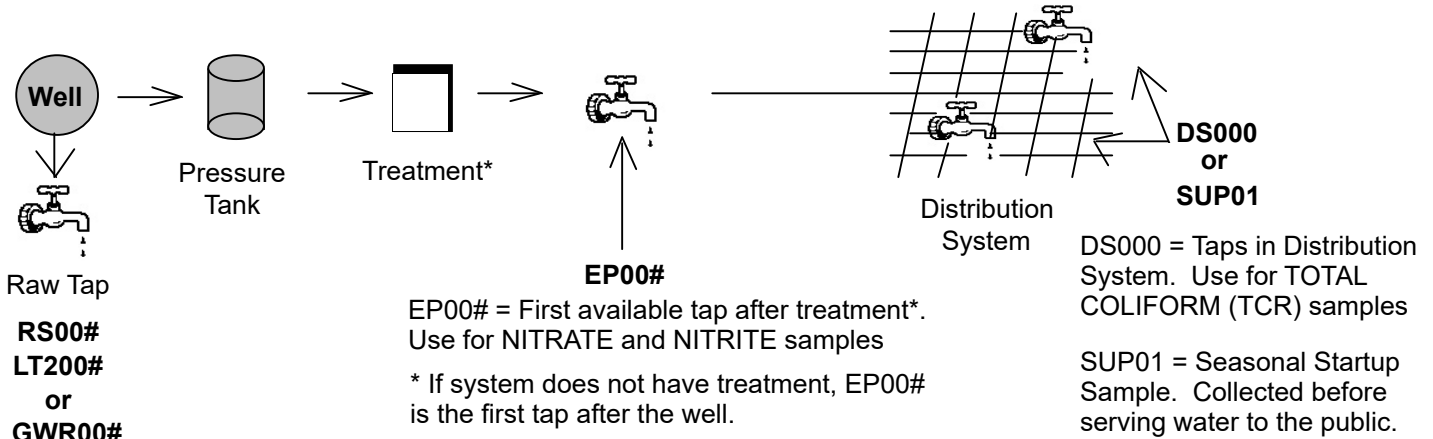

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6043112 NORTHGATE OPEN BIBLE CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6056866 Facility Name: NORTHGATE OPEN BIBLE CHURCH
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 6/1/2021 and 10/31/2021
NITRATE - 1040	1 Sample(s) Required between 6/1/2021 and 10/31/2021

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2021

2021 ENTRY POINT SCHEDULE

OH6045112 AEP DRESDEN FACILITY ADM PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 6061559	Facility Name: AEP DRESDEN FACILITY ADM	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2021 and 10/31/2021

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 1 Sample(s) Required between 6/1/2021 and 10/31/2021

NITRATE - 1040 1 Sample(s) Required between 6/1/2021 and 10/31/2021

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 Not Required

VOLATILE ORGANIC CHEMICALS (VOC) Not Required



OH6045112 AEP DRESDEN FACILITY ADM PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **AEP DRESDEN FACILITY ADM. DISTRIBUTION** Facility Class: **CLASS 1**
Location SMP ID: **DS000**

Chemicals

Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100
1 Sample(s) Required between 1/1/2021 and 3/31/2021
1 Sample(s) Required between 4/1/2021 and 6/30/2021
1 Sample(s) Required between 7/1/2021 and 9/30/2021
1 Sample(s) Required between 10/1/2021 and 12/31/2021

Sampling Facility ID: **DS1** Facility Name: **AEP DRESDEN FACILITY ADM. DISTRIBUTION** Facility Class: **CLASS 1**
Location SMP ID: **DS201** **ADDRESS NOT KNOWN**

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2021 and 9/30/2021 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Facility ID: **DS1** Facility Name: **AEP DRESDEN FACILITY ADM. DISTRIBUTION** Facility Class: **CLASS 1**
Location SMP ID: **LC###** **Refer to your Lead and Copper plan for SMP IDs**

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2021 and 9/30/2021

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

OH6045312 RHEMA HOUSE OF WORSHIP PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **RHEMA HOUSE OF WORSHIP DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2021 and 3/31/2021
	1 Sample(s) Required between 4/1/2021 and 6/30/2021
	1 Sample(s) Required between 7/1/2021 and 9/30/2021
	1 Sample(s) Required between 10/1/2021 and 12/31/2021

Where to Collect Samples For a Small Public Water System

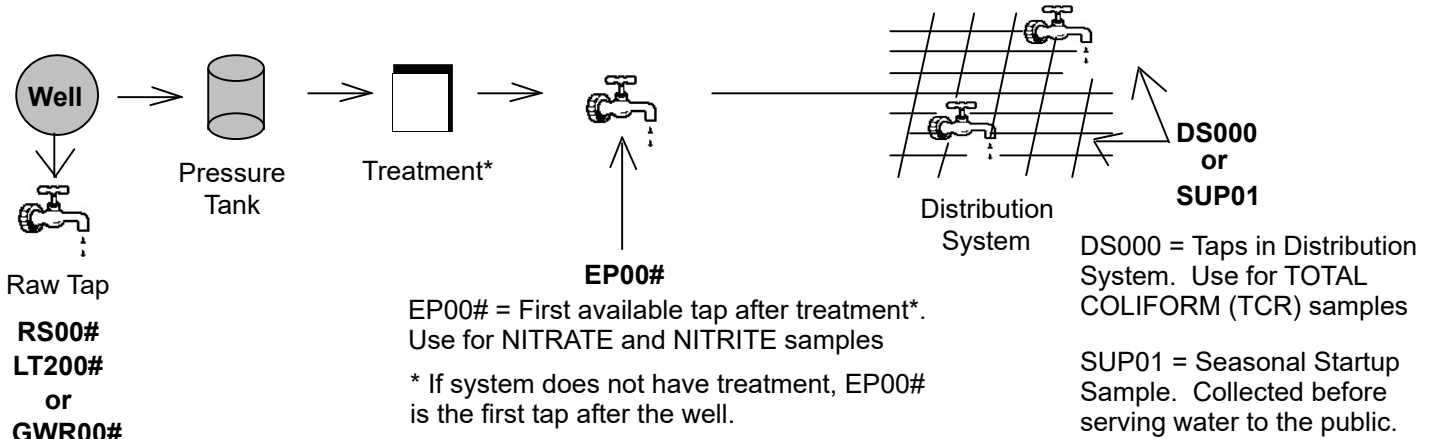

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6045312 RHEMA HOUSE OF WORSHIP PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6062267 Facility Name: RHEMA HOUSE OF WORSHIP
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 6/1/2021 and 10/31/2021
NITRATE - 1040	1 Sample(s) Required between 6/1/2021 and 10/31/2021

Where to Collect Samples For a Small Public Water System

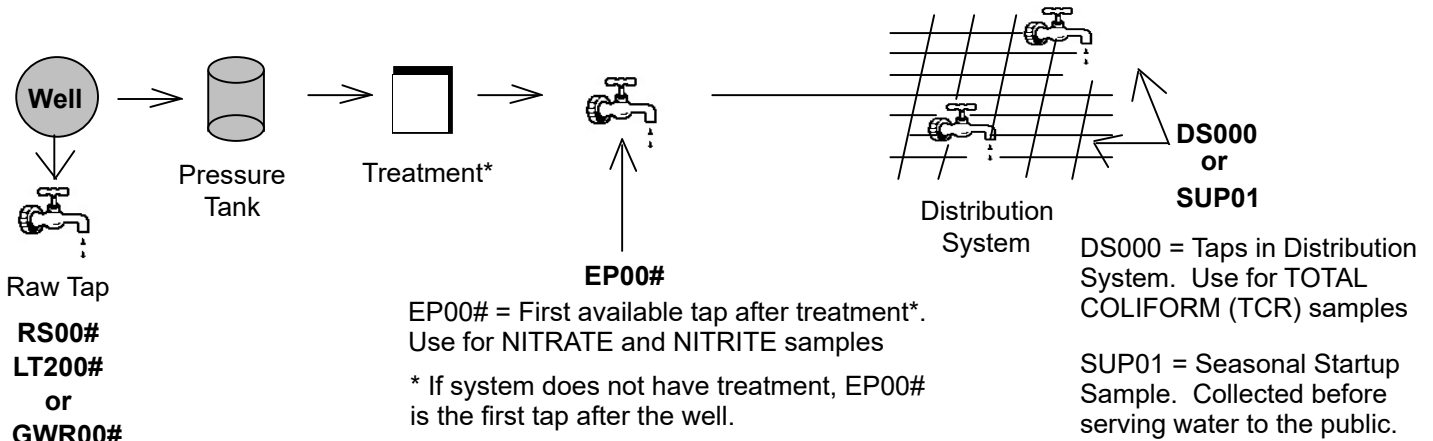

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6045813 FAMILY DOLLAR ROSEVILLE PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2021 and 3/31/2021
	1 Sample(s) Required between 4/1/2021 and 6/30/2021
	1 Sample(s) Required between 7/1/2021 and 9/30/2021
	1 Sample(s) Required between 10/1/2021 and 12/31/2021

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6045813 FAMILY DOLLAR ROSEVILLE PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6062460 Facility Name: FAMILY DOLLAR ROSEVILLE
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 6/1/2021 and 10/31/2021
NITRATE - 1040	1 Sample(s) Required between 6/1/2021 and 10/31/2021

Where to Collect Samples For a Small Public Water System

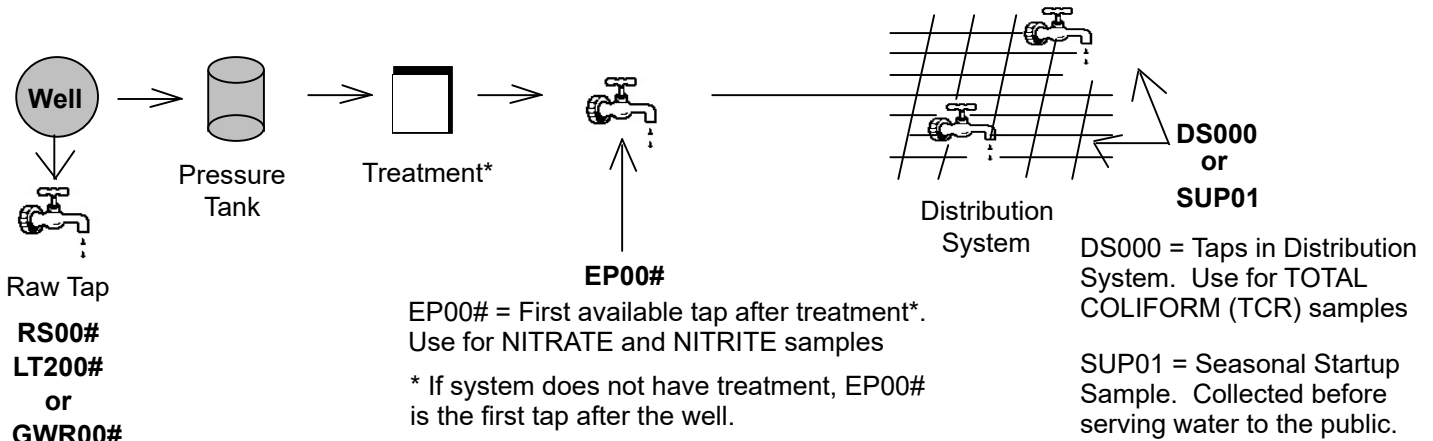

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6045815 DOLLAR GENERAL #17187 - NASHPORT PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: DISTRIBUTION	
Location SMP ID: DS000	Facility Source: Ground Water	Facility Class: CLASS 1

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2021 and 3/31/2021
	1 Sample(s) Required between 4/1/2021 and 6/30/2021
	1 Sample(s) Required between 7/1/2021 and 9/30/2021
	1 Sample(s) Required between 10/1/2021 and 12/31/2021

Where to Collect Samples For a Small Public Water System

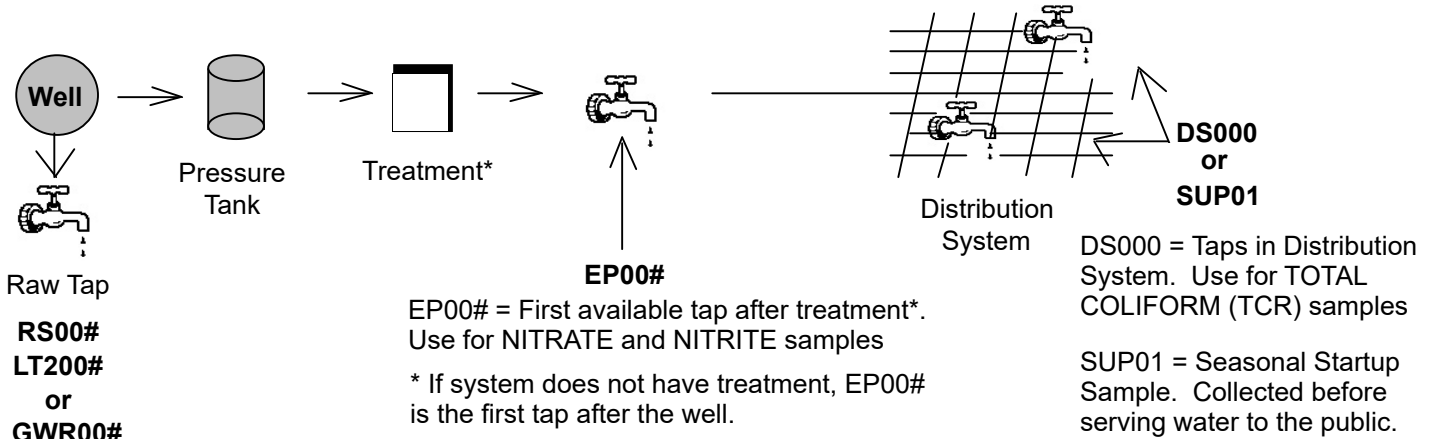

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6045815 DOLLAR GENERAL #17187 - NASHPORT PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6062462	Facility Name: FAMILY DOLLAR NASHPORT
Location SMP ID: EP001	Facility Source: Ground Water
	Facility Class: CLASS 1

Chemicals	Monitoring Requirements
ARSENIC - 1005	1 Sample(s) Required between 1/1/2021 and 3/31/2021
	1 Sample(s) Required between 4/1/2021 and 6/30/2021
	1 Sample(s) Required between 7/1/2021 and 9/30/2021
	1 Sample(s) Required between 10/1/2021 and 12/31/2021
NITRITE - 1041	1 Sample(s) Required between 6/1/2021 and 10/31/2021
NITRATE - 1040	1 Sample(s) Required between 6/1/2021 and 10/31/2021

Where to Collect Samples For a Small Public Water System

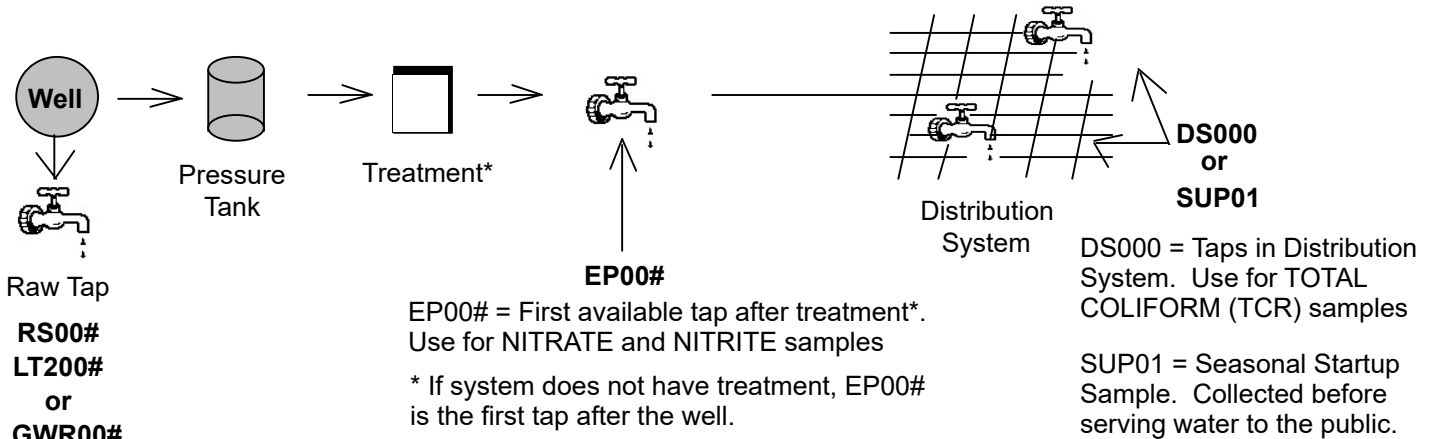

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6045816 THE LANDING AT CEDAR RIDGE, LLC PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2021 and 1/31/2021
	1 Sample(s) Required between 2/1/2021 and 2/28/2021
	1 Sample(s) Required between 3/1/2021 and 3/31/2021
	1 Sample(s) Required between 4/1/2021 and 4/30/2021
	1 Sample(s) Required between 5/1/2021 and 5/31/2021
	1 Sample(s) Required between 6/1/2021 and 6/30/2021
	1 Sample(s) Required between 7/1/2021 and 7/31/2021
	1 Sample(s) Required between 8/1/2021 and 8/31/2021
	1 Sample(s) Required between 9/1/2021 and 9/30/2021
	1 Sample(s) Required between 10/1/2021 and 10/31/2021
	1 Sample(s) Required between 11/1/2021 and 11/30/2021
	1 Sample(s) Required between 12/1/2021 and 12/31/2021

Where to Collect Samples For a Small Public Water System

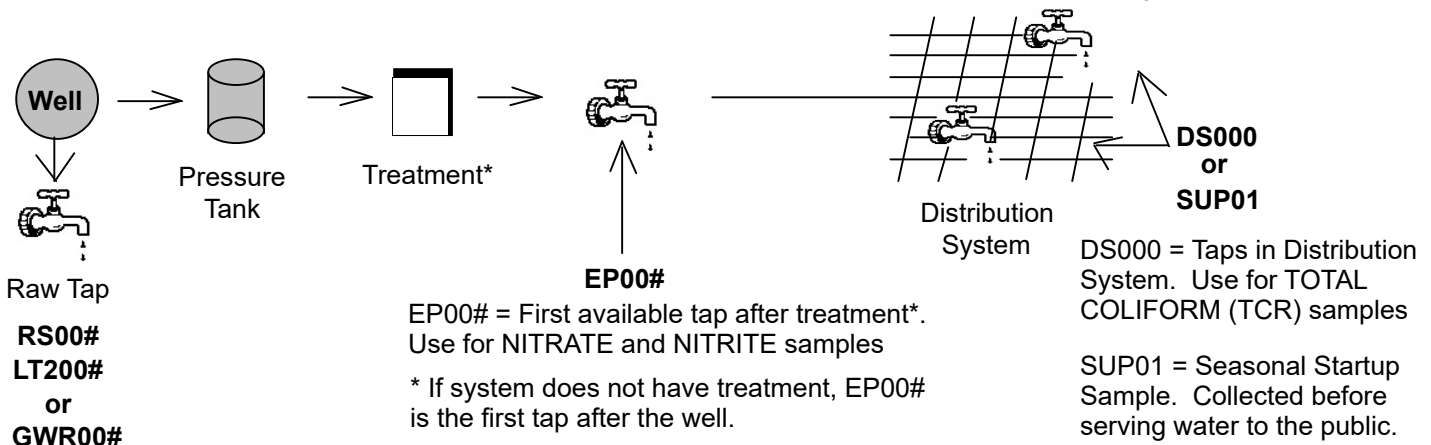

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6045816 THE LANDING AT CEDAR RIDGE, LLC PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6062463 Facility Name: THE LANDING AT ECHO PARK, LLC

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 6/1/2021 and 10/31/2021
NITRATE - 1040	1 Sample(s) Required between 6/1/2021 and 10/31/2021

Where to Collect Samples For a Small Public Water System

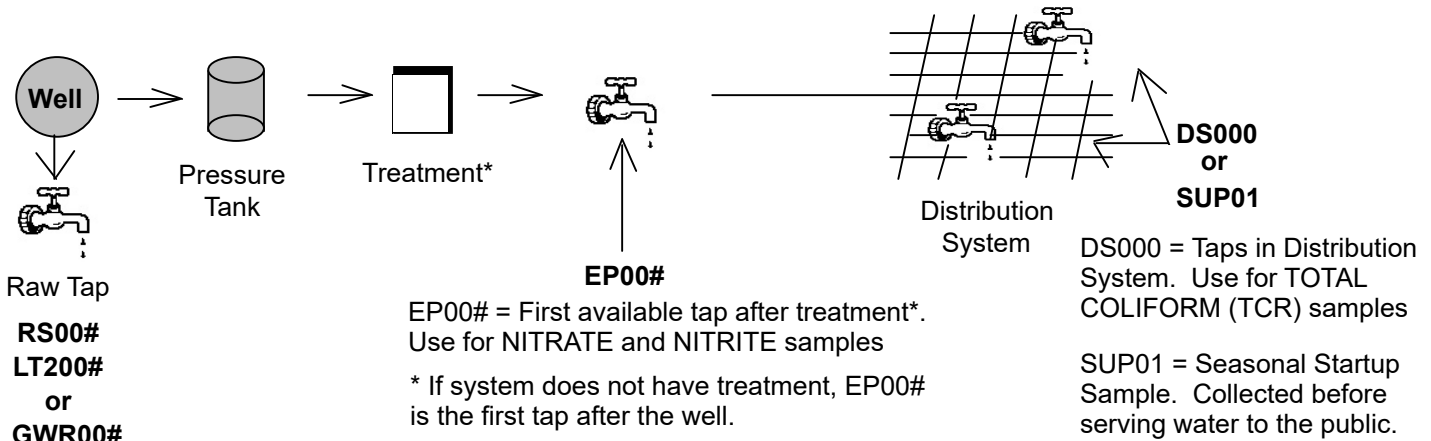

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



OH6045817 GREENLAWN ESTATES MHP

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2021**

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **DISTRIBUTION**
Location SMP ID: **DS000**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2021 and 1/31/2021
	1 Sample(s) Required between 2/1/2021 and 2/28/2021
	1 Sample(s) Required between 3/1/2021 and 3/31/2021
	1 Sample(s) Required between 4/1/2021 and 4/30/2021
	1 Sample(s) Required between 5/1/2021 and 5/31/2021
	1 Sample(s) Required between 6/1/2021 and 6/30/2021
	1 Sample(s) Required between 7/1/2021 and 7/31/2021
	1 Sample(s) Required between 8/1/2021 and 8/31/2021
	1 Sample(s) Required between 9/1/2021 and 9/30/2021
	1 Sample(s) Required between 10/1/2021 and 10/31/2021
	1 Sample(s) Required between 11/1/2021 and 11/30/2021
	1 Sample(s) Required between 12/1/2021 and 12/31/2021

Sampling Facility ID: **DS1** Facility Name: **DISTRIBUTION**
Location SMP ID: **DS201** **260 S BLACKWOOD DR**

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2021 and 9/30/2021 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Facility ID: **DS1** Facility Name: **DISTRIBUTION**
Location SMP ID: **LC###** **Refer to your Lead and Copper plan for SMP IDs**

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2021 and 9/30/2021

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.